



(Based on GA File Nos. FC 5406 and RC 2601)

The ceiling membrane consists of two layers of 5/8" (15.9 mm) type X gypsum board directly applied to framing or furring. The base layer of gypsum board is applied at right angles to ceiling framing 24" (610 mm) o.c. and attached with 1" (25 mm) Type S or S-12 drywall screws (for steel framing) or 1-1/4" (32 mm) Type W or S drywall screws (for wood framing) spaced 24" (610 mm) o.c. The face layer of gypsum board is applied at right angles to the framing and attached with 1-5/8" (41 mm) Type S or S-12 drywall screws (for steel framing) or 1-7/8" (48 mm) Type W or S drywall screws (for wood framing) 12" (305 mm) o.c. at end joints and intermediate joints and 1-1/2" (38 mm) Type G drywall screws 12" (305 mm) o.c. placed 2" (50 mm) back on either side of end joints. Joints of the face layer are offset 24" (610 mm) from the joints in the base layer. Face layer joints and fasteners are finished to Level 1 as specified in GA-214, Levels of Gypsum Board Finish.

C-03 Ceiling at top of rated shaft 1-1/2" = 1'-0"

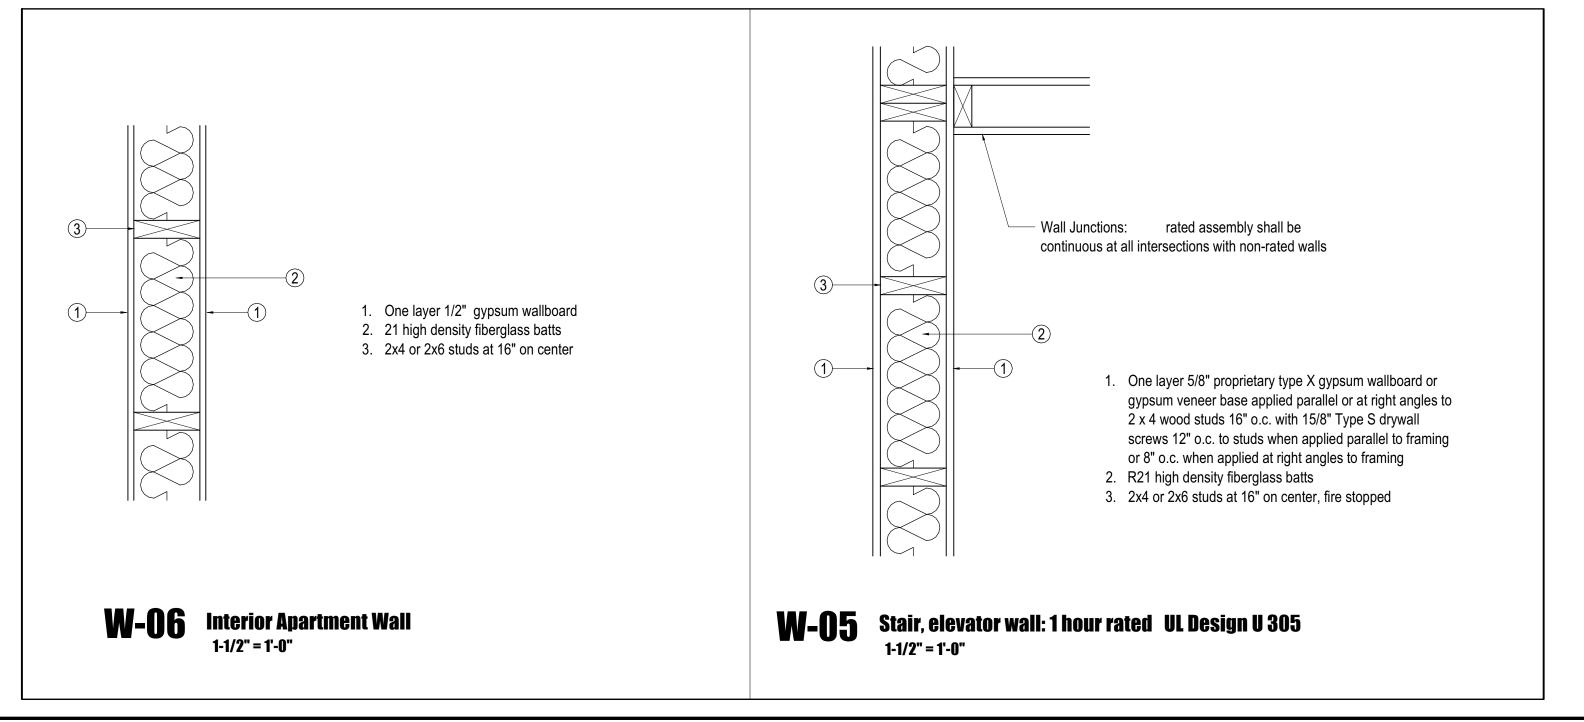

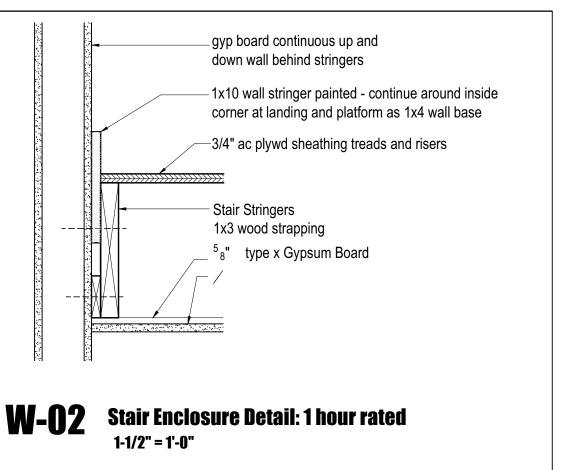

Sunny Time Sola
PO Box 15372
Portland, ME
04112
207.522.4345
livchase@yahoo.com



F U U Z

2016
PROJECT NAME
49 HANCOCK S
PORTLAND, M

REVISIONS

1 -3/29/16
2 - 7/11/16
3 4 5 -

PERMITTING R
DOCUMENTS

LRC
SHEET TITLE

DETAIL

ISSUE DATE 1/9/15 SHEET SCALE

A

4.1