



+ 6"G DROP TO HVAC BOILERS HOT WATER CIRCULATION PUMP (TYPICAL) 4"FD-B W/TP----1½"RPBP FOR COURTYARD IRRIGATION COORDINATE EXACT IRRIGATION REQUIREMENTS WITH THE LANDSCAPE 4"FD-B W/TP DESIGNER PRIOR TO THE START OF WORK 1"RPBP FOR HVAC MAKE—UP WATER SEWAGE EJECTOR 15°CW DROP 2°W DN & V RISE 15°HW DROP 1"165" HW RISE |--1/2"165" HWC DROP 1"140" HW DROP PREPARATION AREA WATER -BOOSTER HEATER (165) 1½°G DROP-1"TW TO EMERGENCY EYEWASH 14 CW DROP THERMOSTATIC MIXING VALVE 34"HW DROP 11/2"HWC DROP TYPICAL FOR 3/140"HWC DROP BOTH 3"CW DROP 4"HW RISE - 2"W DN & V RISE 11/2"W&T W/TP 3"140" HW DROP 2"CW DROP 2"HWC DROP DUPLEX BOILER WATER TO WATER WATER HEATERS SEE DETAIL ON DWG PO.5 3"140" HW RISE --3"140" HW RISE — NOTE: FOR ALL CONTINUATIONS REFER TO PLUMBING FLOOR PLAN DRAWINGS P1.0 AND P1.0U A MECHANICAL ROOM - PLUMBING PLAN

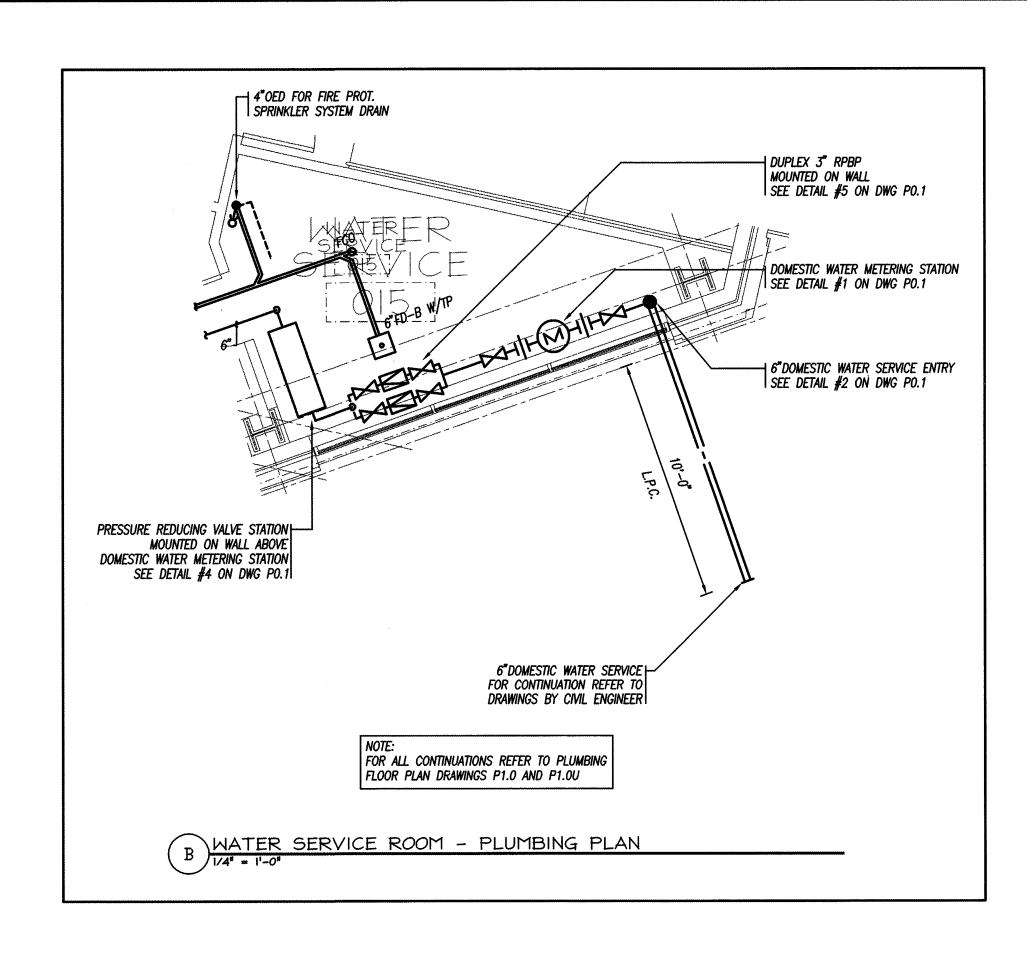

PERMIT ISSUE - 09/27/07

1 11 11 11 10 10 10 10 10 10 10 10 10 10					,, ,,
	NO.	F	REVISION		DATE
		E: 3/32"=1' 09/27/07	0"	DRAWN B	



RWS R. W. Sullivan Engineering HVAC . Electrical . Plumbing . Fire Protection . Code
The Schrafft Center
529 Main Street, Suite 203
Boston, Massachusetts 02129-1107
Phone: (617) 523-8227
Fax: (617) 523-8016
www.rwsullivan.com RWS Job No. 2273.00

RESIDENCE INN BY MARRIOTT

PORTLAND, ME

JOB# 802

TITLE

PLUMBING PART PLAND

GROUP ONE 21 W. THIRD STREET, BOSTON, MA 02127 TEL. (617)268-7000 FAX: (617)268-0209

