

DISPLAY THIS CARD ON PRINCIPAL FRONTAGE OF WORK



CITY OF PORTLAND BUILDING PERMIT

This is to certify that
DEAN & ALLYN, INC.
PO BOX 709 - 116 LEWISTON RD
GRAY, ME 04039

For installation at
52 FEDERAL ST
3 UNIT APARTMENT BUILDING


Job ID: 2012-06-4320-FAFS

CBL: 020- D-008-001

has permission to install a supervised, automatic sprinkler system provided that the person or persons, firm or corporation accepting this permit shall comply with all of the provisions of the Statutes of Maine and of the Ordinances of the City of Portland regulating the construction, maintenance and use of the buildings and structures, and of the application on file in the department.

Notification of inspection and written permission procured before this building or part thereof is lathed or otherwise closed-in. 48 HOUR NOTICE IS REQUIRED.

A final inspection must be completed by owner before this building or part thereof is occupied. If a certificate of occupancy is required, it must be


Fire Prevention Officer

Code Enforcement Officer / Plan Reviewer

THIS CARD MUST BE POSTED ON THE STREET SIDE OF THE PROPERTY
PENALTY FOR REMOVING THIS CARD

CLOSED

SCANNED

BUILDING PERMIT INSPECTION PROCEDURES

Please call 874-8703 or 874-8693 (ONLY)

or email: buildinginspections@portlandmaine.gov

With the issuance of this permit, the owner, builder or their designee is required to provide adequate notice to the city of Portland Inspections Services for the following inspections. Appointments must be requested 48 to 72 hours in advance of the required inspection. The inspection date will need to be confirmed by this office.

- **Please read the conditions of approval that is attached to this permit!! Contact this office if you have any questions.**
- **Permits expire in 6 months. If the project is not started or ceases for 6 months.**
- **If the inspection requirements are not followed as stated below additional fees may be incurred due to the issuance of a "Stop Work Order" and subsequent release to continue.**

Final Fire

The project cannot move to the next phase prior to the required inspection and approval to continue, REGARDLESS OF THE NOTICE OF CIRCUMSTANCES.

IF THE PERMIT REQUIRES A CERTIFICATE OF OCCUPANCY, IT MUST BE PAID FOR AND ISSUED TO THE OWNER OR DESIGNEE BEFORE THE SPACE MAY BE OCCUPIED.



PORTLAND MAINE

Strengthening a Remarkable City, Building a Community for Life • www.portlandmaine.gov

Director of Planning and Urban Development
Penny St. Louis

Job ID: 2012-06-4320-FAFS
install a supervised, automatic
sprinkler system

For installation at:
52 FEDERAL ST
3 UNIT APARTMENT BUILDING

CBL: 020- D-008-001

Conditions of Approval:

Fire

The sprinkler system shall be installed in accordance with NFPA 13R. A signed compliance letter will be required.

A separate sprinkler permit is required from the State Fire Marshal's Office.

Sprinkler supervision shall be provided in accordance with NFPA 101, *Life Safety Code*, and NFPA 72, *National Fire Alarm and Signaling Code*.

Sprinkler protection shall be maintained. Where the system is to be shut down for maintenance or repair, the system shall be checked at the end of each day to insure the system has been placed back in service.

Fire department connection shall be a single 2 1/2". The Fire Department will require Knox locking caps on all Fire Department Connections on the exterior of the building.

System acceptance and commissioning must be coordinated with alarm and suppression system contractors and the Fire Department. Call 874-8703 to schedule.

City ordinance requires a Knox Box for all structures with a sprinkler or fire alarm system.

City of Portland, Maine - Building or Use Permit Application

389 Congress Street, 04101 Tel: (207) 874-8703, FAX: (207) 8716

Job No: 2012-06-4320-FAFS	Date Applied: 6/25/2012	CBL: 020- D-008-001	
Location of Construction: 52 FEDERAL ST	Owner Name: LIV R CHASE & BRENT ADLER	Owner Address: PO BOX 15372 PORTLAND, ME 04112	Phone:
Business Name:	Contractor Name: DEAN & ALLYN INC.	Contractor Address: P.O. BOX 709 GRAY MAINE 04039	Phone: (207) 657-5646
Lessee/Buyer's Name:	Phone:	Permit Type: FIRE SUPPRESSION	Zone: B-2b
Past Use: Three family dwelling	Proposed Use: Same: Three family dwelling – to install a fire suppression system	Cost of Work: \$11,000.00	CEO District:
		Fire Dept: 7/11/12 <input checked="" type="checkbox"/> Approved w/ conditions <input type="checkbox"/> Denied <input type="checkbox"/> N/A	Inspection: Use Group: Type:
		Signature: <i>By Andrew [Signature]</i>	Signature:
Proposed Project Description: Fire suppression system		Pedestrian Activities District (P.A.D.)	

Permit Taken By: Gayle	Zoning Approval		
<p>1. This permit application does not preclude the Applicant(s) from meeting applicable State and Federal Rules.</p> <p>2. Building Permits do not include plumbing, septic or electrical work.</p> <p>3. Building permits are void if work is not started within six (6) months of the date of issuance. False informatin may invalidate a building permit and stop all work.</p>	Special Zone or Reviews	Zoning Appeal	Historic Preservation
	<input type="checkbox"/> Shoreland <input type="checkbox"/> Wetlands <input type="checkbox"/> Flood Zone <input type="checkbox"/> Subdivision <input type="checkbox"/> Site Plan <input type="checkbox"/> Maj <input type="checkbox"/> Min <input type="checkbox"/> MM Date: <i>06/26/12</i>	<input type="checkbox"/> Variance <input type="checkbox"/> Miscellaneous <input type="checkbox"/> Conditional Use <input type="checkbox"/> Interpretation <input type="checkbox"/> Approved <input type="checkbox"/> Denied Date:	<input checked="" type="checkbox"/> Not in Dist or Landmark <input type="checkbox"/> Does not Require Review <input type="checkbox"/> Requires Review <input type="checkbox"/> Approved <input type="checkbox"/> Approved w/Conditions <input type="checkbox"/> Denied Date: <i>[Signature]</i>

CERTIFICATION

I hereby certify that I am the owner of record of the named property, or that the proposed work is authorized by the owner of record and that I have been authorized by the owner to make this application as his authorized agent and I agree to conform to all applicable laws of this jurisdiction. In addition, if a permit for work described in the appication is issued, I certify that the code official's authorized representative shall have the authority to enter all areas covered by such permit at any reasonable hour to enforce the provision of the code(s) applicable to such permit.

SIGNATURE OF APPLICANT	ADDRESS	DATE	PHONE
RESPONSIBLE PERSON IN CHARGE OF WORK, TITLE		DATE	PHONE



Fire Suppression System Permit

2012 06 4350 60

If you or the property owner owes real estate or property taxes or user charges on any property within the city, payment arrangements must be made before permits of any kind are accepted.

By mail

3-2b

Installation address: 52 Federal St CBL: 080 D 008

Exact location: (within structure) _____

Type of occupancy(s) (NFPA & ICC): APARTMENT Bldg

Building owner: Brent Adler

Managing Supervisor: Harry King License No: 262

Supervisor phone: 207 233 9105 E-mail: _____

Installing contractor: Dean and Allyn Inc License No: 262

Contractor phone: 657 5646 E-mail: h.king@maine.vr.com

The suppression work to be done will be: New: Renovation: Addition to existing system:

This is an amendment to an existing permit: Yes: NO Permit no: _____

NFPA Standard will this system is designed to: NFPA #13R Edition: 2010

*Non-NFPA systems are not approved for use within the City of Portland.

Attach all design submittals as required by the Marshal's Office. Contractor shall be approved in writing.

6/25/12
w/ email plan to me.

COST OF WORK: New Sprinkler Sys
PERMIT FEE: \$130 ~~\$10,406~~
\$10 PER \$1,000 + \$30 FOR THE FIRST \$1,000


RECEIVED
JUN 25 2012
Dept. of Building Inspections
City of Portland Maine

Download a new permit for every submittal. Submit all information to the Building Department, 315, Portland, Maine 04101.

Prior to acceptance of the system, the installation and acceptance test must be coordinated with the Fire Department. A copy of such test(s) provided.

All installation(s) must comply with NFPA and the Fire Department Technical Standard(s).

Applicant signature: Harry A. King / Date: 6-21-12

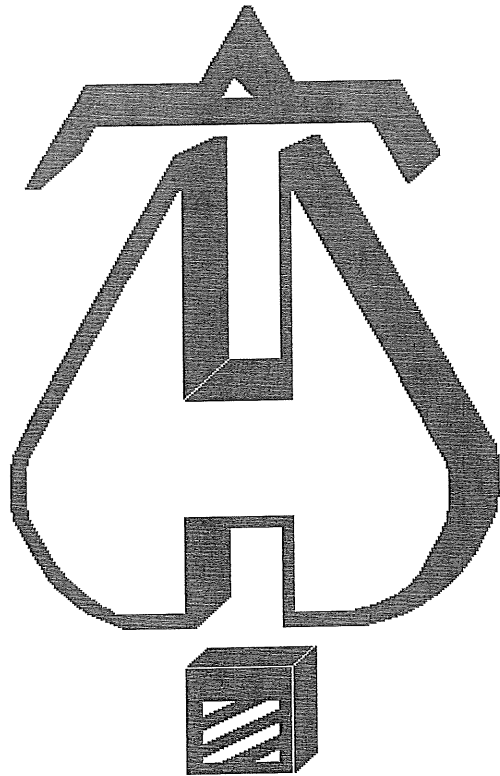

... Fire Protection by Computer Design

DEAN & ALLYN, INC.
PO BOX 709
116 LEWISTON ROAD
GRAY, MAINE 04039
207-657-5646

Job Name : 52 FEDERAL STREET
Building :
Location : 52 FEDERAL STREET PORTLAND MAINE
System :
Contract : 121079
Data File : 52 FEDERAL ST.WXF

HYDRAULIC DESIGN INFORMATION SHEET

Name - BRENT ADLER
Location - 52 FEDERAL STREET PORTLAND MAINE
Building -
Contractor - DEAN AND ALLYN INC
Calculated By - H KING
Construction: (X) Combustible () Non-Combustible
OCCUPANCY - RESIDENTIAL

Date - 6-19-12

System No. -
Contract No. - 121079
Drawing No. - 1 OF 1
Ceiling Height VARIES

S Type of Calculation: ()NFPA 13 Residential (X)NFPA 13R ()NFPA 13D
Y Number of Sprinklers Flowing: ()1 ()2 (X)4 ()
S ()Other
T ()Specific Ruling Made by Date

E
M Listed Flow at Start Point - 13 Gpm System Type
Listed Pres. at Start Point - 7 Psi (X) Wet () Dry
D MAXIMUM LISTED SPACING 16 x 16 () Deluge () PreAction
E Domestic Flow Added - Gpm Sprinkler or Nozzle
S Additional Flow Added - Gpm Make VIKING Model FREEDOM
I Elevation at Highest Outlet - 43' Feet Size 1/2" K-Factor 4.9
G Note:CUSHION: 16.63 PSI Temperature Rating 155
N

Calculation Gpm Required 61.58 Psi Required 66.12 At Test
Summary C-Factor Used: Overhead 120 Underground 120

W Water Flow Test: Pump Data: Tank or Reservoir:
A Date of Test - 8-9-11 Rated Cap. Cap.
T Time of Test - @ Psi Elev.
E Static (Psi) - 83 Elev.
R Residual (Psi) - 20 Other Well
Flow (Gpm) - 1233 Proof Flow Gpm
S Elevation - 0

P Location: FEDERAL STREET

P
L Source of Information: PWD
Y

Fittings Used Summary

DEAN & ALLYN, INC.
52 FEDERAL STREET

Page 2
Date 6-19-12

Fitting Legend		1/2	3/4	1	1 1/4	1 1/2	2	2 1/2	3	3 1/2	4	5	6	8	10	12	14	16	18	20	24
Abbrev.	Name																				
E	NFPA 13 90' Standard Elbow	1	2	2	3	4	5	6	7	8	10	12	14	18	22	27	35	40	45	50	61
G	NFPA 13 Gate Valve	0	0	0	0	0	1	1	1	1	2	2	3	4	5	6	7	8	10	11	13
S	NFPA 13 Swing Check	0	0	5	7	9	11	14	16	19	22	27	32	45	55	65					
T	NFPA 13 90' Flow thru Tee	3	4	5	6	8	10	12	15	17	20	25	30	35	50	60	71	81	91	101	121

Units Summary

Diameter Units Inches
 Length Units Feet
 Flow Units US Gallons per Minute
 Pressure Units Pounds per Square Inch

Note: Fitting Legend provides equivalent pipe lengths for fittings types of various diameters. Equivalent lengths shown are standard for actual diameters of Sched 40 pipe and CFactors of 120 except as noted with *. The fittings marked with a * show equivalent lengths values supplied by manufacturers based on specific pipe diameters and CFactors and they require no adjustment. All values for fittings not marked with a * will be adjusted in the calculation for CFactors of other than 120 and diameters other than Sched 40 per NFPA.

Pressure / Flow Summary - STANDARD

DEAN & ALLYN, INC.
52 FEDERAL STREET

Page 3
Date 6-19-12

Node No.	Elevation	K-Fact	Pt Actual	Pn	Flow Actual	Density	Area	Press Req.
1A	43.0	4.9	7.0	na	12.96	0.05	256	7.0
1	43.0	K = K @ 1	7.35	na	12.96			
2	43.0	K = K @ 1	7.35	na	12.96			
3	43.0	K = K @ 1	14.09	na	17.95			
4	43.0	K = K @ 1	13.46	na	17.54			
10	43.0		8.21	na				
11	43.0		15.29	na				
12	29.0		29.94	na				
13	21.0		35.73	na				
14	9.0		44.9	na				
TR	7.0		55.96	na				
FF	0.0		63.66	na				
CTY	0.0		66.12	na				

The maximum velocity is 13.21 and it occurs in the pipe between nodes 11 and 12

Final Calculations - Hazen-Williams

DEAN & ALLYN, INC.
52 FEDERAL STREET

Page 4
Date 6-19-12

Hyd. Ref. Point	Qa Qt	Dia. "C" Pf/Ft	Fitting or Eqv.	Ln.	Pipe Ftng's Total	Pt Pe Pf	Pt Pv Pn	*****	Notes	*****
1A	12.96	1.049	1T	5.0	1.000	7.000			K Factor = 4.90	
to		120.0		0.0	5.000	0.0				
1	12.96	0.0583		0.0	6.000	0.350			Vel = 4.81	
	0.0									
	12.96					7.350			K Factor = 4.78	
1	13.12	1.049	1T	5.0	6.300	7.350			K Factor @ node 1	
to		120.0		0.0	5.000	0.0				
10	13.12	0.0759		0.0	11.300	0.858			Vel = 4.87	
	0.0									
	13.12					8.208			K Factor = 4.58	
2	12.96	1.049	2E	4.0	5.700	7.350			K Factor @ node 1	
to		120.0	1T	5.0	9.000	0.0				
10	12.96	0.0584		0.0	14.700	0.858			Vel = 4.81	
	0.0									
	12.96					8.208			K Factor = 4.52	
3	17.95	1.049	1T	5.0	6.300	14.090			K Factor @ node 1	
to		120.0		0.0	5.000	0.0				
11	17.95	0.1065		0.0	11.300	1.203			Vel = 6.66	
	0.0									
	17.95					15.293			K Factor = 4.59	
4	17.54	1.049	2T	10.0	8.000	13.456			K Factor @ node 1	
to		120.0		0.0	10.000	0.0				
11	17.54	0.1021		0.0	18.000	1.837			Vel = 6.51	
	0.0									
	17.54					15.293			K Factor = 4.49	
10	26.09	1.049	6E	12.0	16.300	8.208				
to		120.0	1T	5.0	17.000	0.0				
11	26.09	0.2128		0.0	33.300	7.085			Vel = 9.69	
11	35.49	1.38	3E	9.0	11.300	15.293				
to		120.0	1G	0.0	16.000	6.063				
12	61.58	0.3143	1S	7.0	27.300	8.580			Vel = 13.21	
			1Z	0.0						
	0.0	1.38		0.0	8.500	29.936				
to		120.0		0.0	0.0	3.465				
13	61.58	0.2740		0.0	8.500	2.329			Vel = 13.21	
13	0.0	1.38	1E	3.0	11.500	35.730				
to		120.0		0.0	3.000	5.197				
14	61.58	0.2741		0.0	14.500	3.975			Vel = 13.21	
14	0.0	1.38	4E	12.0	25.200	44.902				
to		120.0		0.0	12.000	0.866				
TR	61.58	0.2741		0.0	37.200	10.196			Vel = 13.21	

Hyd. Ref. Point	Qa Qt	Dia. "C" Pf/Ft	Fitting or Eqv. Ln.	Pipe Ftng's Total	Pt Pe Pf	Pt Pv Pn	*****	Notes *****
TR	0.0	1.38	1S 7.0	7.000	55.964			
to		120.0	1Z 0.0	7.000	3.032			
FF	61.58	0.3328	0.0	14.000	4.659		Vel = 13.21	
FF	0.0	1.38	2E 6.0	3.000	63.655			
to		120.0	0.0	6.000	0.0			
CTY	61.58	0.2741	0.0	9.000	2.467		Vel = 13.21	
	0.0							
	61.58				66.122		K Factor = 7.57	


Water Supply Curve (C)


DEAN & ALLYN, INC.
52 FEDERAL STREET

Page 6
Date 6-19-12

City Water Supply:
C1 - Static Pressure : 83
C2 - Residual Pressure: 20
C2 - Residual Flow : 1233

Demand:
D1 - Elevation : 18.623
D2 - System Flow : 61.579
D2 - System Pressure : 66.122
Hose (Demand) :
D3 - System Demand : 61.579
Safety Margin : 16.632

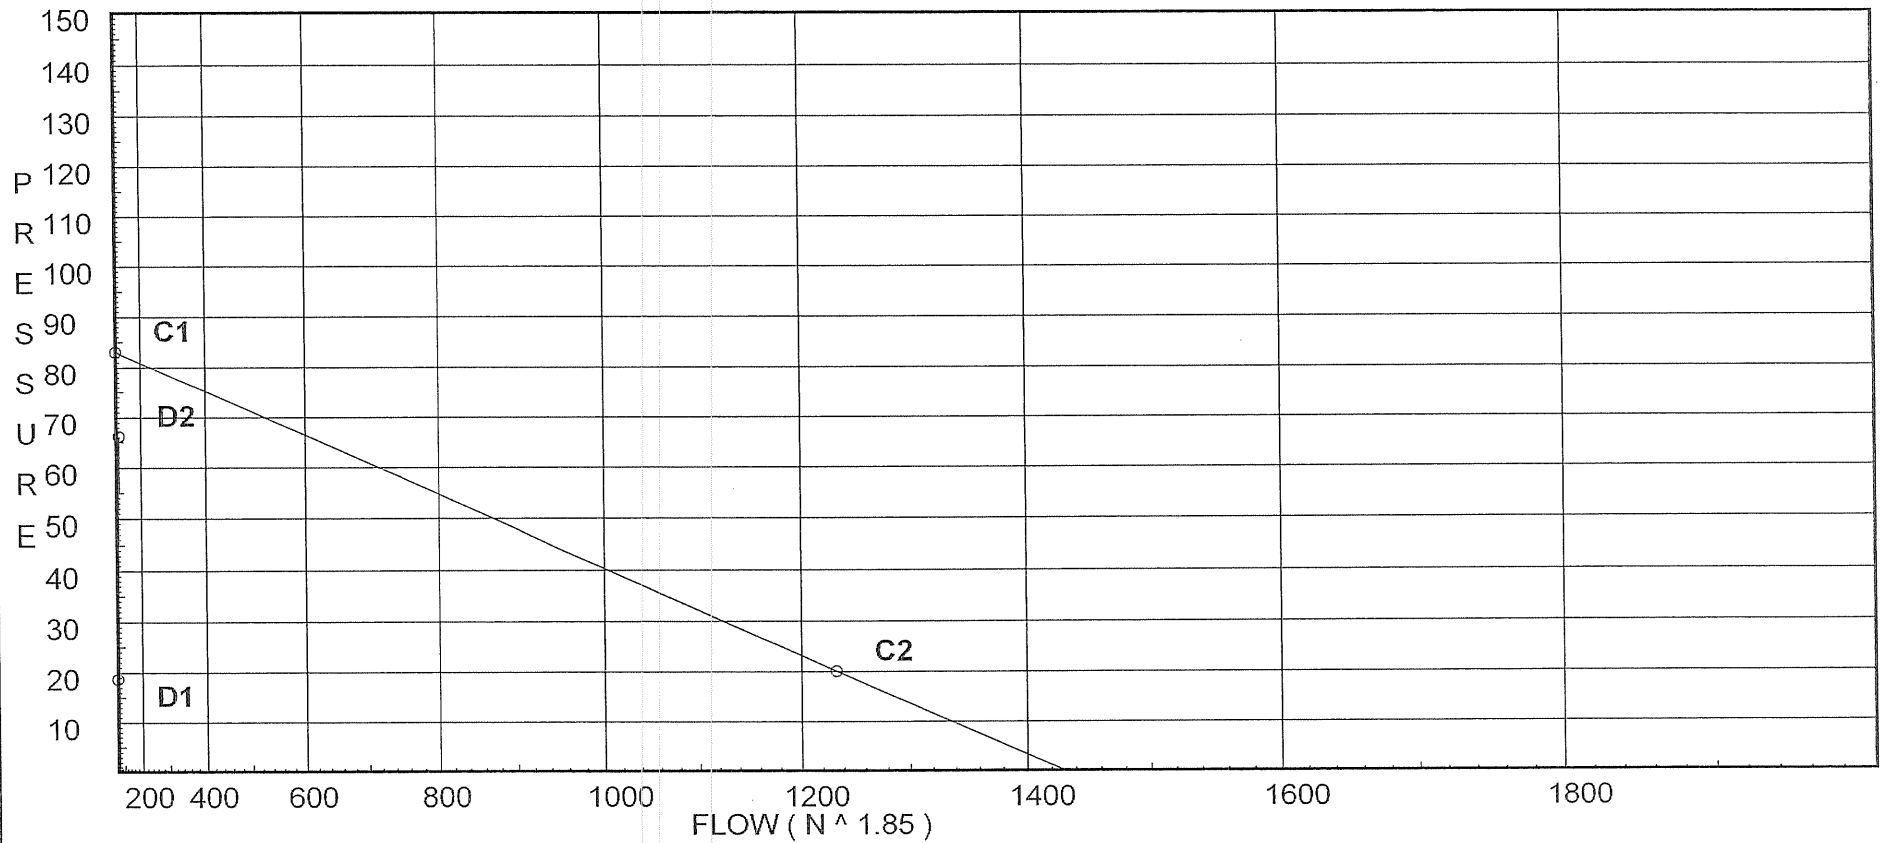

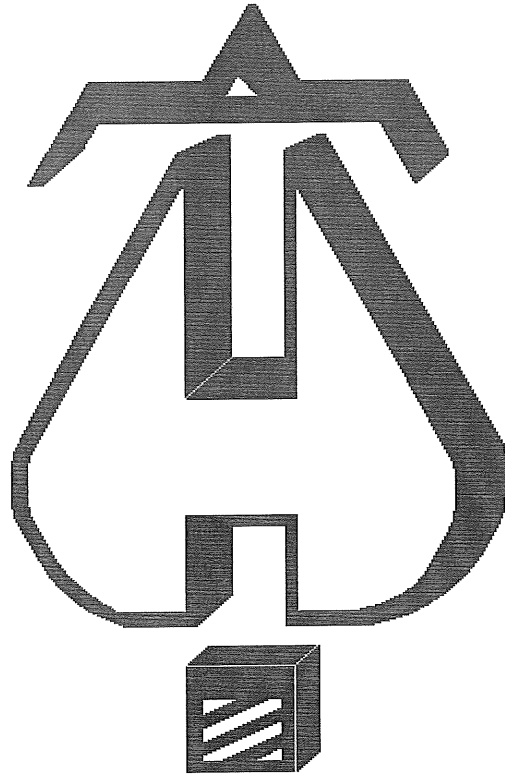

... Fire Protection by Computer Design

DEAN & ALLYN, INC.
PO BOX 709
116 LEWISTON ROAD
GRAY, MAINE 04039
207-657-5646

Job Name : 52 FEDERAL STREET
Building :
Location : 52 FEDERAL STREET PORTLAND MAINE
System :
Contract : 121079
Data File : 52 FEDERAL ST.WXF

HYDRAULIC DESIGN INFORMATION SHEET

Name - BRENT ADLER Date - 6-19-12
Location - 52 FEDERAL STREET PORTLAND MAINE
Building - System No. -
Contractor - DEAN AND ALLYN INC Contract No. - 121079
Calculated By - H KING Drawing No. - 1 OF 1
Construction: (X) Combustible () Non-Combustible Ceiling Height VARIES
OCCUPANCY - RESIDENTIAL

S Type of Calculation: ()NFPA 13 Residential (X)NFPA 13R ()NFPA 13D
Y Number of Sprinklers Flowing: ()1 ()2 (X)4 ()
S ()Other
T ()Specific Ruling Made by Date
E
M Listed Flow at Start Point - 13 Gpm System Type
Listed Pres. at Start Point - 7 Psi (X) Wet () Dry
D MAXIMUM LISTED SPACING 16 x 16 () Deluge () PreAction
E Domestic Flow Added - Gpm Sprinkler or Nozzle
S Additional Flow Added - Gpm Make VIKING Model FREEDOM
I Elevation at Highest Outlet - 43' Feet Size 1/2" K-Factor 4.9
G Note:CUSHION: 16.63 PSI Temperature Rating 155
N

Calculation Gpm Required 61.58 Psi Required 66.12 At Test
Summary C-Factor Used: Overhead 120 Underground 120

W Water Flow Test: Pump Data: Tank or Reservoir:
A Date of Test - 8-9-11 Rated Cap. Cap.
T Time of Test - @ Psi Elev.
E Static (Psi) - 83 Elev.
R Residual (Psi) - 20 Other Well
Flow (Gpm) - 1233 Proof Flow Gpm
S Elevation - 0
P Location: FEDERAL STREET
P
L Source of Information: PWD
Y

Fittings Used Summary

DEAN & ALLYN, INC.
52 FEDERAL STREET

Page 2
Date 6-19-12

Fitting Legend		1/2	3/4	1	1 1/4	1 1/2	2	2 1/2	3	3 1/2	4	5	6	8	10	12	14	16	18	20	24
Abbrev.	Name																				
E	NFPA 13 90' Standard Elbow	1	2	2	3	4	5	6	7	8	10	12	14	18	22	27	35	40	45	50	61
G	NFPA 13 Gate Valve	0	0	0	0	0	1	1	1	1	2	2	3	4	5	6	7	8	10	11	13
S	NFPA 13 Swing Check	0	0	5	7	9	11	14	16	19	22	27	32	45	55	65					
T	NFPA 13 90' Flow thru Tee	3	4	5	6	8	10	12	15	17	20	25	30	35	50	60	71	81	91	101	121

Units Summary

Diameter Units Inches
 Length Units Feet
 Flow Units US Gallons per Minute
 Pressure Units Pounds per Square Inch

Note: Fitting Legend provides equivalent pipe lengths for fittings types of various diameters. Equivalent lengths shown are standard for actual diameters of Sched 40 pipe and CFactors of 120 except as noted with *. The fittings marked with a * show equivalent lengths values supplied by manufacturers based on specific pipe diameters and CFactors and they require no adjustment. All values for fittings not marked with a * will be adjusted in the calculation for CFactors of other than 120 and diameters other than Sched 40 per NFPA.

Pressure / Flow Summary - STANDARD

DEAN & ALLYN, INC.
52 FEDERAL STREET

Page 3
Date 6-19-12

Node No.	Elevation	K-Fact	Pt Actual	Pn	Flow Actual	Density	Area	Press Req.
1A	43.0	4.9	7.0	na	12.96	0.05	256	7.0
1	43.0	K = K @ 1	7.35	na	12.96			
2	43.0	K = K @ 1	7.35	na	12.96			
3	43.0	K = K @ 1	14.09	na	17.95			
4	43.0	K = K @ 1	13.46	na	17.54			
10	43.0		8.21	na				
11	43.0		15.29	na				
12	29.0		29.94	na				
13	21.0		35.73	na				
14	9.0		44.9	na				
TR	7.0		55.96	na				
FF	0.0		63.66	na				
CTY	0.0		66.12	na				

The maximum velocity is 13.21 and it occurs in the pipe between nodes 11 and 12

Hyd. Ref. Point	Qa Qt	Dia. "C" Pf/Ft	Fitting or Eqv. Ln.	Pipe Ftng's Total	Pt Pe Pf	Pt Pv Pn	***** Notes *****
1A to 1	12.96 12.96	1.049 120.0 0.0583	1T 5.0 0.0 0.0	1.000 5.000 6.000	7.000 0.0 0.350		K Factor = 4.90 Vel = 4.81
	0.0 12.96					7.350	K Factor = 4.78
1 to 10	13.12 13.12	1.049 120.0 0.0759	1T 5.0 0.0 0.0	6.300 5.000 11.300	7.350 0.0 0.858		K Factor @ node 1 Vel = 4.87
	0.0 13.12					8.208	K Factor = 4.58
2 to 10	12.96 12.96	1.049 120.0 0.0584	2E 4.0 1T 5.0 0.0	5.700 9.000 14.700	7.350 0.0 0.858		K Factor @ node 1 Vel = 4.81
	0.0 12.96					8.208	K Factor = 4.52
3 to 11	17.95 17.95	1.049 120.0 0.1065	1T 5.0 0.0 0.0	6.300 5.000 11.300	14.090 0.0 1.203		K Factor @ node 1 Vel = 6.66
	0.0 17.95					15.293	K Factor = 4.59
4 to 11	17.54 17.54	1.049 120.0 0.1021	2T 10.0 0.0 0.0	8.000 10.000 18.000	13.456 0.0 1.837		K Factor @ node 1 Vel = 6.51
	0.0 17.54					15.293	K Factor = 4.49
10 to 11	26.09 26.09	1.049 120.0 0.2128	6E 12.0 1T 5.0 0.0	16.300 17.000 33.300	8.208 0.0 7.085		Vel = 9.69
11 to 12	35.49 61.58	1.38 120.0 0.3143	3E 9.0 1G 0.0 1S 7.0 1Z 0.0	11.300 16.000 27.300	15.293 6.063 8.580		Vel = 13.21
12 to 13	0.0 61.58	1.38 120.0 0.2740	0.0 0.0 0.0	8.500 0.0 8.500	29.936 3.465 2.329		Vel = 13.21
13 to 14	0.0 61.58	1.38 120.0 0.2741	1E 3.0 0.0 0.0	11.500 3.000 14.500	35.730 5.197 3.975		Vel = 13.21
14 to TR	0.0 61.58	1.38 120.0 0.2741	4E 12.0 0.0 0.0	25.200 12.000 37.200	44.902 0.866 10.196		Vel = 13.21

Hyd. Ref. Point	Qa Qt	Dia. "C" Pf/Ft	Fitting or Eqv. Ln.	Pipe Ftng's Total	Pt Pe Pf	Pt Pv Pn	*****	Notes	*****
TR	0.0	1.38	1S 7.0	7.000	55.964				
to		120.0	1Z 0.0	7.000	3.032				
FF	61.58	0.3328	0.0	14.000	4.659		Vel = 13.21		
FF	0.0	1.38	2E 6.0	3.000	63.655				
to		120.0	0.0	6.000	0.0				
CTY	61.58	0.2741	0.0	9.000	2.467		Vel = 13.21		
	0.0								
	61.58				66.122		K Factor = 7.57		


Water Supply Curve (C)

DEAN & ALLYN, INC.
52 FEDERAL STREET

Page 6
Date 6-19-12

City Water Supply:
C1 - Static Pressure : 83
C2 - Residual Pressure: 20
C2 - Residual Flow : 1233

Demand:
D1 - Elevation : 18.623
D2 - System Flow : 61.579
D2 - System Pressure : 66.122
Hose (Demand) :
D3 - System Demand : 61.579
Safety Margin : 16.632

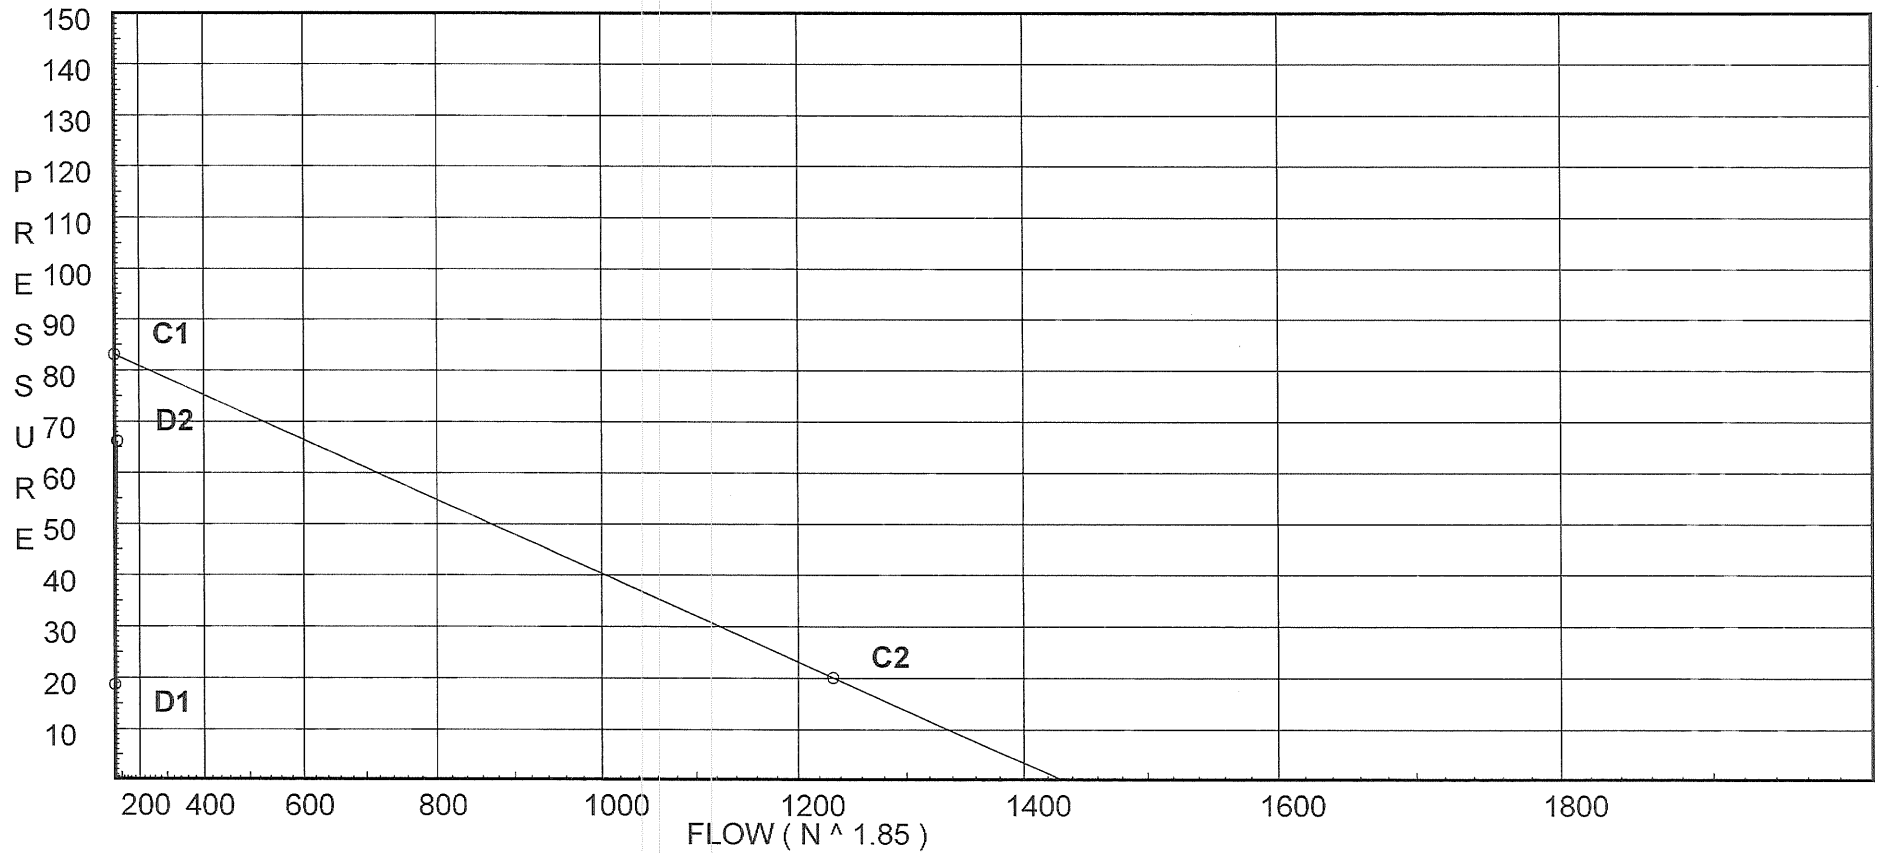



PORTLAND MAINE

Strengthening a Remarkable City, Building a Community for Life • www.portlandmaine.gov

Receipts Details:

Tender Information: Check , BusinessName: Dean & Allyn, Inc., Check Number: 12959

Tender Amount: 130.00

Receipt Header:

Cashier Id: gguertin

Receipt Date: 6/25/2012

Receipt Number: 45310

Receipt Details:

Referance ID:	7013	Fee Type:	BP-Constr
Receipt Number:	0	Payment Date:	
Transaction Amount:	130.00	Charge Amount:	130.00
Job ID: Job ID: 2012-06-4320-FAFS - Fire suppression system			
Additional Comments: Dean & Allyn , Inc			

Thank You for your Payment!