




(A) CURB INTALLATION DETAIL
N.T.S.

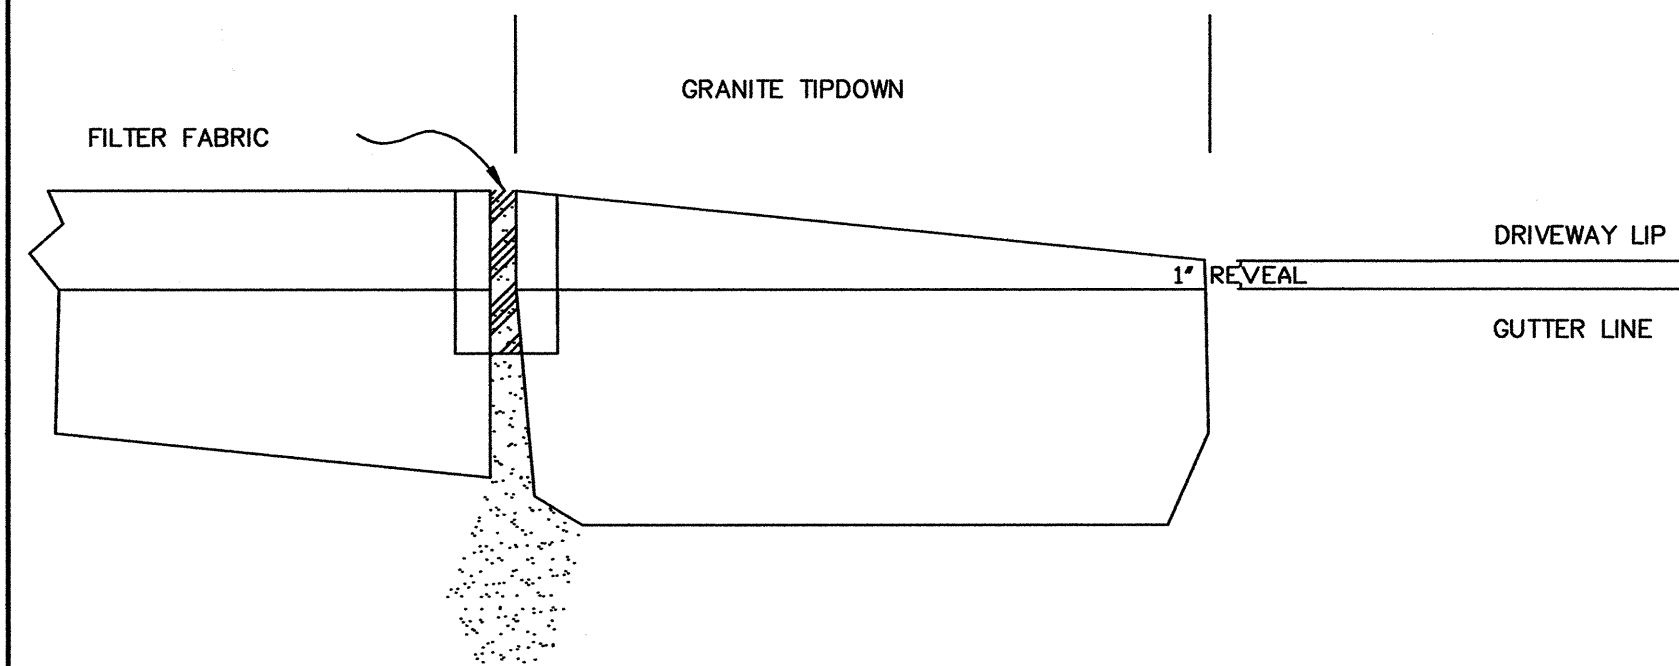


(B) TYPICAL TIPDOWN DETAIL
N.T.S.

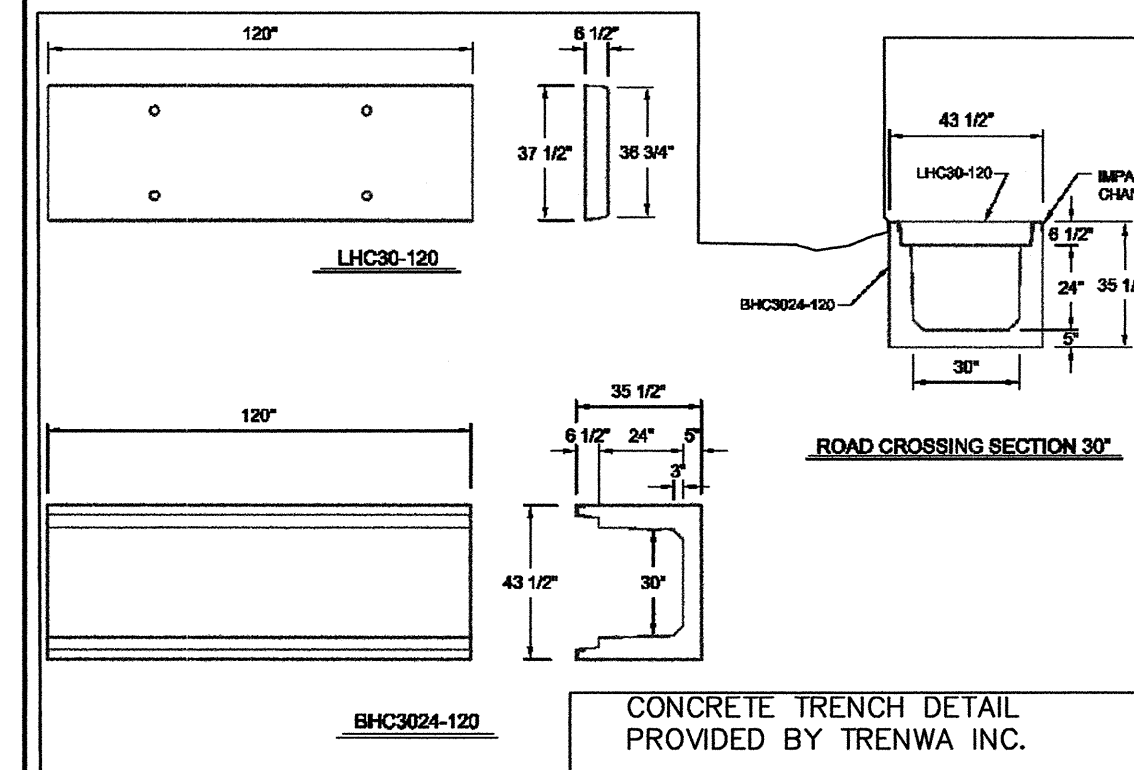

(C) CONCRETE TRENCH DETAIL
N.T.S.

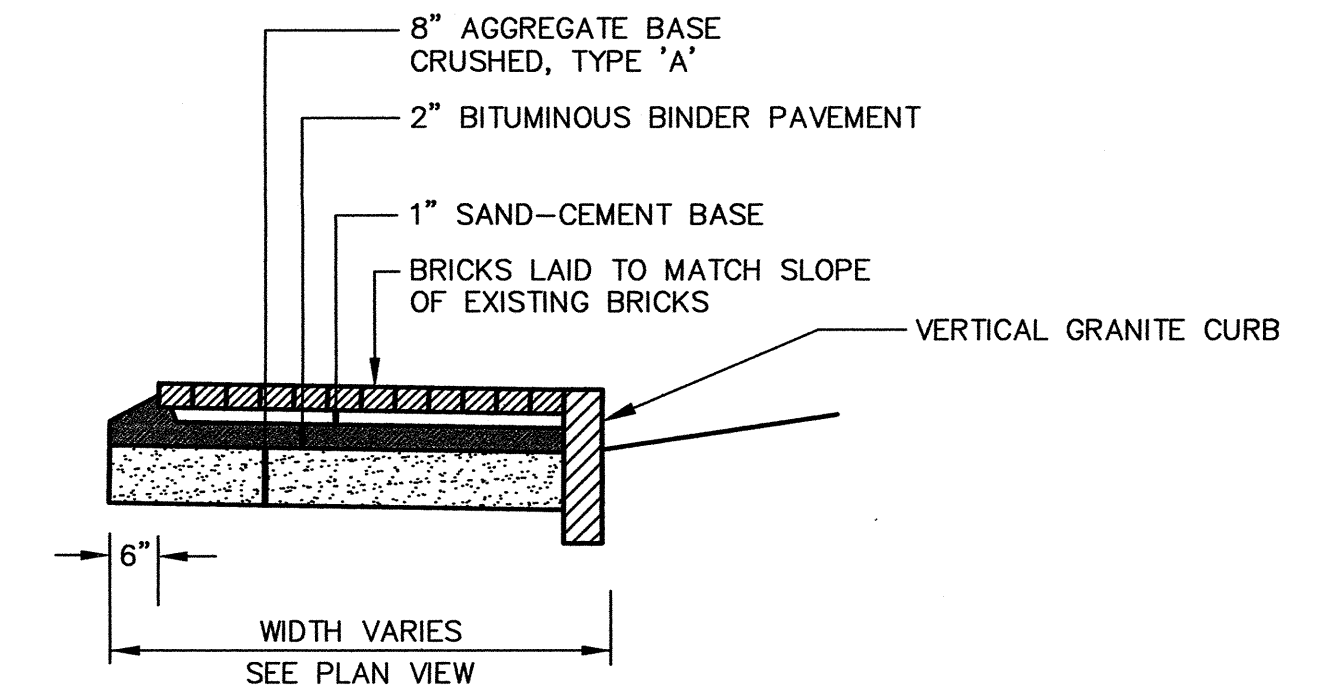


(D) BRICK SIDEWALK CONSTRUCTION DETAIL
N.T.S.

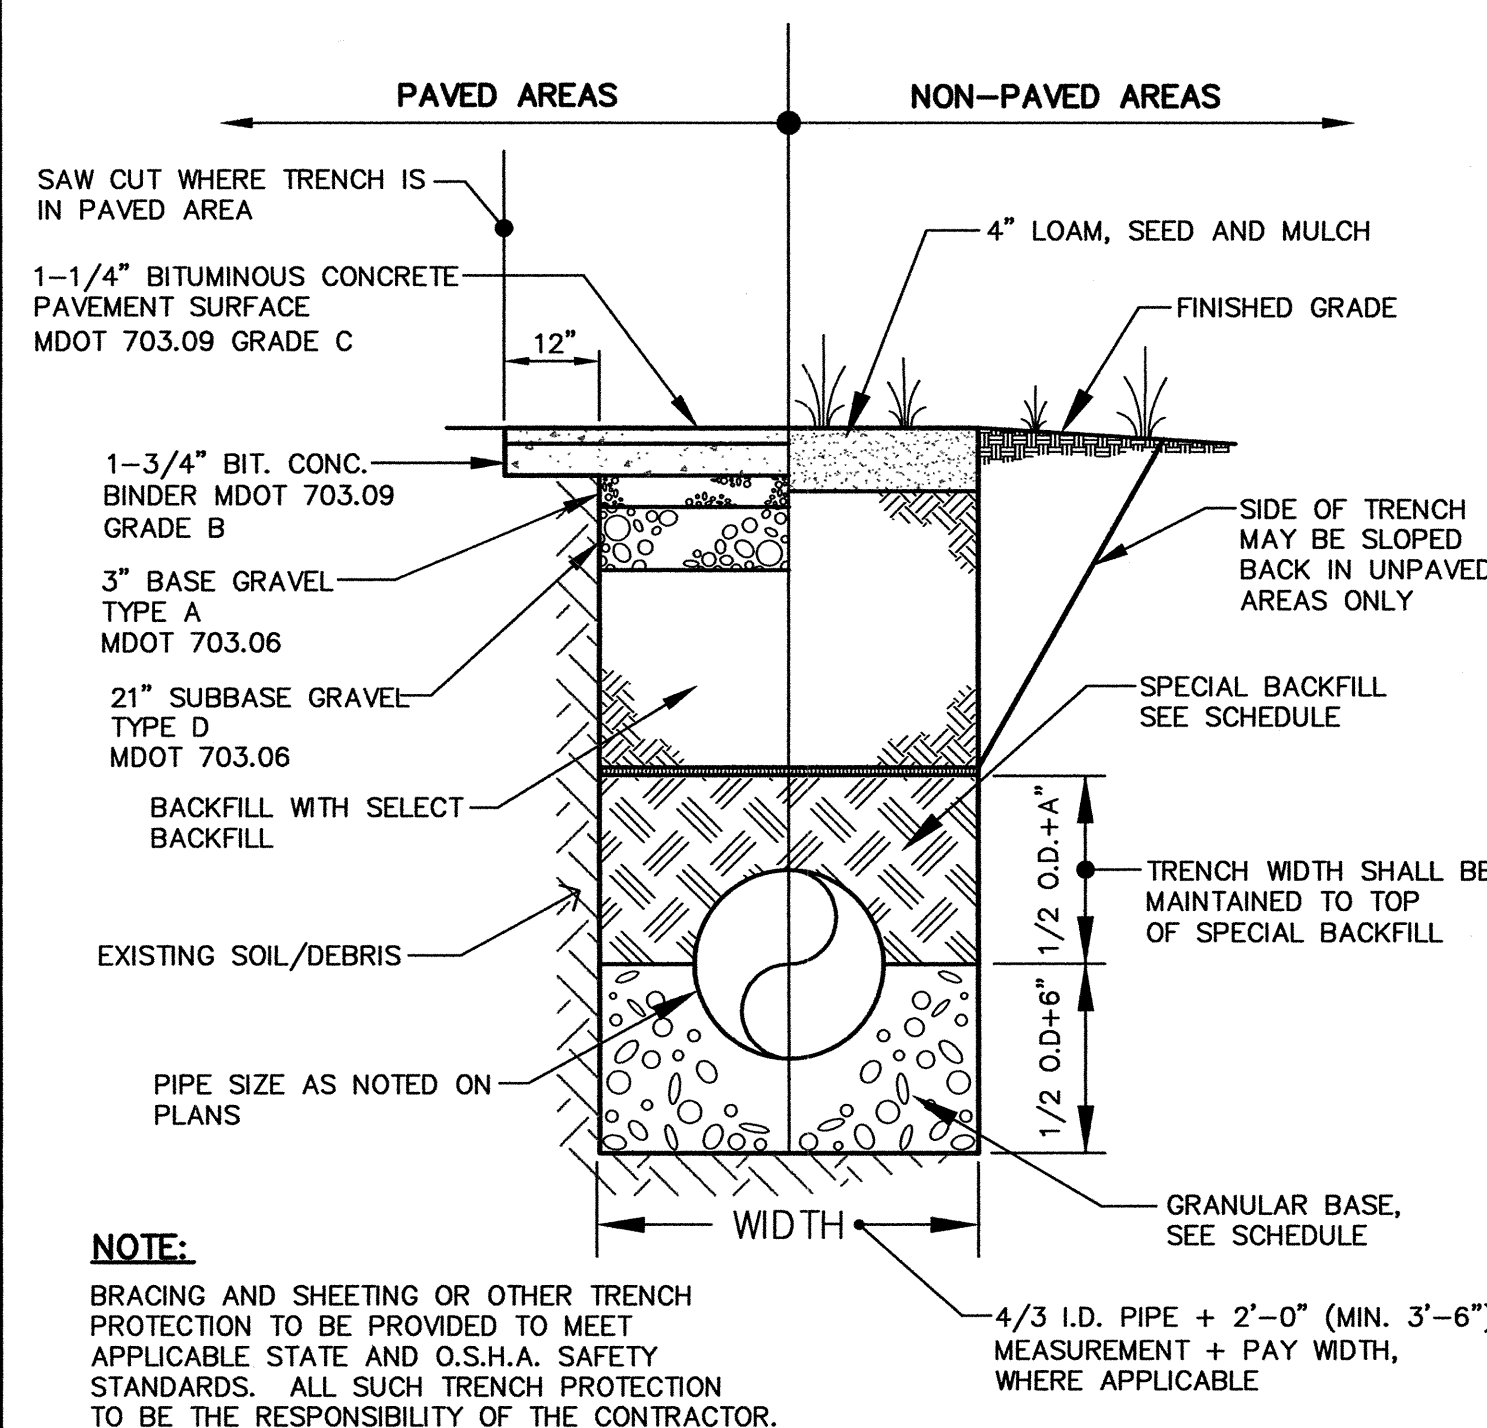


TRENCH SECTION BACKFILL SCHEDULE

TYPE OF PIPE	GRANULAR BASE MATERIAL	SPECIAL BACKFILL	SPECIAL BACKFILL COVER "A" (IN)	SELECT BACKFILL
CONCRETE	GRANULAR AASHTO M145-49 A-3 OR BETTER	GRANULAR AASHTO M145-49 A-3 OR BETTER	12"	GRANULAR AASHTO M145-49 A-3 OR BETTER
PVC	3/4" CRUSHED STONE	GRANULAR AASHTO M145-49 A-3 OR BETTER	6"	GRANULAR AASHTO M145-49 A-3 OR BETTER
DUCTILE IRON	GRANULAR AASHTO M145-49 A-3 OR BETTER	GRANULAR AASHTO M145-49 A-3 OR BETTER	6"	GRANULAR AASHTO M145-49 A-3 OR BETTER
UNDER-DRAINS	3/4" CRUSHED STONE	3/4" CRUSHED STONE	6"	GRANULAR AASHTO M145-49 A-3 OR BETTER


(E) TYPICAL UTILITY PIPE TRENCH SECTION
N.T.S.

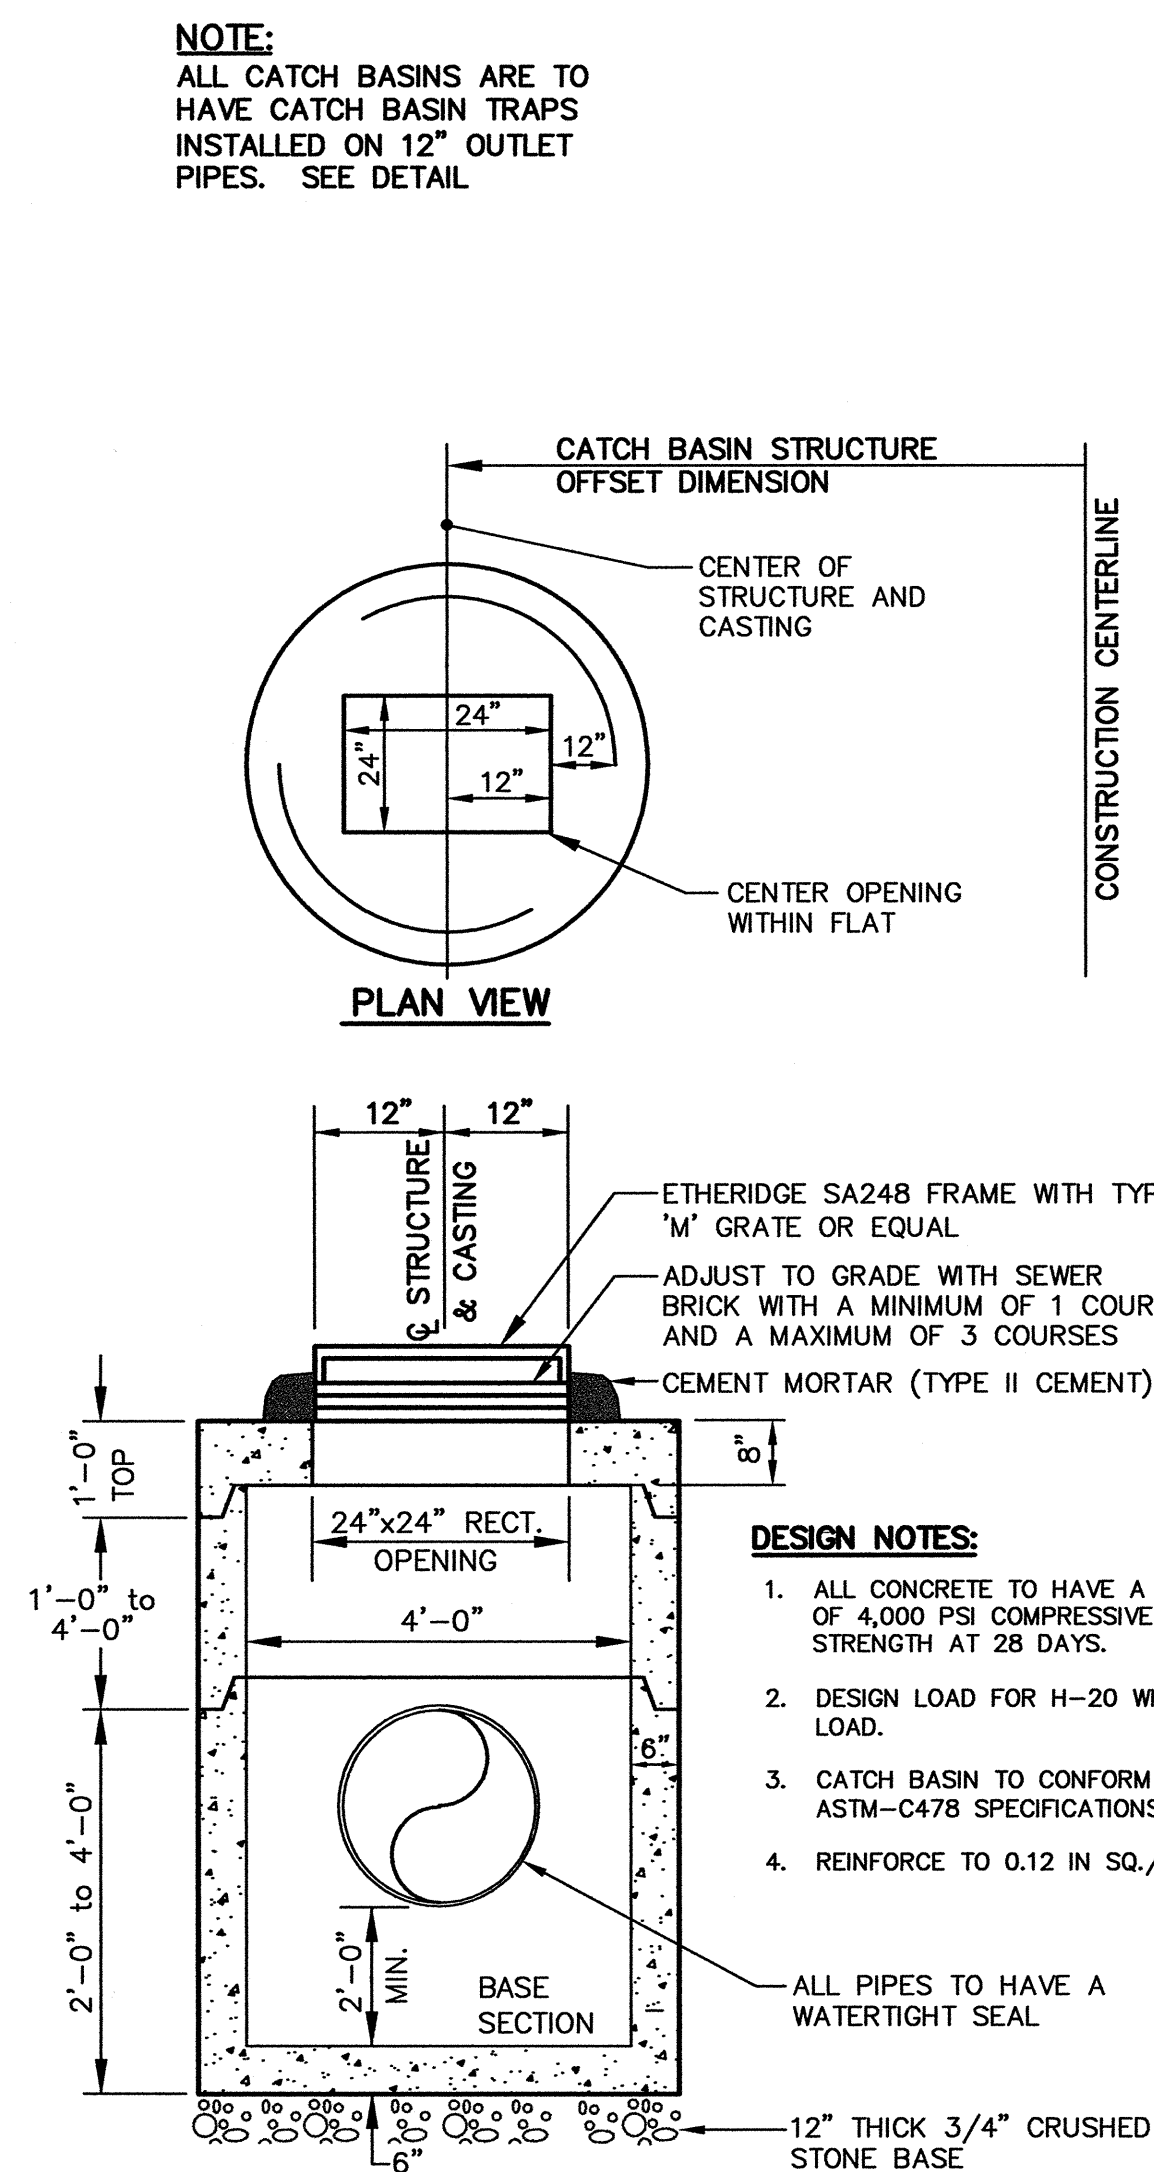

(F) 4'-0" PRECAST CATCH BASIN
N.T.S.

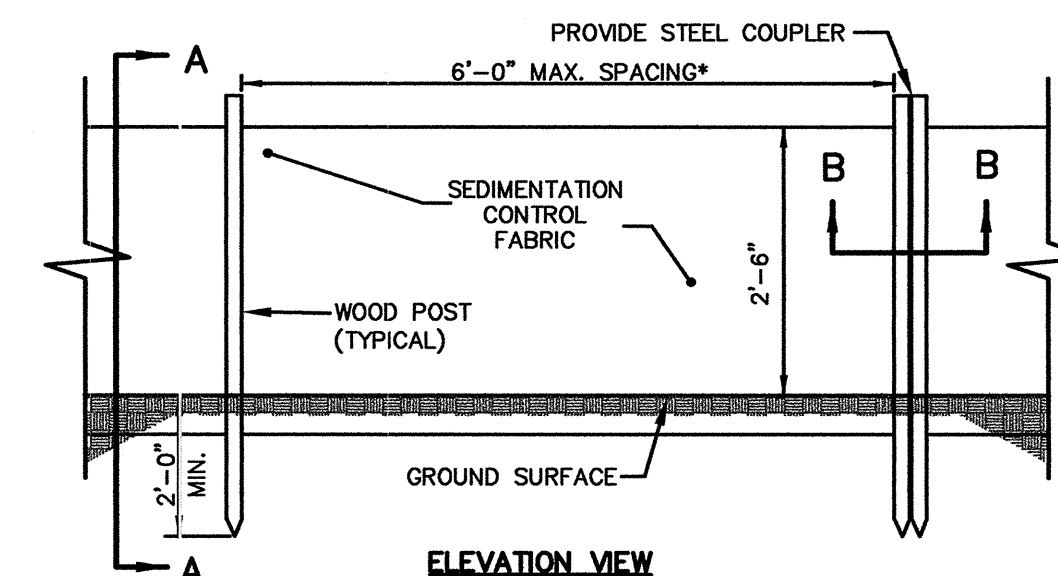


*NOTE: THE SILT FENCE SHOULD HAVE A MAXIMUM STAKING DISTANCE OF 6' UNLESS THE FENCE IS SUPPORTED BY WIRE FENCE REINFORCEMENT A MAXIMUM 14 GAUGE AND WITH A MINIMUM MESH SPACING OF 6".

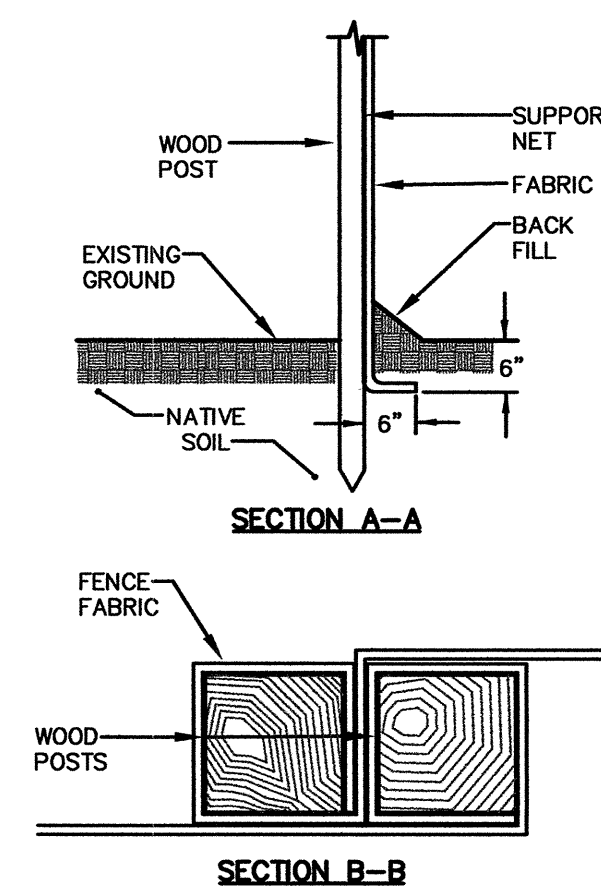


NOTE: BOTTOM OF SILT FENCE MUST BE TOED INTO GROUND OR NO PAYMENT SHALL BE MADE. SEE EROSION / SEDIMENT CONTROL PLAN DRAWINGS FOR SILT FENCE INSTALLATION SCHEDULE.

NOTE: TYPE 1, TYPE 2 OR TYPE 3 APPLIES TO INSTALLATION PERIOD ONLY - REFER TO EROSION CONTROL PLANS.

(G) SILT FENCE DETAIL
N.T.S.

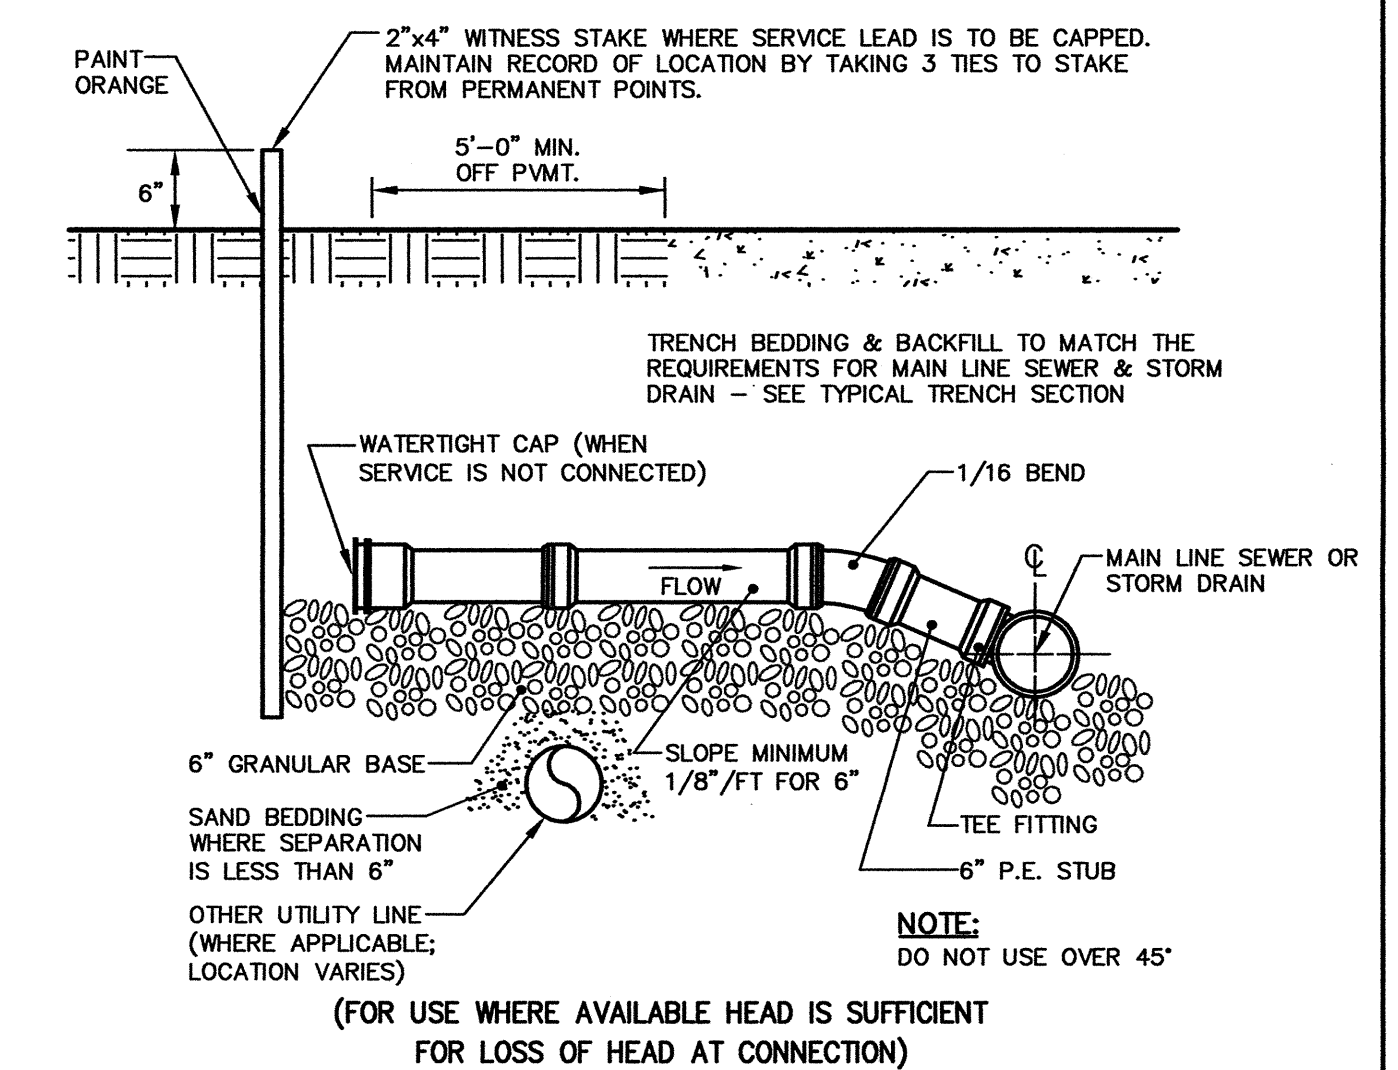

(H) TYPE 2 SEWER AND STORM DRAIN SERVICE LEADS
N.T.S.

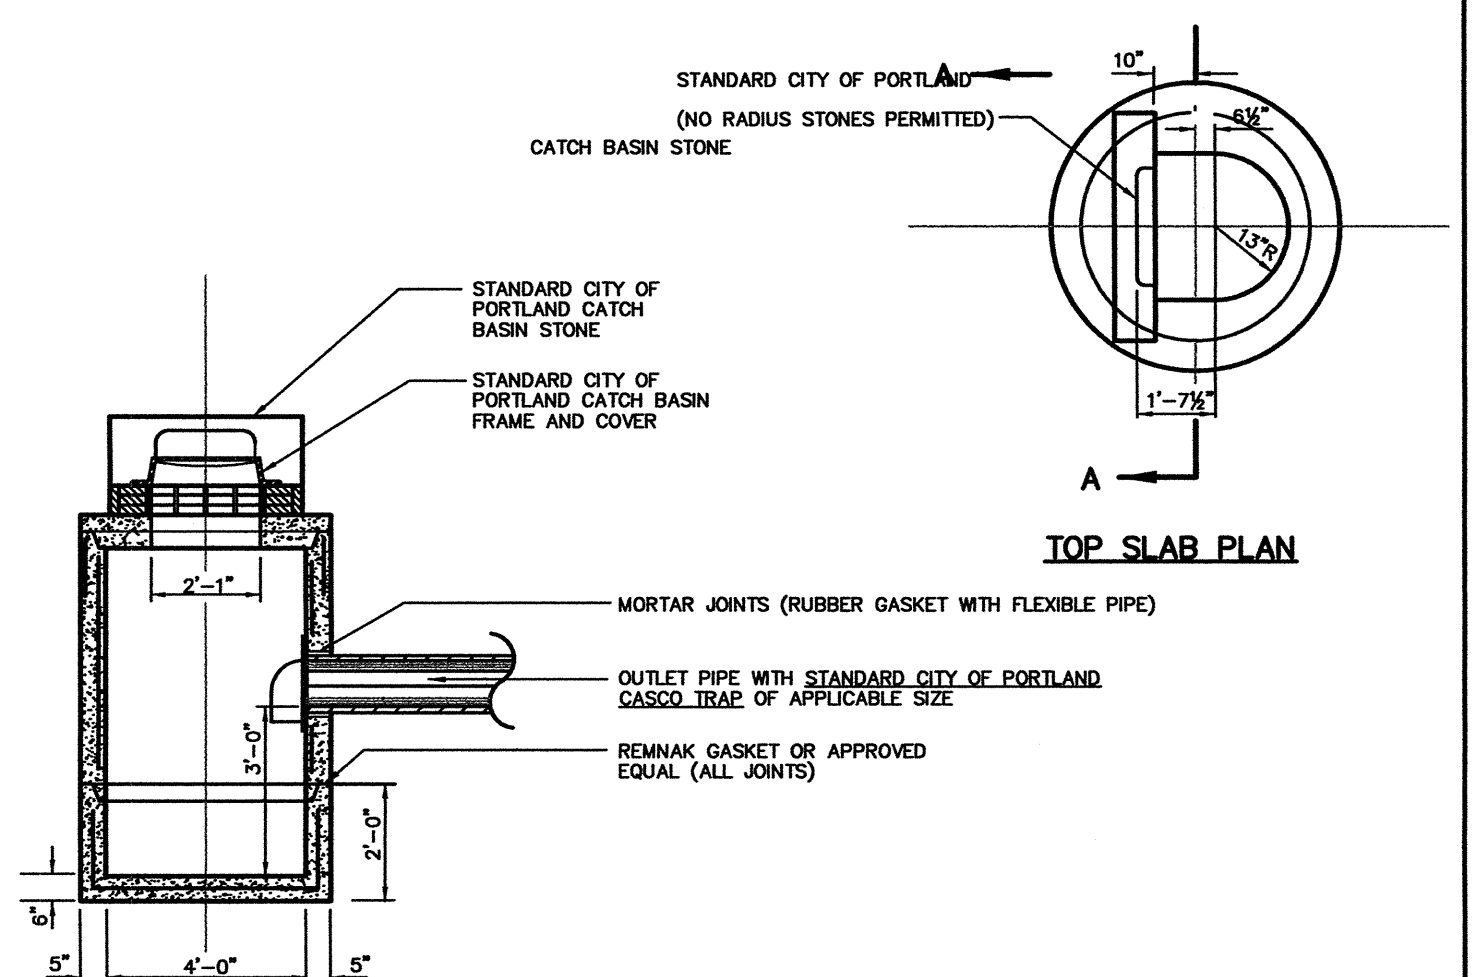

(I) STANDARD CITY OF PORTLAND TYPE "E" CATCH BASIN
N.T.S.

PERMIT SET- NOT FOR CONSTRUCTION

			PROJECT 44 FEDERAL STREET CONDOMINIUMS		DeLUCA-HOFFMAN ASSOCIATES, INC. 778 MAIN STREET, SUITE 6 SOUTH PORTLAND, ME 04106 207.776.1121 WWW.DELUCAHOFFMAN.COM
SHEET TITLE MISCELLANEOUS DETAILS			DRAWN: RJK DATE: FEB 2005 DESIGNED: RJK SCALE: N.T.S. CHECKED: CJO JOB NO.: 2565 FILE NAME: 2565-C4-DET		
CLIENT PORT CITY ARCHITECTURE			SHEET C-5		
REVISIONS					