




- General Mechanical Notes:**
1. Gas piping at the garage level shall be Schedule 40 carbon steel with threaded joints. Gas piping above the Garage Level shall be "RacePipe".
 2. Electric heat shall be provided by the Electrical Contractor.
 3. Louvers shall be by the General Contractor.

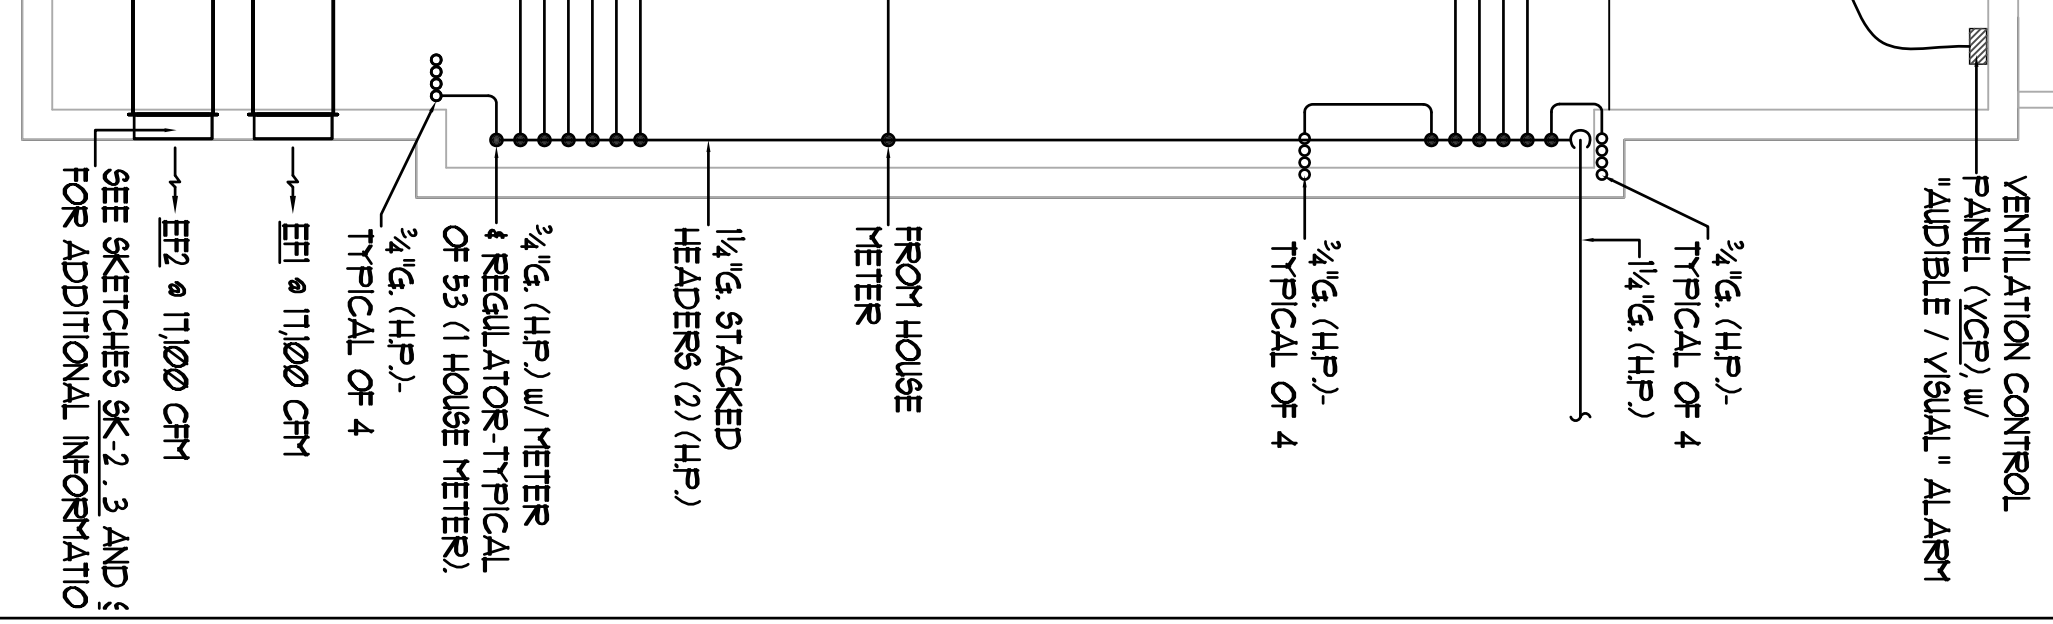

Atlantic Comfort Systems, Inc.
 Mechanical Contractor • 507-284-4390
 882 Hill Street, Balaclava, ME 04005
 www.atlanticcomfort.com

	Revisions: 11/29/2012 - UNDER LAB PIPING FOR CONSTRUCTION 12/14/2012 - FOR PERMIT.
Bay House Portland, ME	

BENNETT ENGINEERING
 MECHANICAL • ELECTRICAL
 (207) 865-9475

Job No.: 3346
 Date: 12/14/12
 Scale: 1/8" = 1'-0" or A.N.
 Drawn by: SP Doel
 Checked by: SP Doel
 Drawing Title:
HYAC Lower Level Plan
Building "1"