

Revisions
11/29/2012-INDERS LAB PIPING FOR
CONSTRUCTION FOR PERMIT.
12/14/2012-

Bay House
Portland, ME




**BENNETT
ENGINEERING**
MECHANICAL • ELECTRICAL
(207) 865-9475


Job No.: 3346
Date: 12/4/12
Scale: 1/8" = 1'-0" or A.N.
Drawn by: SF Dnd
Checked by: SF Dnd

Drawing Title:
Unit Plans

M.14

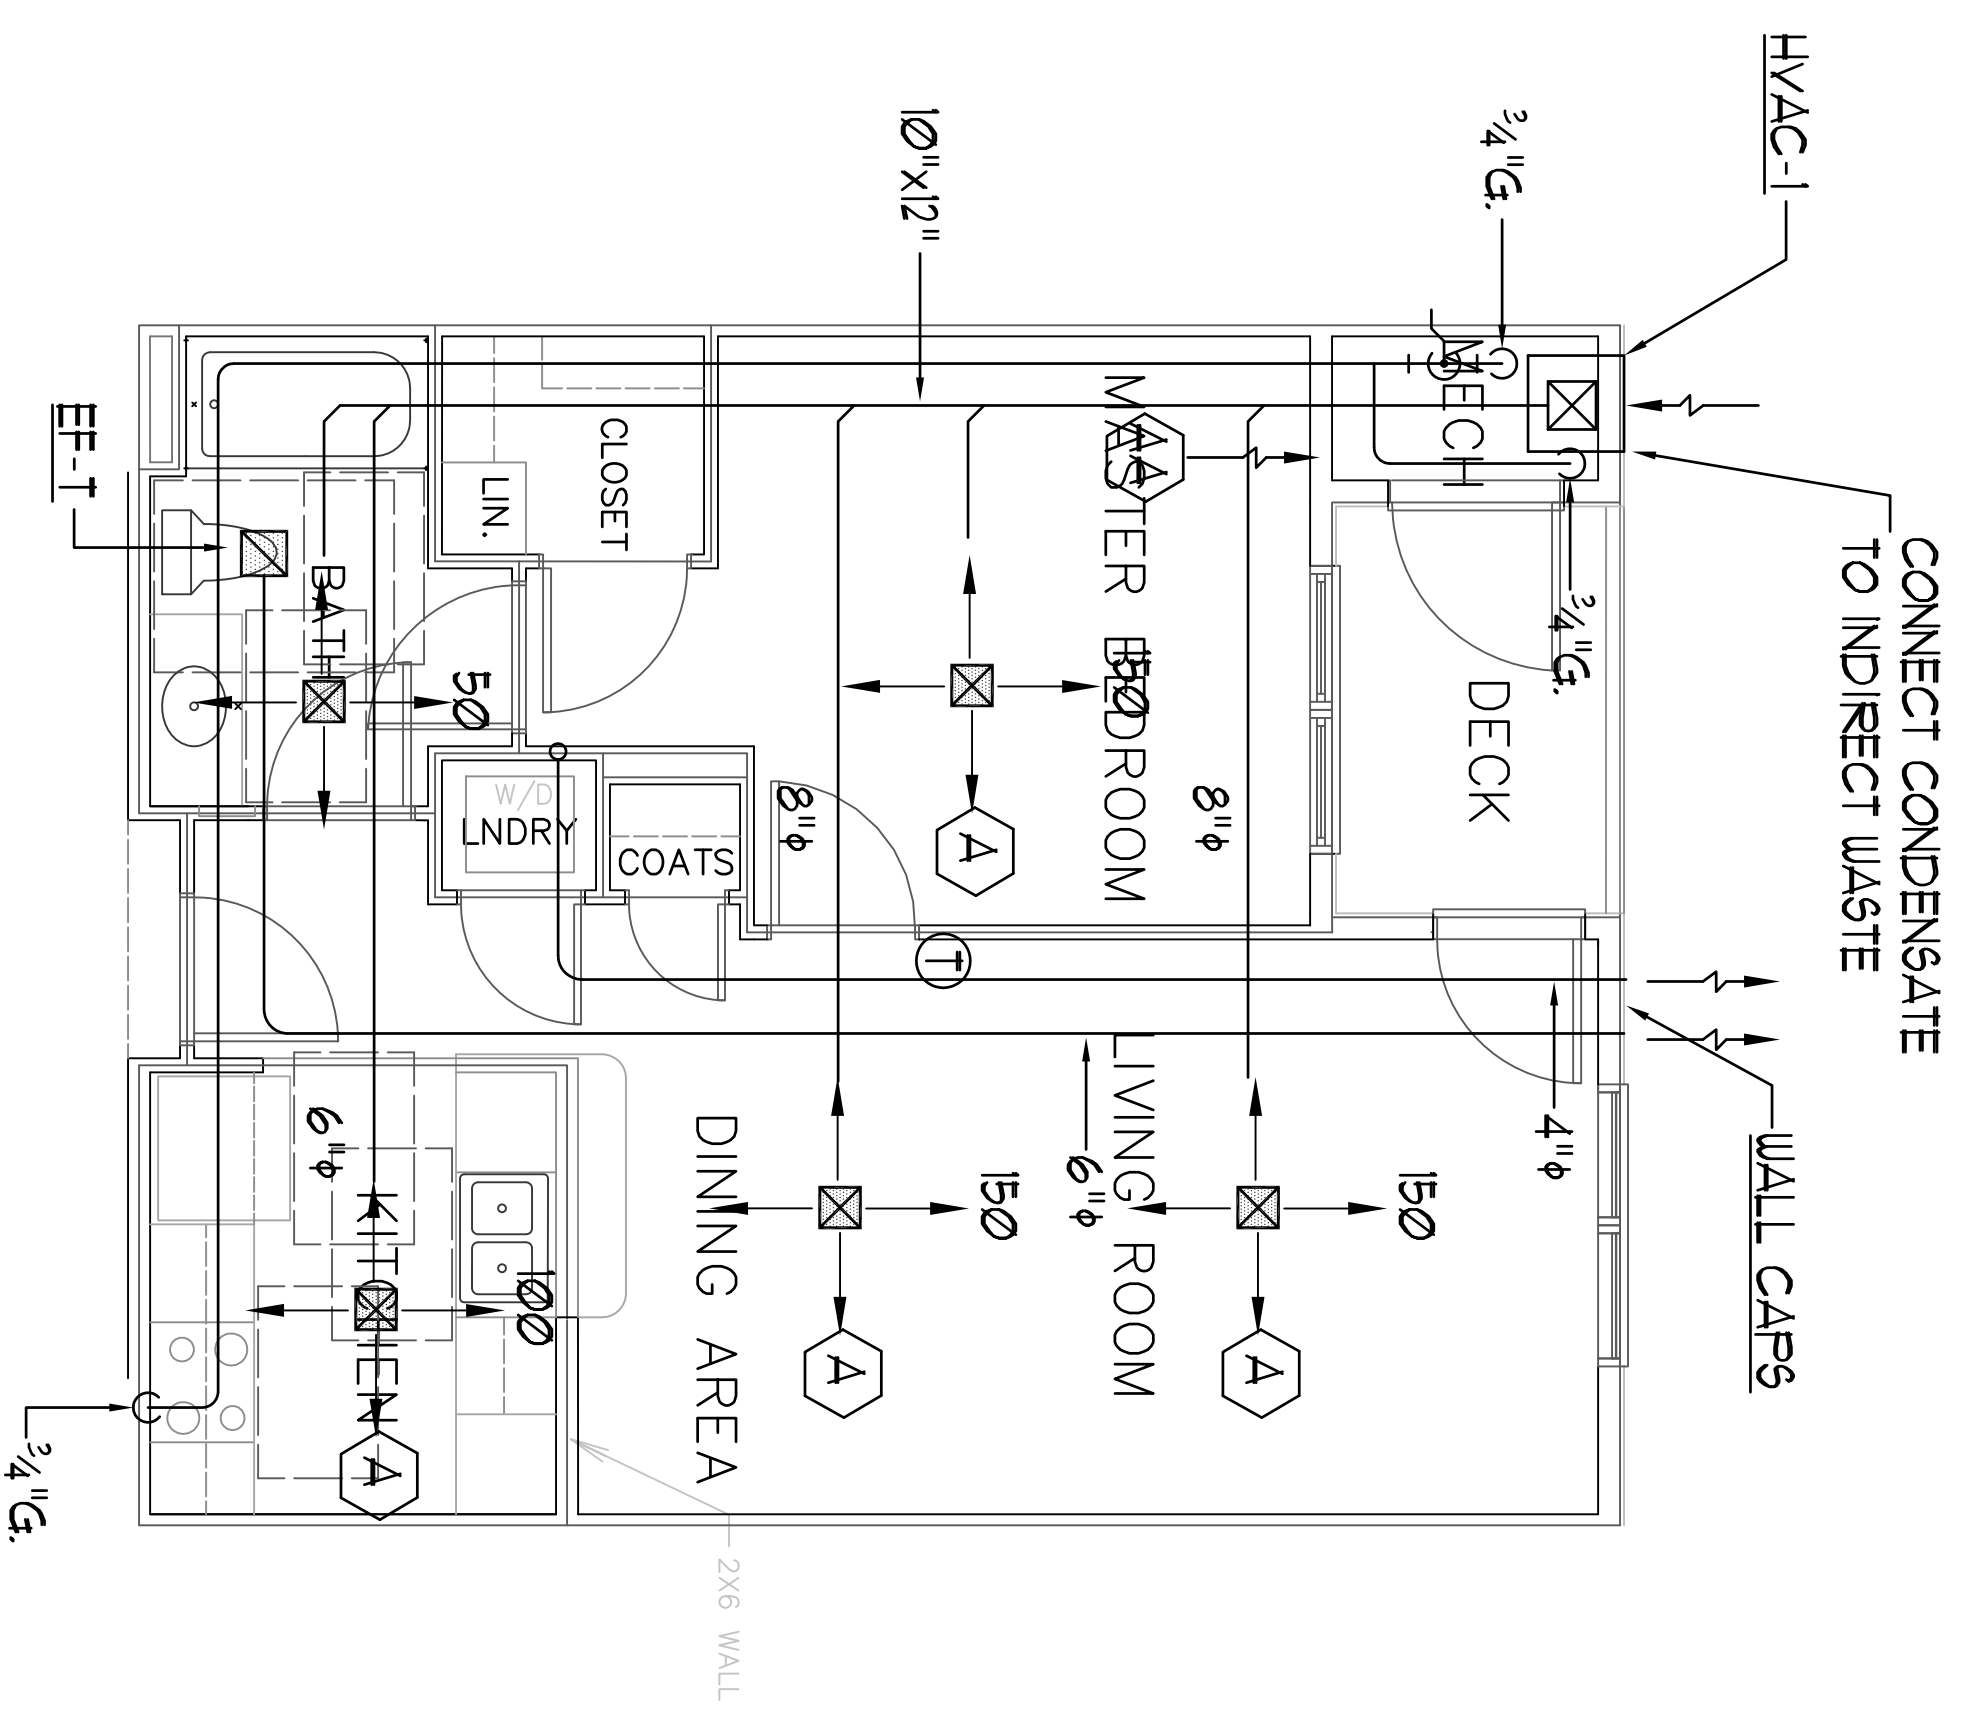


UNIT TYPE E
SCALE: 1/4" = 1' 0"

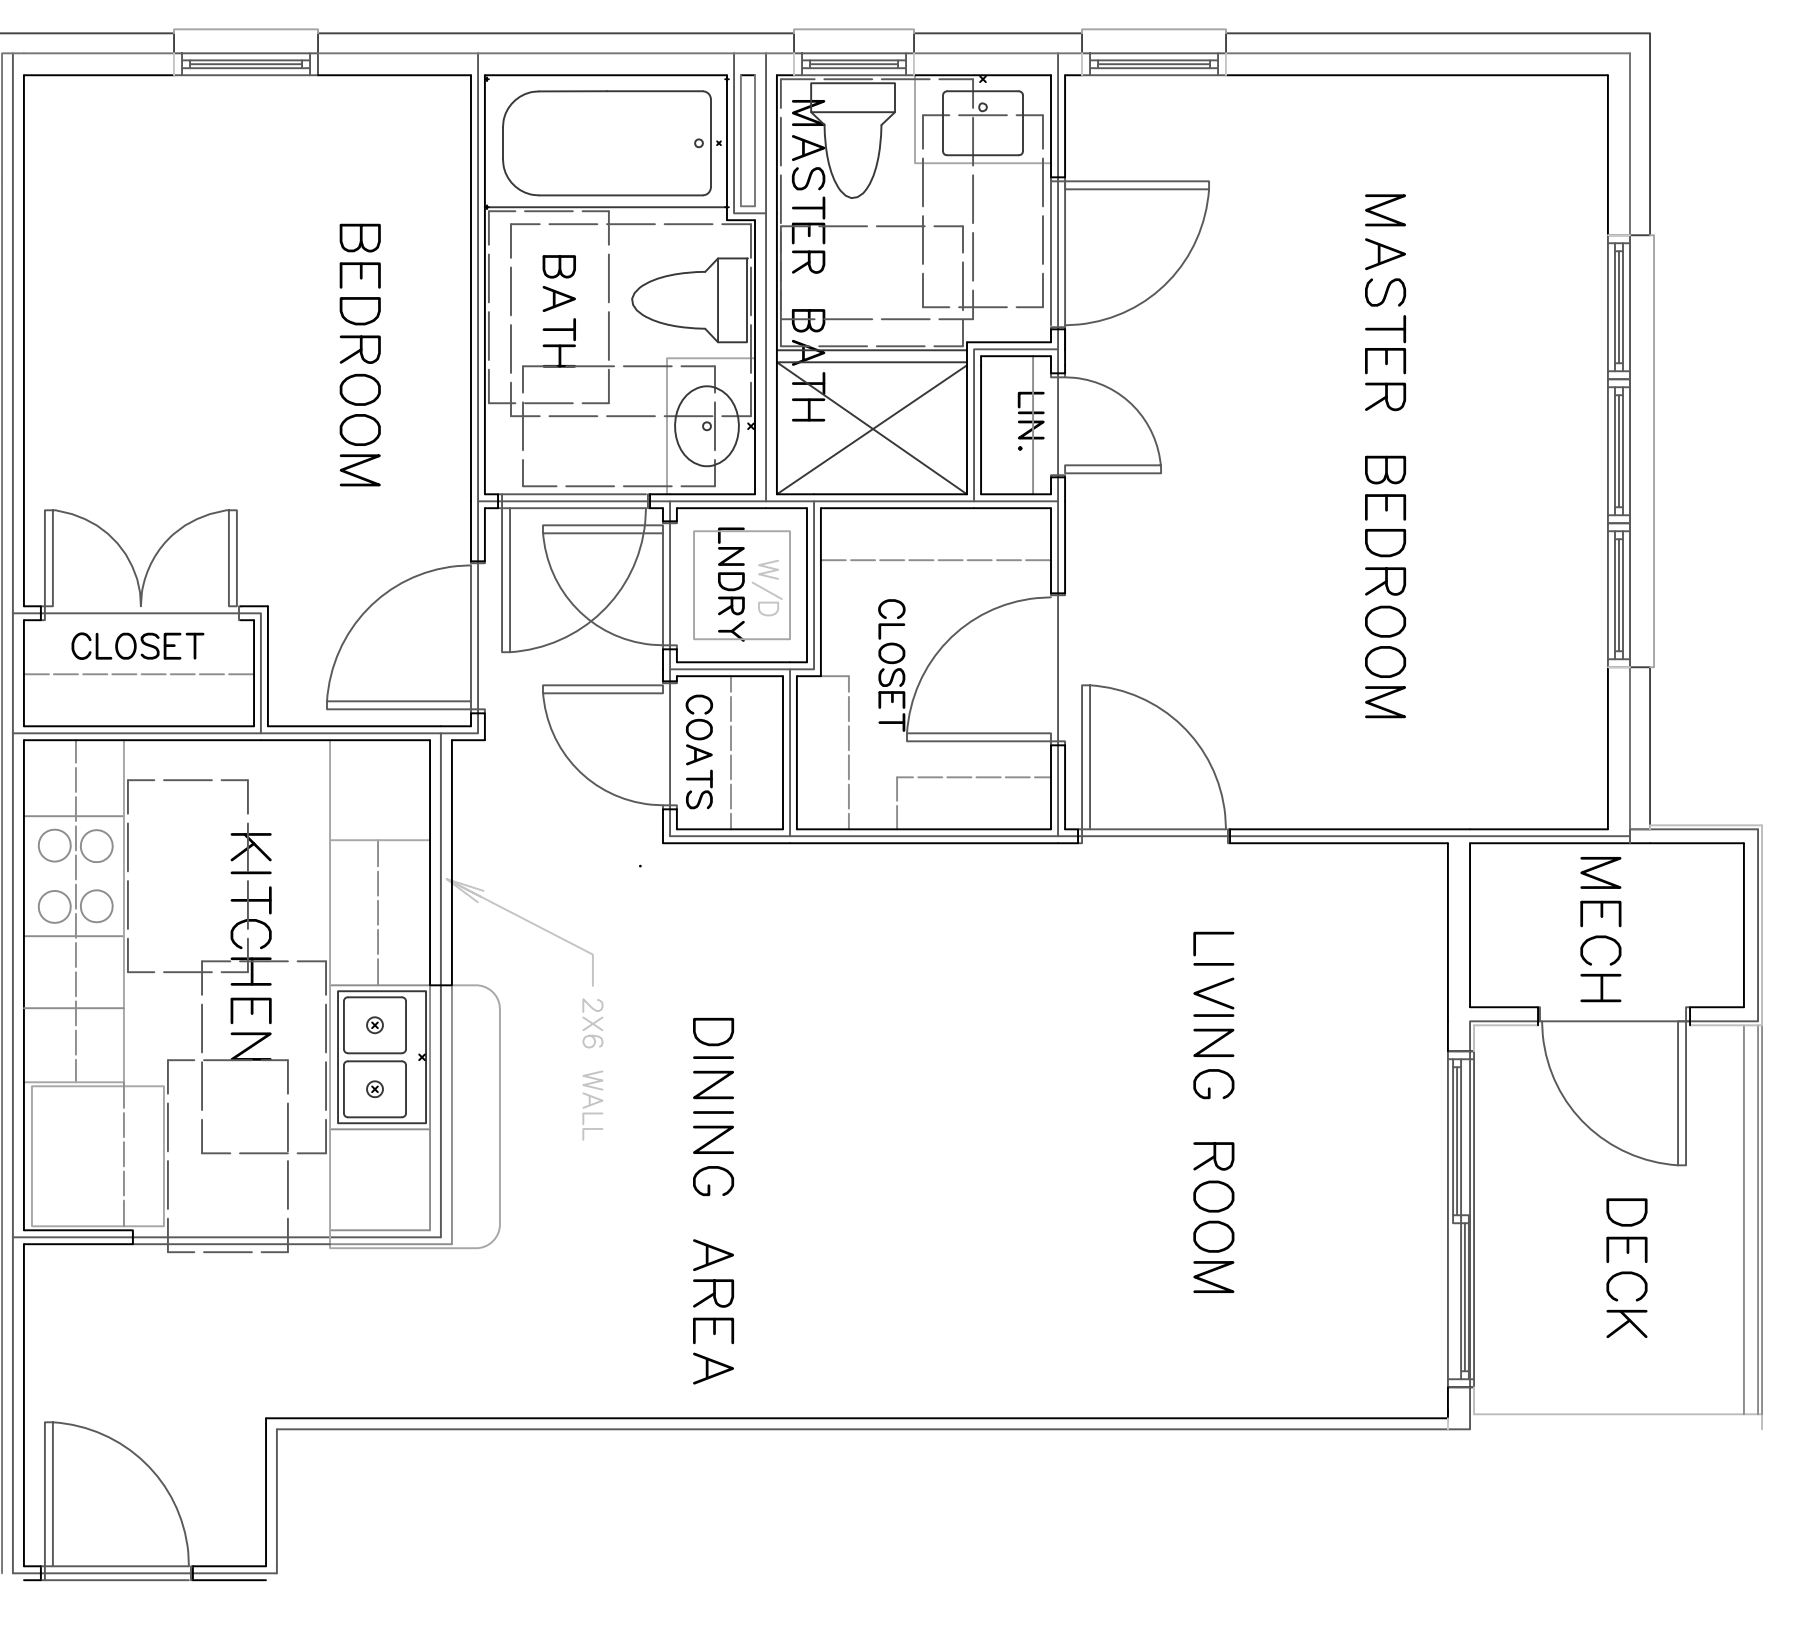

UNIT TYPE D
SCALE: 1/4" = 1' 0"

- General Notes
1. Unit Type D is similar to Unit Type C. See Unit Type C for additional information.
 2. All ceiling diffusers shall have ceiling fire dampers (CFD) with volume control.

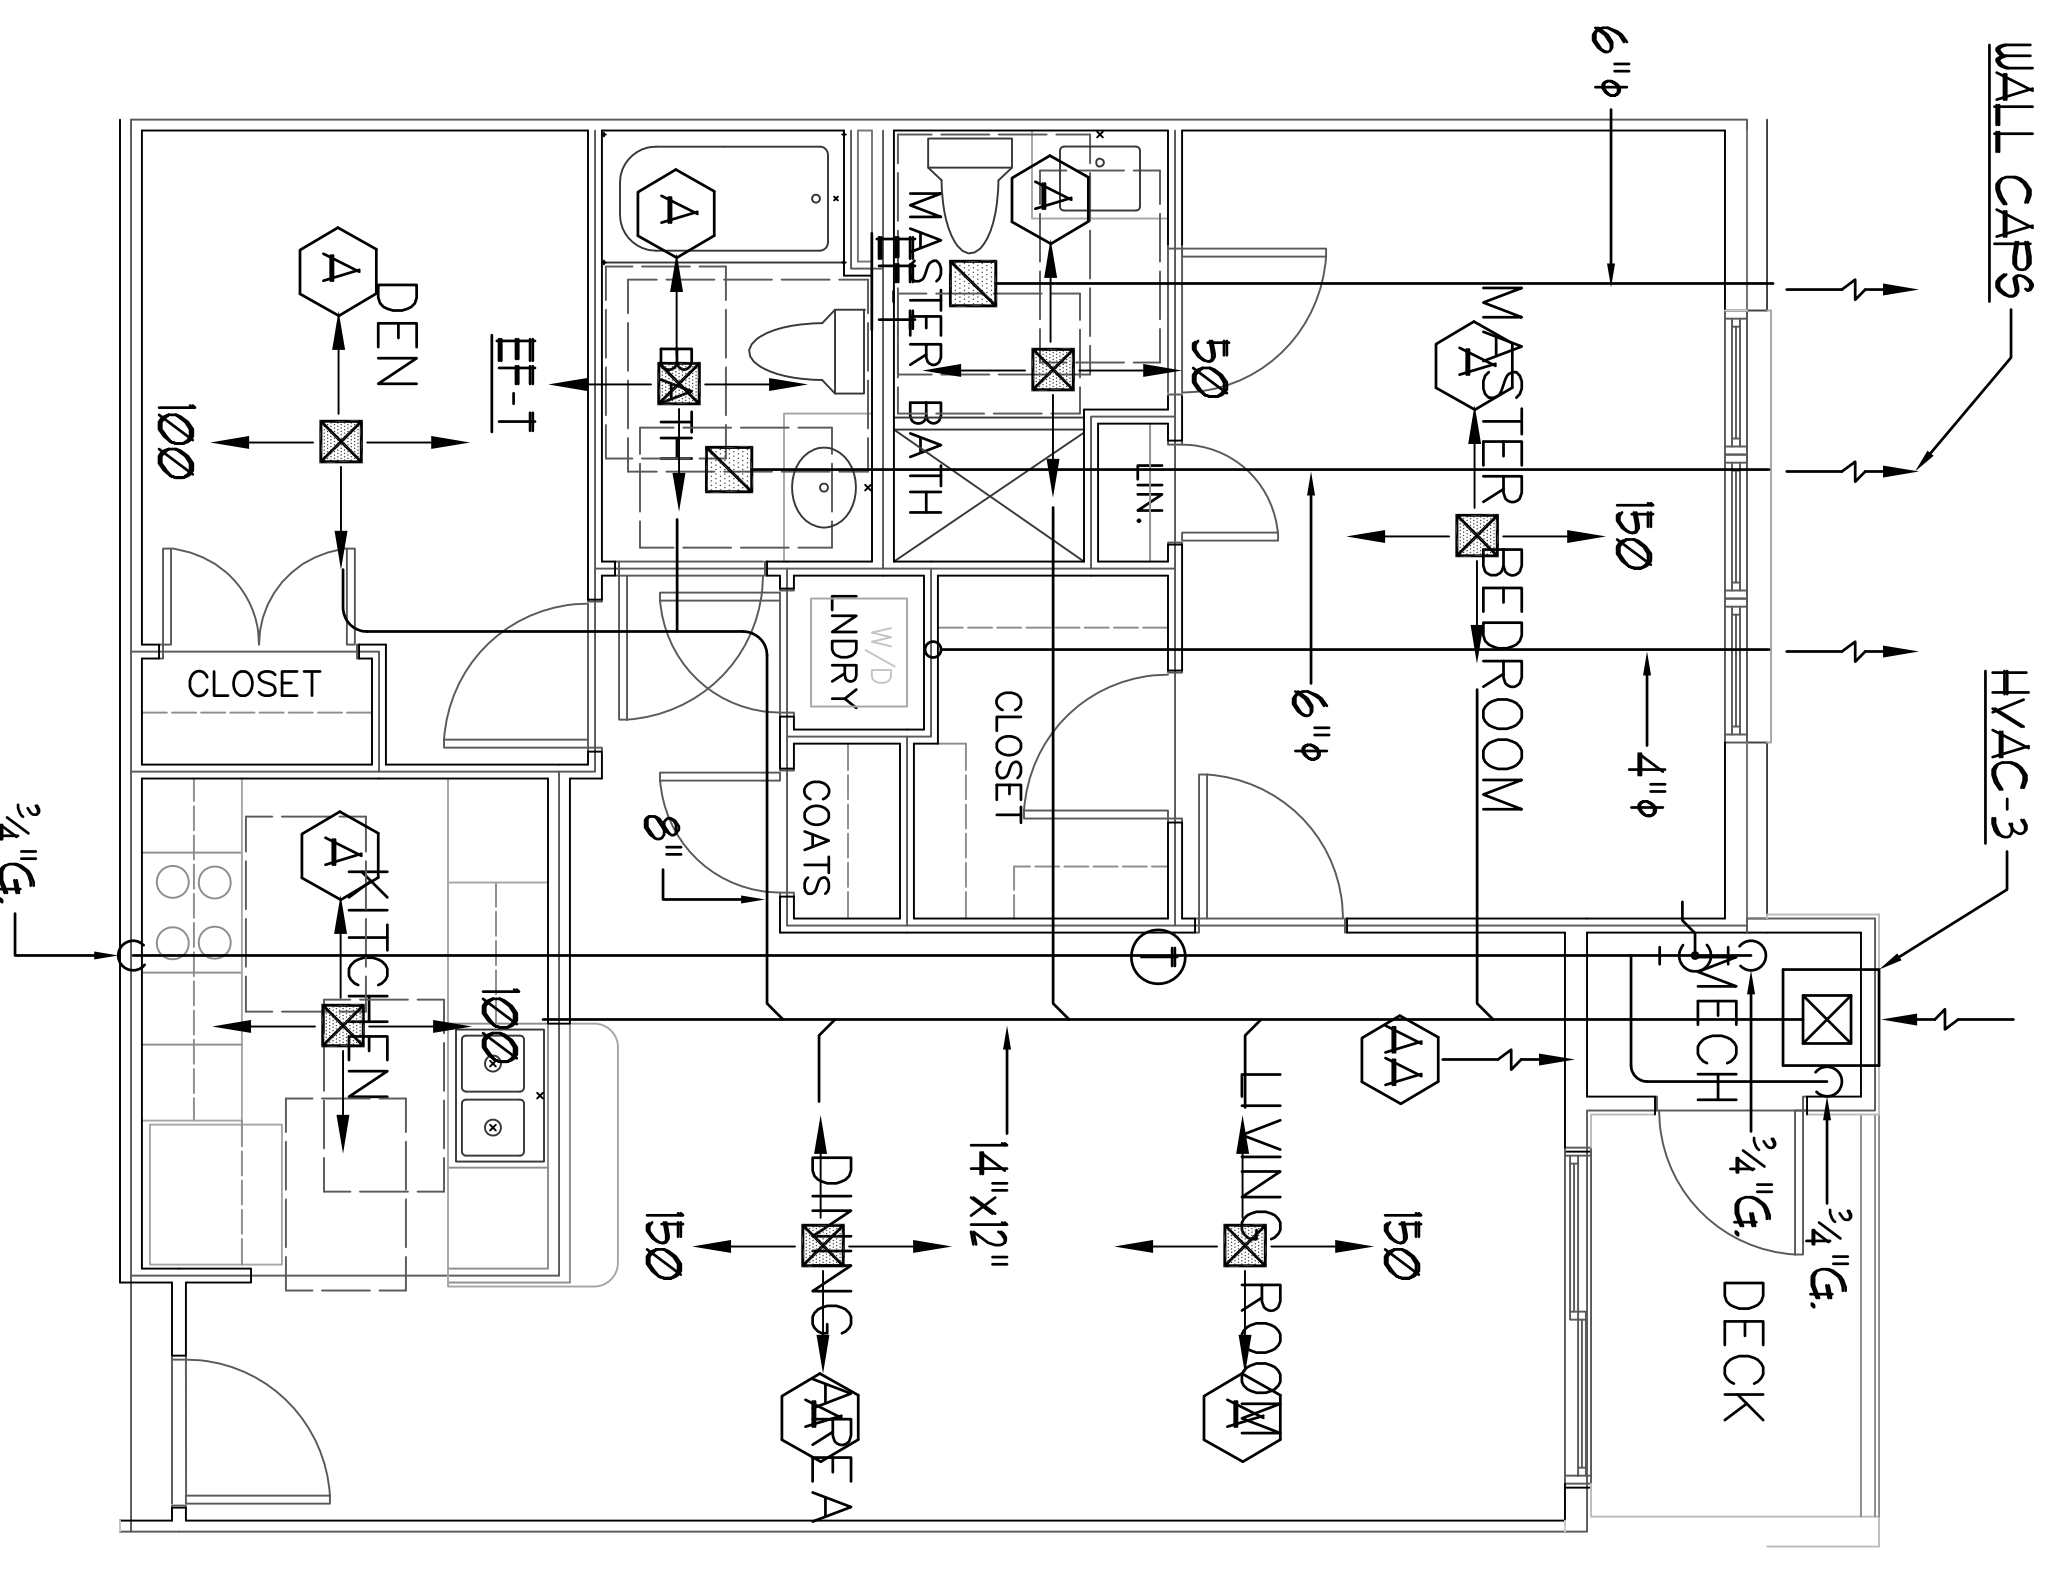

UNIT TYPE C
SCALE: 1/4" = 1' 0"