

Revisions:
11/29/2012 - UNDERSLAB PIPING FOR
CONSTRUCTION - FOR PERMIT.
12/14/2012 - FOR PERMIT.

Bay House
Portland, ME




**BENNETT
ENGINEERING**
MECHANICAL • ELECTRICAL
(207) 865-9475

Job No.: 3346
Date: 12/14/12
Scale: 1/8" = 1'-0" or A.N.
Drawn by: SF Doel
Checked by: SF Doel


Drawing Title:
Unit Plans

M.15

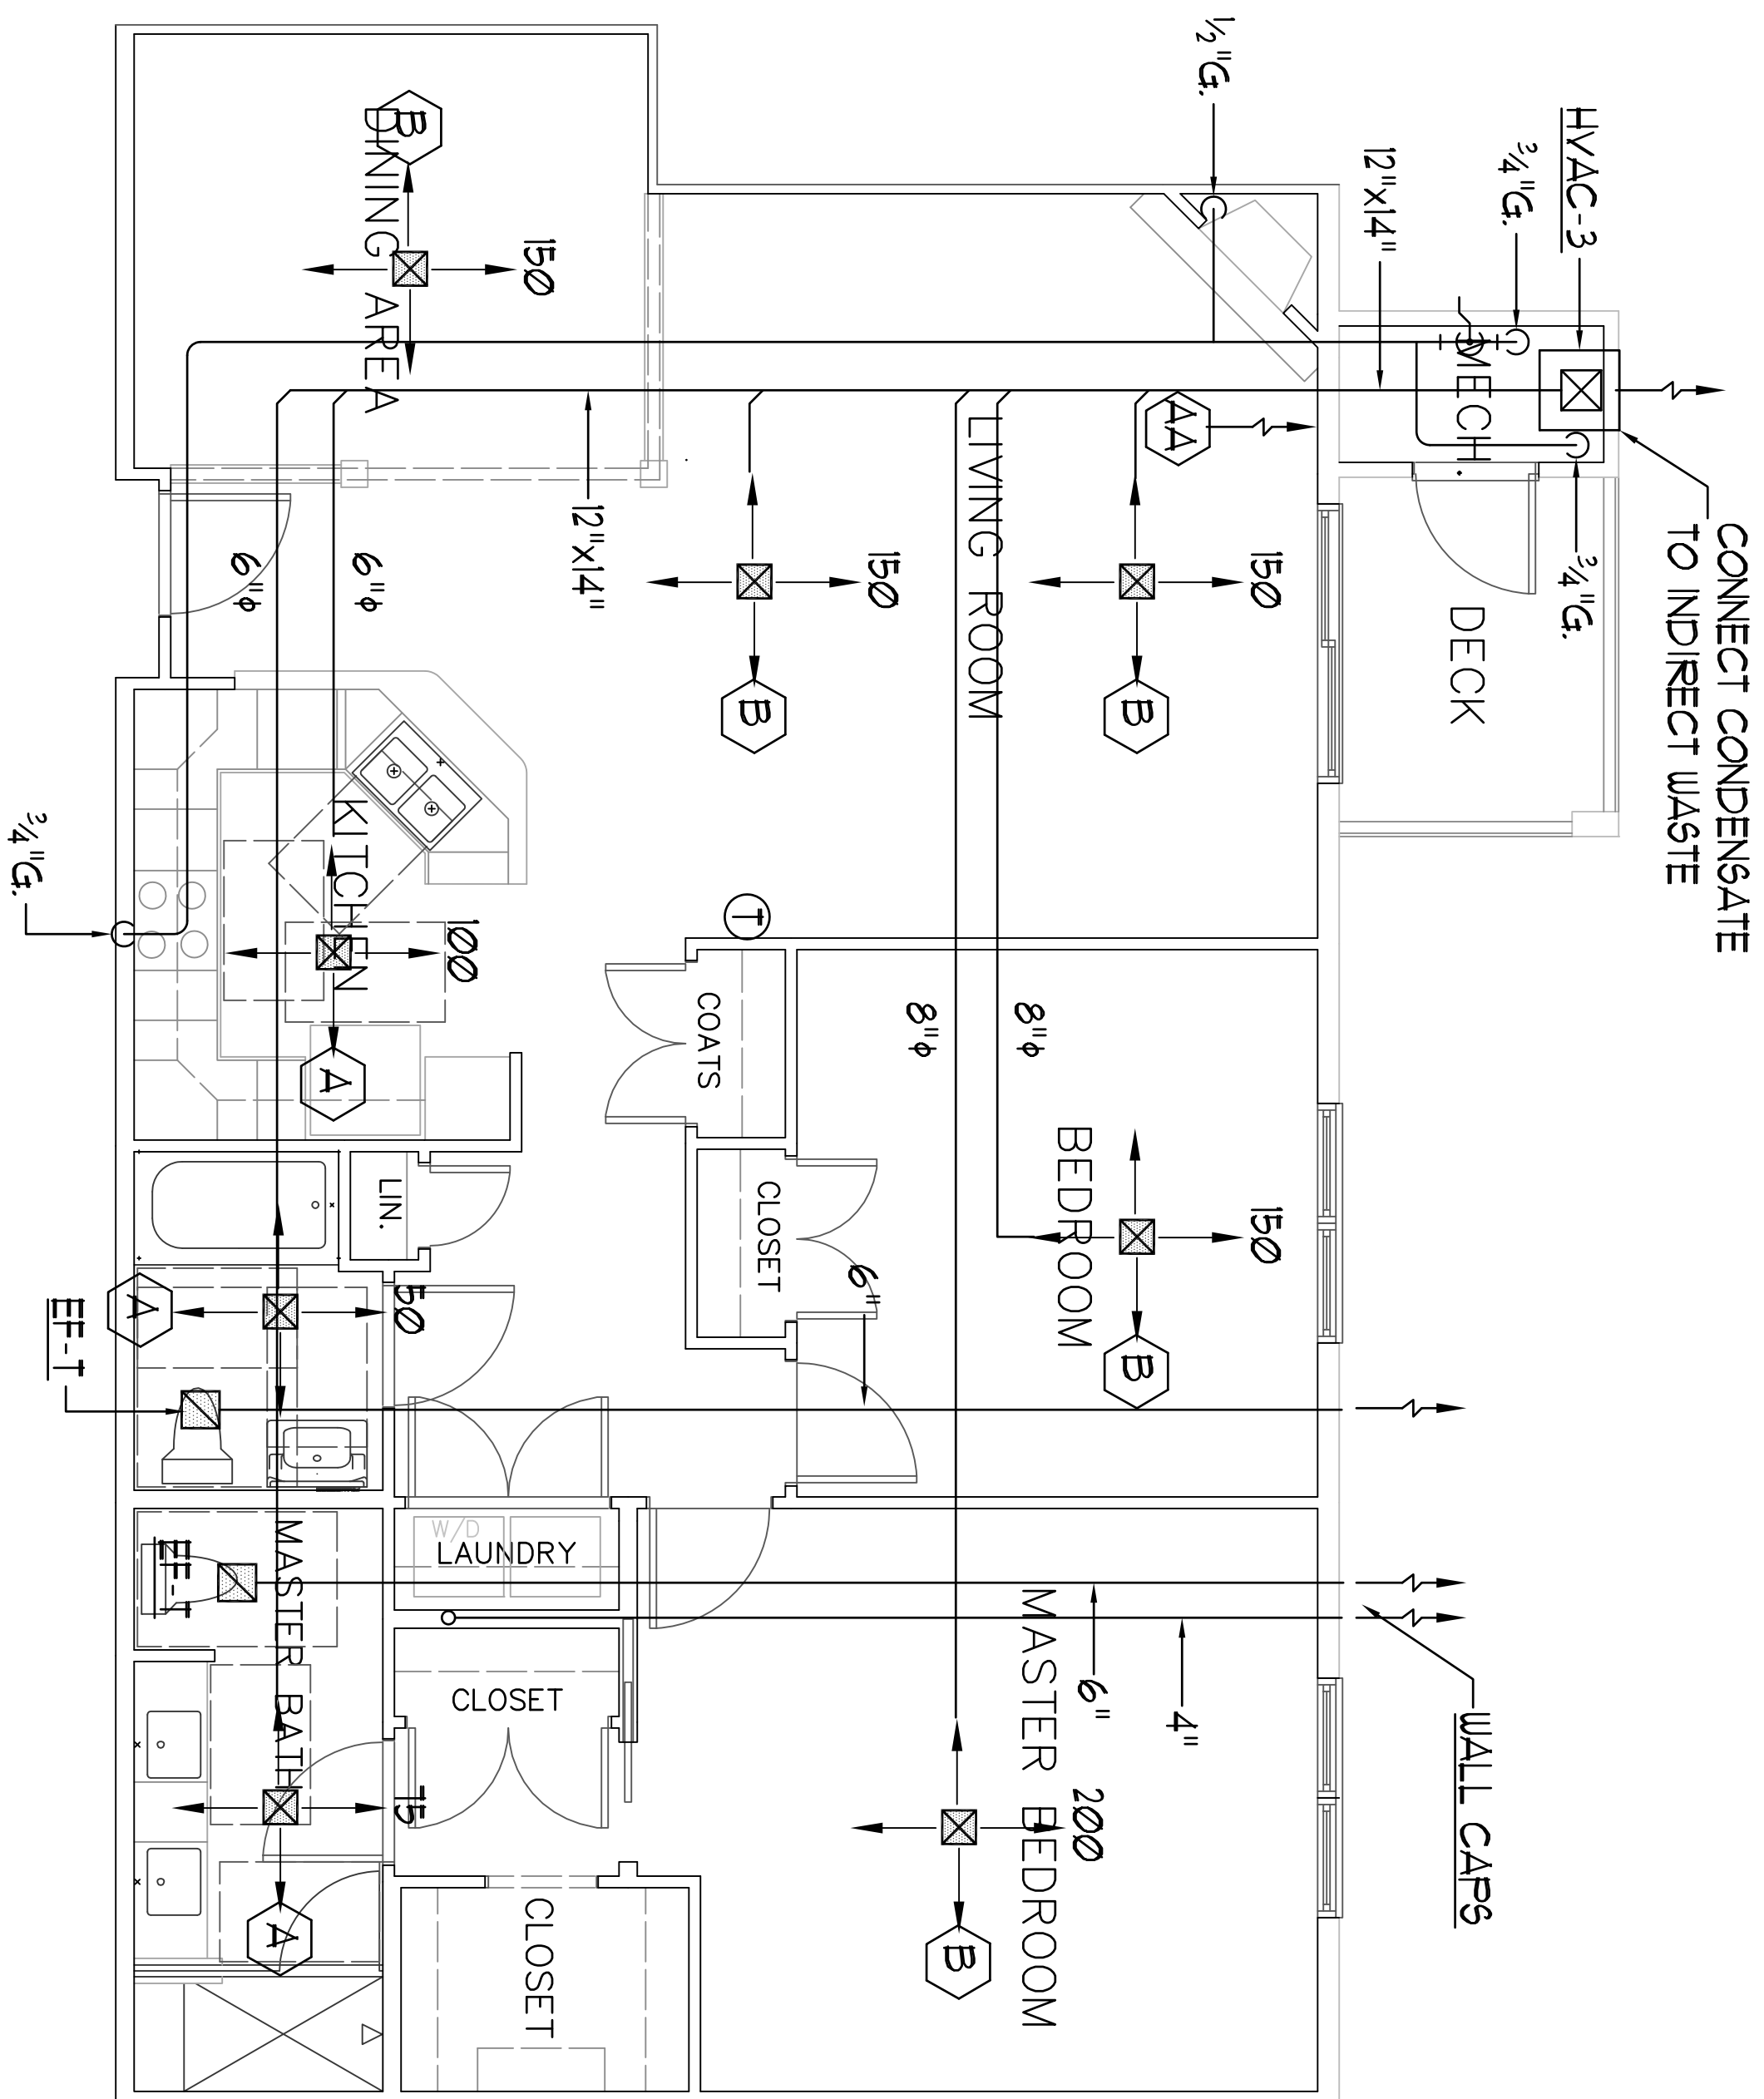

UNIT TYPE L
SCALE: 1/4" = 1' 0"

General Notes
1. All ceiling diffusers shall have ceiling fire dampers (CFD) with volume control.

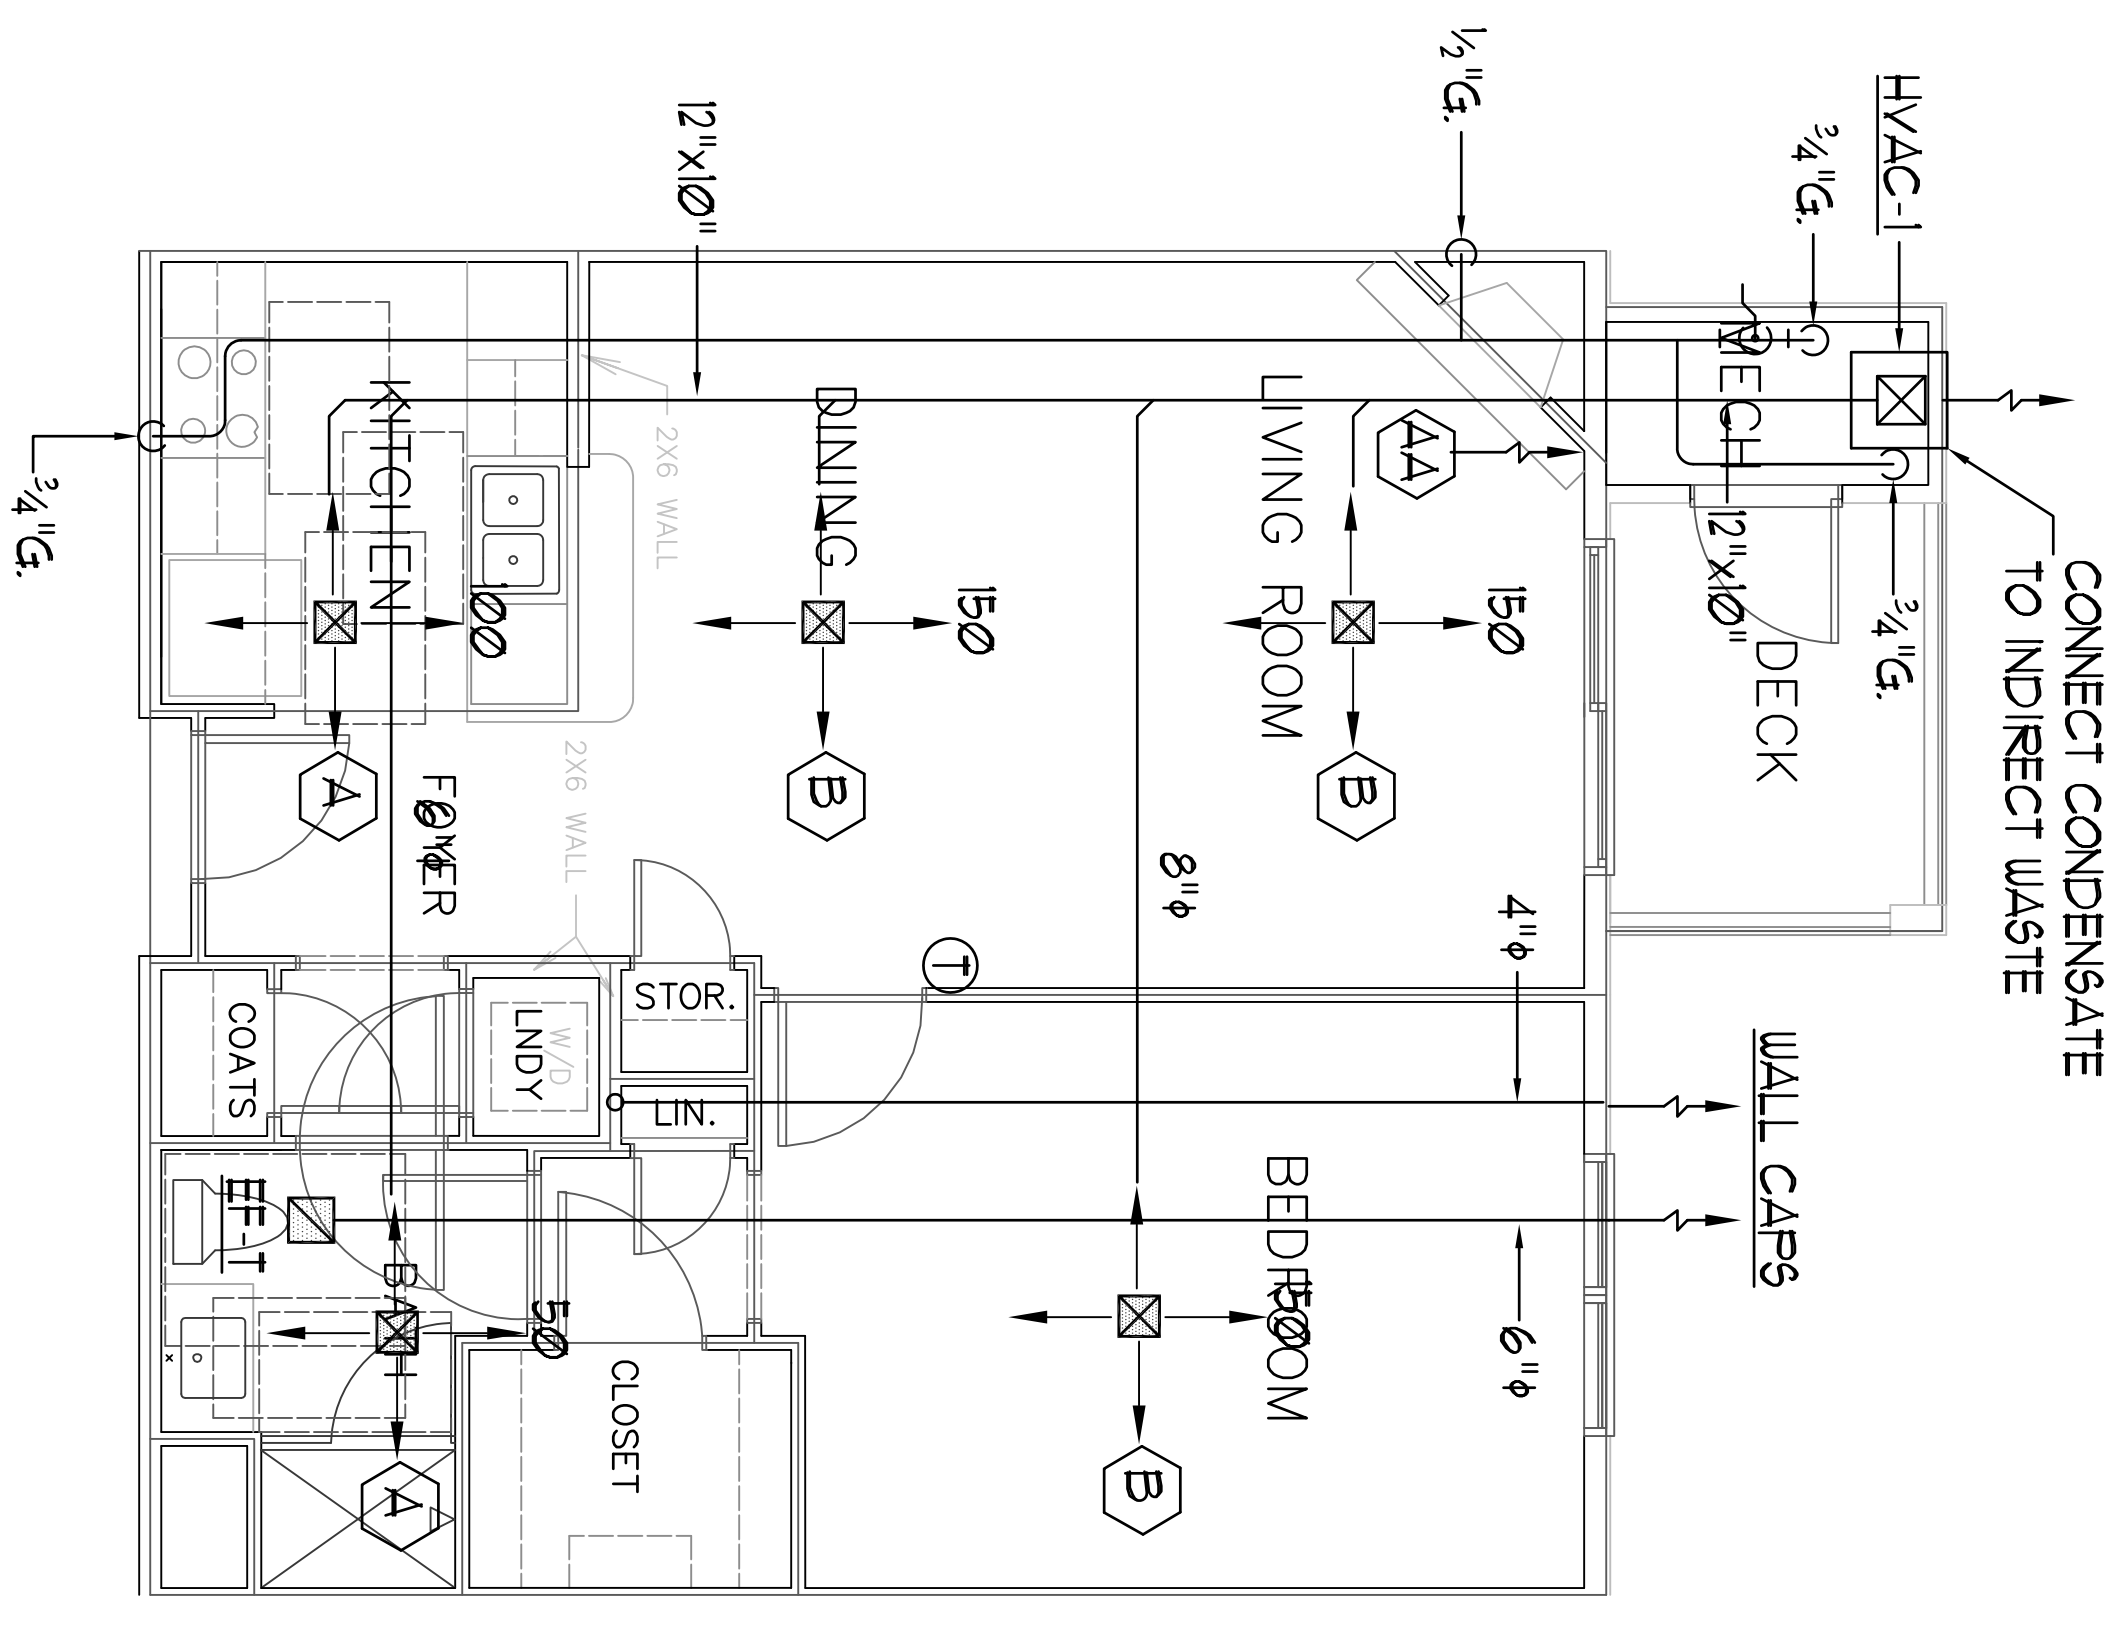

UNIT TYPE K
SCALE: 1/4" = 1' 0"