


Revisions:
11/29/2012 - UNDERSLAB PIPING FOR
CONSTRUCTION
12/14/2012 - FOR PERMIT.

Bay House
Portland, ME




**BENNETT
ENGINEERING**
MECHANICAL • ELECTRICAL
(207) 865-9475

Job No.: 3346
Date: 12/4/12
Scale: 1/8" = 1'-0" or A.N.
Drawn By: SF Doel
Checked by: SF Doel
Drawing Title:
Unit Plans




**Atlantic Comfort
Systems, Inc.**
Mechanical Contractor • 207-284-4390
882 Hill Street, Bridgton, ME 04005
www.atlanticcomfort.com

M.17

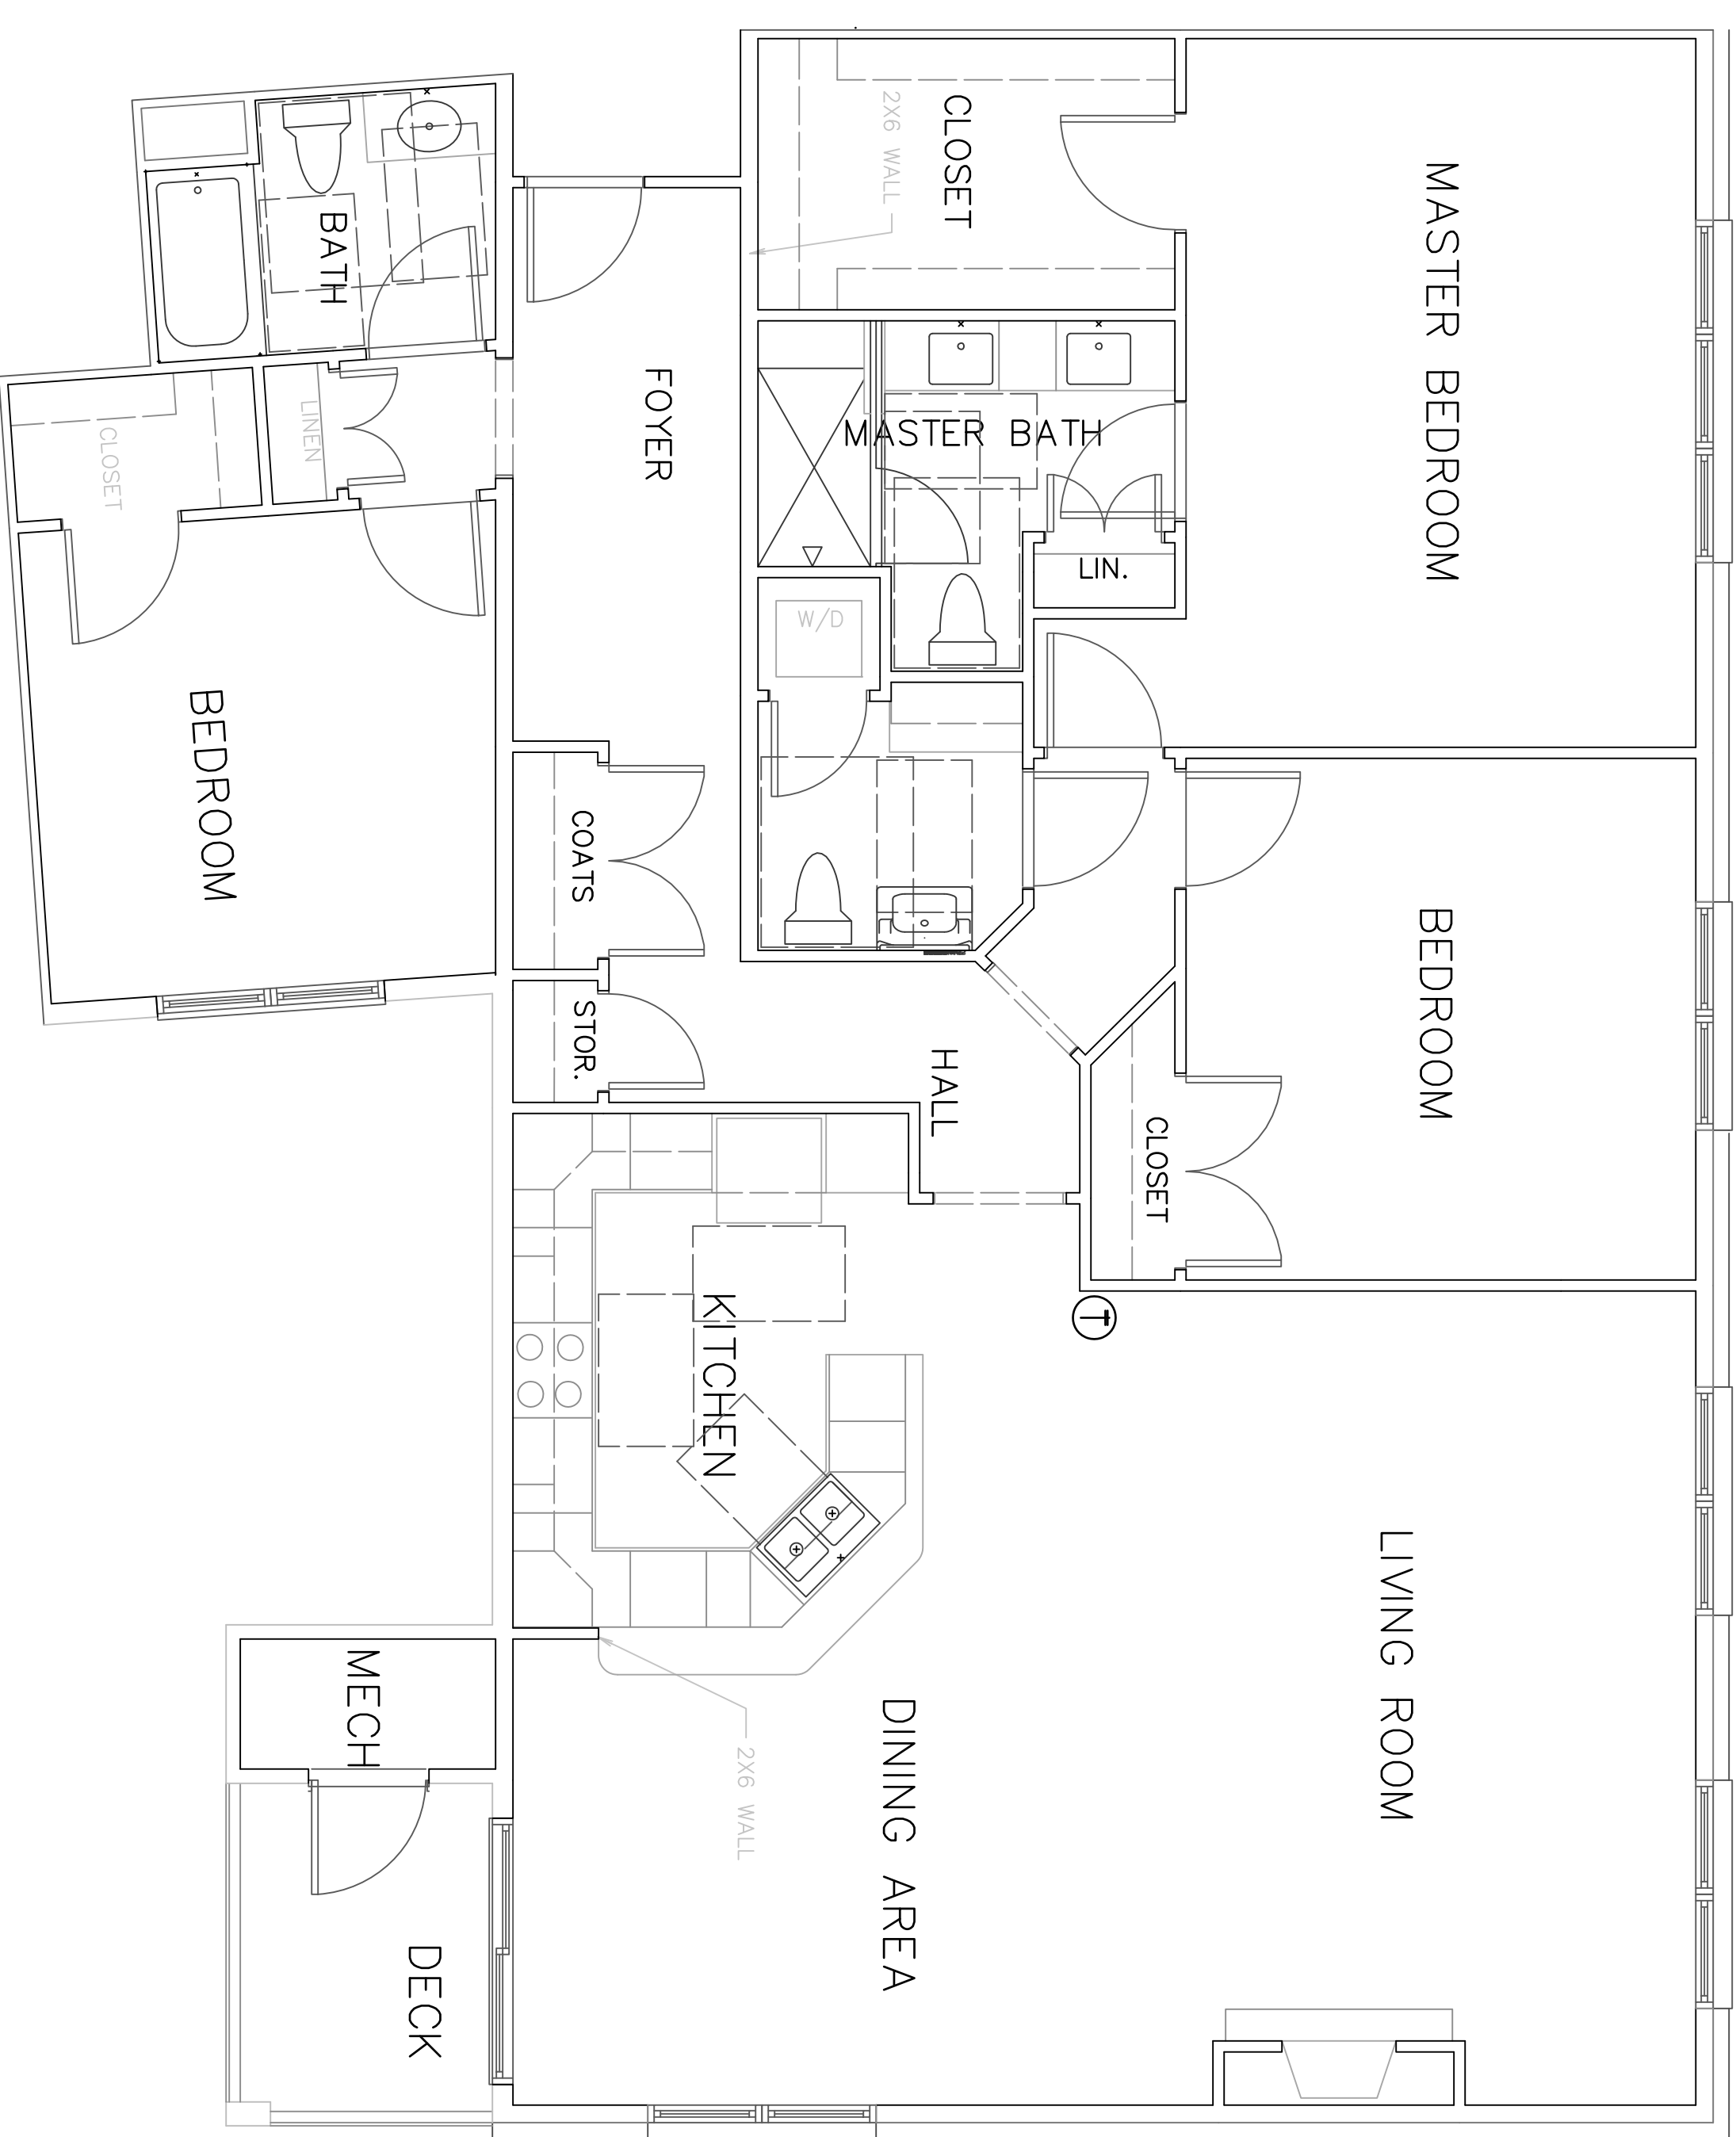

- General Notes**
1. Unit Type M is similar to Unit Type N. See Unit Type N for additional information.
 2. All ceiling diffusers shall have ceiling fire dampers (CFD) with volume control.
 3. Supplemental heating / cooling will be added.

UNIT TYPE M
SCALE: 1/4" = 1' 0"

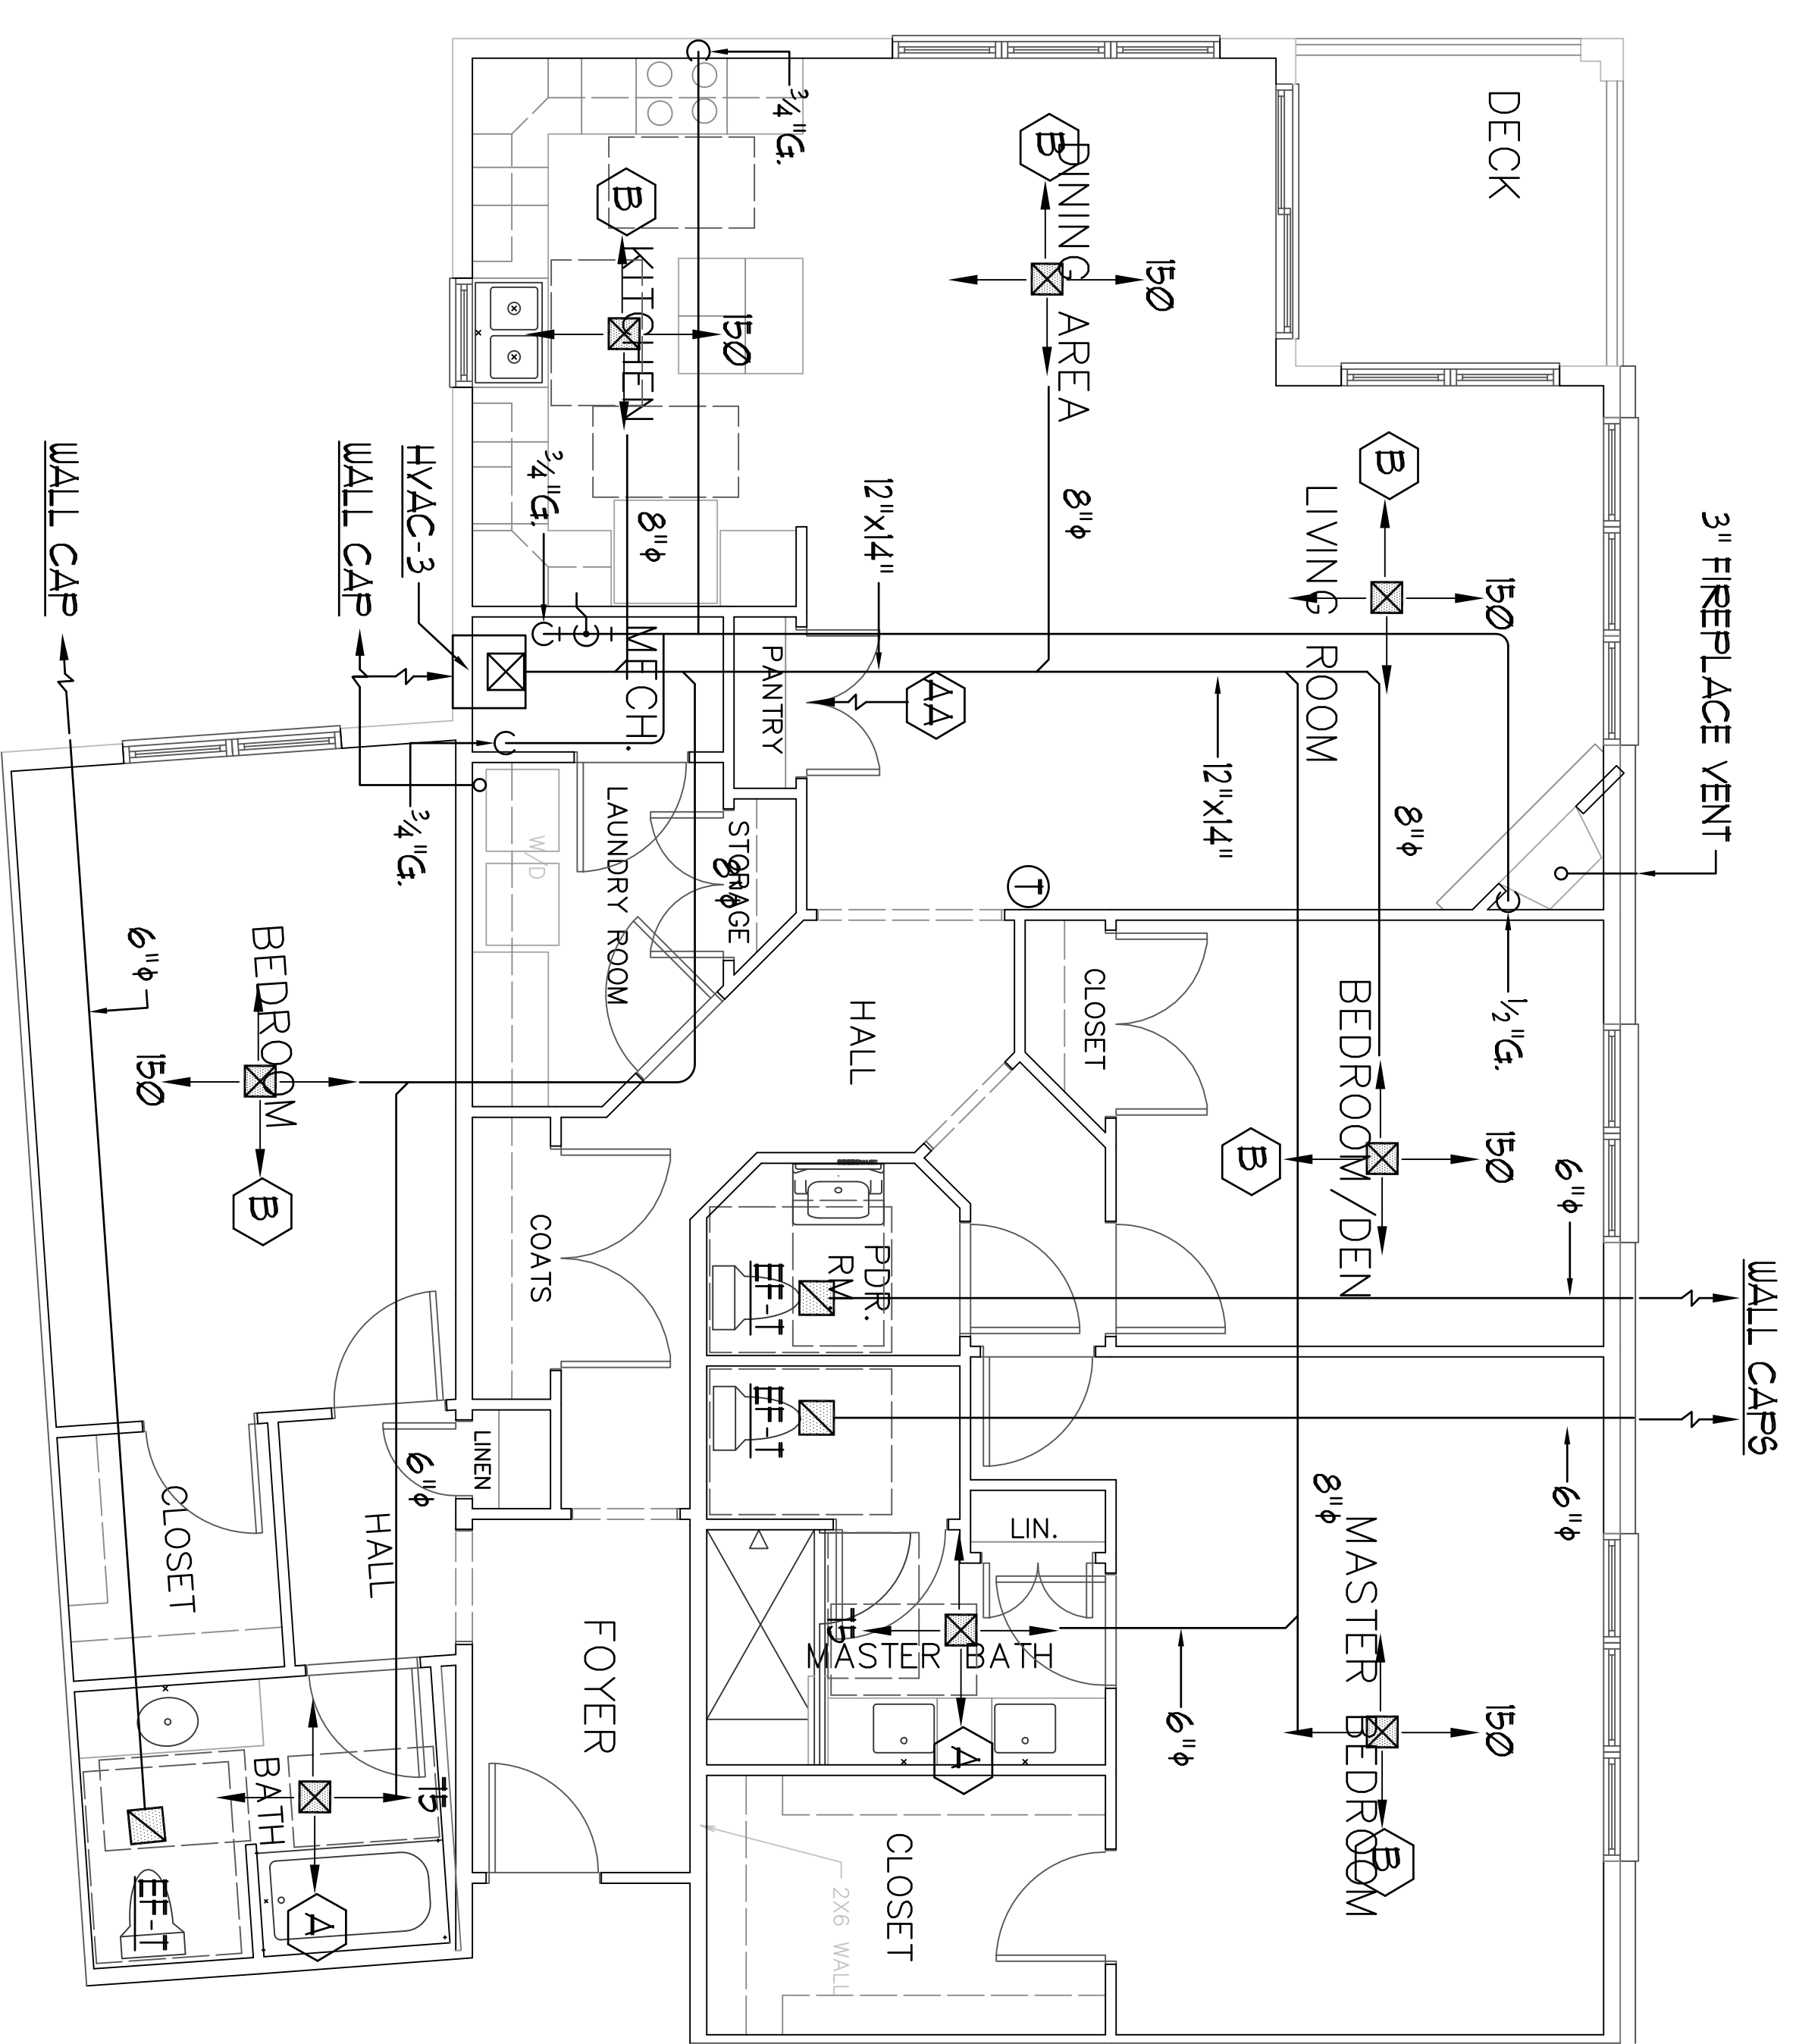

UNIT TYPE N
SCALE: 1/4" = 1' 0"