

Revisions  
11/29/2012--UNDERSLAB PIPING FOR  
CONSTRUCTION FOR PERMIT.  
12/14/2012-- FOR PERMIT.

Bay House  
Portland, ME




**BENNETT  
ENGINEERING**  
MECHANICAL • ELECTRICAL  
(207) 865-9475


Job No.: 3346  
Date: 12/4/12  
Scale: 1/8" = 1'-0" or A.N.  
Drawn by: SF Doel  
Checked by: SF Doel

Drawing Title:  
Unit Plans

**M.19**

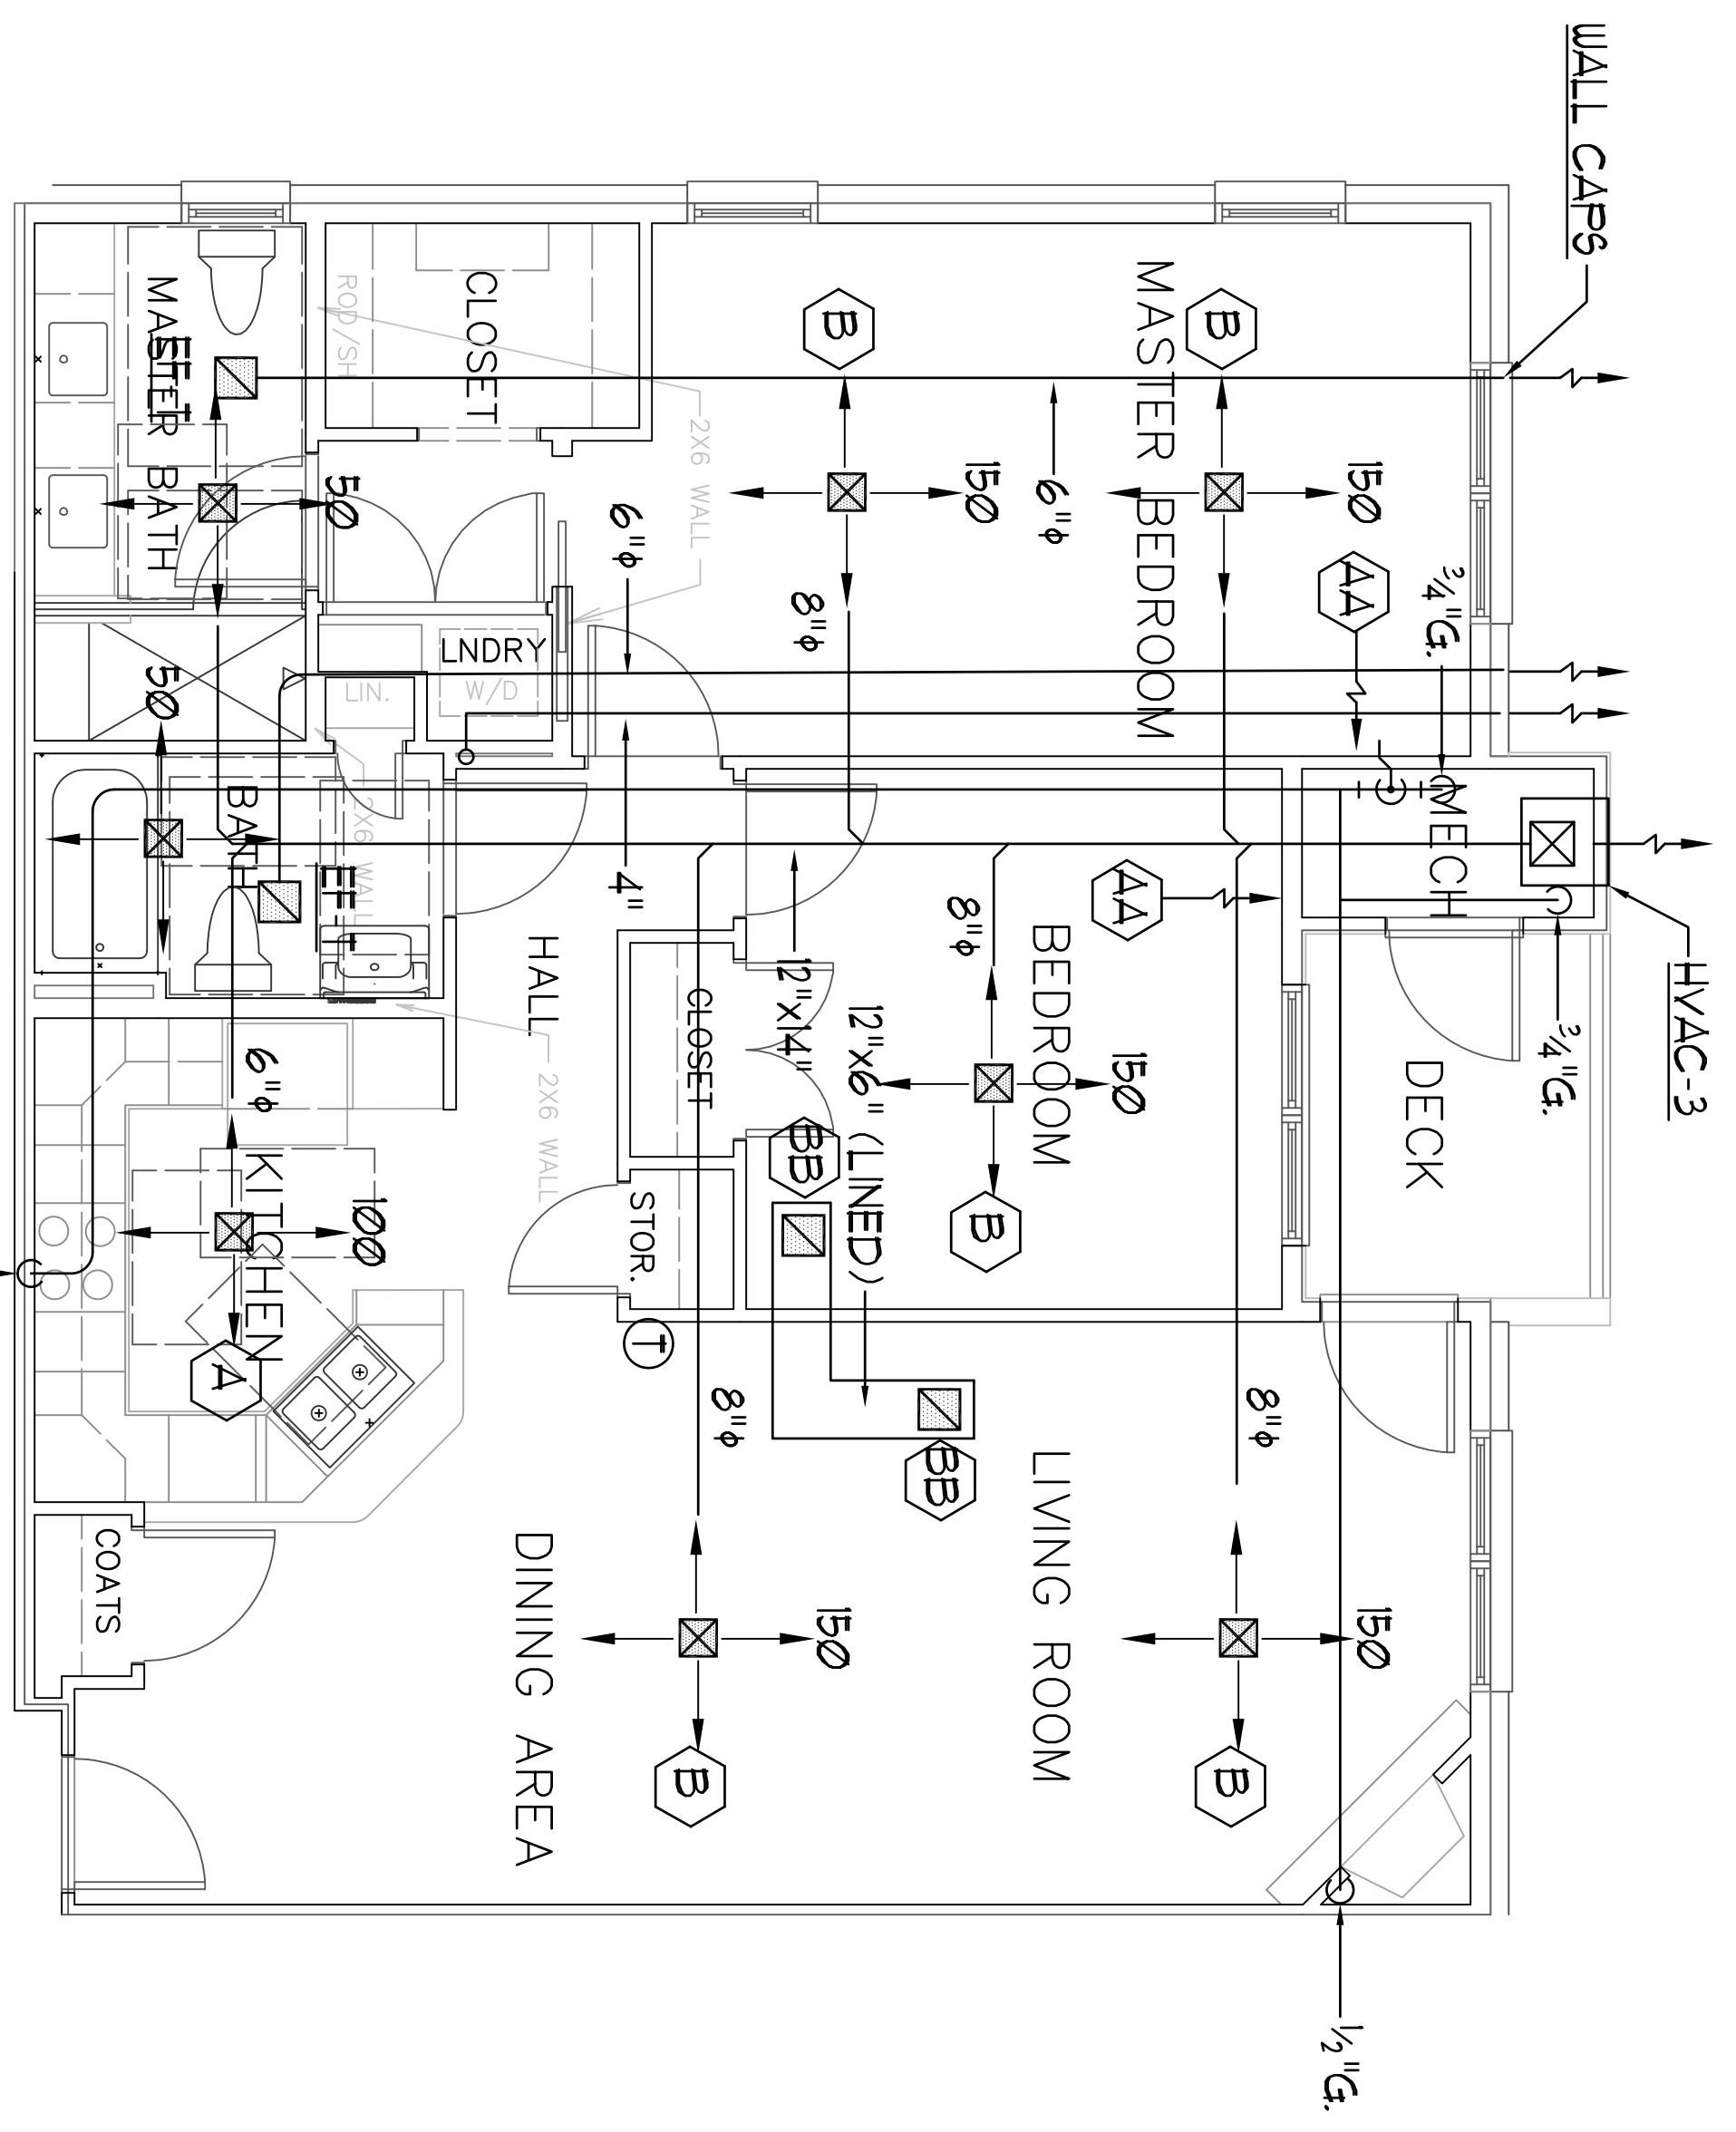

UNIT TYPE I  
SCALE: 1/4" = 1' 0"

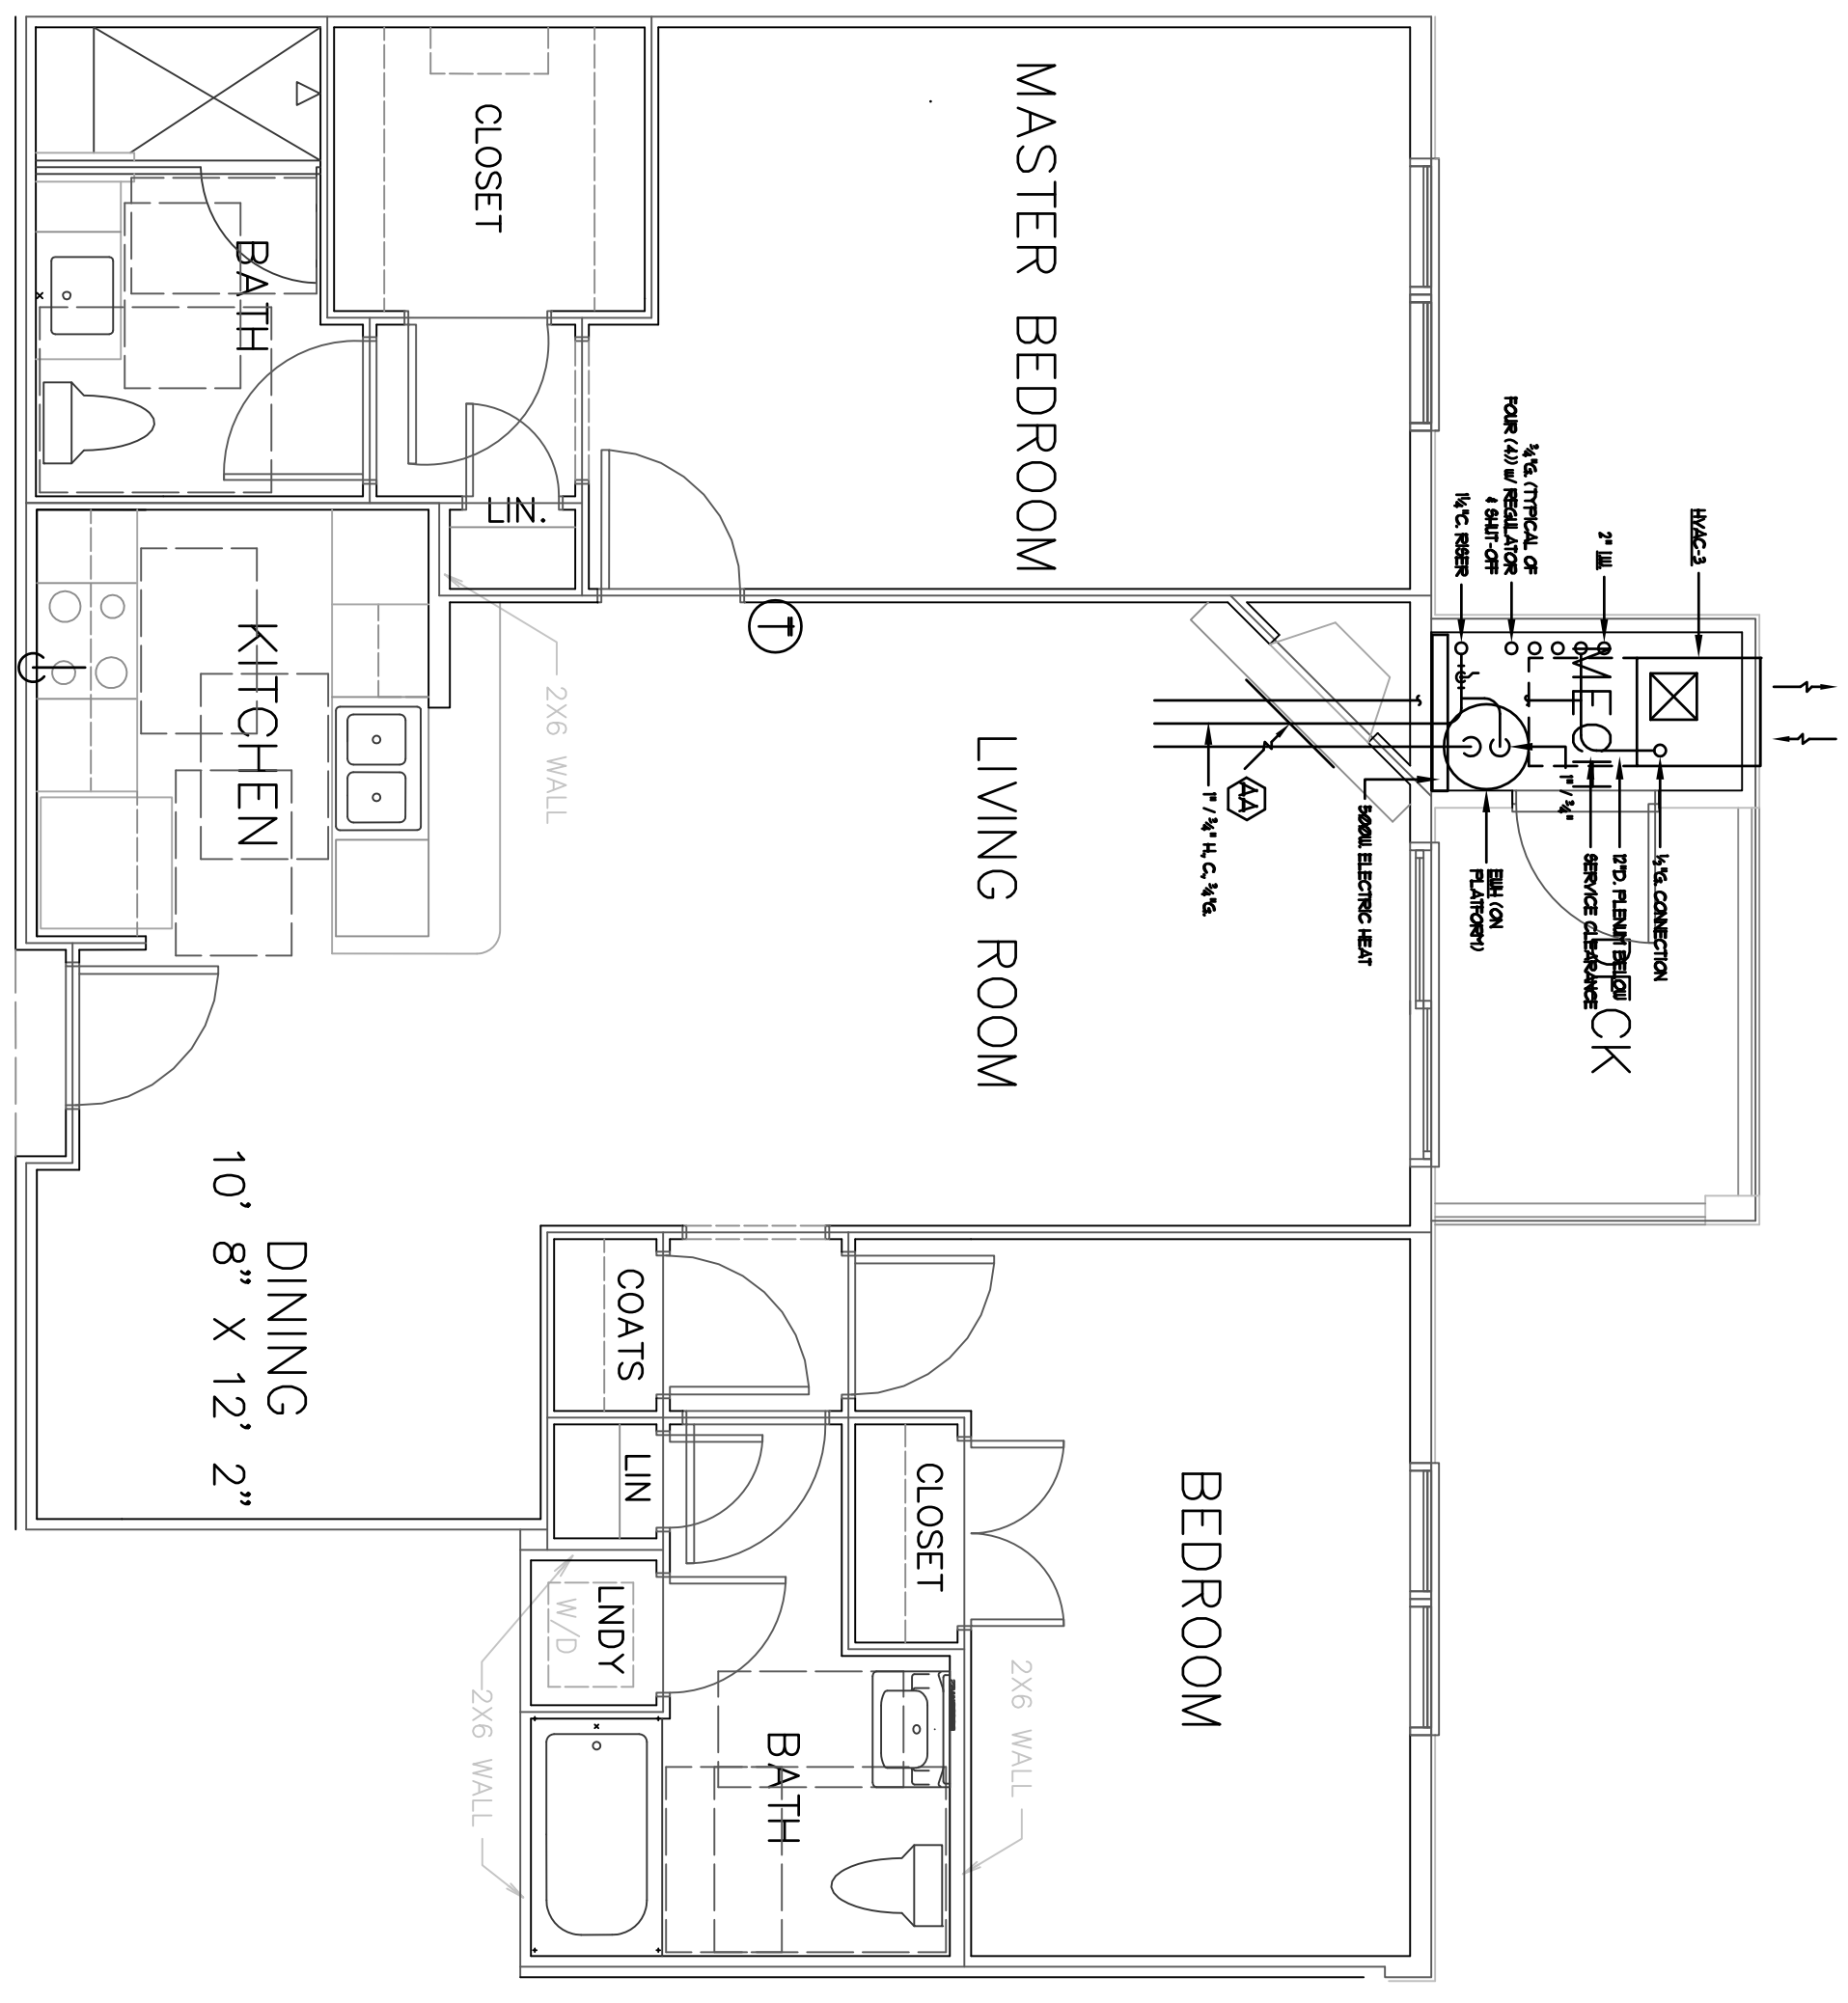

UNIT TYPE J  
SCALE: 1/4" = 1' 0"

- General Notes
1. Unit Type J is similar to Unit Type I. See Unit Type I for additional information.
  2. All ceiling diffusers shall have ceiling fire dampers (CFD) with volume control.