

Revisions
 11/29/2012-INDERS LAB PIPING FOR
 CONSTRUCTION FOR PERMIT
 12/14/2012- FOR PERMIT
 1/14/2013- PLUMBING REVISIONS.
 2/6/2013- 100% For Review
 and Comment

Bay House
 Portland, ME




**BENNETT
 ENGINEERING**
 MECHANICAL • ELECTRICAL
 (207) 865-9475

Job No.: 3346
 Date: 12/14/12
 Scale: 1/8" = 1'-0" or A.N.
 Drawn by: SF Dnd
 Checked by: SF Dnd

Drawing Title:
 Unit Plans


M.18

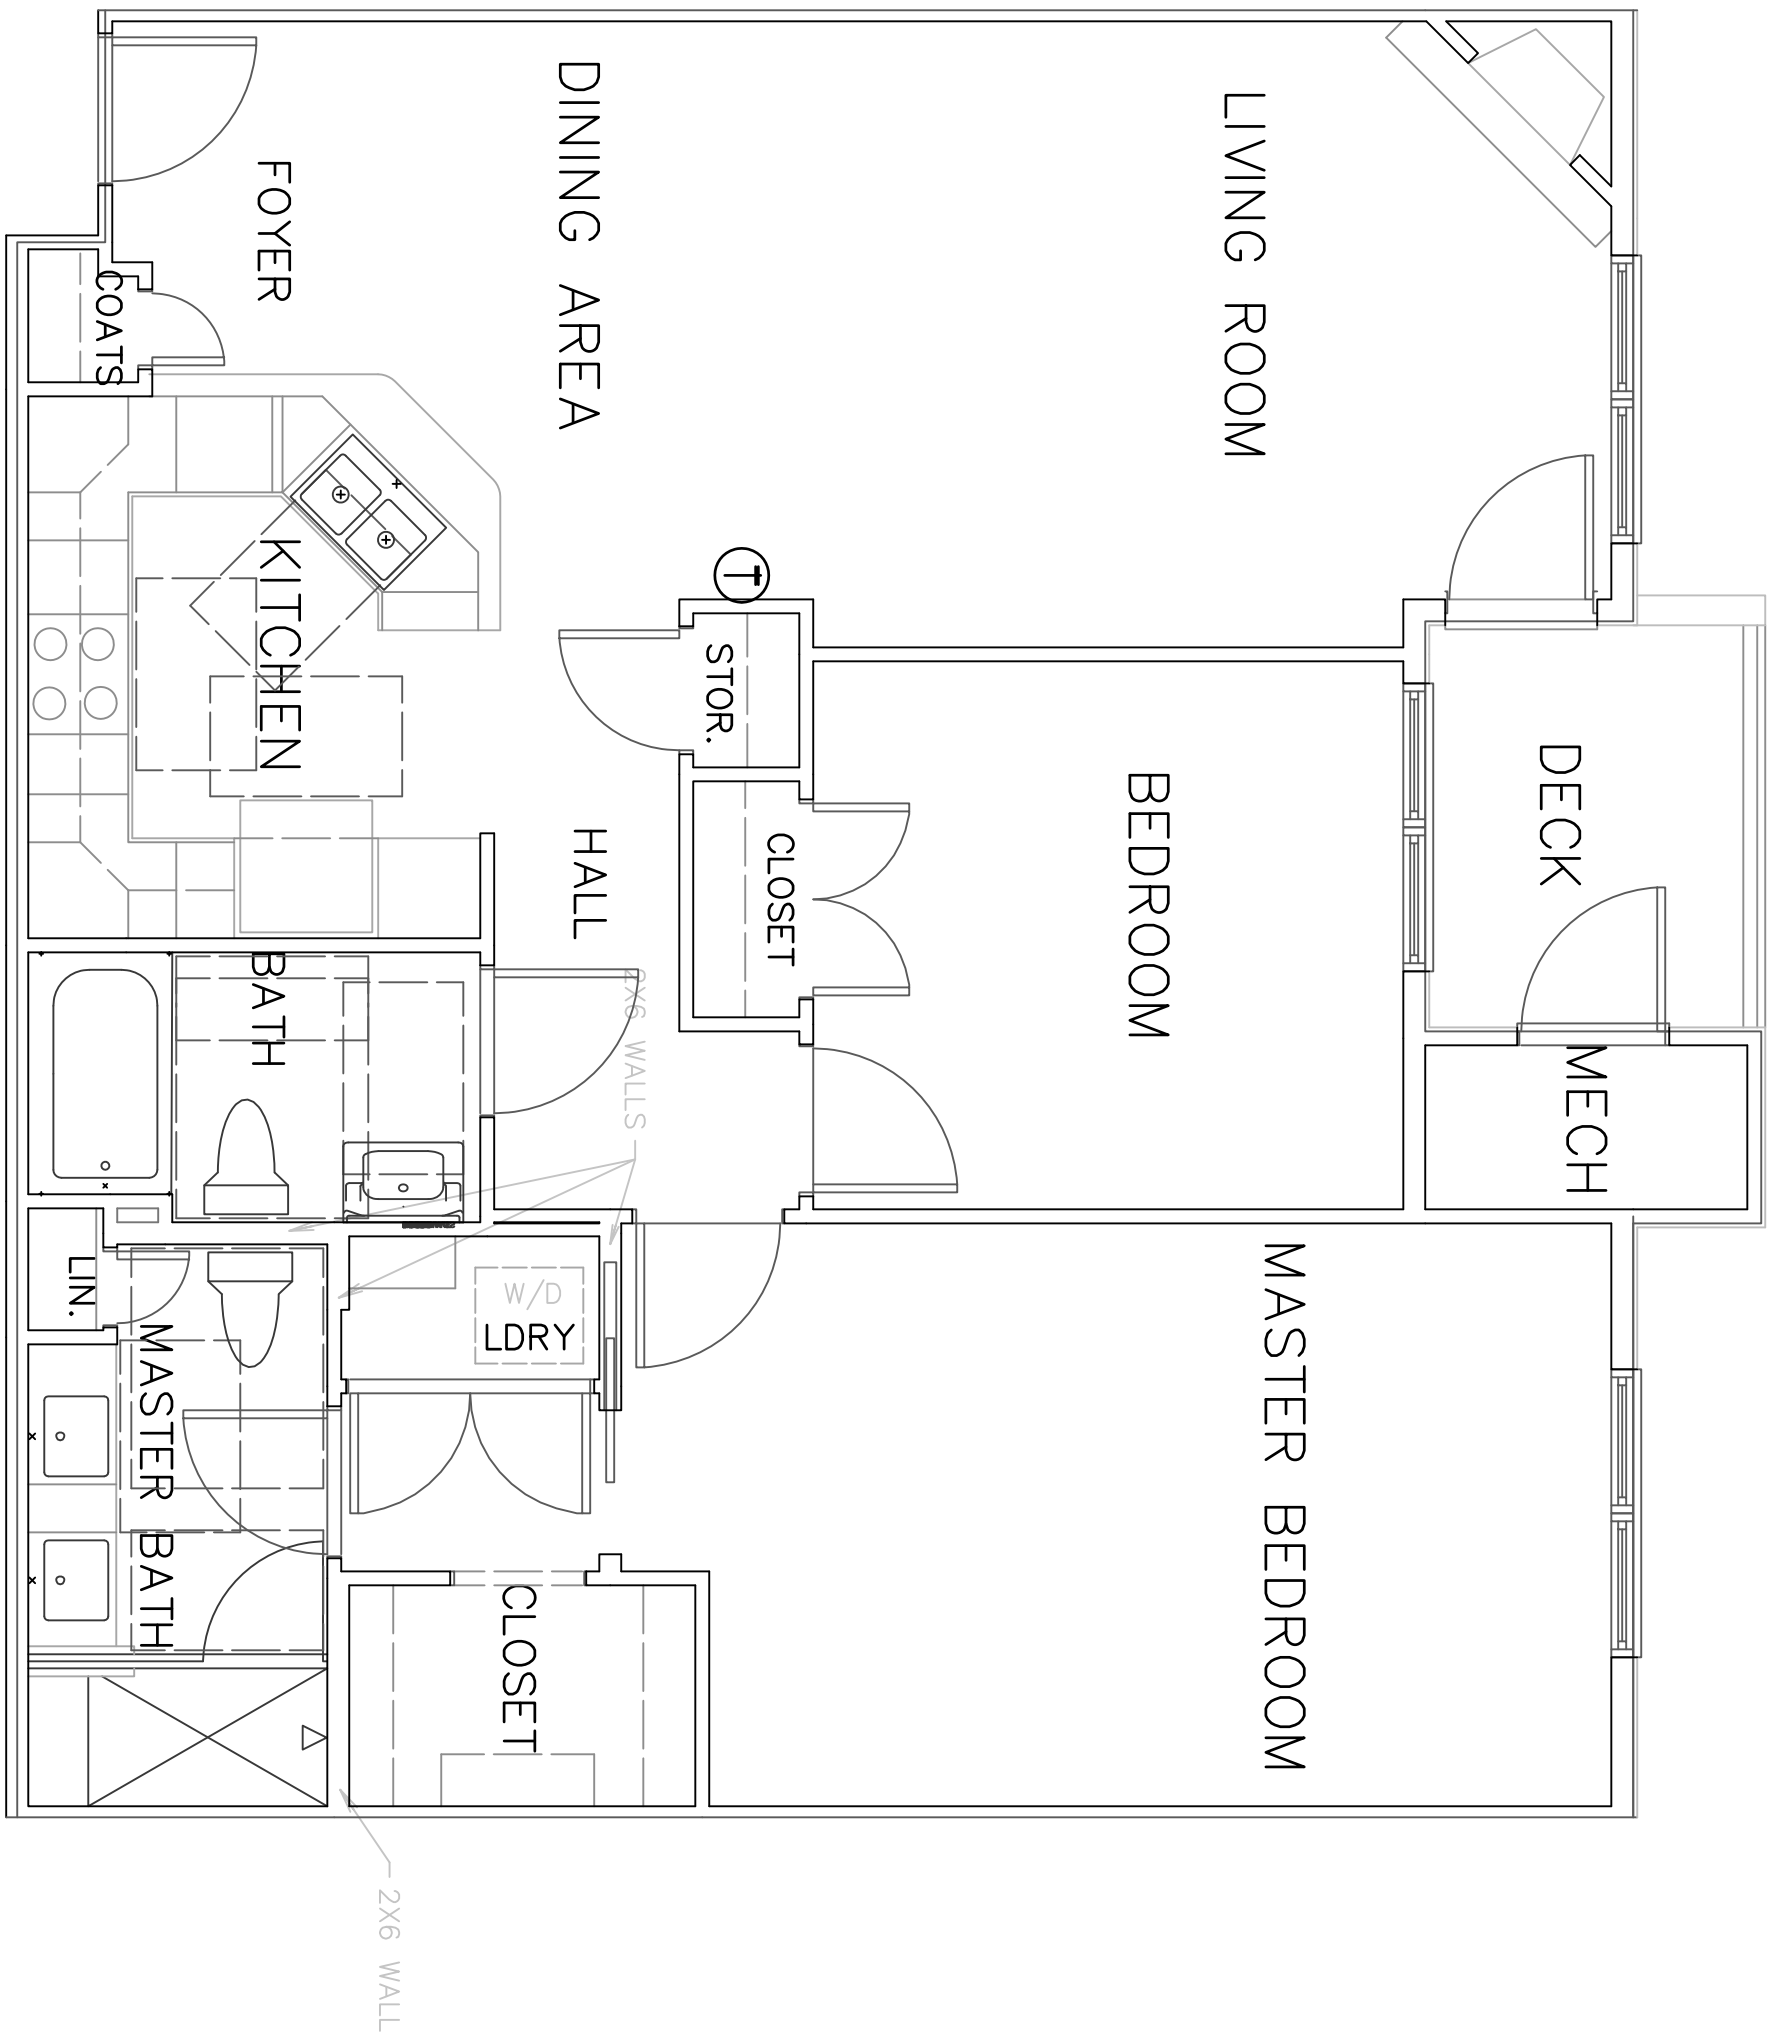

- General Notes**
1. Unit Type P is similar to Unit Type Q. See Unit Type Q for additional information.
 2. All ceiling diffusers shall have ceiling fire dampers (CFD) with volume control.

UNIT TYPE P

SCALE: 1/4" = 1' 0"

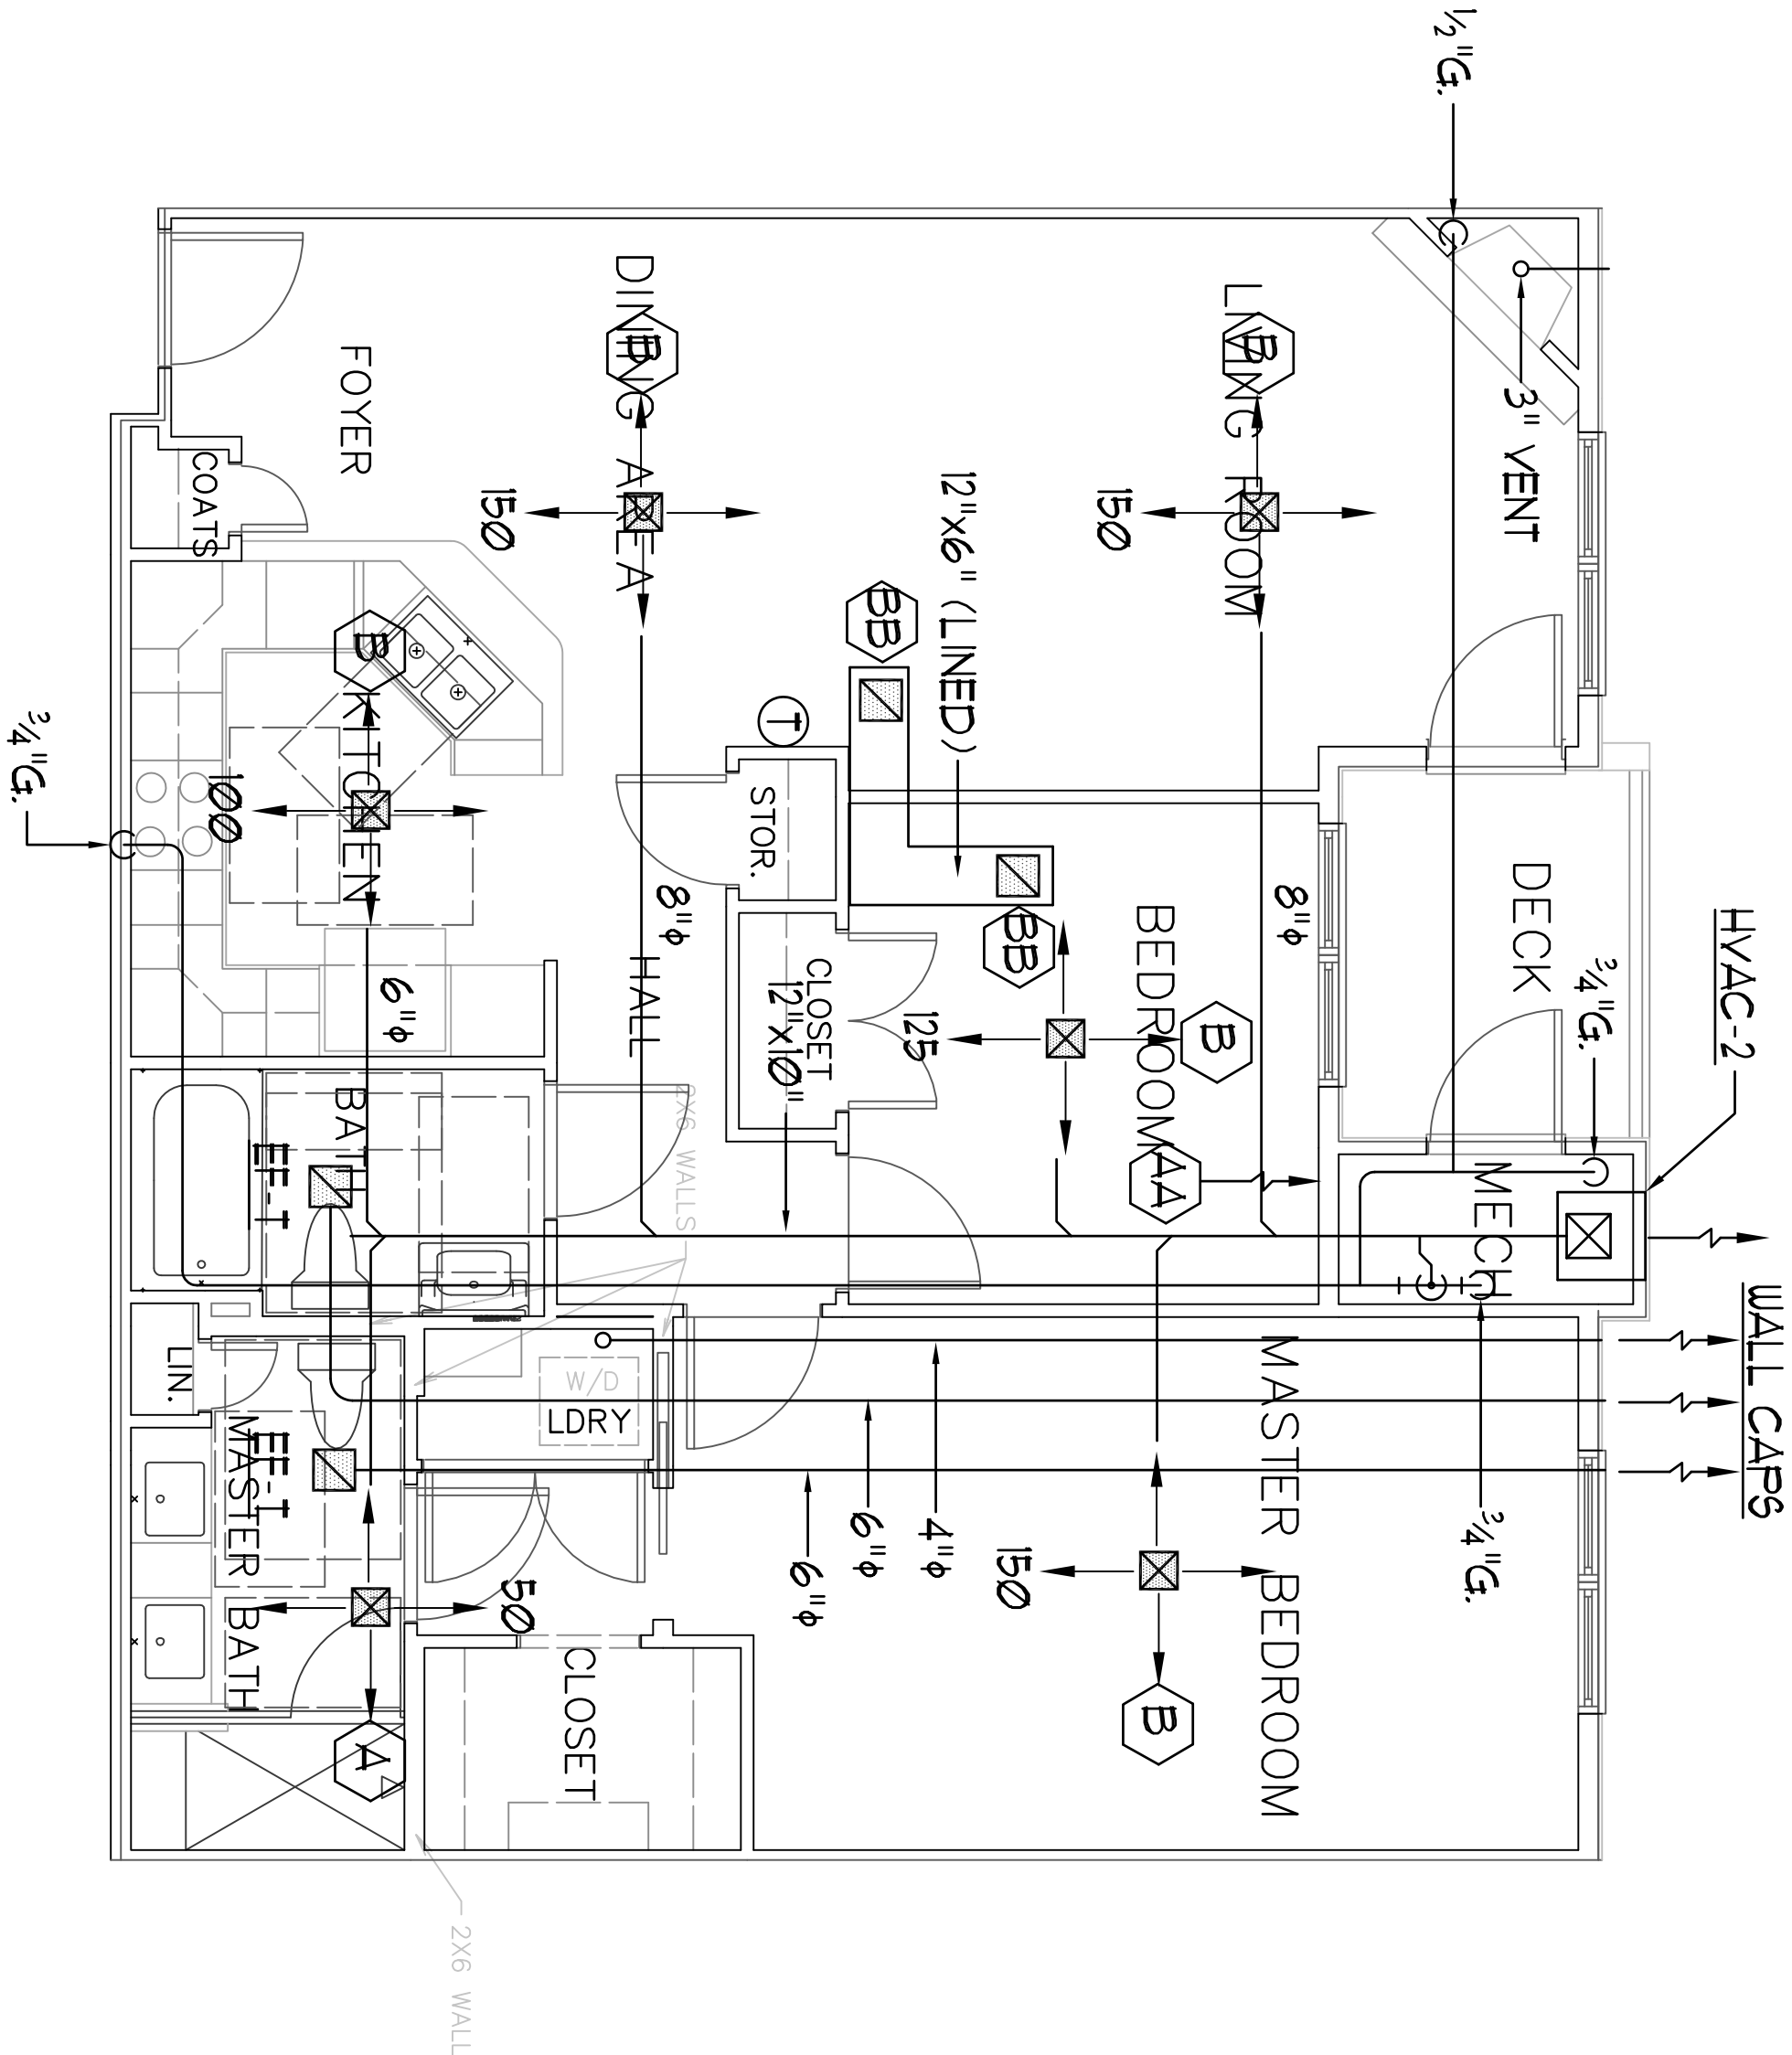

UNIT TYPE Q

SCALE: 1/4" = 1' 0"