

Revisions
 1/29/2012-INDERS LAB PIPING FOR
 CONSTRUCTION
 12/14/2012- FOR PERMIT
 1/14/2013- PLUMBING REVISIONS
 2/6/2013- 100% For Review
 and Comment

Bay House
 Portland, ME




**BENNETT
 ENGINEERING**
 MECHANICAL • ELECTRICAL
 (207) 865-9475

Job No.: 3346
 Date: 12/14/12
 Scale: 1/8" = 1'-0" or A.N.
 Drawn by: SF Deel
 Checked by: SF Deel

Drawing Title:
 Unit Plans


M.19

**Atlantic Comfort
 Systems, Inc.**
 Mechanical Contractor • 807-884-4390
 882 Hill Street, Bridgton, ME 04005
 www.atlanticcomfort.com

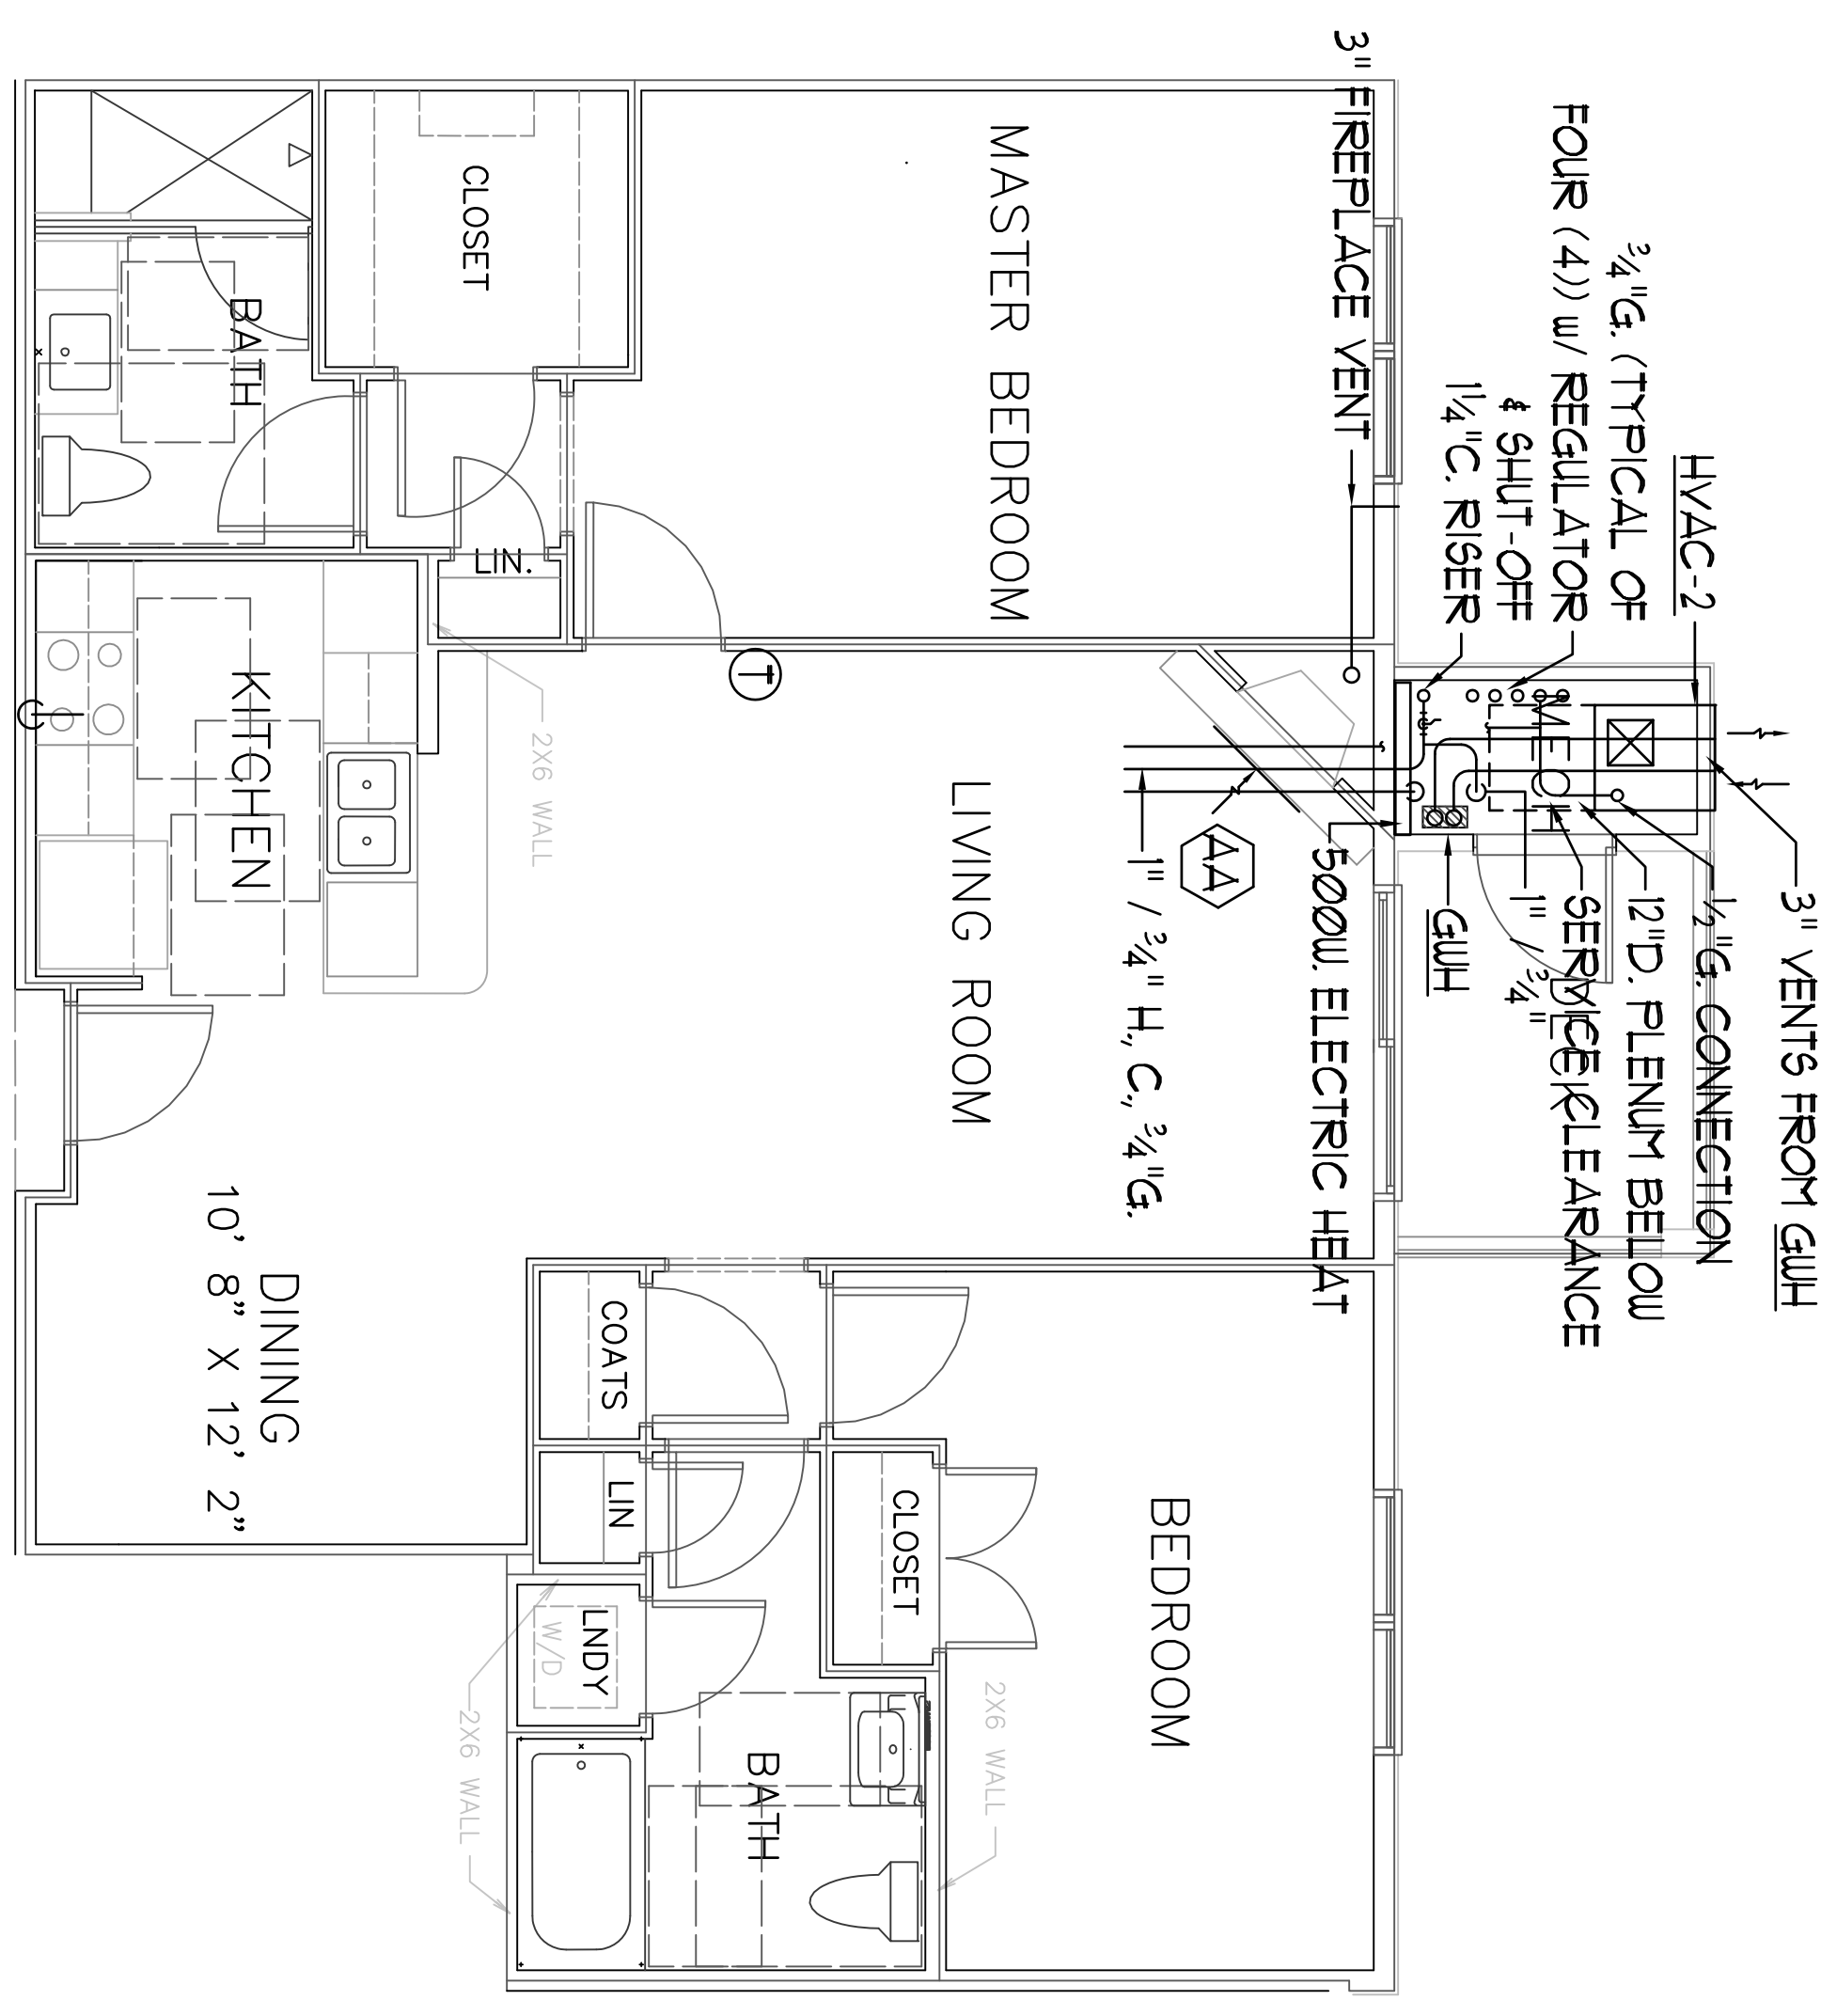

UNIT TYPE J
 SCALE: 1/4" = 1' 0"

- General Notes
1. Unit Type J is similar to Unit Type I. See Unit Type I for additional information.
 2. All ceiling diffusers shall have ceiling fire dampers (CFD) with volume control.

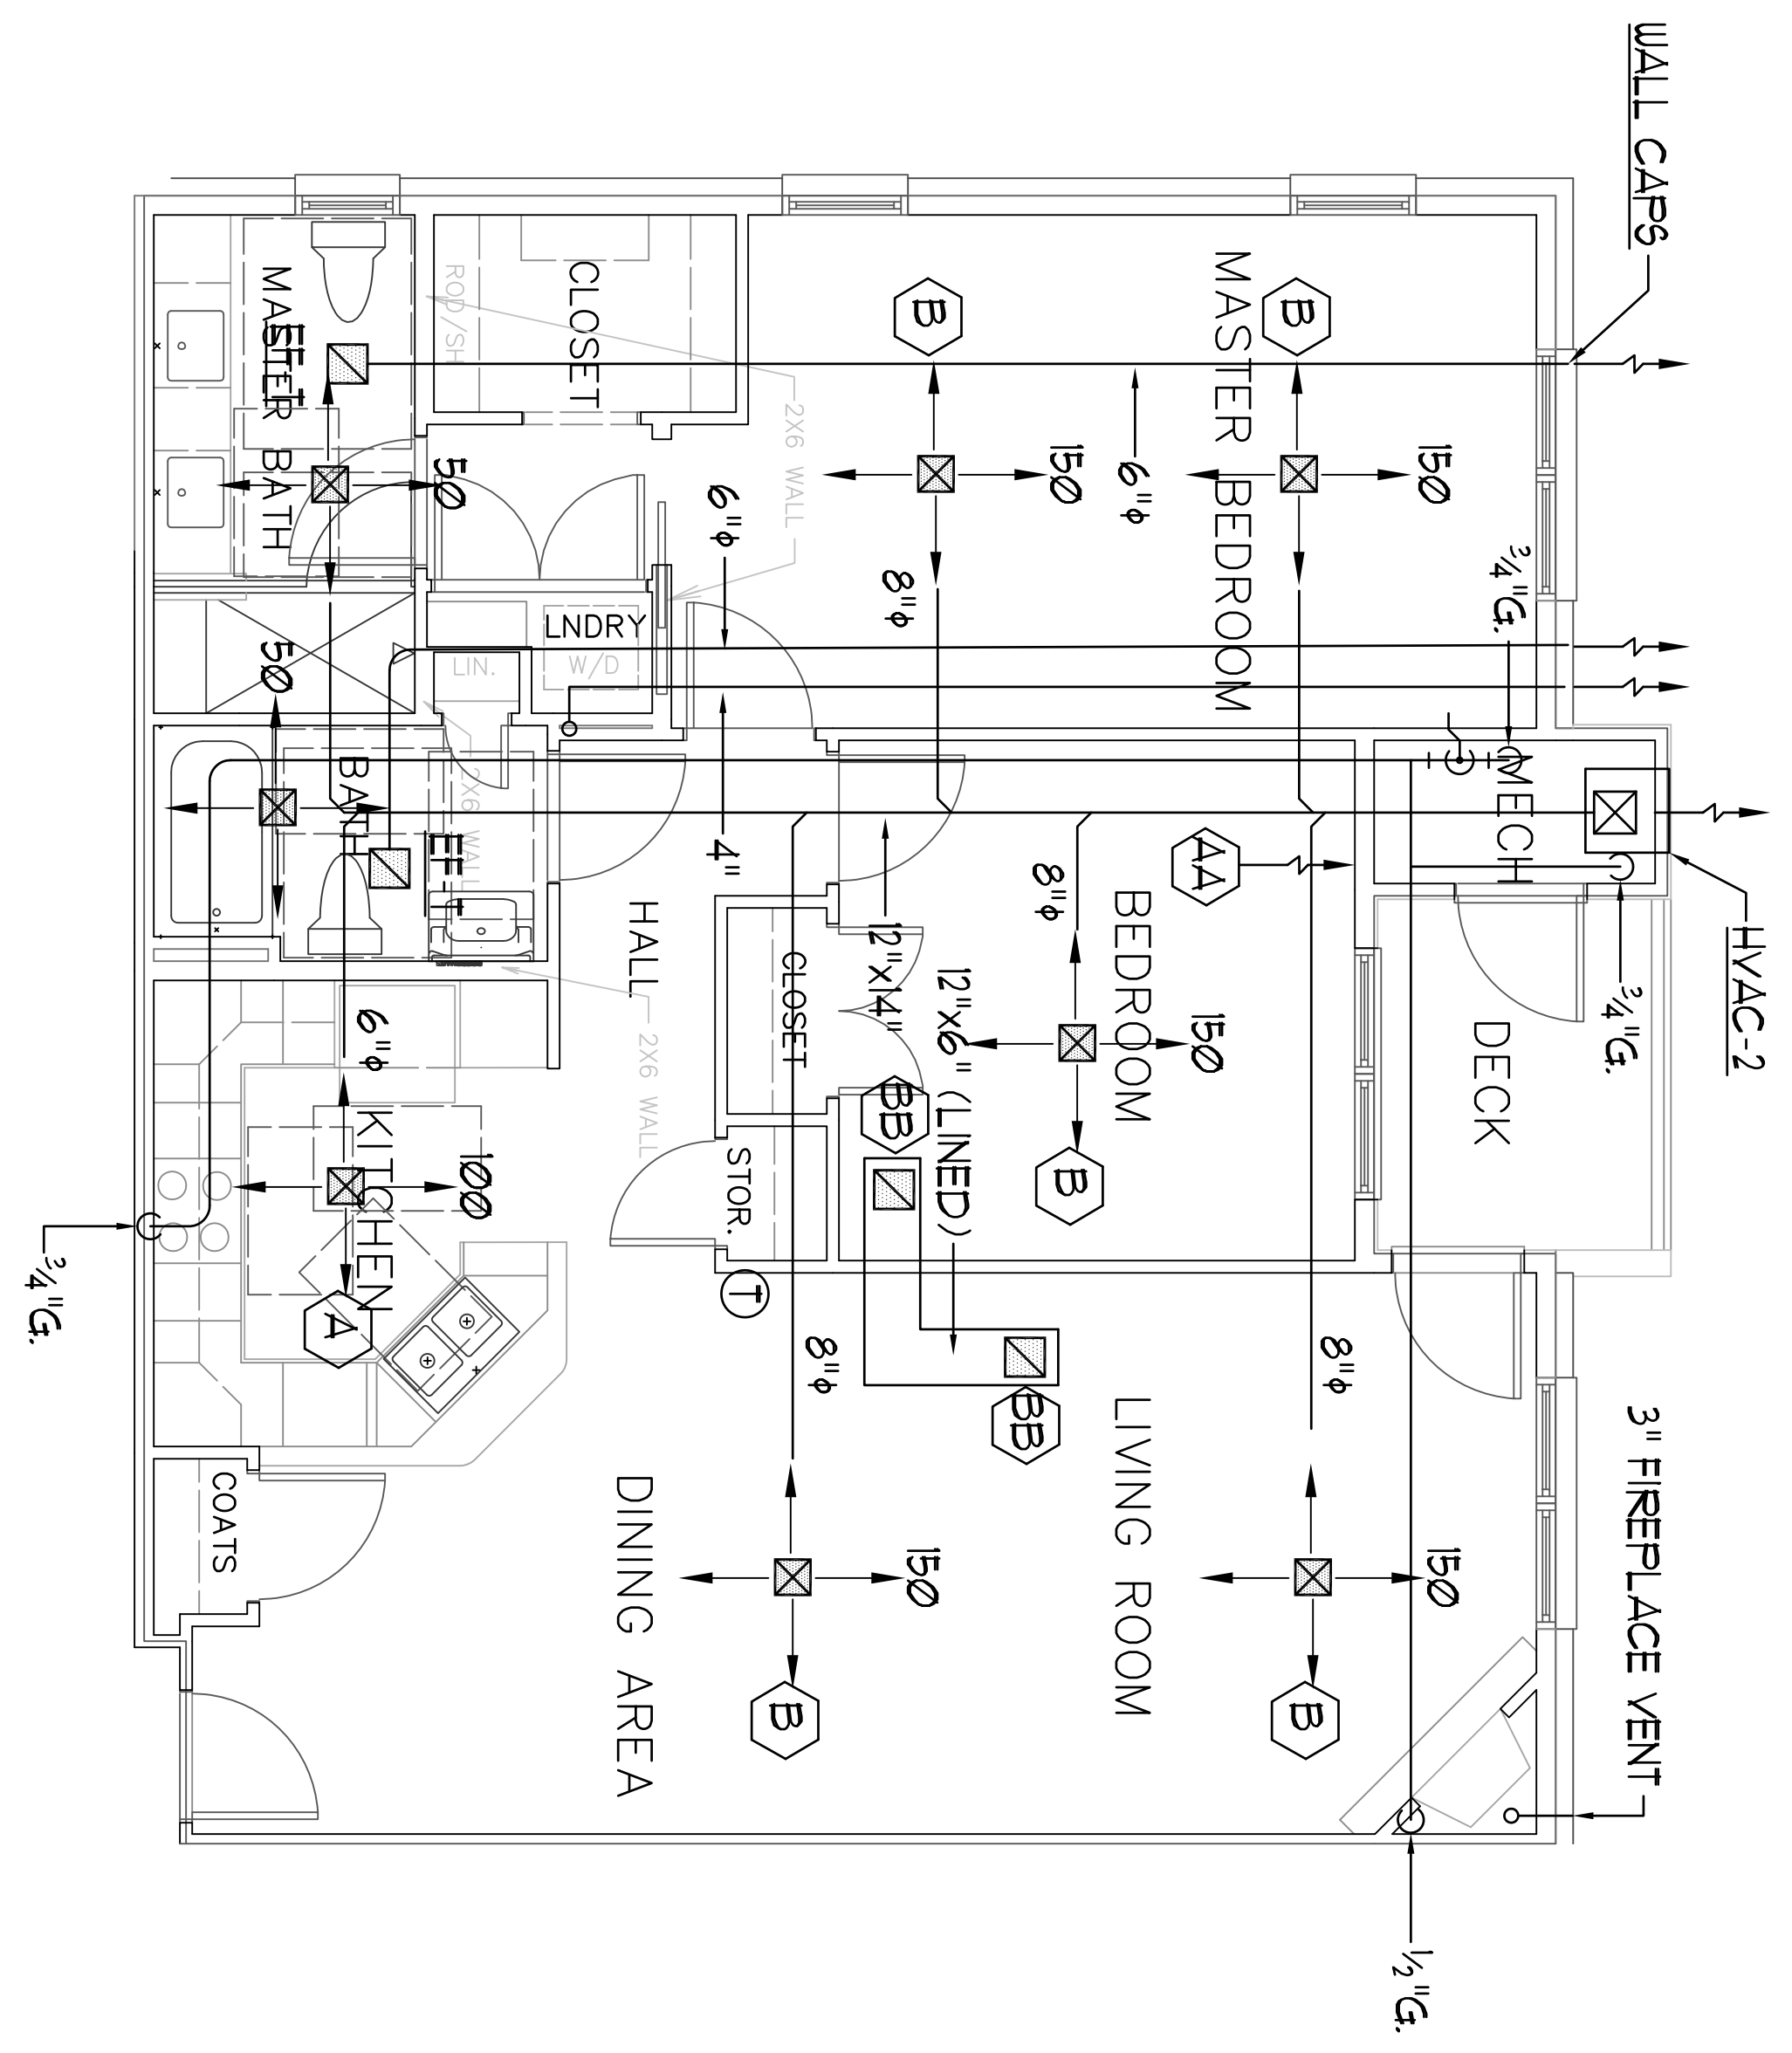

UNIT TYPE I
 SCALE: 1/4" = 1' 0"