


| SCHEDULE OF SHEAR WALL CONSTRUCTION | |
|---|--|
| DESIGNATION | SHEATHING AND FASTENING |
| GB6/12-25 (SEE ARCHITECTURAL DRAWINGS) | 2" LAMINATED GYPSUM ASSEMBLY ONE SIDE, NO.6 SCREWS AT 6/12, BLOCKED (2) LAYERS 5/8" GYP. WALLBOARD OTHER SIDE, SCREWS AT 6/12, BLOCKED |
| FB4/6-25 | FIBERBOARD WALL SHEATHING ON TWO SIDES, 8D NAILS AT 4/6, BLOCKED |
| FB3/6-25 | FIBERBOARD WALL SHEATHING ON TWO SIDES, 8D NAILS AT 3/6, BLOCKED |
| PA/12-15 | WOOD SHEATHING ONE SIDE WITH 10D NAILS AT 4/12, BLOCKED |
| P6/12-25 | WOOD SHEATHING TWO SIDES WITH 10D NAILS AT 6/12, BLOCKED |
| P6/12-15 (TYP. EXT. WALL, U.N.O.) | WOOD SHEATHING ONE SIDE WITH 10D NAILS AT 6/12, BLOCKED |

NOTE:
 - FASTENER PATTERN SHALL BE REPRESENTED AS "SPACING OF FASTENERS AT THE PERIMETER OF THE PANEL"/"SPACING OF FASTENERS IN THE FIELD OF THE PANEL"
 - GYPSUM WALLBOARD SHALL BE FASTENED IN PATTERN WITH NO. 6 SCREWS (TYPE S OR W) WITH LENGTH SUFFICIENT TO PROVIDE MINIMUM 1" EMBEDMENT INTO WOOD FRAMING AT 1/2", 5/8", AND 1" THICKNESSES
 - "BLOCKED" SHALL INDICATE THAT ALL EDGES OF THE APPLIED SHEATHING MUST BE BLOCKED AND FASTENED PER THE FASTENER SPACING INDICATED
 - WOOD SHEATHING SHALL BE 15/32" A.P.A. RATED EXPOSURE 1 PLYWOOD OR OSB SHEATHING. TYPICAL FASTENING OF WOOD SHEATHING SHALL BE MINIMUM 10D NAILS AT FASTENED 6" ON CENTER AT ALL EDGES (BLOCKED) AND 12" ON CENTER IN THE FIELD OF THE PANEL TO ALL SUPPORTS, UNLESS NOTED OTHERWISE.
 - INTERIOR WALL SHEATHING SHALL BE 1/2" THICK STRUCTURAL FIBERBOARD WALL SHEATHING SATISFYING ASTM C 208, TYPE IV, GRADE 2, STRUCTURAL.
 - SEE DETAIL 12/S1.4 FOR FASTENING OF BOTTOM PLATES OF SHEAR WALL TO SECOND FLOOR SLAB
 - SEE SHEETS S2.3 AND S5.2 FOR SHEAR WALL FASTENING DETAILS AT WOOD FRAMED FLOOR LOCATIONS AND ROOF LOCATIONS, RESPECTIVELY.

NOTE: FLOOR TRUSSES AND WALL STUDS MUST ALIGN FOR FULL HEIGHT OF BUILDING - DO NOT OFFSET FLOOR TRUSSES OR STUDS FROM FRAMING ABOVE OR BELOW

- NOTES:
- G.C. SHALL BE RESPONSIBLE FOR VERIFYING ALL DIMENSIONS. G.C. MAY CONTACT ARCHITECT IF DIMENSIONAL CLARIFICATION IS NEEDED DUE TO SCALE OF DRAWINGS.
 - TOP OF THIRD FLOOR SHEATHING IS AT 112'-1"
 - SEE SHEETS SN.0 AND SN.1 FOR ADDITIONAL STRUCTURAL NOTES.
 - COORDINATE FLOOR OPENINGS WITH PLUMBING DRAWINGS. G.C. TO ENSURE OPENINGS ARE LOCATED IN SUCH A MANNER AS NOT TO INTERFERE WITH THE BEARING WALLS OR FLOOR TRUSSES.
 - VERIFY STAIR OPENING DIMENSIONS WITH ARCHITECTURAL DRAWINGS (TYP.).
 - TYPICAL WOOD POSTS SHOWN IN FRAMED WALLS SHALL BE TRIPLE STUD POSTS. PROVIDE (3) 2X6 POST IN 2X6 WALLS AND (3) 2X4 POST IN 2X4 WALLS.
 - FASTEN STAIR STRINGERS TO STAIR WALLS WITH (2) 1/4" DIAMETER LAG SCREWS INTO STUDS AT 48" O.C. (EVERY OTHER STUD). PROVIDE 2" PENETRATION INTO WALL STUDS.
 - FLOOR TRUSSES AND WALL STUDS ALIGN THROUGHOUT THIS PROJECT. WHERE FLOOR TRUSS SPACING IS ALTERED FOR PLUMBING, PROVIDE ADDITIONAL WALL STUDS BENEATH EACH TRUSS.

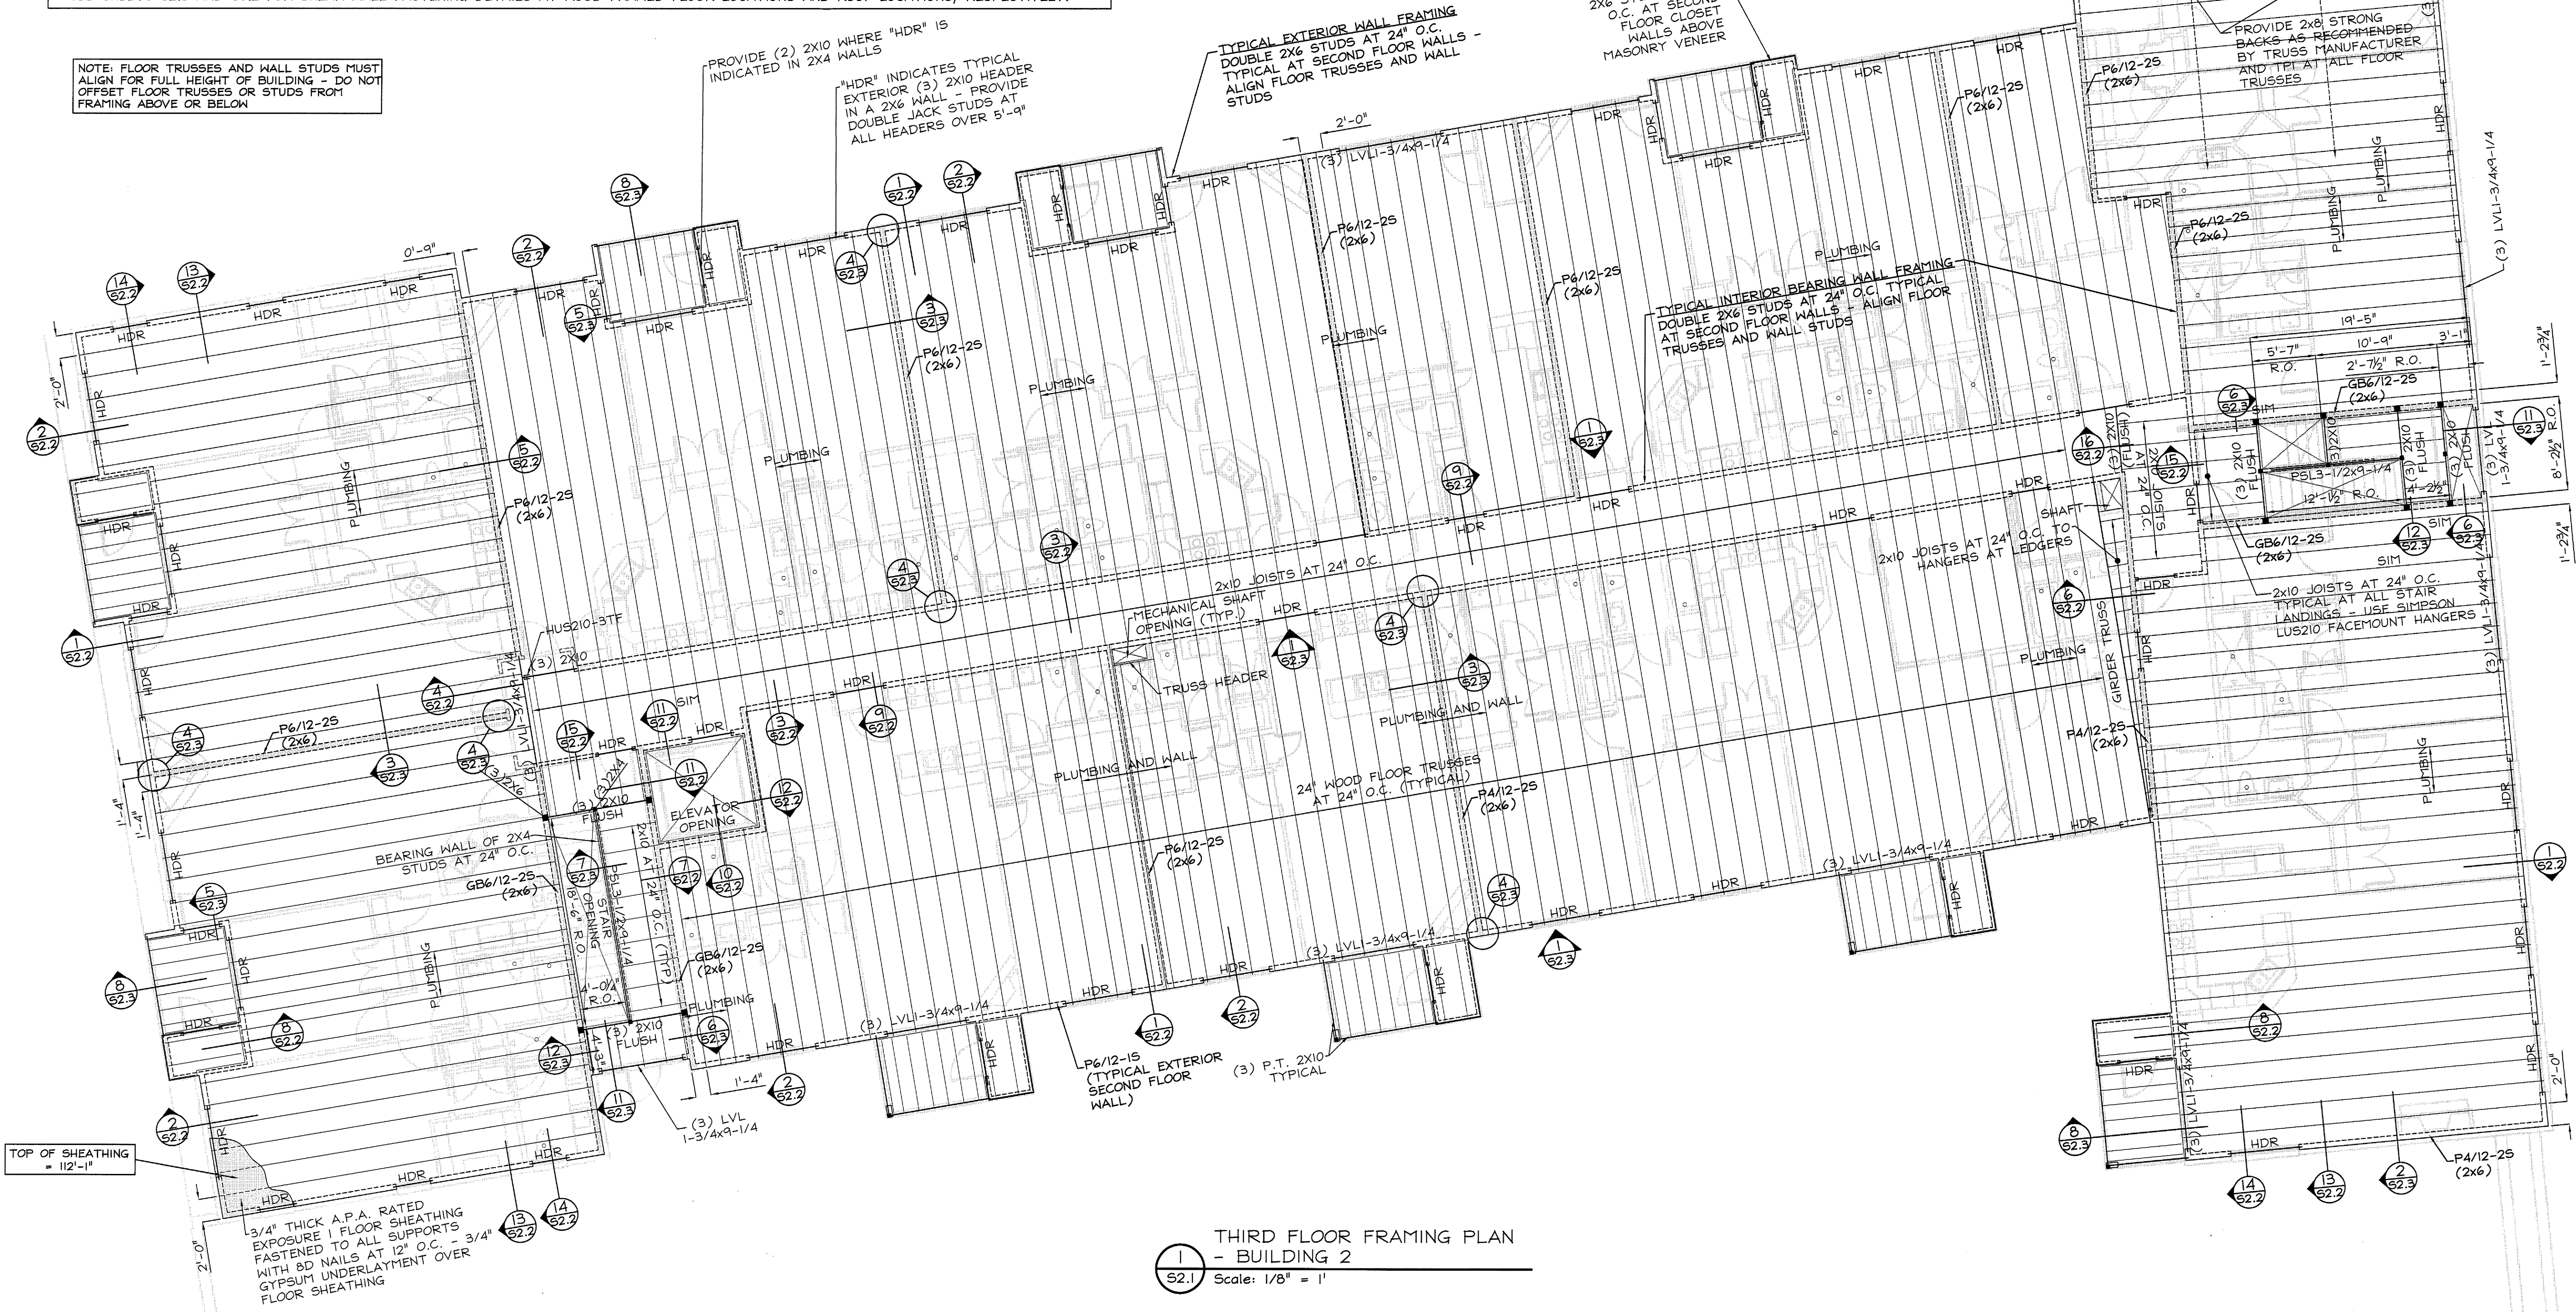

1 THIRD FLOOR FRAMING PLAN - BUILDING 2
 S2.1 Scale: 1/8" = 1'



DAVID M. WHITE, ARCHITECT
 403 Tbetts Hill Road
 P. O. Box 447
 Goffstown, New Hampshire 03045
 (603) 497-3405

THE VILLAGE AT OCEAN GATE, LLC
 GFI Partners
 93 Pearl Street
 Boston, MA 02110

THE BAY HOUSE
 Middle Street
 Portland, Maine

THIRD FLOOR FRAMING
 Phase 1 / Building 2
 Scale: 1/8" = 1'
 Commission No: 06-008
 Date: July 15, 2008

REVISIONS:

DRG. NO.
 S2.1
 JEN: 070120

