



JOB NO 1925596 MODEL NUMBER SC-EMS1111 INSTALL 12/16/2013 ECP #2-1

DESCRIPTION OF OPERATION:
Energy Management System w/ 1 Exhaust Fan, 1 Supply Fan, Exhaust on in Fire, Lights out in Fire, Fans modulate based on duct temperature. INVERTER DUTY THREE PHASE MOTOR REQUIRED! Room temperature sensor shipped loose for field installation.

BREAKER PANEL TO HOOD CONTROL PANEL
Responsibility: Electrician

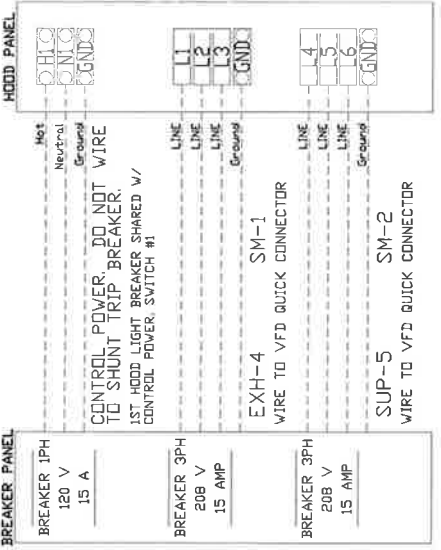

HOOD CONTROL PANEL TO ACCESSORY ITEMS
Responsibility: Electrician

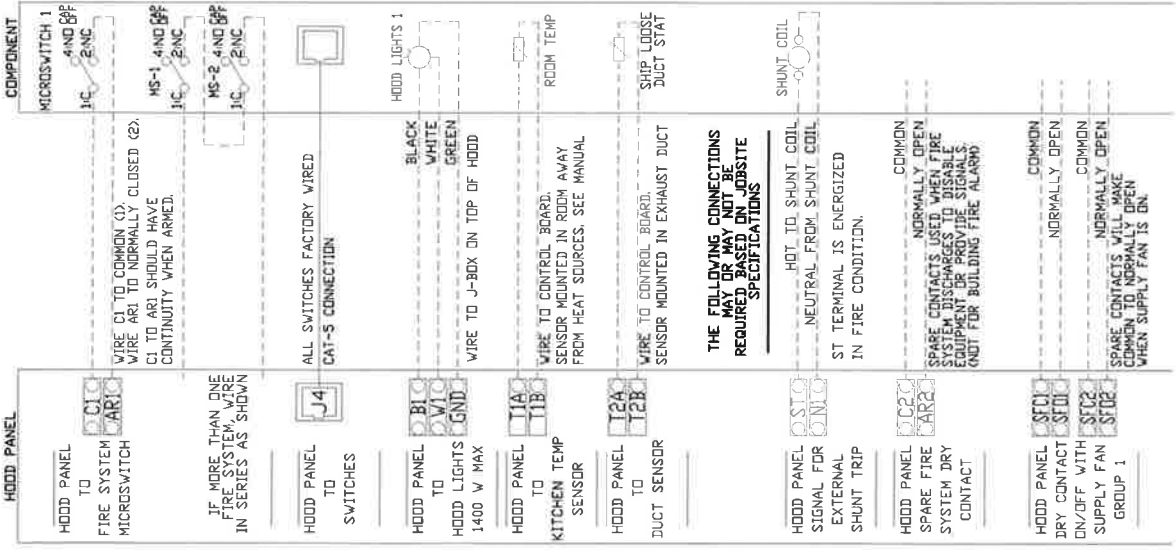

HOOD CONTROL PANEL TO FANS / MUA
Responsibility: Electrician

