



- FAN #2 A2-G12 - SUPPLY FAN
 1. UNTEMPERED SUPPLY UNIT WITH 12" BLOWER IN SIZE #2 HOUSING
 2. INTAKE HOOD WITH EZ FILTERS
 3. SIDE DISCHARGE - AIR FLOW RIGHT -> LEFT
 4. GRAVITY BACK DRAFT DAMPER 22" X 24" , STANDARD GALVANIZED CONSTRUCTION, 1 1/4" REAR FLANGE, FOR SIZE 2 UNTEMPERED FAN HOUSING (5182)
 5. WALL MOUNT OPTION FOR SIZE 2 UN-TEMPERED MAKE-UP AIR FAN. 40" LONG ANGLE IRON FRAME.
 6. FULL CRATING FOR UNTEMPERED FANS FOR SHIPPING.

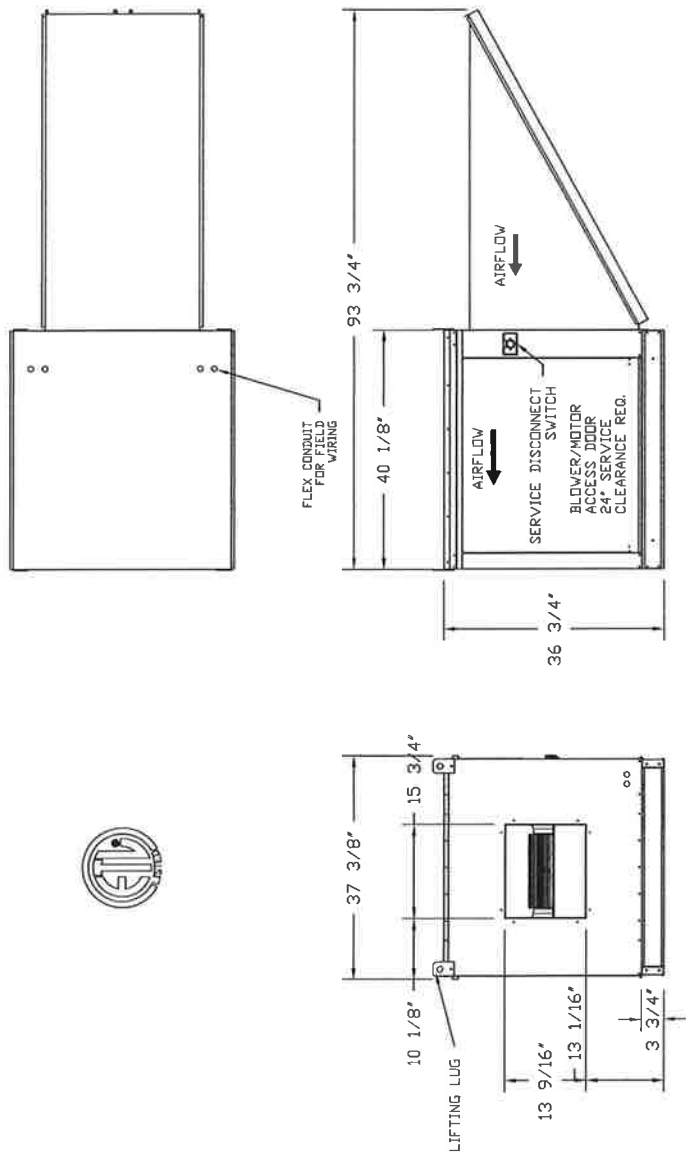

FAN #3 B122CARM - EXHAUST FAN

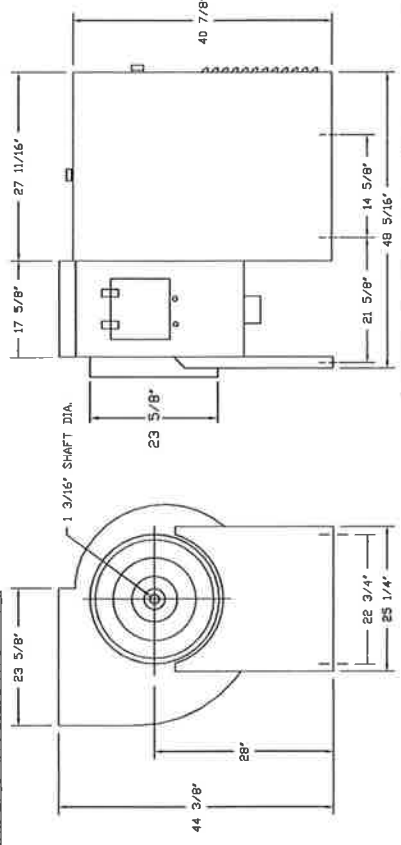

- FEATURES:**
- FULL AHIC CLASS 1 OPERATION
 - VENTED MOTOR COVER FOR WEATHER PROTECTION
 - UL766 LISTED FOR RESTAURANT DUTY
 - PLASTIC DISCHARGE DIRECTS AIR AWAY FROM FLOOR
 - 1/2" SERVICE CLEARANCE REQ. FOR SERVICE
 - CLEANOUT DOOR WITH LATCHES PROVIDE EASY ACCESS WITHOUT TOOLS
 - 2" GREASE DRAIN WILL NOT CLOG

OPTIONS:

- UTILITY SET - SPRING VIBRATION ISOLATORS - B120 THRU B124 / EQUIVALENT
- SIZED UTILITY SET - INDOOR/OUTDOOR USE.
- EXHAUST FAN GREASE CUP (CANARM UTILITY SET)
- RAIN CAP - V CAP ASSEMBLY FOR B118/27 & HRE 20/24.

CAPTIVEAIRE

JOB Food Works 12ft	
LOCATION	Lewiston, ME
DATE	12/6/2013
DWG #	4
REV.	
JOB #	1925596
DRAWN BY	BFC-21
SCALE	3/8" = 1'-0"