


SECOND FLOOR LIGHTING PLAN
SCALE: 1/4" = 1'-0"

GENERAL NOTES:


1. SWITCHES, OUTLETS, TEL JACKS AND TV JACKS TO BE STAGGERED IN COMMON WALLS BETWEEN UNITS TYPICAL. PROVIDE PUTTY PADS IN INSTANCES WHERE DEVICES CANNOT BE PROPERLY STAGGERED.
2. CONTRACTOR SHALL ROUGH IN BOXES IN ONE OF EACH UNIT TYPE FOR REVIEW IN THE FIELD BY THE OWNER.
3. MINIMUM WIRE SIZE IS #12 AWG - #14 AWG WIRE IS NOT PERMITTED.
4. PROVIDE AIR-VAPOR BARRIER ELECTRICAL BOXES AT EXTERIOR WALLS. LESSCO OR EQUIVALENT.
5. REFER TO ARCHITECTURAL REFLECTED CEILING PLAN TO COORDINATE THE LOCATION OF LIGHTING FIXTURES.
6. ALL PRODUCTS OF COMBUSTION DETECTORS (SMOKE DETECTORS) SHALL PROVIDE BOTH AUDIO AND VISUAL ALARMS.
7. ALL WIRING PENETRATING INTO BUILDING THERMAL ENVELOPE COMPONENTS SHALL BE PROPERLY "AIR-SEALED".
8. SWITCHES FOR RANGE HOOD FAN AND LIGHT SHALL BE MOUNTED AT COUNTER HEIGHT.
9. ELECTRICAL PANELS SHALL BE MOUNTED WITH THE TOP BREAKER NOT HIGHER THEN 48" AFF FOR ADA UNITS, ALL NON ADA UNITS 72".
10. UNIT THERMOSTATS SHALL BE MOUNTED NOT HIGHER THEN 48" AFF FOR ADA UNITS, ALL NON ADA UNITS 72".

UNIT FIRE ALARM NOTES:

1. SUPERVISED CENTRAL SYSTEM ACTIVATION ALL SYSTEM AUDIO/VISUAL AND VISUAL ONLY DEVICES SHALL ALARM.
 2. WHEN UNIT SMOKE DETECTOR GOES INTO ALARM ALL SINGLE STATION AUDIO/VISUAL AND VISUAL ONLY DEVICES WITHIN THAT UNIT WILL ACTIVATE. THIS WILL NOT ACTIVATE THE ENTIRE BUILDING SYSTEM.
 3. THE WALL MOUNTED HORN/STROBES WITHIN THE LIVING UNITS SHALL BE CONNECTED TO THE SUPERVISED CENTRAL SYSTEM.
 4. INTERCONNECT ALL 120 VOLT SINGLE STATION SMOKE DETECTORS WITHIN EACH LIVING UNIT. ALL INTERCONNECTED SMOKE DETECTORS SHALL BE ON THE SAME CIRCUIT FOR PROPER OPERATION. REFER TO MANUFACTURER'S INSTALLATION MANUAL AND MOUNT DETECTORS IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.
 5. CARBON MONOXIDE DETECTORS (120V) IN RESIDENCES SHALL BE INSTALLED AT LEAST 10 FEET FROM ANY HEAT SOURCE.
 6. INTERCONNECT ALL 120 VOLT CARBON MONOXIDE (CO) DETECTORS WITHIN EACH LIVING UNIT. ALL INTERCONNECTED CO DETECTORS SHALL BE ON THE SAME CIRCUIT FOR PROPER OPERATION. REFER TO MANUFACTURER'S INSTALLATION MANUAL AND MOUNT DETECTORS IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS. CO DETECTORS SHALL HAVE AN ALARM SOUND THAT IS DIFFERENT THAN THE LIVING UNIT SMOKE DETECTORS AND FIRE ALARM SYSTEM ALARMS.
- AUDIBLE ALARM Db LEVELS SHALL COMPLY WITH NFPA 72.
8. A/V DEVICES IN BEDROOMS SHALL BE 75db AND 15 Cd. STROBES SHALL BE 110 Cd FOR HEARING IMPAIRED.

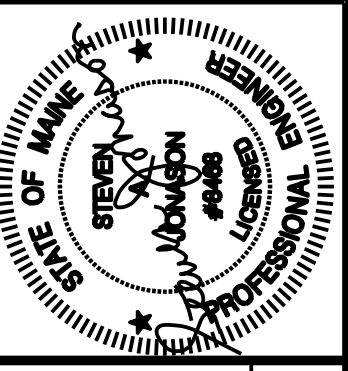

Prepared For:

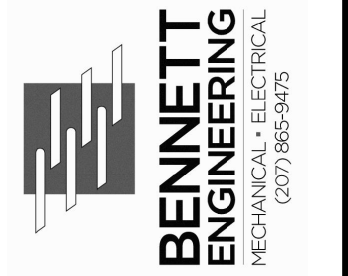

Consultant:



Architect:

185 FORE STREET
Portland, Maine

Project:

06-11-15 ADDENDUM #1

Revisions:

Scale: As indicated

Date: 22 May, 2015

SECOND FLOOR LIGHTING PLAN
E1.2