


FOOTING SCHEDULE - 1.5 Kips

MARK	FOOTING SIZE	REINFORCING
F4.0	4'-0"x4'-0"x1'-0"	5-#4 EMB
F4.5	4'-6"x4'-6"x1'-0"	6-#4 EMB
F5.0	5'-0"x5'-0"x1'-0"	5-#5 EMB
F5.5	5'-6"x5'-6"x1'-0"	6-#5 EMB
F6.0	6'-0"x6'-0"x1'-0"	7-#5 EMB
F6.5	6'-6"x6'-6"x1'-2"	8-#5 EMB
F6.5A	6'-6"x6'-6"x2'-0"	7-#7 EMB
F7.0	7'-0"x7'-0"x1'-2"	9-#5 EMB
F7.0/14.5	7'-0"x14'-6"x2'-0"	#6@2" O.C. EX T4B
F7.5	7'-6"x7'-6"x1'-4"	8-#6 EMB
F7.5A	7'-6"x7'-6"x2'-2"	8-#7 EMB
F8.0	8'-0"x8'-0"x1'-4"	9-#6 EMB
F8.5	8'-6"x8'-6"x1'-6"	10-#6 EMB
F8.5A	8'-6"x8'-6"x2'-2"	10-#6 EMB
F9.0	9'-0"x9'-0"x1'-6"	9-#7 EMB
F9.0A	9'-0"x9'-0"x2'-0"	9-#7 EMB
F9.5	9'-6"x9'-6"x1'-8"	9-#7 EMB
F10.0	10'-0"x10'-0"x1'-8"	11-#7 EMB
F10.5	10'-6"x10'-6"x1'-8"	11-#7 EMB
F11.0	11'-0"x11'-0"x1'-10"	13-#7 EMB
F11.5	11'-6"x11'-6"x1'-10"	14-#7 EMB
F12.0	12'-0"x12'-0"x2'-0"	15-#7 EMB

FOUNDATION PLAN
1/4"=1'-0"

FOUNDATION NOTES:

- FOR TYPICAL DETAILS & GENERAL NOTES SEE DRAWINGS S2.01 TO 2.03.
- SLAB ELEVATION SHALL BE ELEVATION X'-X" U.N.O.
- F... INDICATES FOOTING MARK. FOR FOOTING SIZES & REINFORCING SEE FOOTING SCHEDULE ON THIS DRAWING.
- P... INDICATES PIER TYPE. FOR DETAILS AND SCHEDULE SEE DRAWING S3.01.
- C... INDICATES COLUMN MARK. FOR SIZES SEE COLUMN SCHEDULE ON DRAWING S3.01.
- BOTTOM OF EXTERIOR FOOTING SHALL BE -4'-0" BELOW GRADE UNLESS NOTED THIS: (...).
- TOP OF INTERIOR FOOTING SHALL BE -1'-0" FROM REFERENCE SLAB ELEVATION UNLESS NOTED THIS: (T/F...).
- TOP OF EXTERIOR WALL (TOW) SHALL BE 0" FROM REFERENCE SLAB ELEVATION UNLESS NOTED THIS: 'TOW EL.-----'.
- TOP OF EXTERIOR PIER AND TOP OF EXTERIOR WALL PIERS SHALL BE -8" FROM REFERENCE SLAB ELEVATION UNLESS NOTED THIS: (...).
- TOP OF INTERIOR PIERS SHALL BE -1'-0" FROM REFERENCE SLAB ELEVATION UNLESS NOTED THIS: (...).
- (---) INDICATES BOTTOM OF FOOTING ELEVATION.
- (...) INDICATES TOP OF PIER ELEVATION.
- (T/F...) INDICATES TOP OF FOOTING ELEVATION.
- ALL EXPOSED CONCRETE TO BE "RUBBED" FINISH.
- FOR FLOOR DRAIN ELEVATIONS, SLAB DEPRESSIONS AND SLOPING CONCRETE FLOORS SEE ARCHITECTURAL DRAWINGS.
- FOR DIMENSIONS & SLOPES OF RAMPS & SIDEWALKS SEE ARCHITECTURAL & CIVIL DRAWINGS.
- FOR ELEVATIONS OF FOUNDATION WALL PENETRATIONS SEE MECHANICAL AND CIVIL DRAWINGS. SEE DRAWING S2.02 FOR TYPICAL FOOTING DETAIL AT PIPE SLEEVES.
- THE GENERAL CONTRACTOR SHALL COORDINATE DEPTH OF ALL SLAB DEPRESSIONS SHOWN ON PLANS.
- THE EXTERIOR WALL FOOTINGS HAVE BEEN DROPPED AT LOCATIONS OF SEWERS, DRAINS, GAS LINES AND WATERLINES. THE TOP OF FOOTING IS SET AT 6 INCHES PLUS/MINUS LOWER THAN THE PIPE INVERT ELEVATION. THE GENERAL CONTRACTOR SHALL NOTIFY THE ENGINEER IF STEPPED FOOTINGS ARE NOT LOCATED AT EXTERIOR WALL PIPE PENETRATIONS.
- FOR LOCATION AND EXTENT OF FOUNDATION INSULATION SEE ARCHITECTURAL DRAWINGS.
- FOR SLOPED SLAB, SPOT ELEVATIONS, AND ADA RAMP REQUIREMENTS SEE ARCHITECTURAL & CIVIL DRAWINGS.

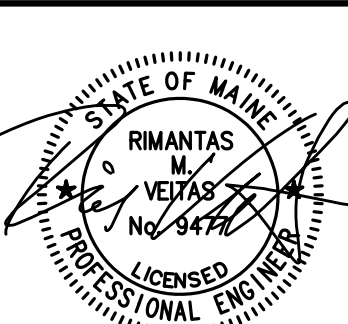

BATEMAN PARTNERS, LLC.
470 FORE STREET
PORTLAND, ME 04101

Prepared For:

VEITAS VEITAS
engineers

Consultant:

ARCHETYPE
architects
48 Union Wharf Portland, Maine 04101
(207) 772-6022 Fax (207) 772-4056

Architect:

185 FORE STREET
Portland, Maine

Project:

FOUNDATION PLAN

Revisions:
1 05-22-2015 BID SET

Date: 16 JUNE, 2014

Scale:

S1.01