



General Notes

1. Multi heat pump outdoor units SAC #1, #2, #3 shall be located on the high roof. Coordinate locations with the Architect.
2. Provide Maxitrol or Pietro-Fiorini gas pressure regulators with vent limiter (or vent to atmosphere) at each appliance.
3. Provide refrigerant piping between indoor and outdoor units per the manufacturers recommendations.

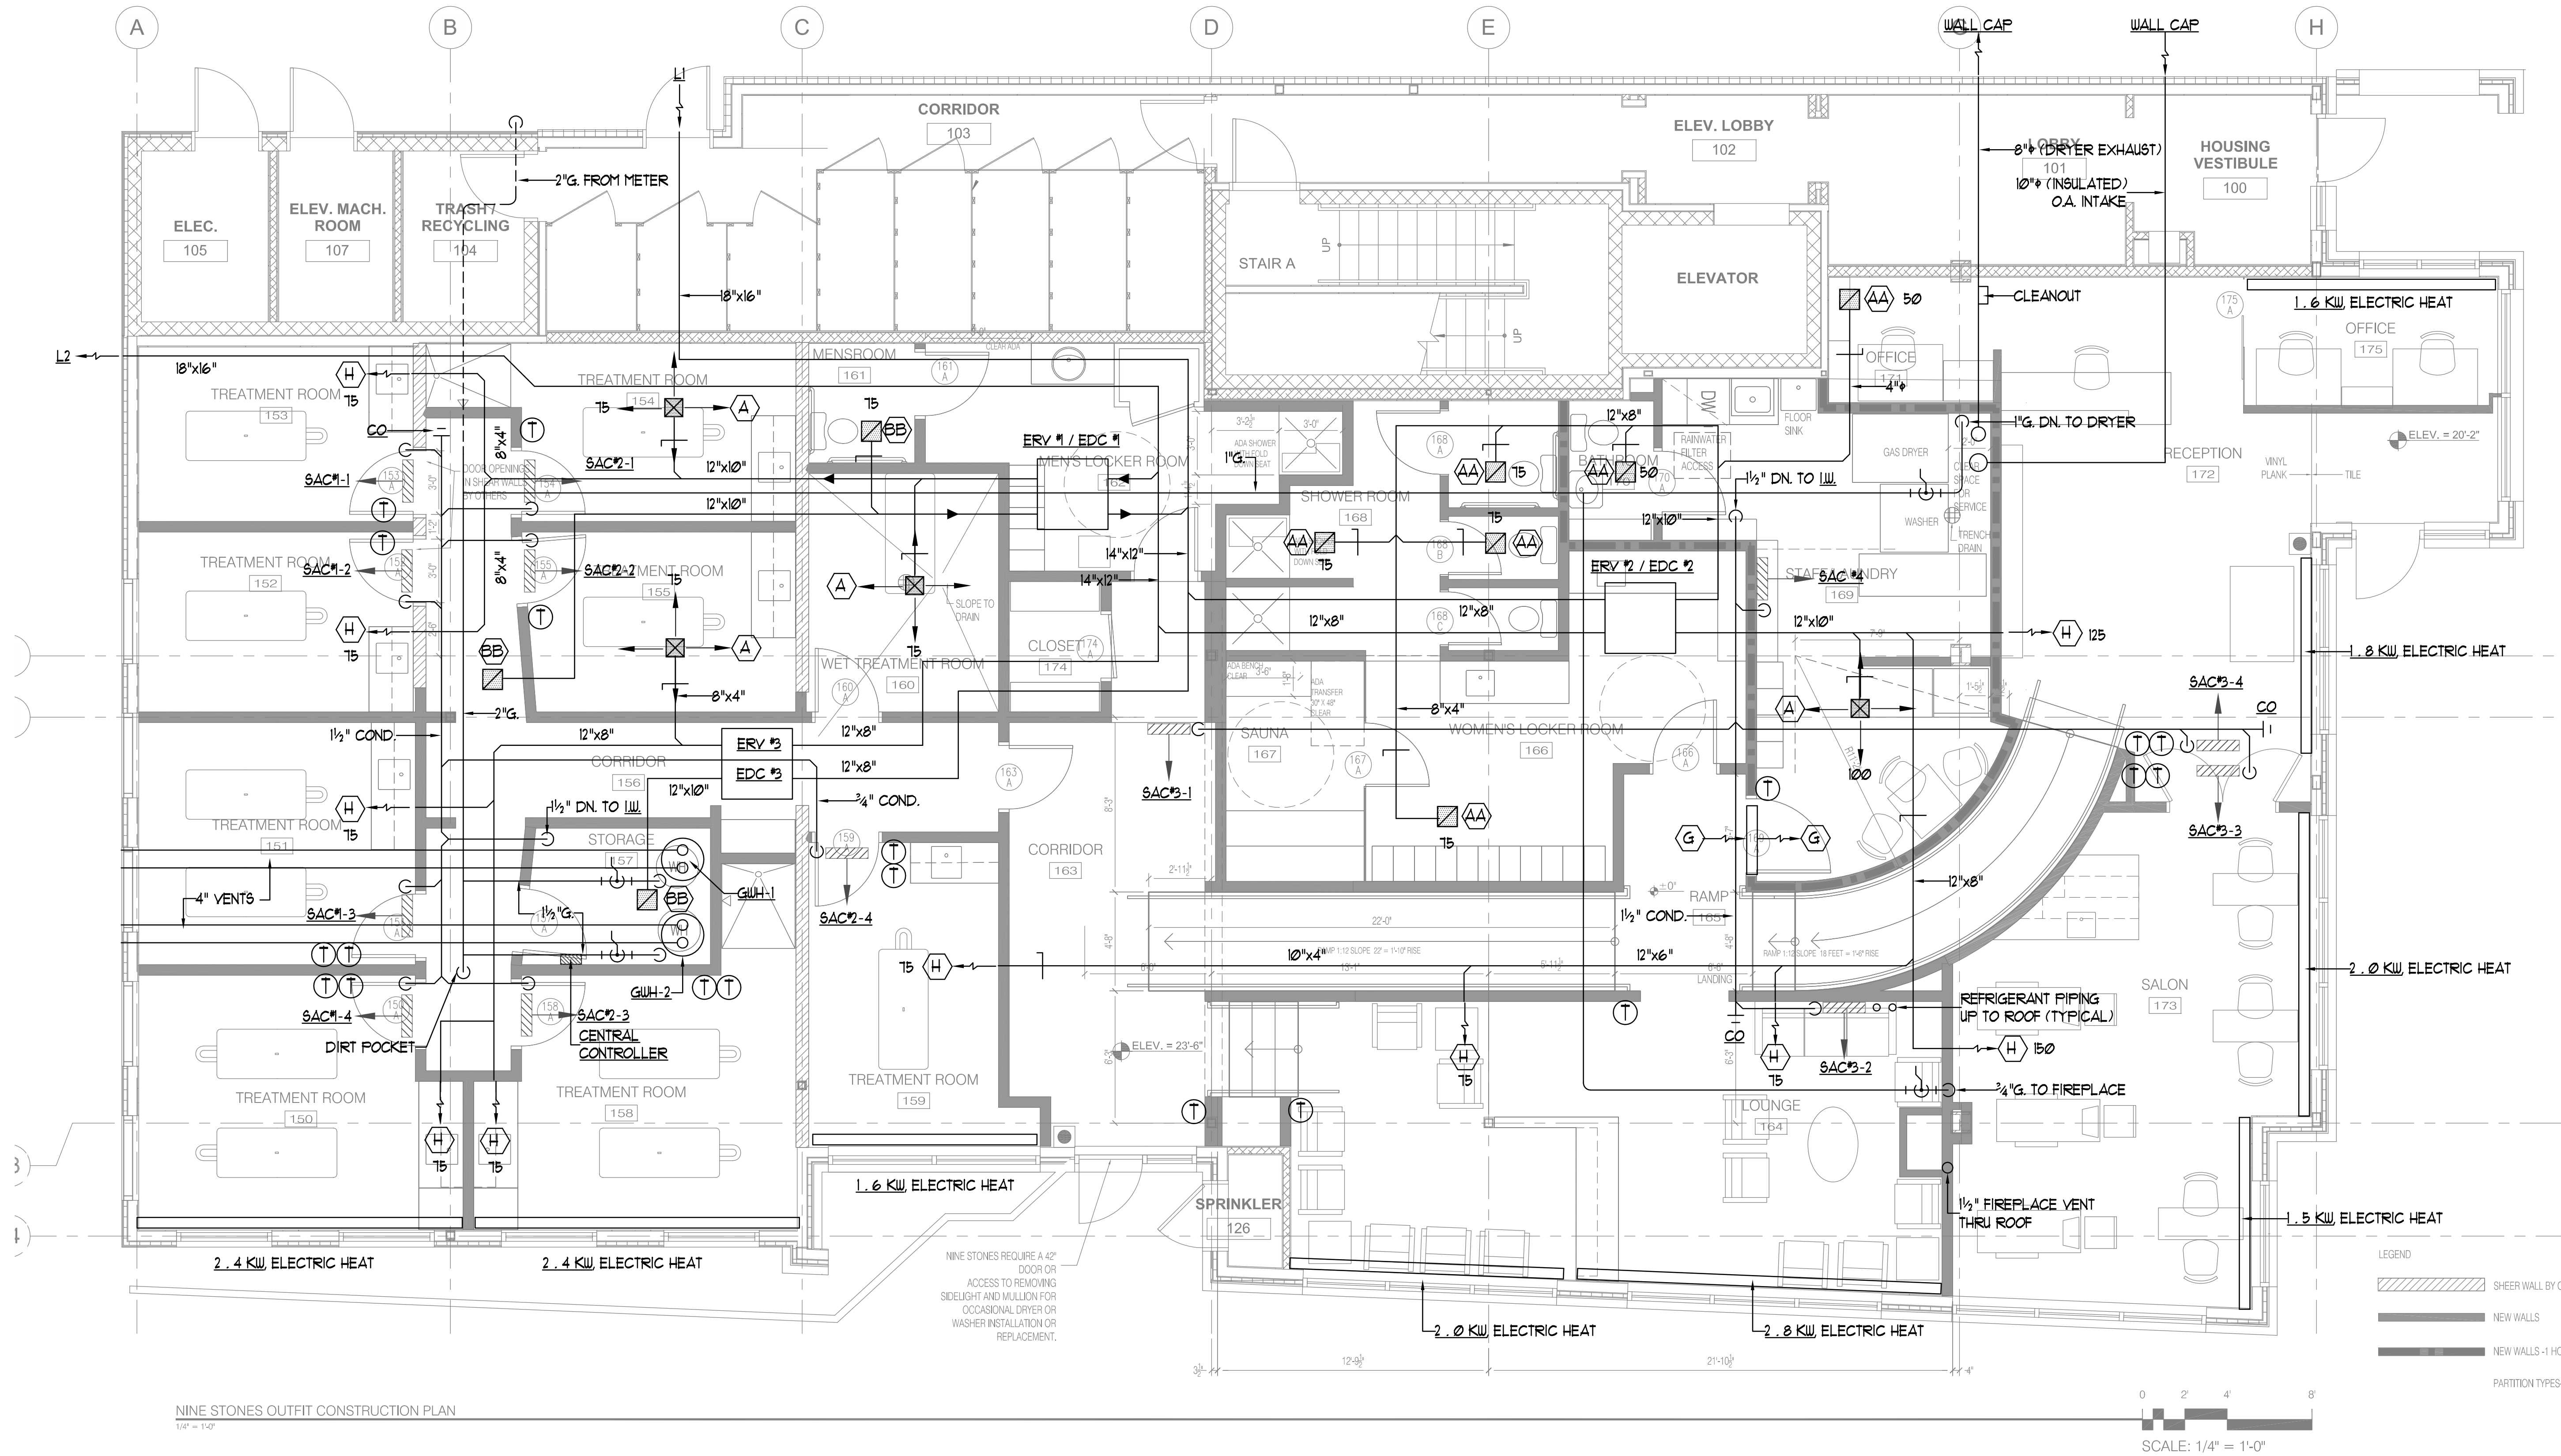

NINE STONES OUTFIT CONSTRUCTION PLAN
1/4" = 1'-0"

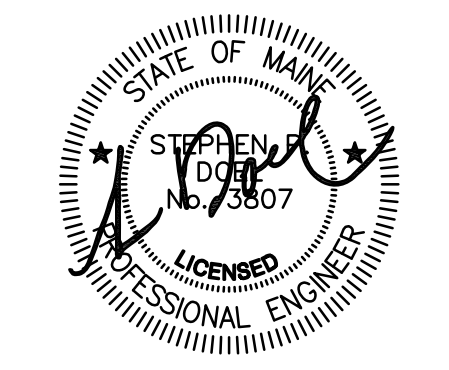

HEMESphere DESIGN
Architecture
58 Fore Street
Portland, ME 04101
207.232.6079
joe@hemespheredesign.com
www.hemespheredesign.com

PROSPECT DESIGN
58 FORE ST. PORTLAND, ME
www.prospectdesign.me
T: 207-749-7400

BENNETT ENGINEERING
MECHANICAL • ELECTRICAL
(207) 865-9475

NINE STONES TENANT FIT-UP
165 FORE STREET
BATEMAN PARTNERS, LLC
PORTLAND BUILDERS INC

PERMIT

REVISION	DATE

DRAWN BY: _____
DATE: January 14, 2016

M1