



1 STAIR PROFILE IN LOUNGE 164
3/4" = 1'-0"

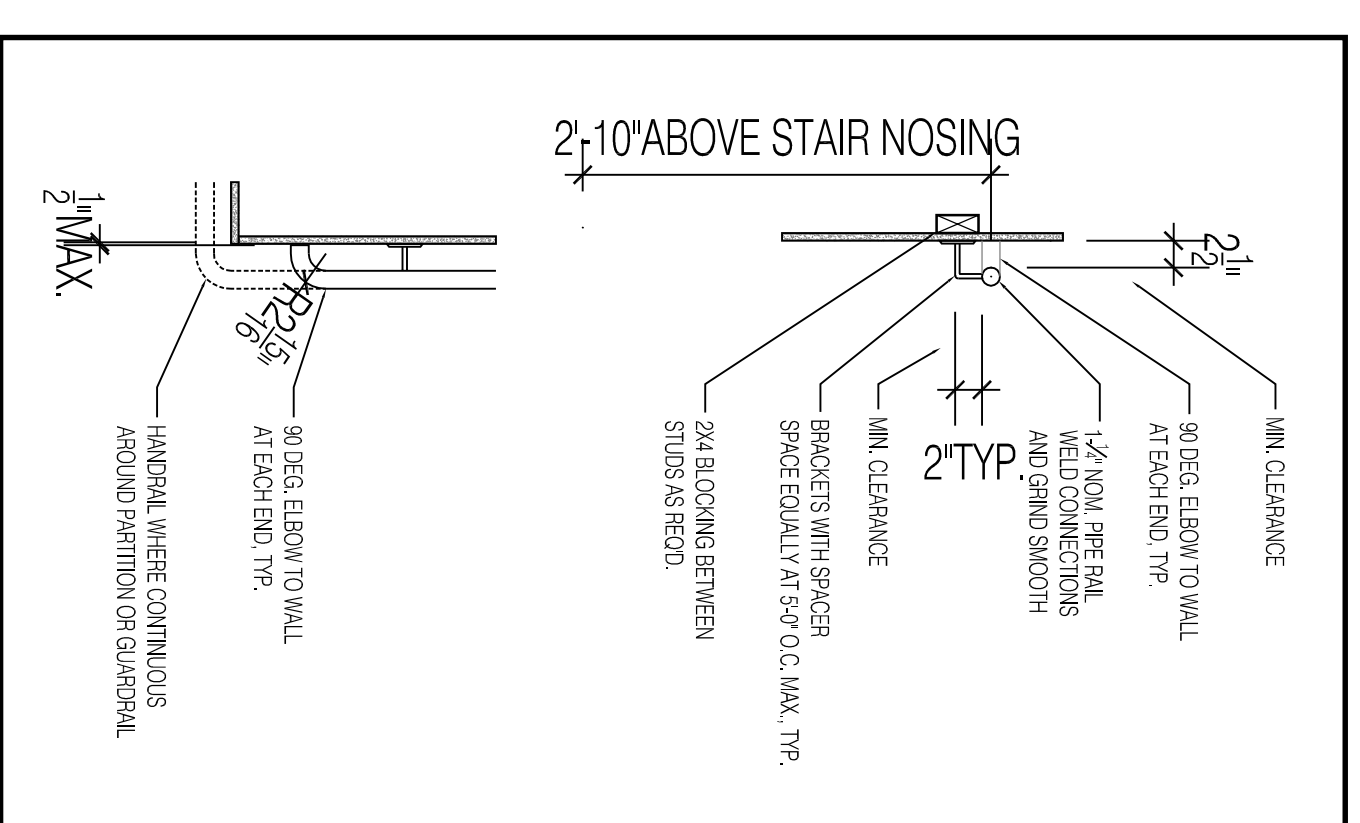

2 HANDRAIL DETAIL
3/4" = 1'-0"

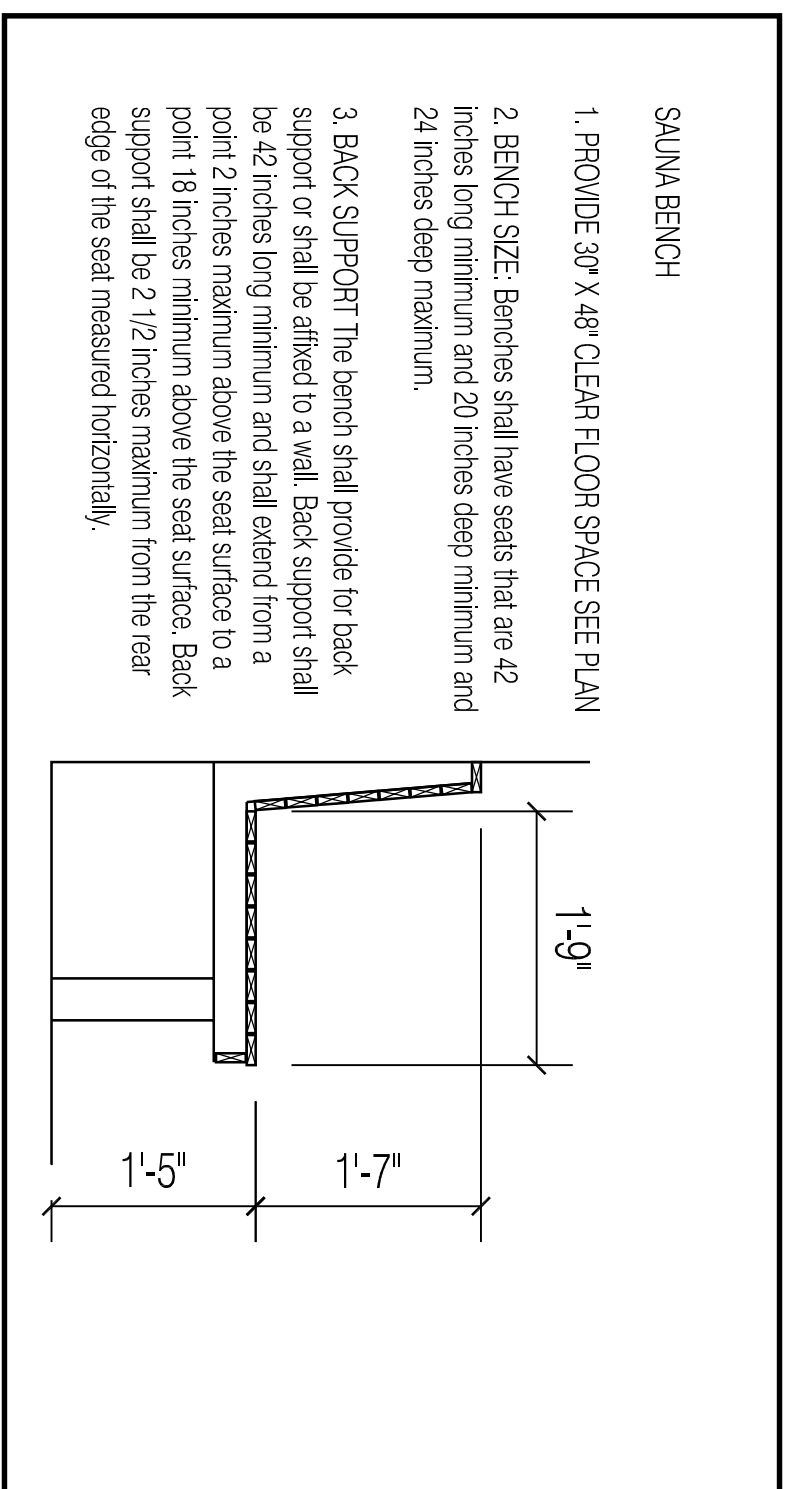

4 SAUNA BENCH DETAIL
3/4" = 1'-0"

1 HOUR RATED	NON-RATED	PARTITION TYPES
1	2	5/8" GWB TYPE "X" 3 5/8" METAL STUDS @ 24" O.C. (25 GAUGE MIN.) 3" ROXUL SAFE N SOUND BATT INSULATION 1/2" RESILANT FURRING CHANNELS (MIN 25 GAUGE) 5/8" GWB TYPE "X" SEALANT AT DECK
3	4	5/8" GWB TYPE "X" 6" METAL STUDS @ 24" O.C. (25 GAUGE MIN.) 3" ROXUL SAFE N SOUND BATT INSULATION 1/2" RESILANT FURRING CHANNELS (MIN 25 GAUGE) 5/8" GWB TYPE "X" SEALANT AT DECK
	5	5/8" GWB TYPE "X" 3 5/8" METAL STUDS @ 24" O.C. (25 GAUGE MIN.) 3" ROXUL SAFE N SOUND BATT INSULATION RESILANT SOUND ISOLATION CLIPS (TREATMENT ROOM SIDE) SPACED 48" OC 1/2" RESILANT FURRING CHANNELS (MIN 25 GAUGE) 5/8" GWB TYPE "X" SEALANT AT DECK
	6	5/8" GWB TYPE "X" 3 5/8" METAL STUDS @ 24" O.C. 5/8" GWB TYPE "X" ACOUSTICAL SEALANT ALL SIDES
		CEILING TYPES
		METAL JOISTS SIZED BY STRUCTURAL ENGINEER 5/8" GWB TYPE "X" ACOUSTICAL SEALANT ALL SIDES

- GENERAL PARTITION NOTES:**
- ALL PARTITIONS ARE CONTINUOUS TO GYP CEILING AND SEALED TIGHT TO UNDERSIDE OF THE DECK TO PROVIDE SMOKE BARRIERS AND SOUND-TIGHT ENCLOSURES - EXCEPT WHERE OTHERWISE NOTED. PROVIDE SEALANT SYSTEM COMPLYING WITH FIRE RATED ASSEMBLIES.
 - SEAL ALL PENETRATIONS THROUGH WALLS.
 - PENETRATIONS THROUGH FIRE RATED WALLS SHALL BE SEALED WITH FIRE STOP SEALANT SYSTEMS WITH APPROVED INSTALLATION FOR SPECIFIC RATED ASSEMBLIES.
 - STUD LAYOUT SHALL CONFORM TO REQUIREMENTS OF FIRE RATED ASSEMBLIES WITH GWB JOINTS CONTINUOUSLY SUPPORTED BY STEEL STUDS OR FRAMING. SEE TYPICAL DEFLECTION JOINT DETAILS ON THIS SHEET
 - ALL STUD WALLS UNDER BEAMS & DECKS SHALL HAVE DEFLECTION JOINTS.
 - PROVIDE 20 GA. STEEL STUDS FOR PARTITIONS TO RECEIVE TILE BACKER BOARD & CERAMIC TILE
 - REFER TO STRUCTURAL DRAWINGS FOR TOP OF WALL BRACING.
 - PROVIDE TILE BACKER BOARD AT WALLS SCHEDULED TO RECEIVE CERAMIC TILE. PROVIDE MOISTURE RESISTANT GYPSUM BOARD AT ALL LOCATIONS WITHIN 3'-0" OF PLUMBING FIXTURES. IF NO BACKER BOARD.
 - ACOUSTIC BATT INSULATION TO BE ADHERED TO GWB OR SUPPORTED BY INSUL-HOLD-OR EQUIVALENT DEVICE.
 - STORAGE 157 AND CLOSET 174 SHALL BE SPRINKLED
 - AND SMOKE TIGHT IN LIEU OF 1-HOUR RATED
 - COORDINATE WITH SHEAR WALLS BY OTHERS, SO NEW WALLS AND SHEAR WALLS HAVE THE SAME WIDTH AND COORDINATE WITH ELECTRICAL AND PLUMBING REQUIREMENTS.



Hemesphere DESIGN
Architecture
58 Fore Street
Portland, ME 04101
207.232.6079
joe@hemespheredesign.com
www.hemespheredesign.com

PROSPECT DESIGN
58 Fore St. Portland, ME
www.prospectdesign.me
T: 207-749-7400

NINE STONES TENANT FIT-OUT
185 FORE STREET
BATEMAN PARTNERS, LLC
PORTLAND BUILDERS INC

90% CONSTRUCTION SET

DATE: March 18, 2016

A5