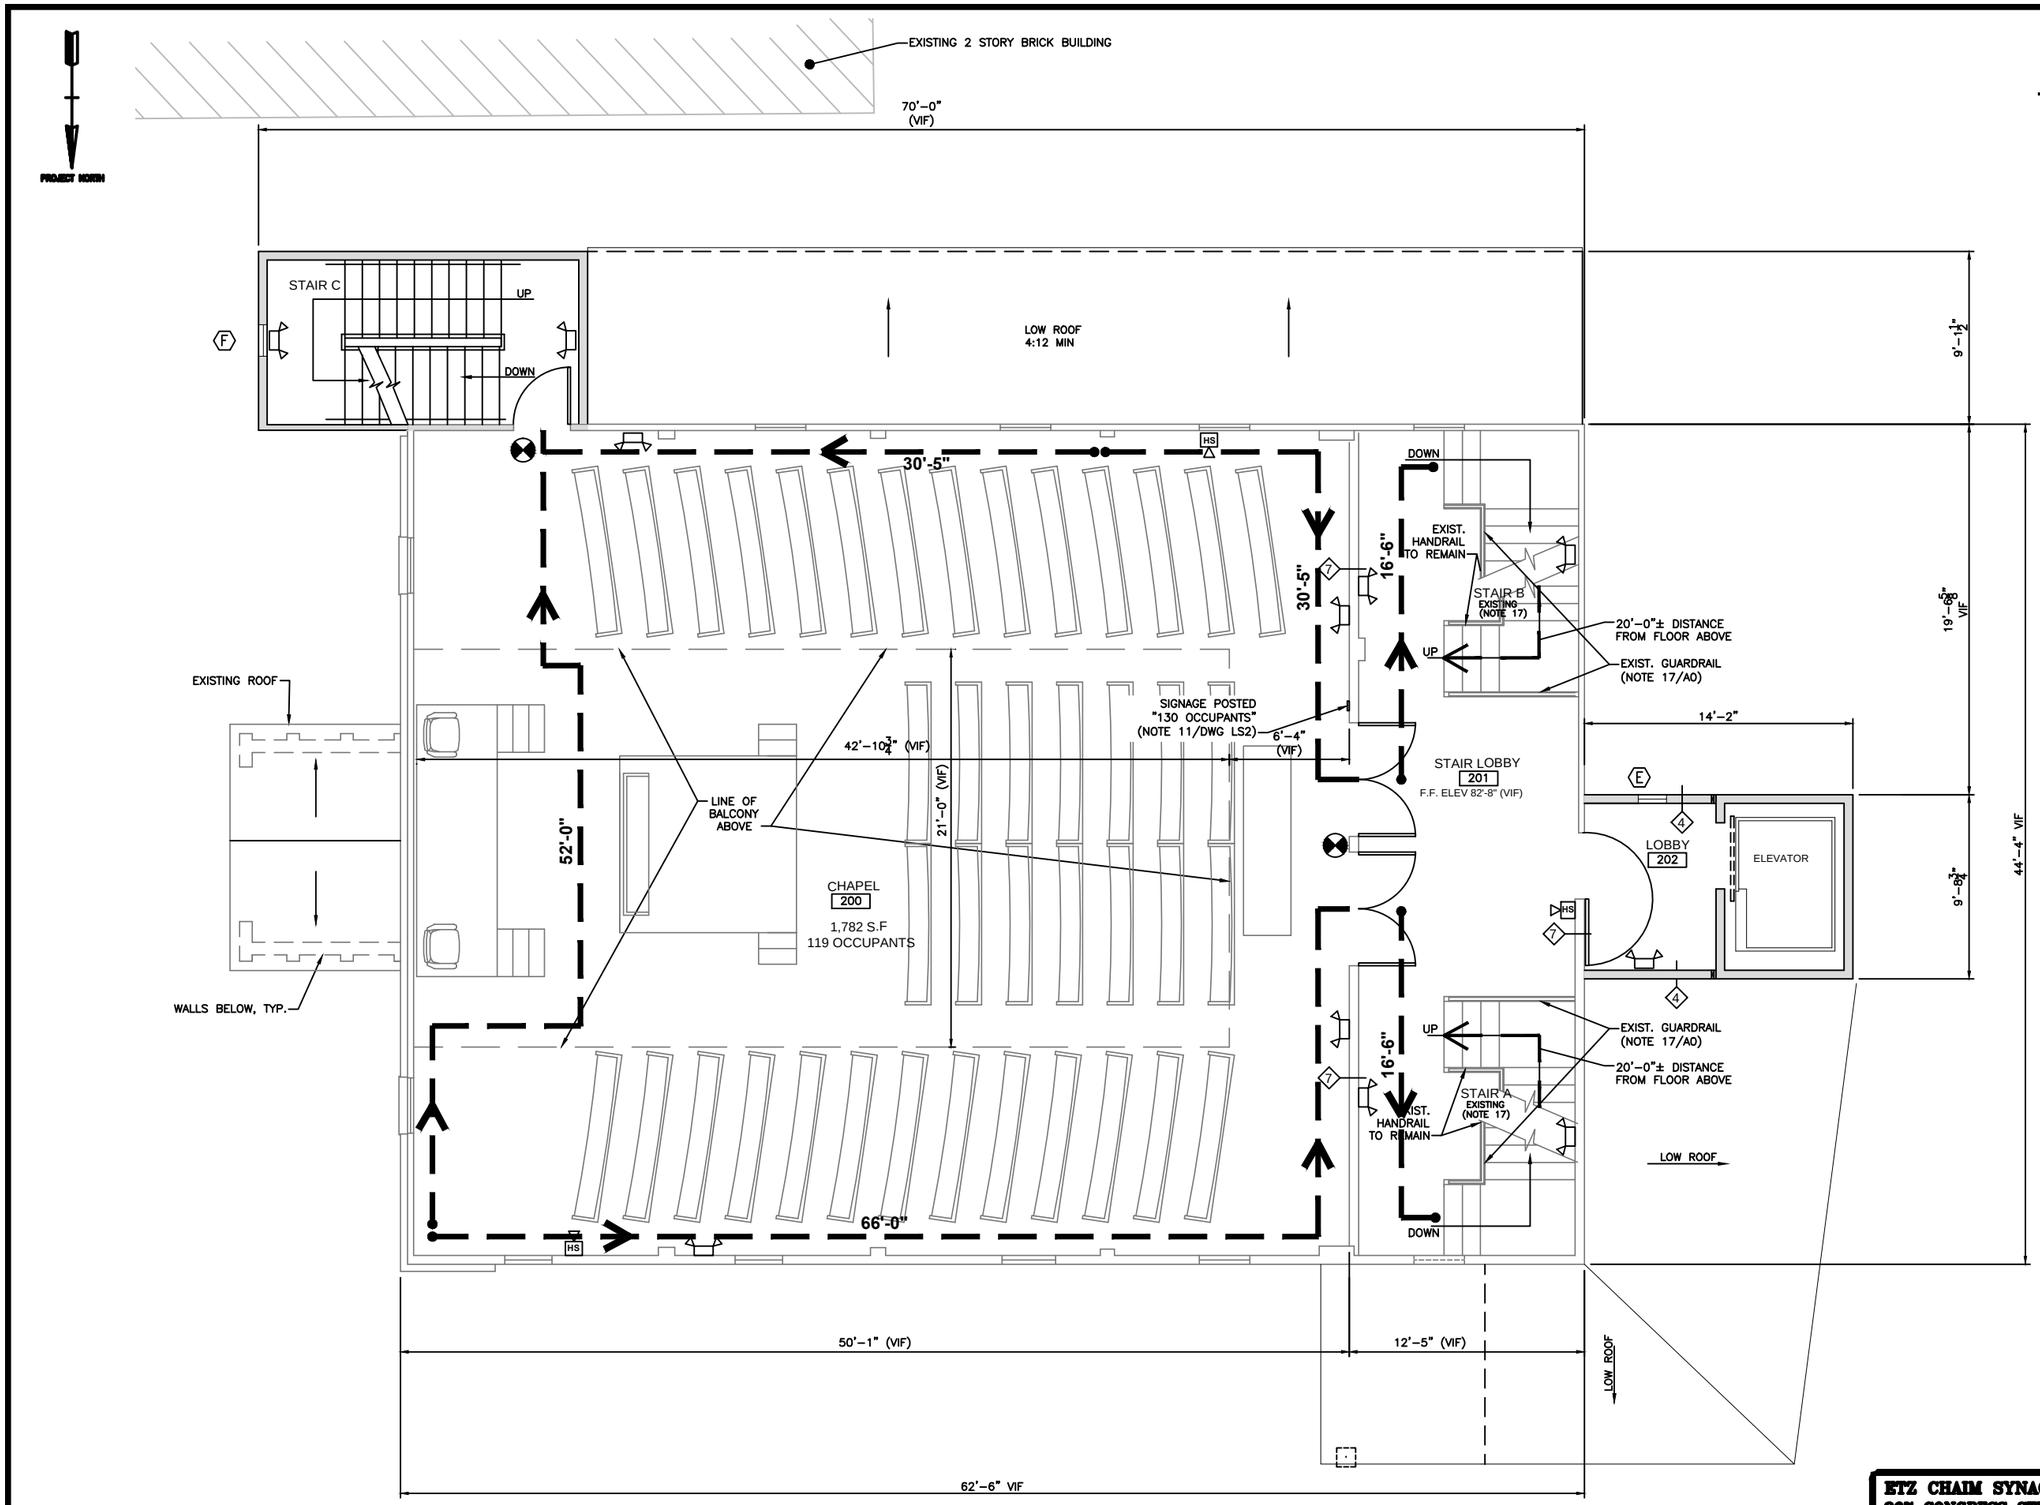

ENTIRE BUILDING SPRINKLERED PER NFPA 13

LEGEND

(FT)	COMMON PATH OF TRAVEL (IN FEET)
HS	FIRE ALARM AUDIO/VISUAL
HS	FIRE ALARM AUDIO/VISUAL (15 CANDELA)
	EXIT LIGHT ILLUMINATED (UNSWITCHED)
	EMERGENCY BATTERY UNIT (2 HEADS) 6V DC-10.8 WATTS FOR 90 MINUTES
T	SPRINKLER TAMPER SWITCH
F	SPRINKLER FLOW SWITCH

REGISTERED ARCHITECT JOHN H. LEASURE No. 310 STATE OF MAINE

STATUS

REV.	DATE	
1	1-18-13	CHANGE SIDE ADDITION FOOTPRINT & RELOCATE STAIR
2	4-8-13	STATE FIRE MARSHAL SUBMISSION
3	4-25-13	ISSUED FOR PERMIT

JOHN H. LEASURE ARCHITECT, INC.
6 Q STREET
SOUTH PORTLAND, MAINE 04106

ETZ CHAIM SYNAGOGUE
267 CONGRESS STREET
PORTLAND, MAINE

LIFE SAFETY SECOND FLOOR PLAN

LS3