




TYP SLAB DETAIL  
N.T.S.

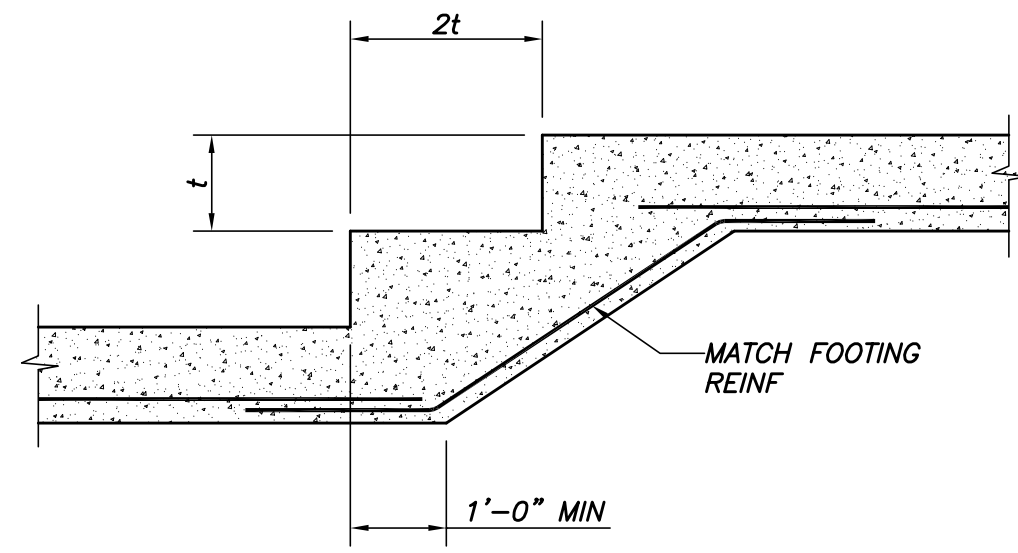

TYP STEP FOOTING DETAIL  
N.T.S. t = FOOTING THICKNESS

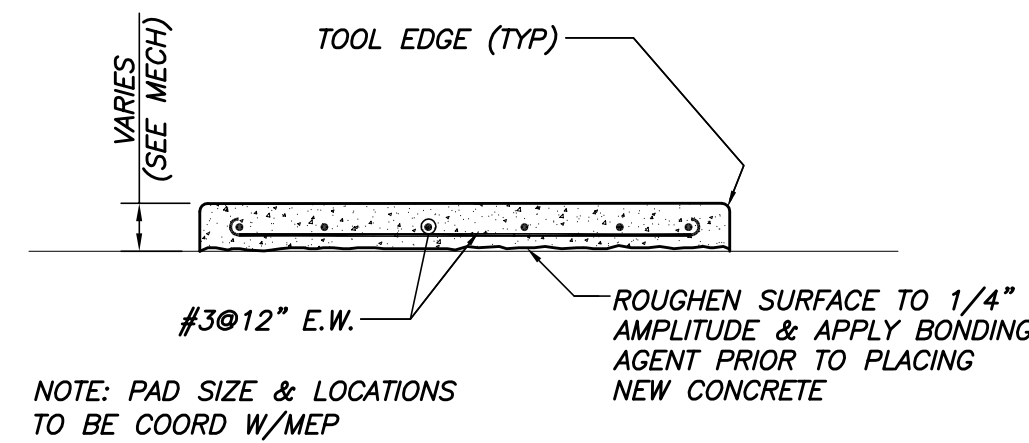


TYP EQUIPMENT HOUSEKEEPING PAD DETAIL  
1/2" = 1'-0"

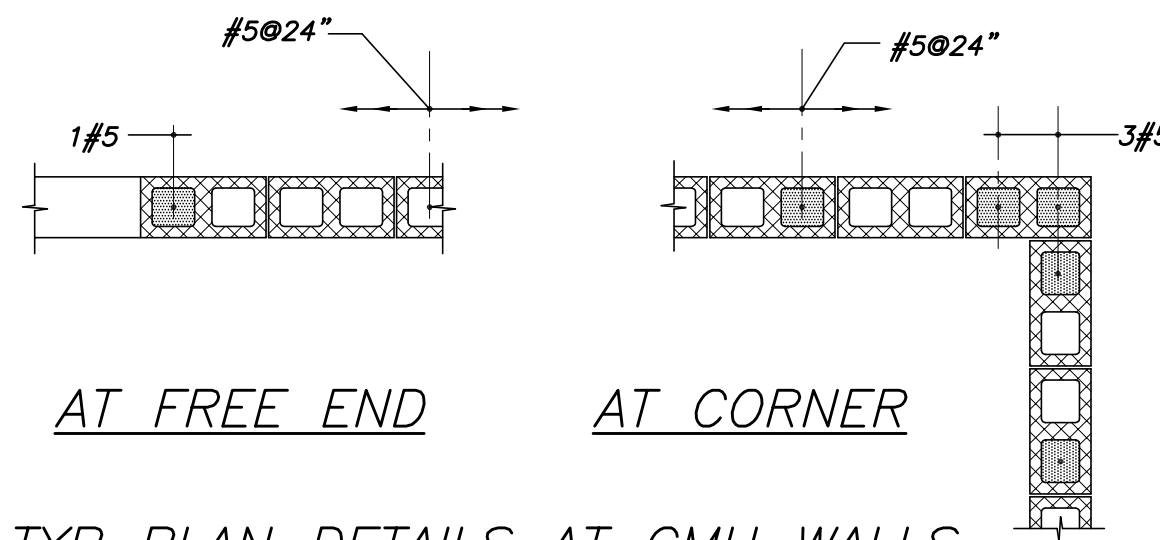


TYP PLAN DETAILS AT CMU WALLS  
N.T.S.


- NOTES:  
1. PROVIDE TRUSS TIE HORIZ REINF @ 16" O.C., UN.O.  
2. ALL REINFORCED CELLS ARE TO BE GROUTED.  
3. LAP BARS AT SPLICES MIN. 48 BAR DIAMETERS.

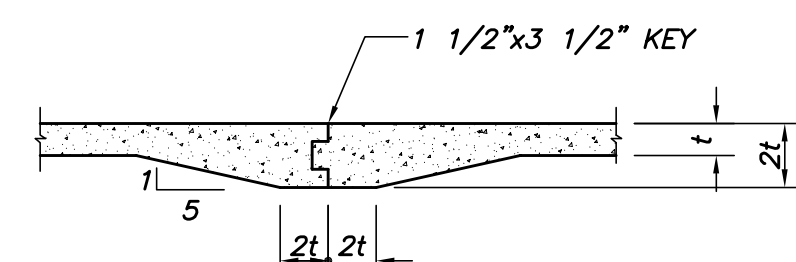


TYP SLAB ON GRADE CONST JOINT DETAIL  
N.T.S. t = WALL THICKNESS

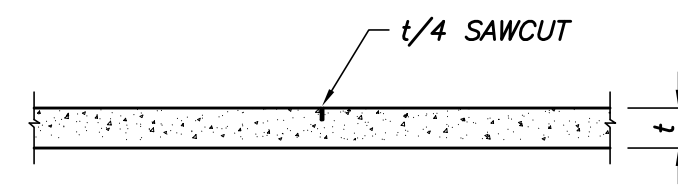


TYP SLAB ON GRADE CONTRACTION JOINT DETAIL  
N.T.S.

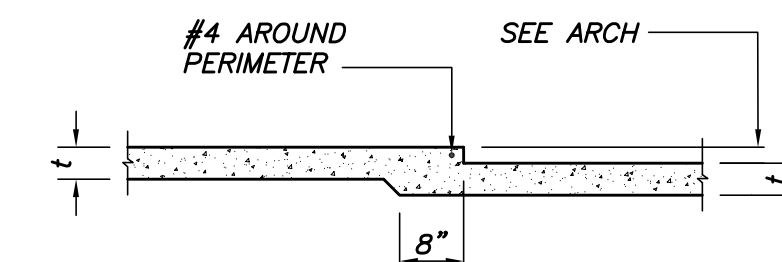


TYP SLAB DEPRESSION DETAIL  
1/2" = 1'-0"

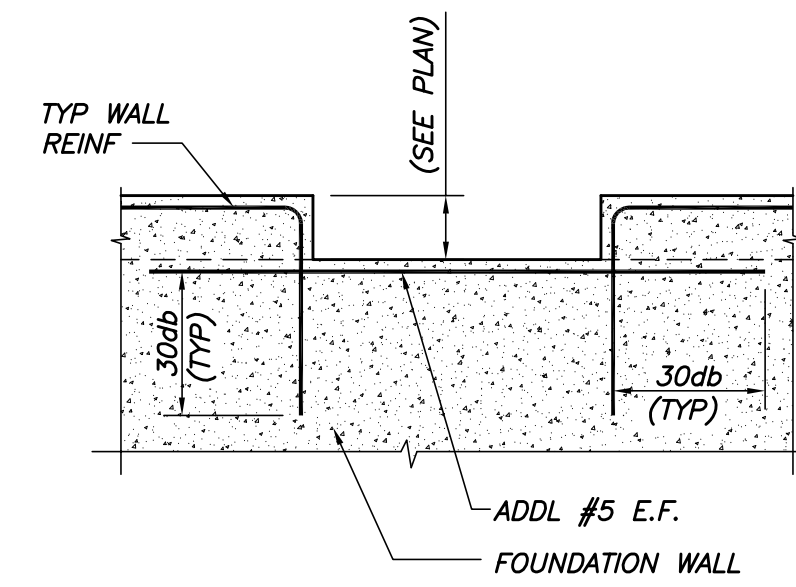

TYP WALL DEPRESSION DETAIL AT DOOR  
N.T.S.

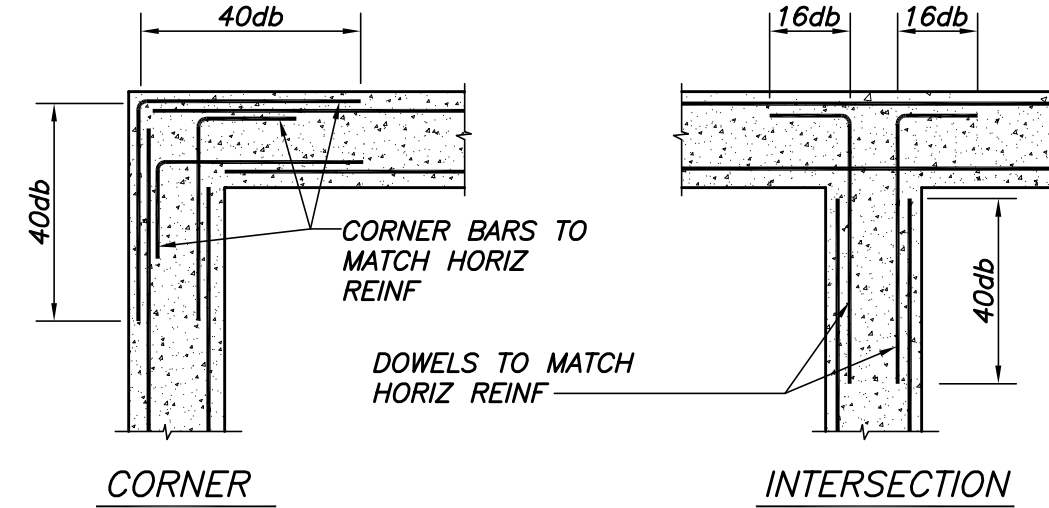


TYP WALL REINF DETAILS  
N.T.S.

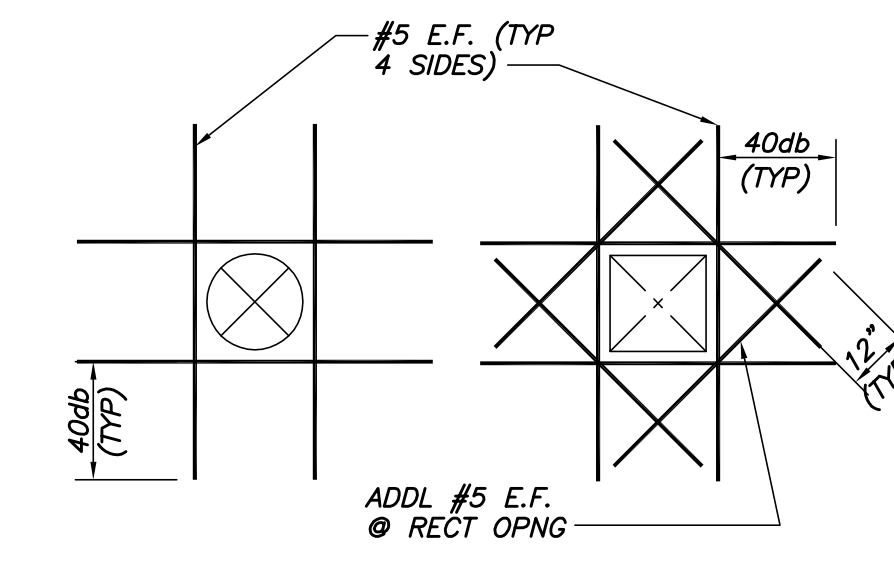


TYP OPENING IN WALL OR SLAB  
N.T.S.


REBAR LAP SPLICE TABLE	
BAR SIZE	LAP LENGTH
	3,000 PSI
#3	30"
#4	36"
#5	48"
#6	64"
#7	81"

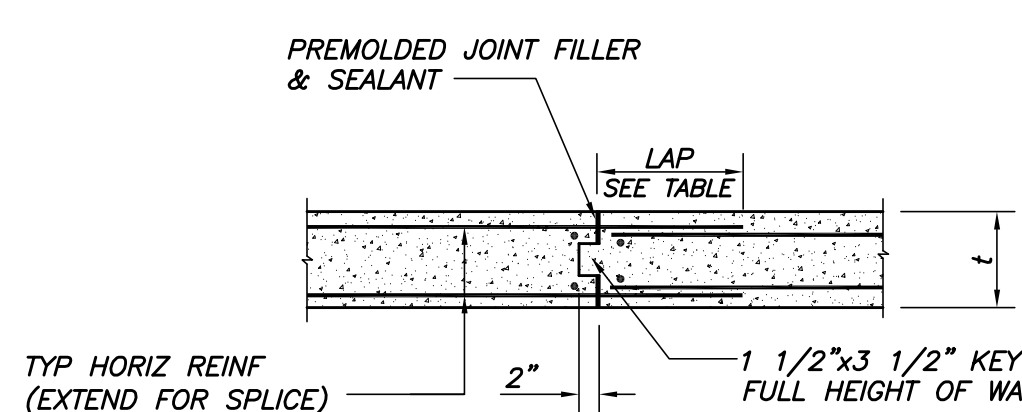


TYP CONSTRUCTION JOINT IN WALL  
N.T.S. t = WALL THICKNESS

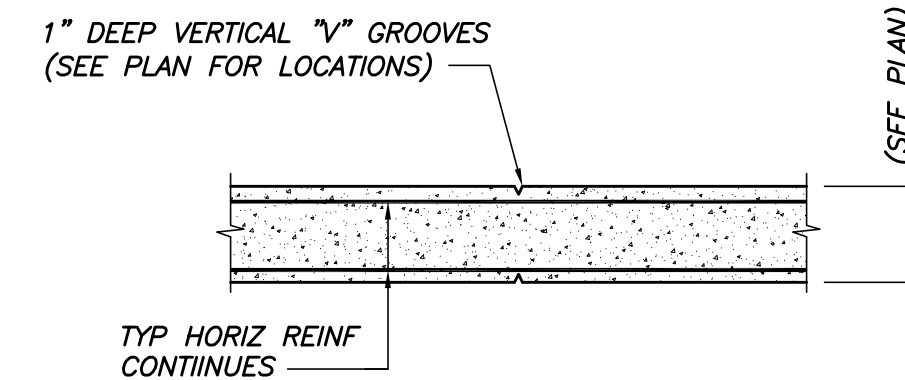

TYP CONTROL JOINT IN WALL  
N.T.S.

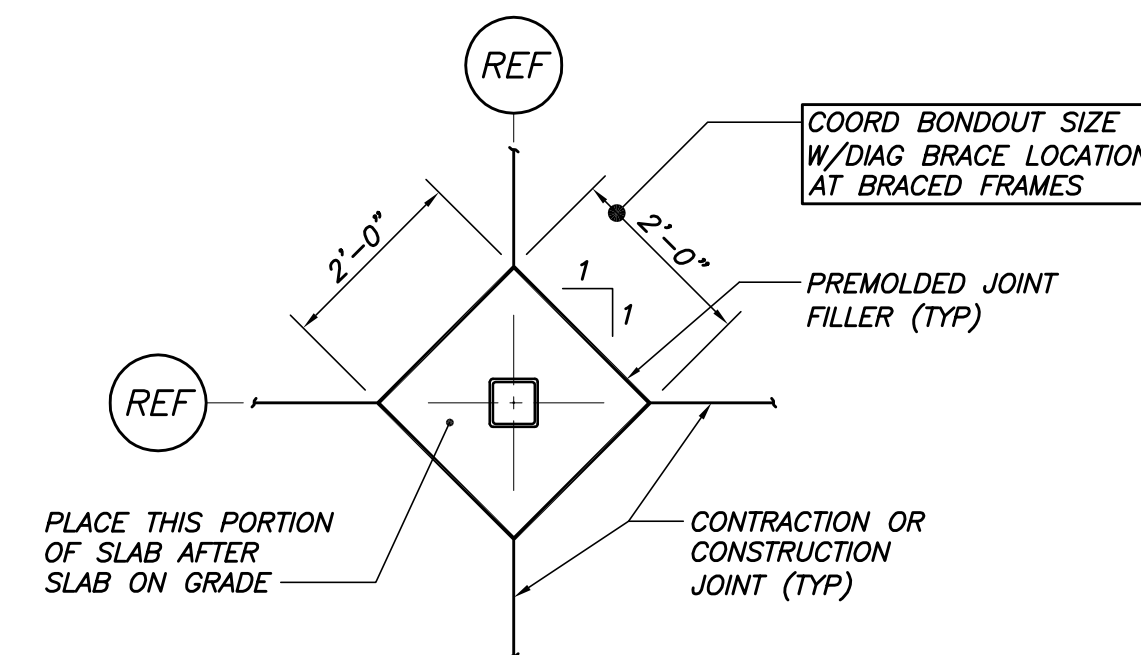


TYP INT COLUMN ISOLATION JOINT DETAIL  
N.T.S.

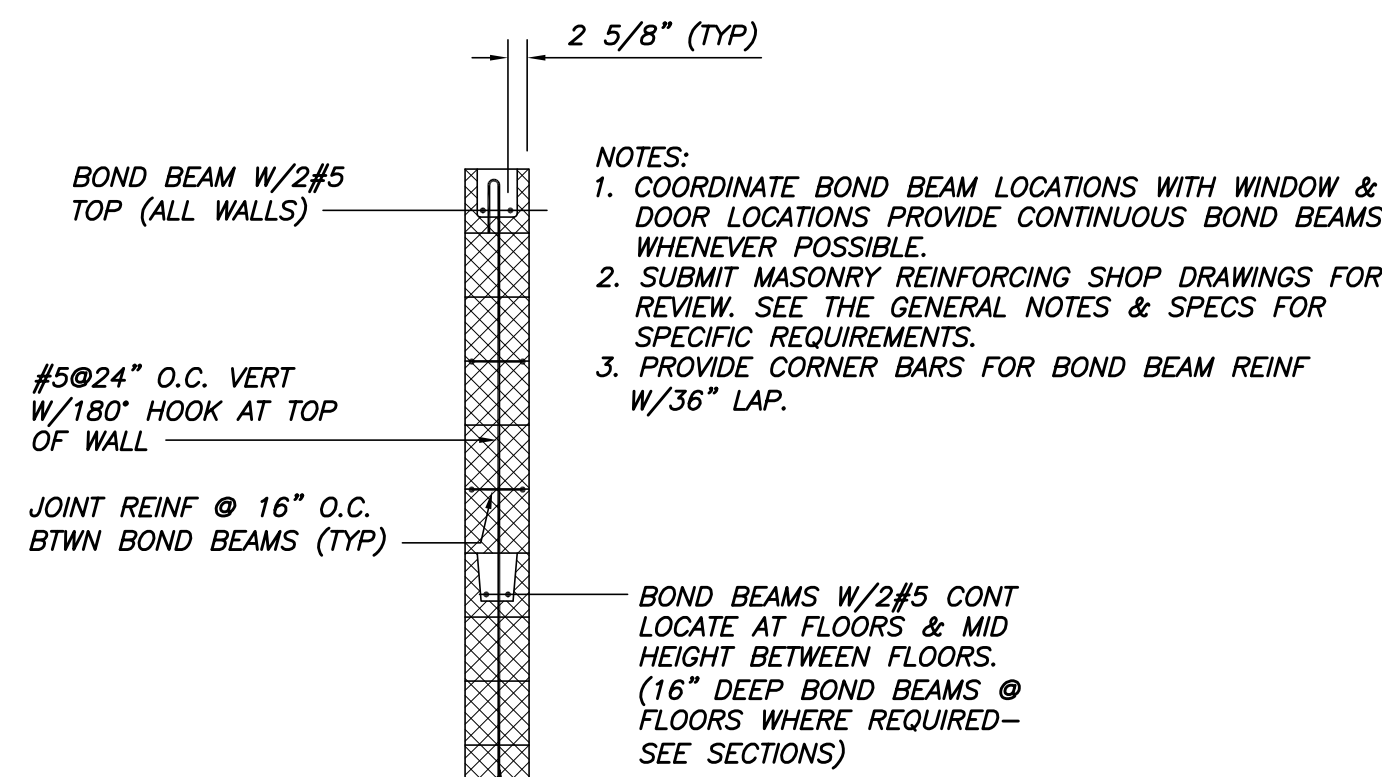

CMU WALL SECTION  
N.T.S.

CMU LINTEL SCHEDULE			
CLEAR SPAN	WIDTH	DEPTH	REINF
< 6'-0"	8"	8"	2#5 CONT

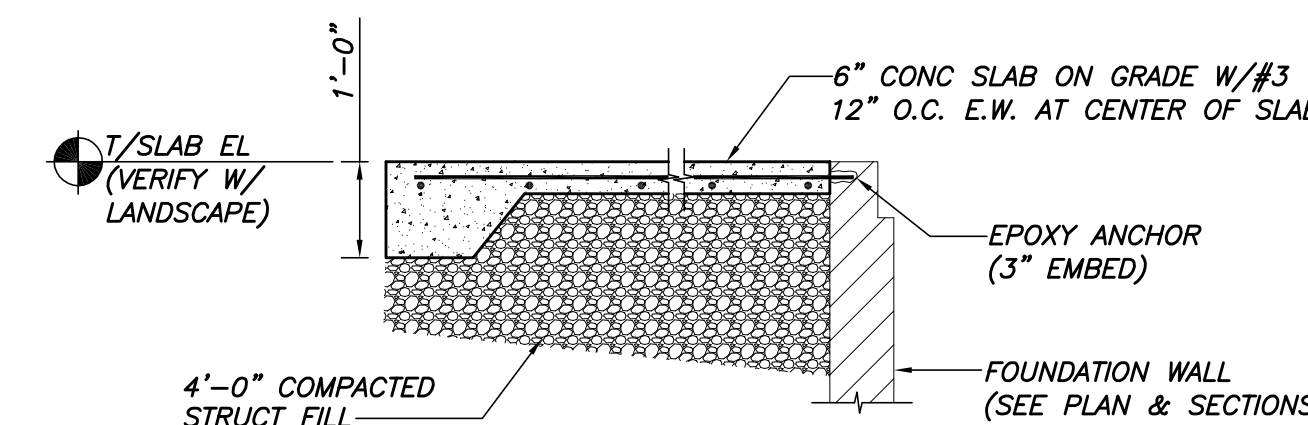

TYP ENTRY SLAB DETAIL  
N.T.S.