
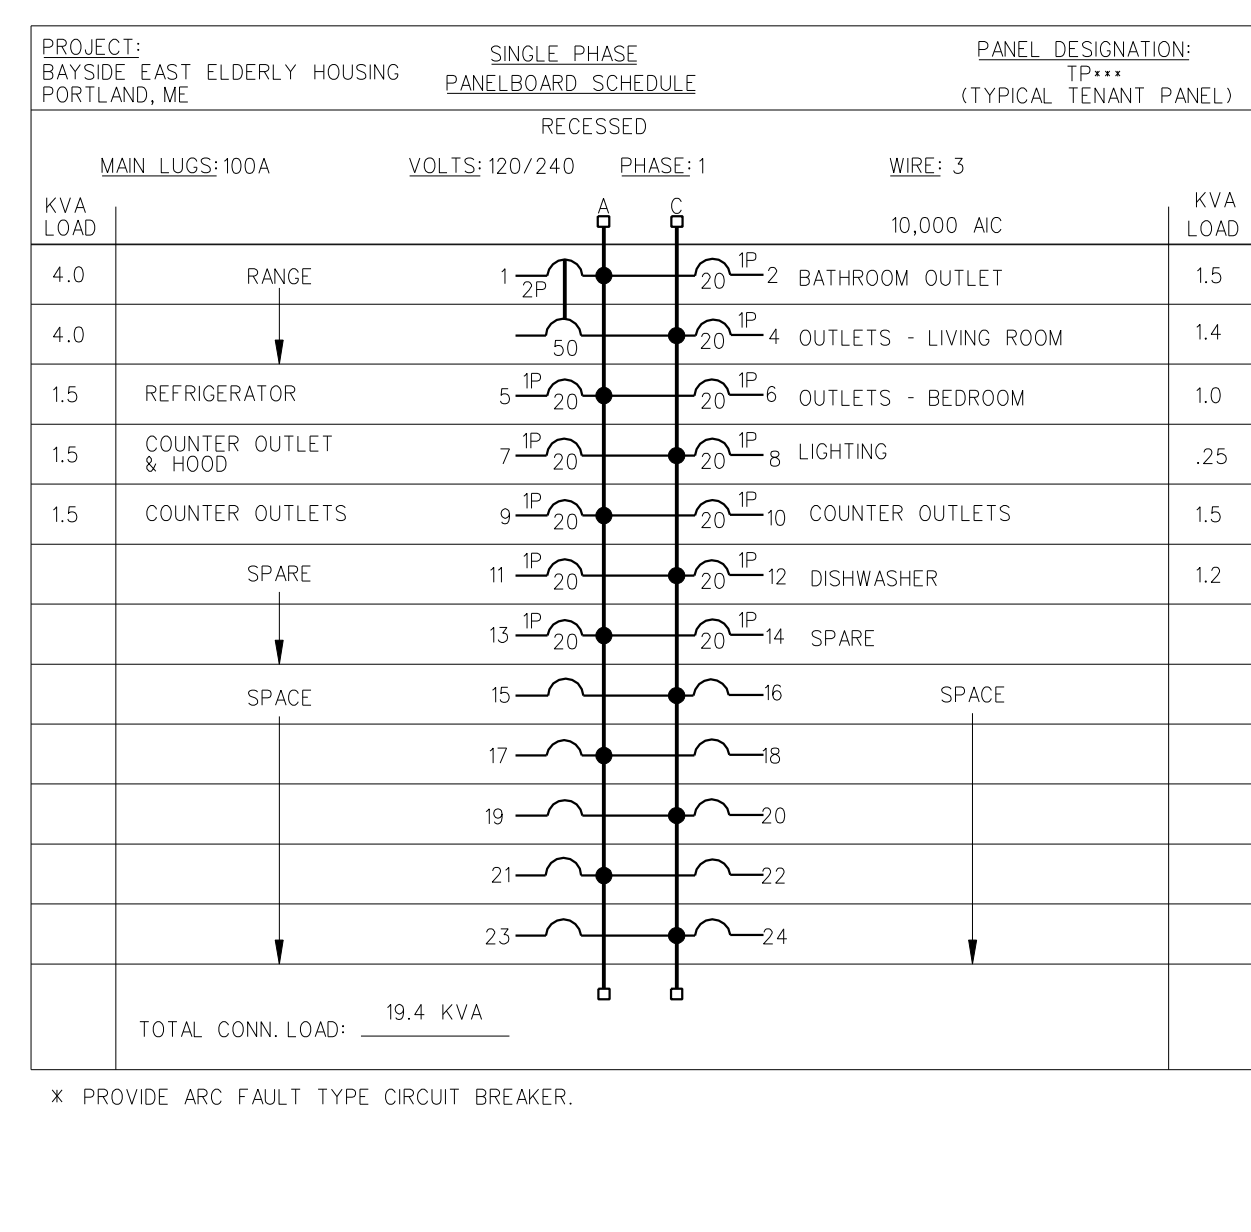
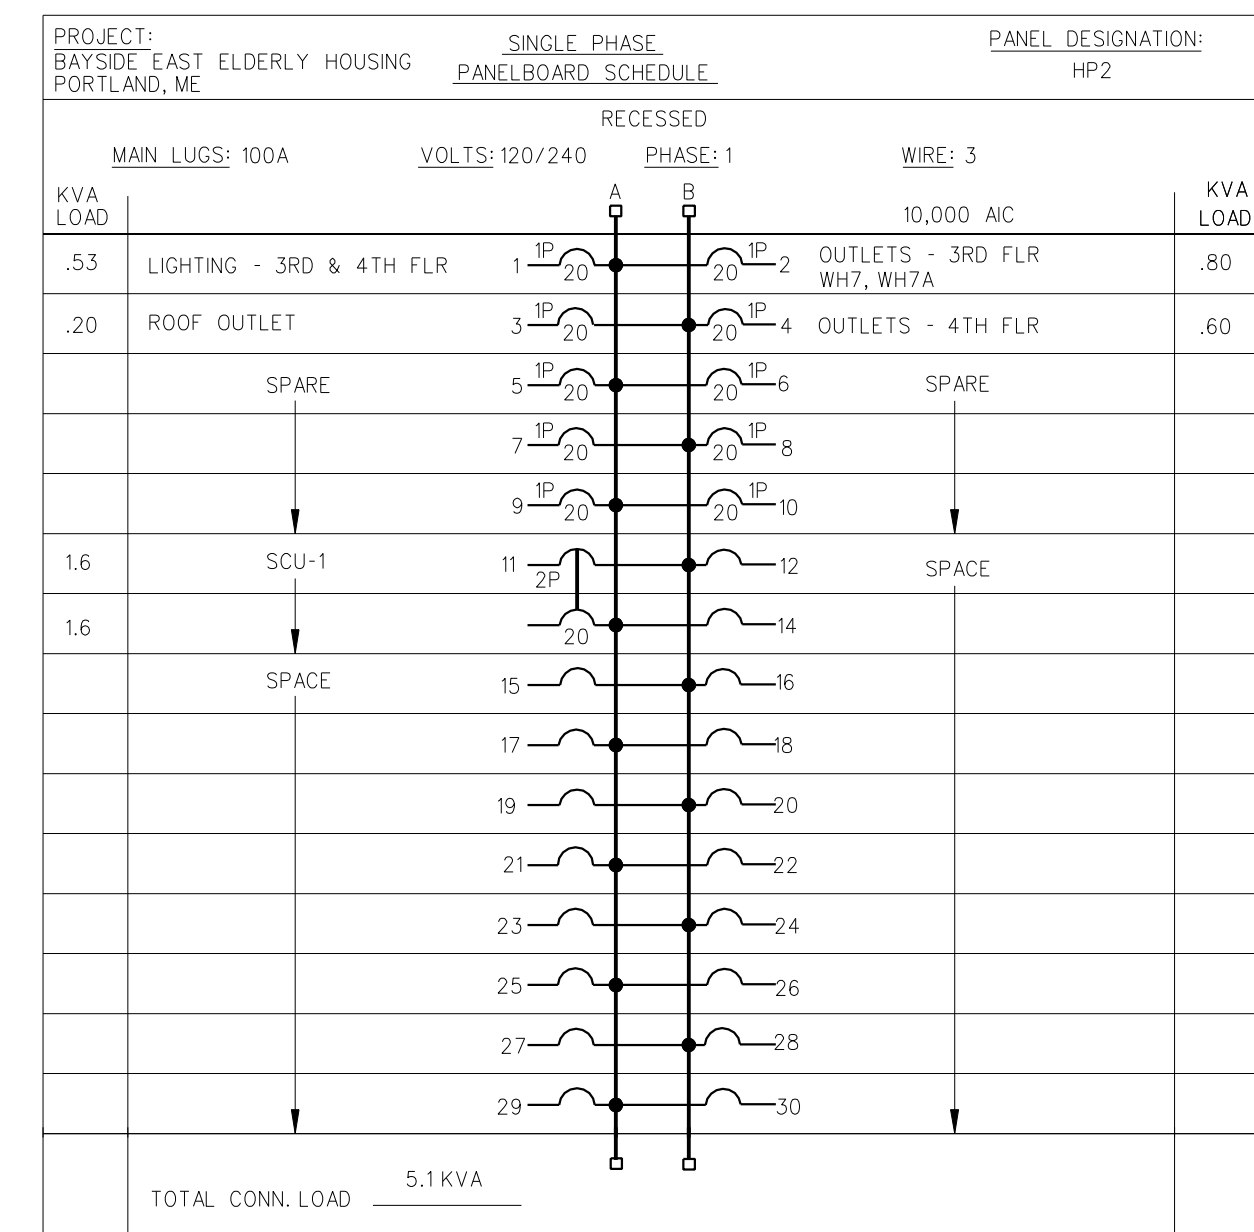
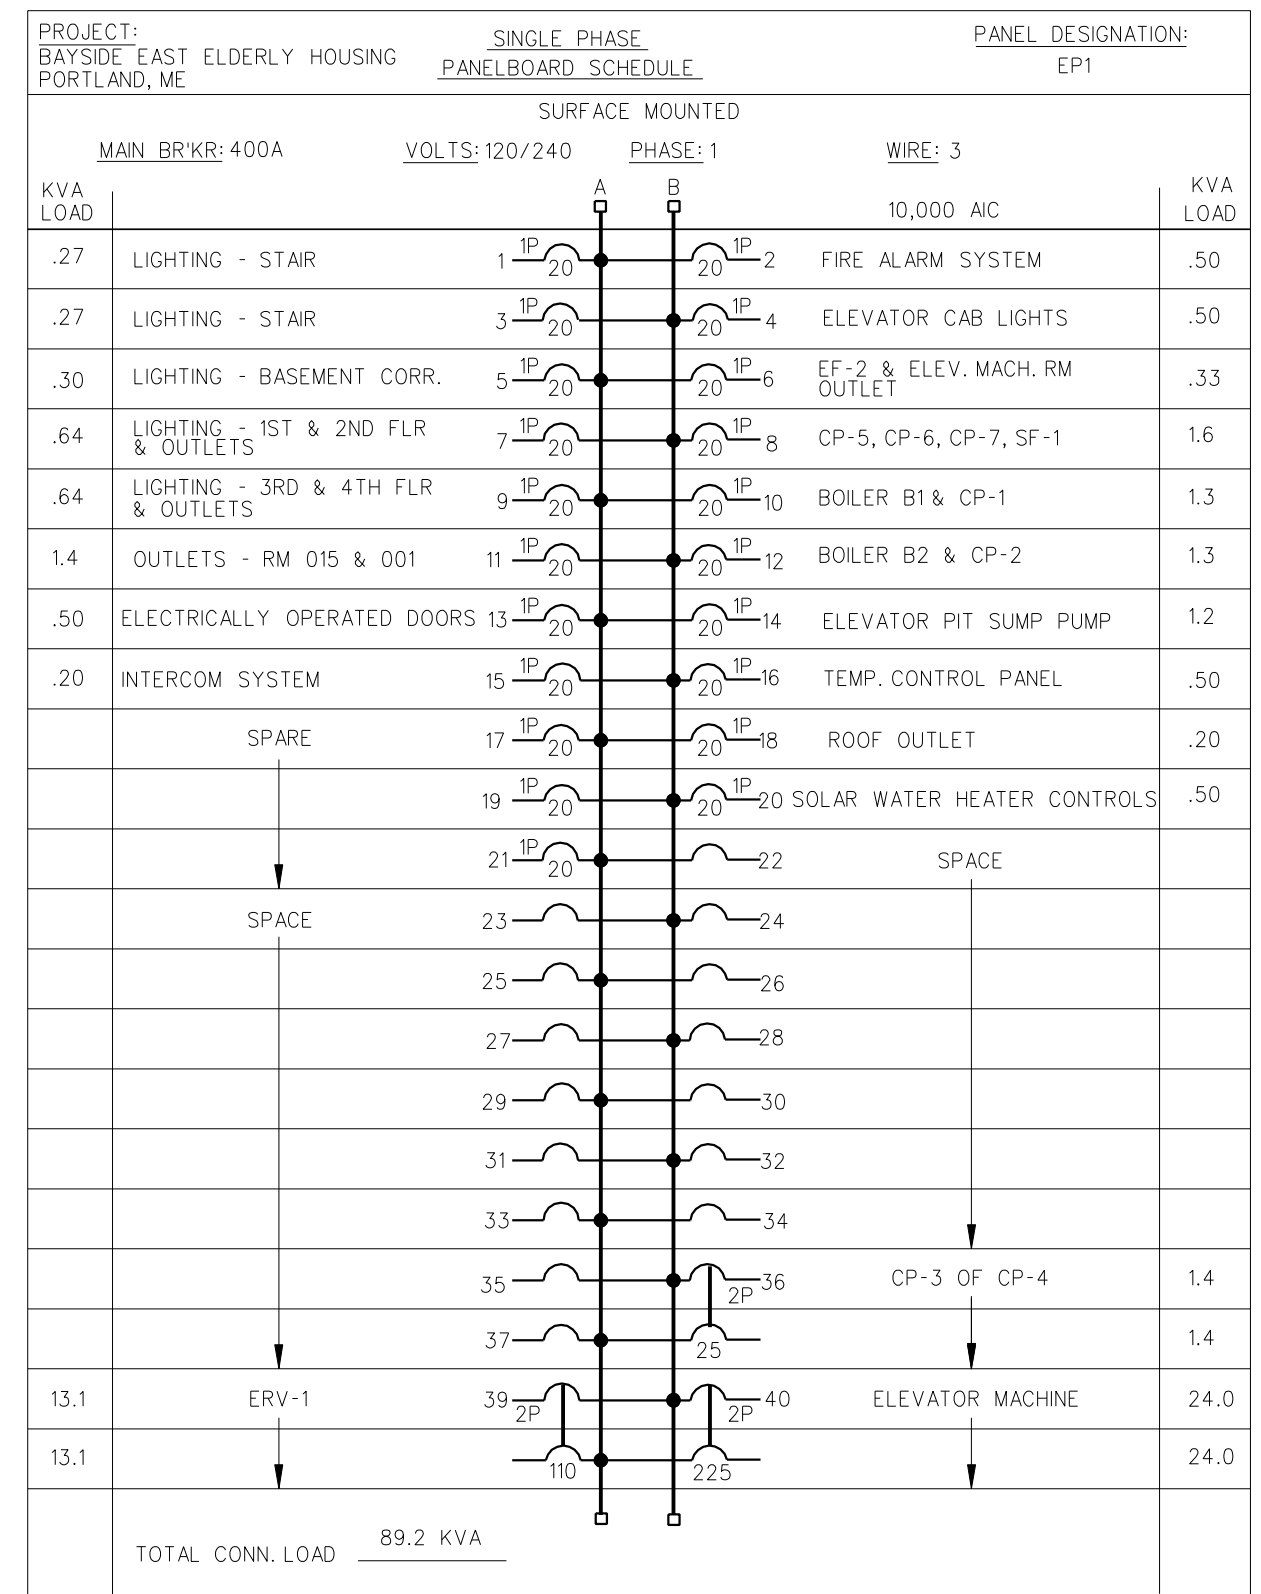
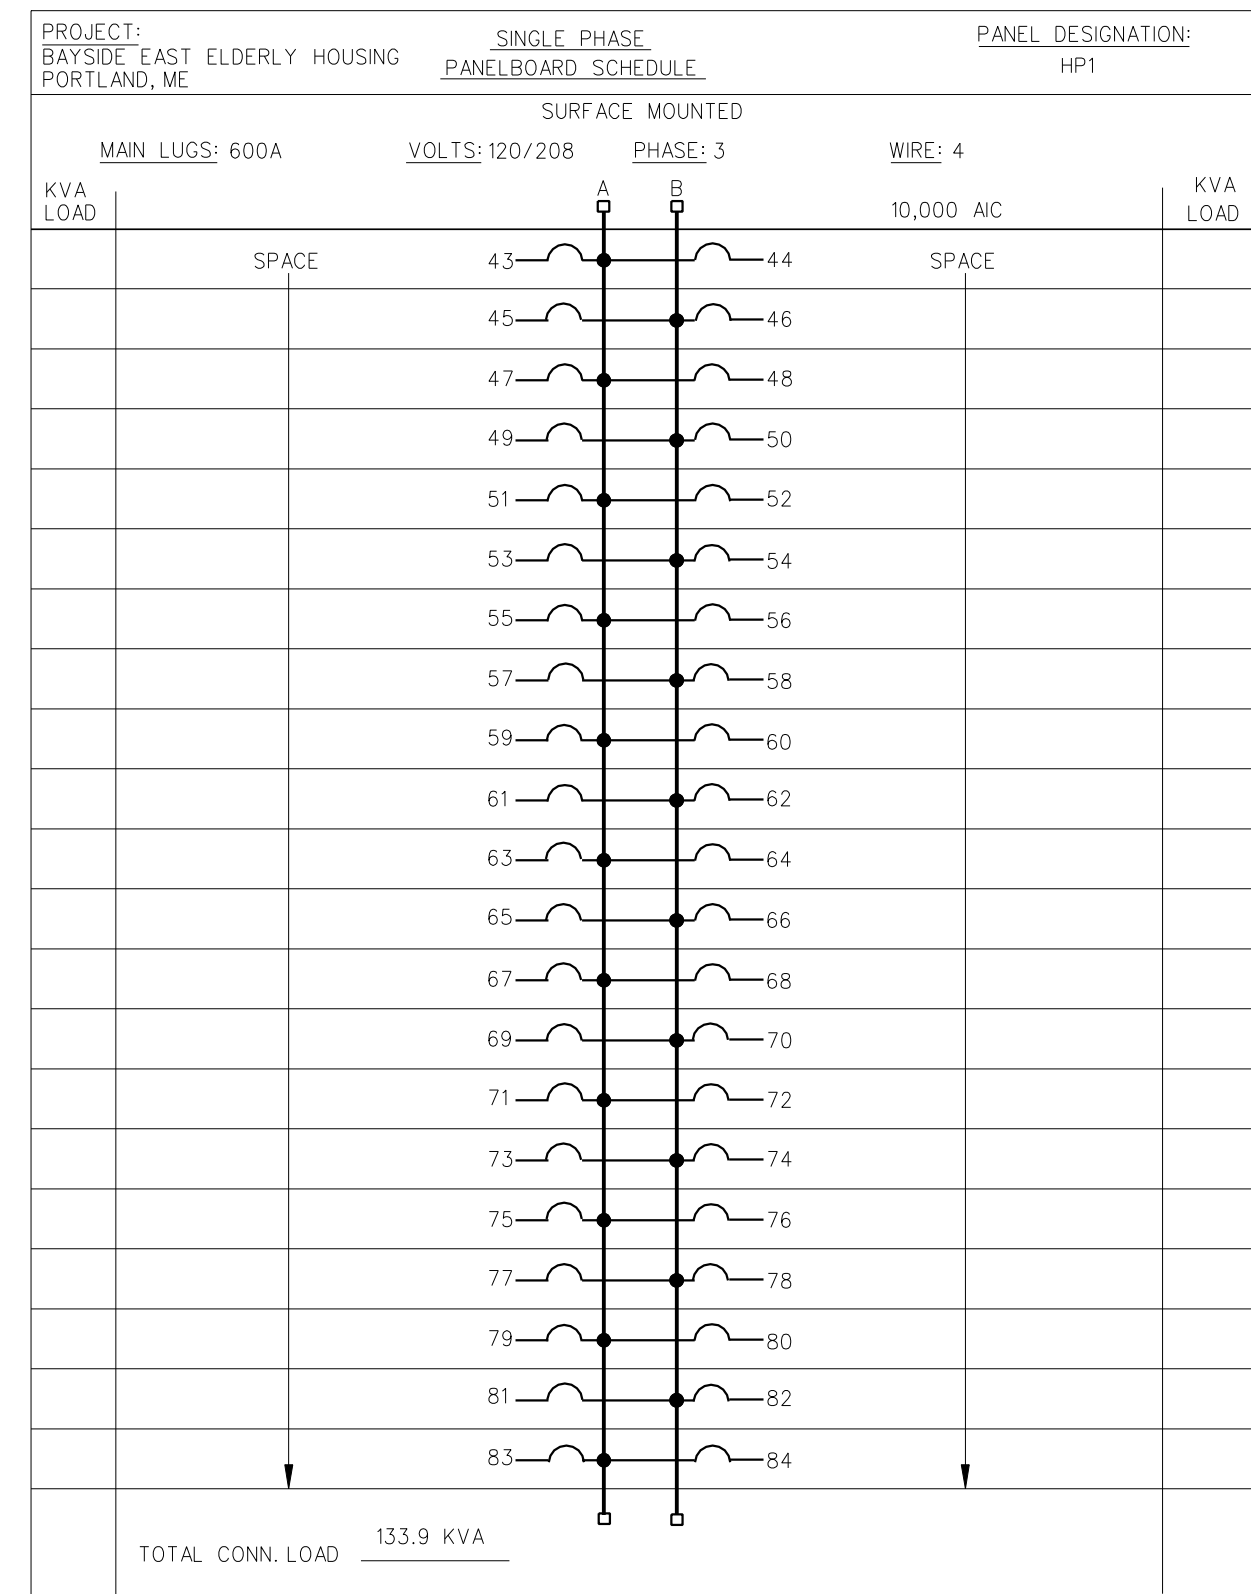


LIGHTING FIXTURE SCHEDULE

TYPE	DESCRIPTION	LAMPS QUANTITY & TYPE	REMARKS
A	PROGRESS *P83-26ICAT, W/ P8075-28 BAFFLE	(1) 26W CF	RECESSED DOWNLIGHT - APARTMENT ENTRY
B	PROGRESS *P3760-09STRWB	(2) 18W CF	SURFACE MOUNT - UNIT DINING AREA
C	PROGRESS *P3765-09STRWB	(2) 13W CF	SURFACE MOUNT - UNIT BEDROOM
D	PROGRESS *P7114-60EB	(2) 17W	WALL MOUNT - UNIT BATHROOM VANITY
E	PROGRESS *P3764-09STRWB	(1) 13W CF	SURFACE MOUNT - UNIT BATHROOM
F	LITHONIA *UC5D8	8W T5	UNDERCABINET LIGHTING
G	PROGRESS *P7114-60EB	(2) 17W	SURFACE MOUNT - UNIT KITCHEN
H	LITHONIA *UC5D14	14W T5	SURFACE MOUNT - BEDROOM CLOSET
J	PROGRESS *P7057-01EBWB	(2) 13W	WALL MOUNTED IN CORRIDOR
K	NOT USED		
L	LITHONIA LF6 1/42TRT F6LS 120	(1) 42W CF	RECESSED LENSED DOWNLIGHT
M	PROGRESS *P7324-13EBWB	(2) 13W CF	SURFACE MOUNT - COMMUNITY ROOM
N	PROGRESS *P7186-30EB	(2) 32W T8	4' STRIP LIGHT
O	LITHONIA *VRE 7TT 120LP1	(1) 7W CF	SURFACE MOUNTED - ROUGH SERVICE
X	LITHONIA *LQM S W 3 R 120/277 EL N	LEDS FURNISHED WITH FIXTURE	LED EXIT SIGN - SINGLE/DOUBLE FACE - END/CEILING/WALL MOUNT

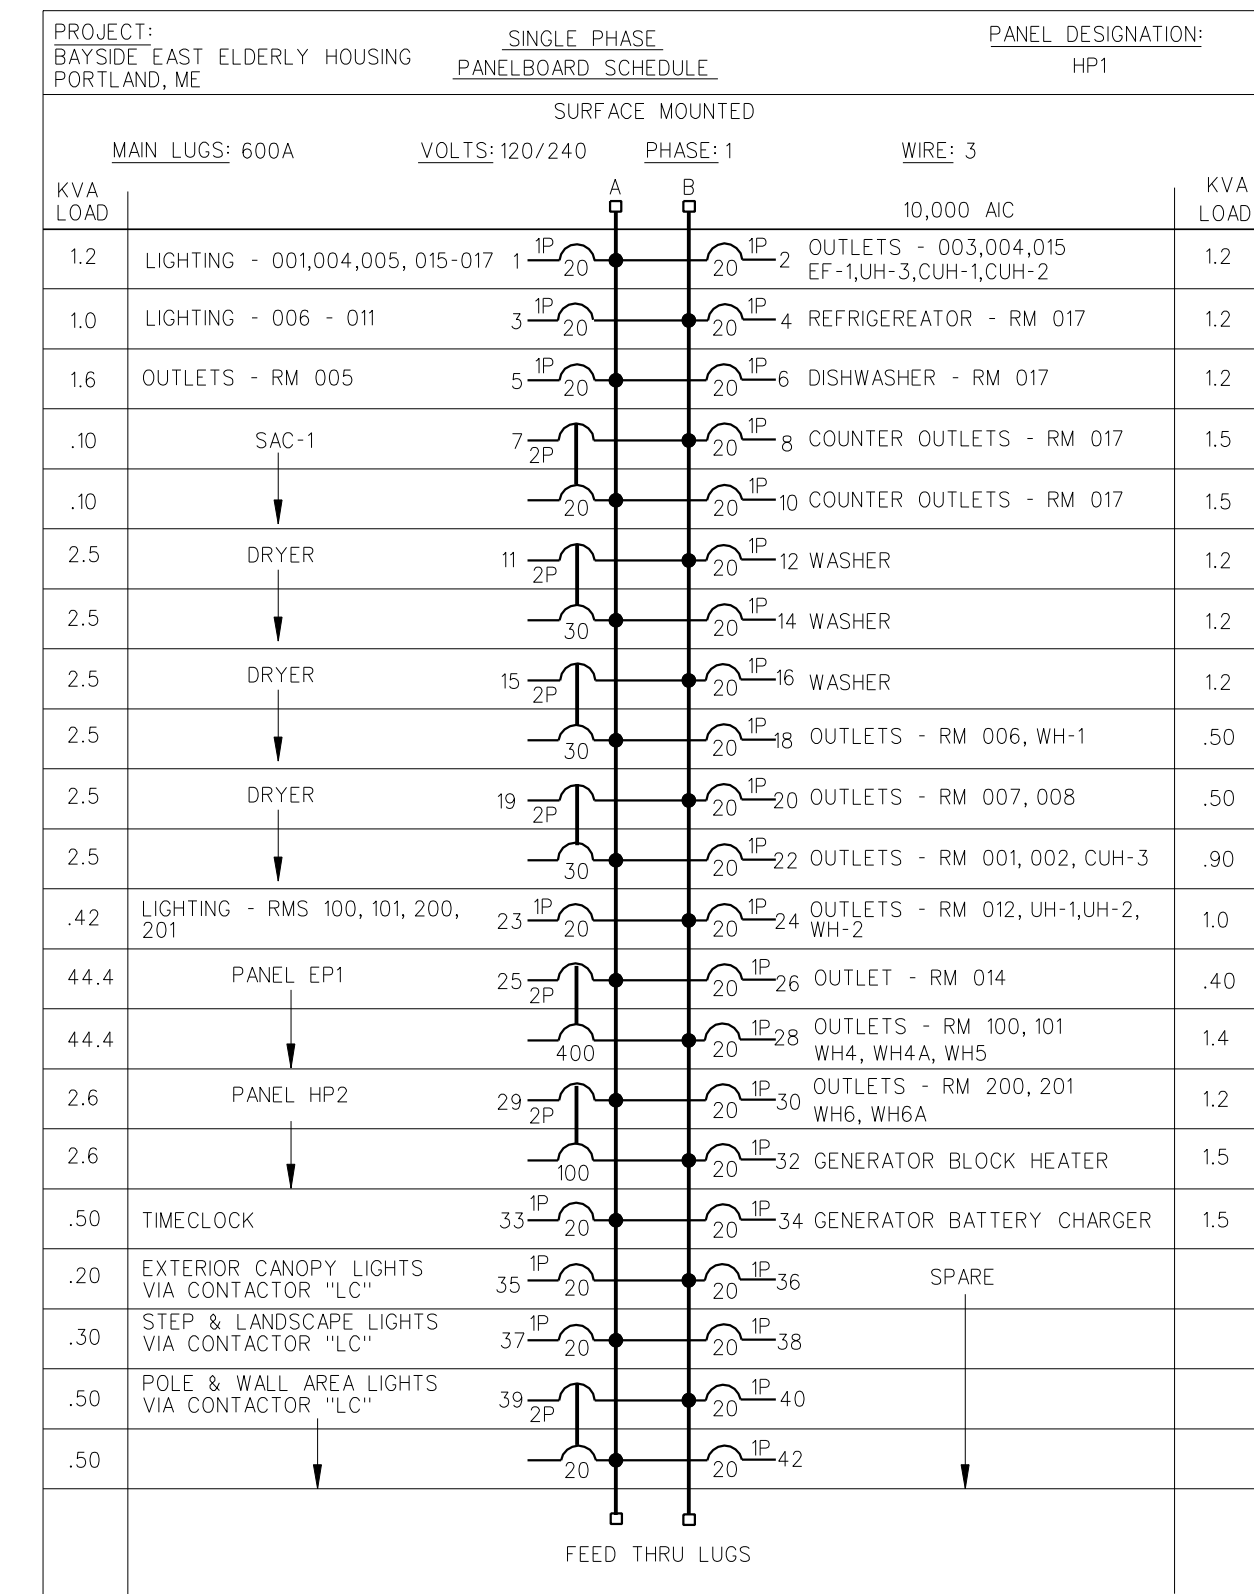

SYMBOL LEGEND

- POWER PANEL, 120/240V, 1PHS, 3WIRE
- LOAD CENTER, 120/240V, 1PHS, 3WIRE
- ELECTRIC MOTOR DRIVEN EQUIPMENT, HP SHOWN
- MANUAL MOTOR STARTER SWITCH WITH THERMAL OVERLOAD DEVICE, MOUNTED AT UNIT
- JUNCTION BOX - "H" DENOTES RANGE HOOD, "DS" DENOTES DISPOSAL, "DW" DENOTES DISHWASHER
- LIGHTING FIXTURES - CAPITAL LETTERS DENOTE TYPE AS PER LIGHTING FIXTURE SCHEDULE, LOWER CASE LETTERS INDICATE SWITCH CONTROL, ADDITIONAL CROSS LINE INDICATES NIGHT LIGHT - UNSWITCHED
- DISCONNECT SWITCH - 250 VOLT - SIZE AND NUMBER OF POLES AS INDICATED ON DRAWING PROVIDED AND INSTALLED BY E.C. - UNLESS OTHERWISE NOTED.
- VARIABLE FREQUENCY DRIVE - PROVIDED BY M.C., INSTALLED AND WIRED BY E.C.
- RACEWAY & WIRING OR MC CABLE RUN CONCEALED IN WALLS/CEILING.
- RACEWAY & WIRING RUN EXPOSED
- RACEWAY & WIRING RUN CONCEALED UNDER FLOOR
- HOME RUN TO PANEL - ARROWS INDICATE QUANTITY OF CIRCUITS - NUMERALS DENOTE CIRCUIT NUMBERS
- SINGLE POLE SWITCH, 120 VOLT, 20 AMP, SPEC GRADE, GROUNDING TYPE "MOUNT 48" AFF, 3-3-WAY, 4-4-WAY, PLOT LOWER CASE LETTER INDICATES FIXTURE OR CONTROLLED LOAD. PILOT LIGHT SWITCHES SHALL BE PROVIDED W/ ENGRAVED NAMEPLATE IDENTIFYING USE.
- BURNER SAFETY SWITCH - PROVIDE WITH RED PLATE - MOUNTED 72" AFF
- SELF CONTAINED EMERGENCY LIGHTING UNIT W/ 2 HEADS - LITHONIA \*ELM2 12WATTS FOR 90 MINUTES, 6V
- EXIT LIGHT FIXTURE - UNSWITCHED - SEE LIGHTING FIXTURE SCHEDULE
- TEMPERATURE CONTROL PANEL - PROVIDED BY M.C. WIRED BY E.C.
- DUPLEX RECEPTACLE - 20A 125V SPEC GRADE GROUNDING TYPE AND MATCHING PLATE - MOUNT 18" AFF. "R" DENOTES REFRIGERATOR.
- SAME AS ABOVE EXCEPT DOUBLE DUPLEX
- DUPLEX RECEPTACLE - 20A 125V SPEC GRADE GROUNDING TYPE AND MATCHING PLATE - MOUNT 18" AFF. BOTTOM RECEPTACLE SWITCHED
- DUPLEX RECEPTACLE - GROUND FAULT OUTLET 20A 125V - WITH MATCHING PLATE FURNISHED W/ OUTLET, FLUSH MOUNTED 45" AFF EXCEPT AS NOTED.
- RANGE OUTLET 50 AMP, 250 VOLT, GROUNDING TYPE FLUSH MOUNTED 18" AFF
- DRYER OUTLET 30 AMP, 250 VOLT, GROUNDING TYPE FLUSH MOUNTED 18" AFF
- FIRE ALARM CONTROL PANEL
- FIRE ALARM REMOTE ANNUNCIATOR - GRAPHIC
- FIRE ALARM AUDIO/VISUAL MOUNT 6'-8" AFF - NUMERAL DENOTES CANDELA RATING "WF" DENOTES W/FORM.
- FIRE ALARM VISUAL STROBE ONLY - FLUSH MOUNT 6'-8" AFF NUMERALS DENOTE CANDELA RATINGS.
- SYSTEM CONNECTED FIXED TEMPERATURE HEAT DETECTOR
- SMOKE DETECTOR, PHOTOELECTRIC TYPE - SYSTEM CONNECTED. "ER" - ELEV. RECALL
- SYSTEM CONNECTED SMOKE DETECTOR, PHOTOELECTRIC TYPE - W/ STROBE. "SB" DENOTES SOUNDER BASE.
- SPRINKLER TAMPER SWITCH - PROVIDED BY SPRINKLER CONTRACTOR WIRED BY E.C.
- SPRINKLER FLOW SWITCH - VERIFY LOCATION WITH SPRINKLER CONTRACTOR
- DUCT SMOKE DETECTOR & TEST STATION
- FIRE ALARM PULL STATION - MOUNT 48" AFF
- DOOR RELEASE
- CABLE TV ENTRANCE BOX
- TV OUTLET LOCATION - CABLE AND JACKS BY E.C. - INTERCONNECT ALL LOCATIONS WITHIN EACH UNIT WITH (1) HOMERUN OF RG6 BACK TO TBB.
- TELEPHONE/DATA DUAL JACK LOCATION MOUNT 18" AFF - TWO CAT 5 CABLES BACK TO TBB.
- TELEPHONE JACK LOCATION MOUNT 18" AFF - ONE CAT 5 CABLE BACK TO TBB. "W" DENOTES WALL MOUNTED AT 45" AFF.
- PHOTOCELL
- LIGHTING CONTACTOR
- TIME CLOCK
- INTERCOM PANEL IN UNIT
- INTERCOM PANEL AT ENTRANCE
- PADLE SWITCH FOR ELECTRICALLY OPERATED DOOR - FURN. W/ DOOR OPERATOR - WIRED BY E.C.
- DOOR CHIME
- DOOR PUSHBUTTON
- WEATHERPROOF
- MOTION SENSOR (WATTSTOPPER OR EQUAL) CORRIDORS: WT-225S SENSOR & B120E-P POWER PACK OTHER COMMON SPACES: WT-605 SENSOR & B120E-P POWER PACK
- PROXY READER

© 2007 TFH ARCHITECTS

**BAYSIDE EAST**  
PROPOSED ELDERLY HOUSING  
47 SMITH STREET, PORTLAND  
FOR BAYSIDE EAST LP

**TFH ARCHITECTS**  
100 COMMERCIAL STREET  
PORTLAND MAINE 04101  
TELEPHONE 207 775 6141  
ARCHITECTURE PLANNING

CONSULTANTS:  
**BENNETT ENGINEERING**  
CONSULTING ENGINEERS  
1200 BAYVIEW AVENUE  
PORTLAND, MAINE 04106  
TEL: 207 775 6141

REVISIONS:

DATE: MAY 18, 2007


PROJECT No. 0514

DRAWN BY: SPD

CHECKED BY: CWA

SCALE: AS NOTED

SHEET TITLE:  
ELECTRICAL  
DETAILS, LEGEND  
AND SCHEDULES

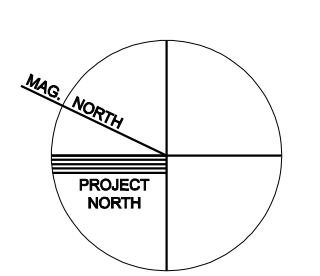

E3.1