

PROJECT SUMMARY:

THE PROJECT SCOPE INCLUDES THE DESIGN, SPECIFICATION, PROCUREMENT, INSTALLATION AND COMMISSIONING OF A COMPLETE, TURN-KEY, GRID-TIED PHOTOVOLTAIC ELECTRIC SYSTEM.


MODULE TYPE	(13) Q CELL Q.PEAK-G4.1 305
INVERTER	(1) SE3800H-US
OPTIMIZER	(13) SOLAREEDGE P320
ARRAY PITCH	34°
ARRAY AZIMUTH	140°
RACKING	IRONRIDGE XRI00 ALUMINUM RAIL
ROOF ATTACHMENT	ALUMINUM L-FEET WITH SS LAG SCREWS, 3 X5/16 WITH ECOFASTEN FLASHED ROOF ATTACHMENT KITS

DESIGN CRITERIA:


OCCUPANCY	RESIDENTIAL
DESIGN WIND LOAD	100 MPH
RISK CATEGORY	I
GROUND SNOW LOAD	60 PSF
EXPOSURE CATEGORY	C
ROOF HEIGHT	20' ABOVE GRADE TO EAVES
ROOF COMPOSITION	ASPHALT SHINGLES
RAFTER	3"X4" ROUGH CUT
RAFTER SPACING	16-18" O.C.

EQUIPMENT LOCATIONS:

- SUPPLY SIDE DISCONNECT LOCATED IN BASEMENT NEXT TO THE MAIN PANEL
- INVERTER LOCATED IN THE BASEMENT TO THE LEFT OF THE ELECTRICAL PANELS

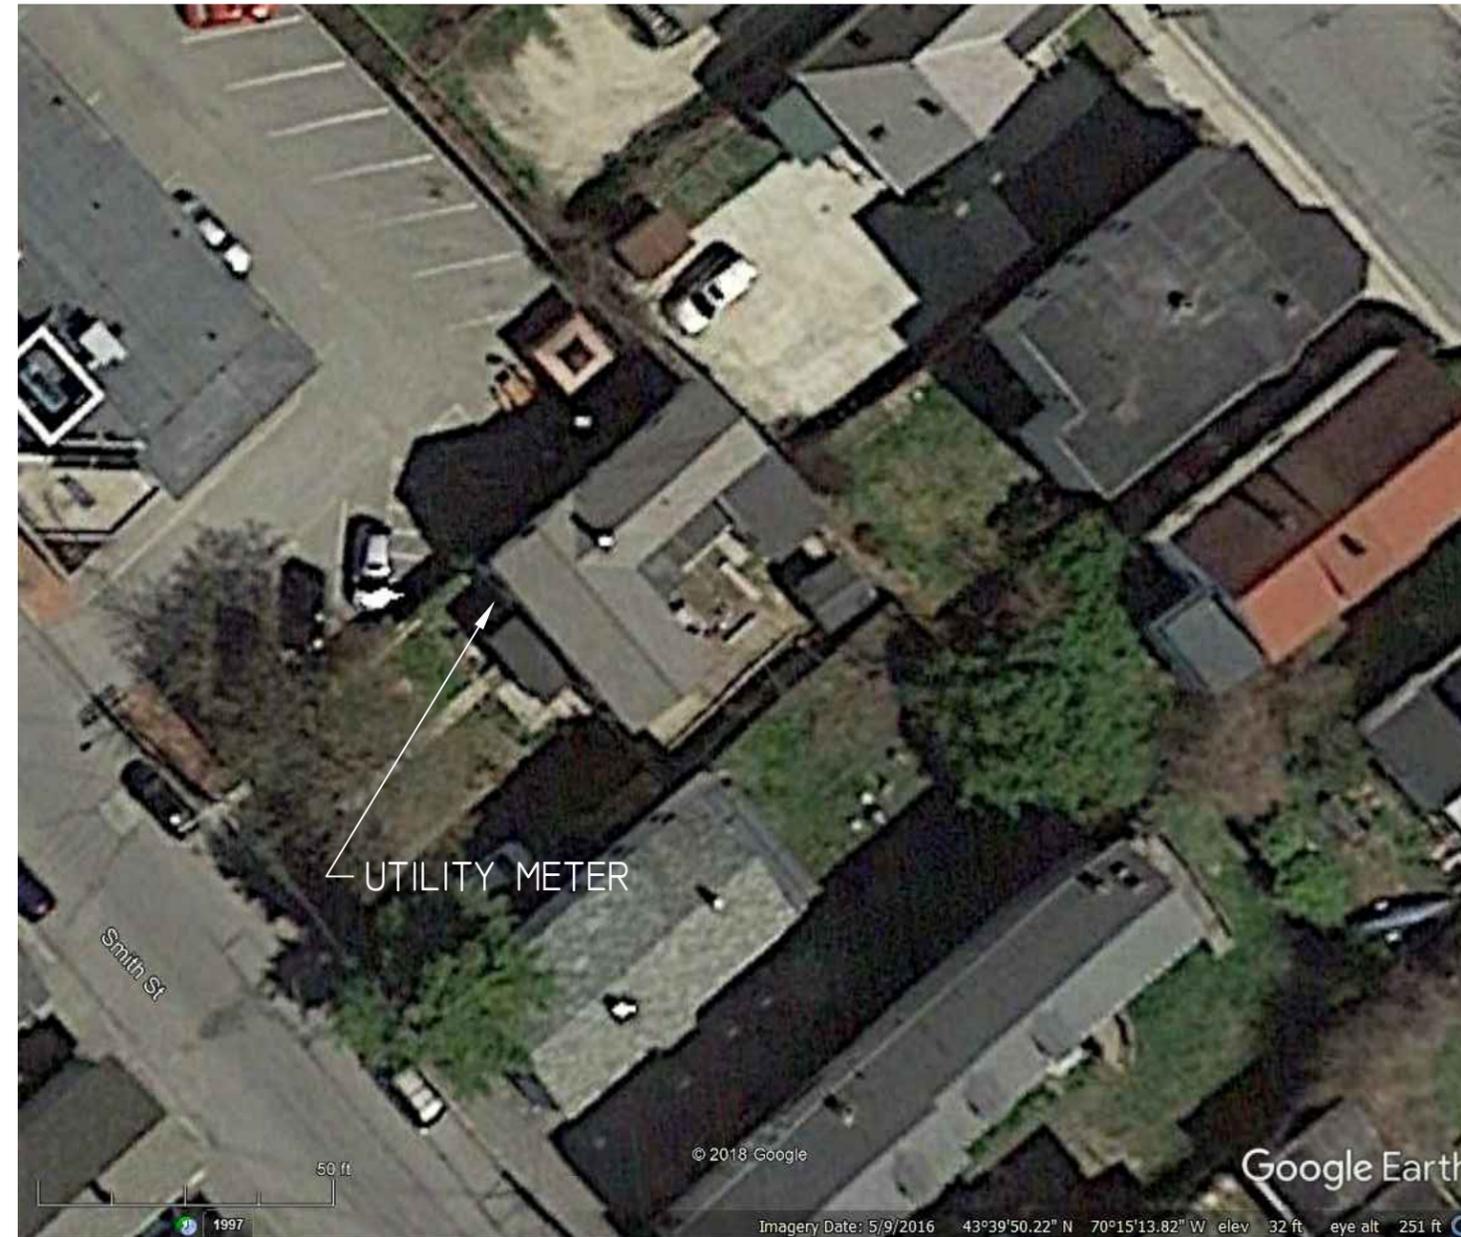

Inspections Division
Date: 03/22/18

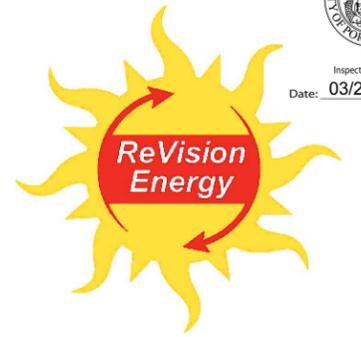

142 PRESUMSCOT STREET
PORTLAND, ME 04103
(207)-221-6342

CLIENT:

CHRISTIAN MILNEIL
45 SMITH STREET
PORTLAND MAINE, 04101

SYSTEM TYPE:

3.965KWDC SOLAR
PHOTOVOLTAIC SYSTEM

DESIGNED BY: GJD
REVISION: 0
PRINT SIZE: 11" X 17"
DATE: 2/28/2018

DWG TITLE:

SITE PLAN

DWG NUMBER:

A001

© COPYRIGHT REVISION ENERGY

THIS DIAGRAM IS PROVIDED AS A SERVICE AND IS BASED ON THE UNDERSTANDING OF THE INFORMATION SUPPLIED. IT IS SUBJECT TO CHANGE BASED ON ACTUAL CONDITIONS, APPLICABLE EDITION OF THE NATIONAL ELECTRIC CODE, AND LOCAL GOVERNMENTAL AUTHORITIES.