



18 - CD29D1 - 3

# Installer's Guide

## Upflow/ Horizontal, Downflow/ Horizontal, Gas-Fired, Direct Vent Condensing Furnaces

- \*UH1B040A9241A      \*UH1C100A9481A      \*DH1B040A9241A
- \*UH1B060A9361A      \*UH1D100A9601A      \*DH1B065A9421A
- \*UH1B080A9421A      \*UH1D120A9601A      \*DH1C085A9481A
- \*UH1C080A9601A


\*...First letter may be "A" or "T"

ALL phases of this installation must comply with NATIONAL, STATE AND LOCAL CODES


**IMPORTANT** — This Document is customer property and is to remain with this unit. Please return to service information pack upon completion of work.




\*UH1

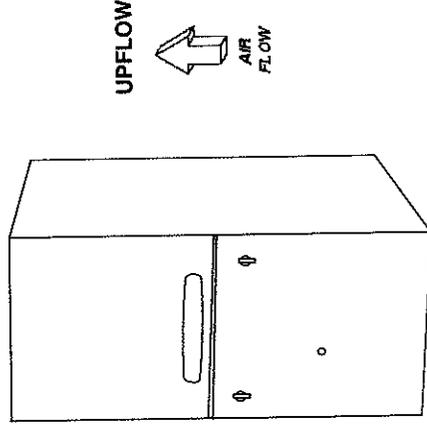


\*DH1

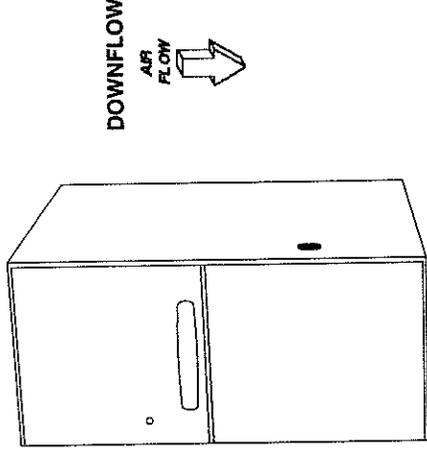

\*UH1

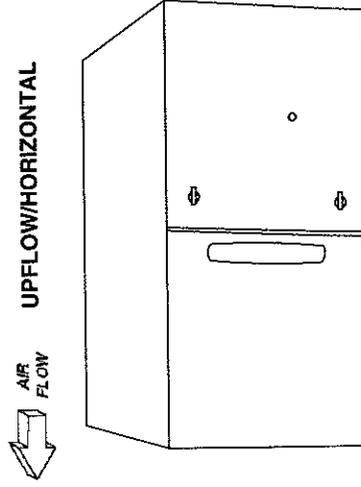

\*DH1

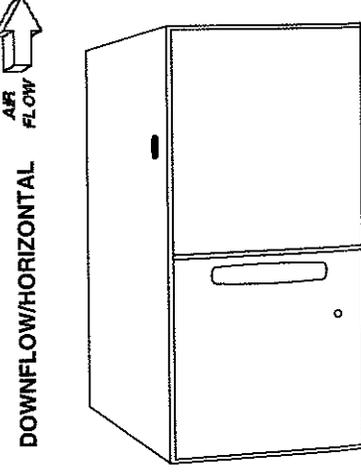

A341624P13