


STORMWATER MANAGEMENT **REPORT**

Prepared For:

Redfern Properties, LLC
70 Anderson Redevelopment
70 Anderson Street
Portland, Maine 04101

Prepared By:

Acorn Engineering, Inc.
158 Danforth Street
Portland, Maine 04102

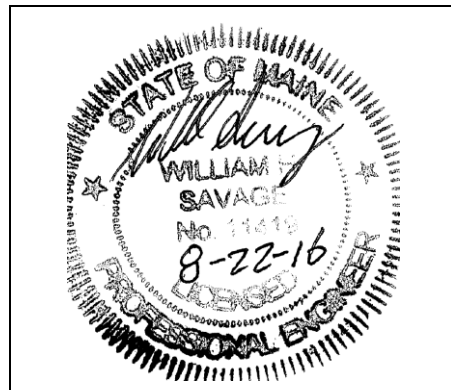

April 2016
Rev. August 2016

INTRODUCTION

Acorn Engineering, Inc. has been retained by Redfern Properties, LLC to provide civil engineering services for the proposed redevelopment of 70 Anderson Street (1 East Lancaster Street). The proposed project is to develop an existing single family residence into ten townhouses.

A stormwater analysis will be prepared to demonstrate that the project will meet the following requirements of the City of Portland (the City):

- City of Portland Land Use Ordinance Chapter 14, Article V. Site Plan Section 14-523. Required Approvals and Applicability (F) Level III Site Plan Review.
- City of Portland Technical Manual – Section 5 – Portland Stormwater Management Standards and Maine DEP Chapter 500 Stormwater Management.

The proposed project will include the redevelopment of existing, impervious area including rooftops, and paved asphalt and concrete driveways. The project will result in a net increase of impervious area above 1,000 sf, as such, is required to include stormwater management features for stormwater quality & quantity control. The stormwater analysis is documented with supporting calculations and reports attached to this narrative.

The current course of action is to provide primary water quality treatment to the stormwater through filtration utilizing a Maine Department of Environmental Protection – Rain Garden (Bioretention Cell) and Roof Dripline Filtration approved stormwater Best Management Practice (BMP); for the remainder of this report, ‘Rain Garden’ will be used in place of ‘Bioretention Cell’. The implemented BMPs are to provide water quality treatment for no less than 95% of the new impervious area and 80% of the developed area.

EXISTING CONDITIONS

The proposed project site is located on the corner of Anderson and East Lancaster Street within the East Bayside neighborhood. A boundary plan has been prepared by Titcomb Associates of Falmouth, Maine dated January 14th, 2016.

Abutting Uses:

- | | | |
|---------|----------|--------------------------|
| ➤ North | R-6 Zone | Multi-Family Residential |
| ➤ West | R-6 Zone | Multi-Family Residential |
| ➤ South | R-6 Zone | Multi-Family Residential |
| ➤ East | R-6 Zone | Multi-Family Residential |

The property is also near a recreation open space, Kennedy Park (Cunningham Playground), that is due west of the property.

About half of the property is currently covered by impervious surfaces including two bituminous driveways from Anderson and East Lancaster Street (a portion of the East Lancaster driveway is concrete), a 1.5 story dwelling, a detached garage, and covered shed. The remaining surface is a grassy lawn. The site as a whole is relatively flat with an average

grade of approximately 3% sloping to the rear of the property. Based on existing conditions, the stormwater runoff is directed to the westernmost corner of the site and eventually enters the Fox Street municipal stormwater system.

The project team is not aware of the presence of any existing significant natural features located on the site. Given the urban setting, and existing free-draining soils, a field inventory of significant natural feature was not undertaken. The project is not located within a watershed classified as an Urban Impaired Stream.

PROPOSED DEVELOPMENT

The proposed project is a 10-unit redevelopment of an existing single-family lot. The new ten units will be orientated as such to create a courtyard and central walking space through the property. Within the courtyard, a Rain Garden is proposed as a central focus on stormwater mitigation on site and will be landscaped with perennials, shrubs and trees as designed Soren Denoird Design Studio. The side setback along the abandoned paper street, Anderson Lane, is to be partially vegetated and contain the proposed Roof Dripline Filtration BMP. The final landscaping design has been provided by Soren Denoird Design Studio.

Tenant parking is to be provided on-site with a driveway access from East Lancaster Street. Pedestrian access to the site shall be provided off of Anderson Street into the central courtyard and via East Lancaster Street along the parking area.

The development will be served by the Portland Water District, underground power/cable/communications, and the municipal sewer system. The project anticipates incorporating Maine DEP approved stormwater Best Management Practices to meet the General and Flooding Standards.

GENERAL STANDARDS - WATER QUALITY

The Roof Dripline Filtration system and the Rain Garden was sized to meet or exceed to the requirements set forth within the MDEP Volume III BMPs Technical Design Manual, Chapter 7.6 and 7.2 respectively. Filter BMP systems have shown to be effective at filtering out and removing a wide range of pollutants from stormwater runoff.

Impervious Treatment Area

The majority of the impervious runoff is from the roof and 30% of all roof stormwater runoff shall be redirected into the Roof Dripline BMP. The water will then filter through a series of permeable layers before exfiltrating into the ground below the system. All runoff not exiting the BMP will be transported to the municipal stormwater system within Anderson Street via a perforated distribution pipe; the pipe is positioned within the BMP as such to act as the foundation drain as well.

The remaining impervious runoff to be treated shall be redirected into the Rain Garden within the courtyard. This runoff includes that redirected from a portion of the rooftops as well as the internal brick sidewalks and shall flow into the rain garden whose plants and storage area shall provide initial treatment. The stormwater is to be detained above the

surface before flowing vertically through the permeable soil filter layer before exfiltrating into the ground below. All remaining treated stormwater not dispersed into the ground, shall then be collected within perforated pipes and released slowly by the outlet control at an attenuated rate. Larger storm events are to overflow into an oversized horizontal atrium grate.

The treatment of the impervious surface by the BMPs are as follows:

Table 1 - Impervious Treatment Area Table					
	Existing Impervious Area (SF)	Proposed Total Impervious Area (SF)	Net change in Impervious Area (SF)	Proposed Impervious Area with Treatment (SF)	% Overall New Imp. Area Treated
Roof Dripline				1260	
Rain Garden				2207	
TOTAL	4376	7236	2860	3467	121%

As shown above the project anticipates meeting and exceeding the required treatment for new impervious surfaces through the use of the filter BMPs.

Rain Garden Calculations

According to the requirements for a rain garden as defined in the Volume III: BMPs Technical Design Manual, Chapter 7.2, the surface area of the filter shall be no less than the sum of 7% of the tributary impervious area and 3% of the tributary vegetated area. The filter area is calculated by the following formula:

$$[(\text{Imp. SF} \times 0.07) + (\text{Veg. SF} \times 0.03)] = \text{Filter Area (SF)}$$

Please refer to Table 2 below.

Table 2 – Total Filter Surface Area, displays the proposed Rain Garden sizing requirements, actual size and the percentage of required area.

Table 2 -Total Filter Surface Area			
	Required Filter Area (SF)	Actual Filter Area (SF)	Percentage of Required Area (%)
Rain Garden	172	275	160%

The outflow from the Rain Garden is then tributary to the municipal stormwater system. As shown, the size of the soil filter area will meet and exceed the surface area requirements. Values from the HydroCAD calculations attached to this report.

Water Quality Volume

In accordance with the Volume III: BMPs Technical Design Manual, a water quality volume of 1.0 inch times the tributary impervious area plus 0.4 inch times the tributary landscaped developed area is required to be treated by the Roof Dripline and Rain Garden. The water quality volume is calculated by the following formula:

$$\left(\frac{\text{Imp. SF} \times 1.0''}{12''/1'} \right) + \left(\frac{\text{Dist. SF} \times 0.4''}{12''/1'} \right) = \text{Treatment Volume (CF)}$$

The proposed water quality volume is as follows:

Table 4 - Water Quality Volume Table				
	Developed Area (SF)	Impervious Area (SF)	Treatment Volume Required (CF)	Treatment Volume Provided
Roof Dripline	596	1,260	125	126
Rain Garden	569	2,207	203	431
Total	1,165	3,467	328	557

As shown, the size of the combined water quality volume will meet and exceed the treatment volume requirements. Values from the HydroCAD calculations are attached to this report.

HydroCAD Adjustments

A simulation water quality outlet (vertical orifice) is modeled to mimic the minimum 24-hour release time through the soil filter media. This is completed by adjusting the rainfall amount in HydroCAD until the inflow volume is equal to or greater than the calculated treatment volume. The storm events are modeled as type III, 24-hour storm events in HydroCAD.

A vertical orifice is then modeled in HydroCAD at the outlet structures of each BMP. The simulation orifice diameter is sized to mimic the percolation rate through the soil filter media, a physical orifice is not proposed.

FLOODING STANDARD – WATER QUANTITY

The proposed project was modeled using HydroCAD to verify that the post-development conditions do not exceed the pre-development conditions. A 24-hour SCS Type III storm distribution for the 2, 10, and 25-year storm events were used. The corresponding rainfall amounts for these storms are 3.10", 4.60", and 5.80" respectively. Rainfall amounts are from the Northeast Regional Climate Center website (<http://precip.eas.cornell.edu>), Extreme Precipitation Tables.

Both the pre and post-development conditions were modelled so that all runoff would enter the Fox Street municipal stormwater system. This assumption is based on the existing grades sloping downward from the property, Anderson Street, and East Lancaster towards Fox

Street and allows the two conditions and their corresponding peak flows to be compared directly.

Due to the numerous variables, and inherent inaccuracies with the modeling program used to calculate stormwater runoff it is custom at Acorn Engineering, Inc. to round to the nearest whole number or to the nearest tenth for urban infill project. Due to the small size of the project the stormwater runoff shall be rounded to the nearest tenth of a cubic foot per second (cfs).

Time of Concentration (T_c)

A time of concentration (T_c) of 5 minutes was applied to the subcatchment for both the pre and post-development condition, given the urban setting.

Curve Number

Conservative curve number (CN) runoff values were used within the subcatchment for the landscaped area. The stormwater calculations used the following CN values in the post development condition for vegetated areas, as follows:

- Woods/Grass Combination Good

Given the landscaping plan is to design a densely planted perennial gardens within the rain garden and street frontages, the Woods/Grass Combination was deemed an appropriate CN value for the projected portion of the project area to receive such landscaping. The remaining landscaping along the side setbacks to be mostly grass covered.

Pre-development Calculations

The pre-development condition was modeled as one subcatchment to determine the net impact of the development.

- Subcatchment 1 – The subcatchment area is defined by the property line to the corner of Anderson and East Lancaster Street

A Pre-Development Watershed Map developed for this project can be viewed in Attachment A, and a copy of the HydroCAD calculations is included within Attachment C, or this report. Peak flow rates for the storm events are as follows:

Drainage Area	2 – Year Storm Event (cfs)	10 – Year Storm Event (cfs)	25 – Year Storm Event (cfs)
Fox Street	0.2	0.5	0.7

Post-development Calculations:

The one predevelopment subcatchment was broken into four separate subcatchments for the post-development condition.

- Subcatchment 1 – Northernmost roof surface and landscaped area along the side setback
- Subcatchment 2 – Central most roof surfaces, courtyard brick sidewalks, and landscaped area within the rain garden
- Subcatchment 3 – Southernmost roof surface, paved parking, remaining brick sidewalk surface, retaining wall, transformer area, and landscaped areas along the East Lancaster Street frontage and rear setback
- Subcatchment 4 – Landscaped area and entrance steps along the Anderson Street frontage

The post development calculations include changes to the land use and compensation provided by the BMP systems. The following table represents comparison of predevelopment and post-development condition peak runoff rates for the proposed development and tributary area.

Drainage Area	2 – Year Storm Event (cfs)		10 – Year Storm Event (cfs)		25 – Year Storm Event (cfs)	
	Pre	Post	Pre	Post	Pre	Post
Fox Street	0.22	0.26	0.5	0.4	0.7	0.6

As shown in Table 5 the net impact of the post development peak flows shall remain below the predevelopment levels for the ten and twenty-five-year storm. The net change between the pre and post-development flows for the two-year storm was 0.04 cubic feet per gallon. Given that it is a standard of care to round to the nearest whole number and the analysis was completed to the tenth of a cubic foot due to the small project scope, this net change, though greater, is de minimis.

A Post-Development Watershed Map created for this project can be viewed in Attachment B, and a copy of the HydroCAD calculations is included within Attachment C of this report.

SOILS

Onsite soil information includes the following:

- Soil Conservation Service Medium Intensity Soil Survey for Cumberland County

Typical of the East End of Portland the Soil Survey list, Deerfield and Hinckley are the existing onsite soil series. The Deerfield series is composed of deep, moderately well drained soils while the Hinckley series consists of very deep, excessively drained soils; both are formed in glaciofluvial materials. The permeability of Deerfield and Hinckley soil is rapid in the surface layer and subsoil and very rapid in the substratum with typically a low groundwater table. Given the soils information, listed above, no onsite wastewater is

proposed, the applicant does not intend to perform a more intense hydric soil boundary delineation or permeability test because the waiver requirements set forth in the City of Portland Technical Manual – Section 7 – Soil Survey, Rev. 6/17/12 are met. Acorn has used the conservative exfiltration rate of 2.41 in/hr when modeling the roof dripline and rain garden in HydroCAD.

The area within and surrounding the project includes soils types listed in the table below. The susceptibility of soils to erosion is indicated on a relative “K” scale of values over a range of 0.02 to 0.69. Higher “K” values indicate more erodible soils.

Table 3 - “K” Value		
Soils Type	Subsurface	Substratum
Deerfield	0.17	0.17
Hinckley	0.17	0.17

The soil “K” values for the soils, listed above, show a low susceptibility to erosion. The site’s susceptibility to erosion is from the Soil Conservation Service Medium Intensity Soil Survey for Cumberland County. Although soil “K” values for the soils show a low susceptibility to erosion, implementation of the proposed Erosion & Sedimentation Measures by the contractor will still be of considerable importance.

Conclusion


The proposed development was designed to meet the requirements implemented by the MDEP under the Stormwater Management Statute (38 M.R.S.A. § 420-D) as well as the City of Portland Technical Manual – Section 5 – Portland Stormwater Management Standards. As a result, the design of the proposed development and stormwater system does not anticipate to create erosion, drainage or runoff problems either in the development or with respect to adjoining properties.

Attachments

- Attachment A: Pre Development Watershed Map
- Attachment B: Post Development Watershed Map
- Attachment C: HydroCAD Calculations
- Attachment D: Soils Map

- GENERAL NOTES:
- REFER TO STORMWATER REPORT FOR MORE INFORMATION
 - GIVEN THE URBAN SETTING, SMALL WATERSHED AREA AND PREDOMINANCE OF IMPERVIOUS AREAS A 5 MINUTE TIME OF CONCENTRATION WAS USED FOR BOTH THE PRE-DEVELOPMENT AND POST-DEVELOPMENT CONDITIONS.

1



SUBCATCHMENT NUMBER

SUBCATCHMENT EXTENTS

apparent fence encroachment into Housing Authority 0.2'±

FLOWLINES, TYP.

concrete sidewalk

ANDERSON LANE

(private)




FINAL APPLICATION NOT ISSUED FOR CONSTRUCTION

ISSUED FOR	BY
PRELIMINARY APP	WHS
DATE	2/25/16
FINAL APP	WHS
DATE	8/22/16


DRAWING NAME: POST-DEVELOPMENT STORMWATER PLAN
 PROJECT NAME: 70 ANDERSON ST REDEVELOPMENT
 CLIENT: REDFERN PROPERTIES, LLC
 P.O. BOX 8816 PORTLAND, ME 04104

ENGINEERING, INC.
A C O R N
 ENGINEERING, INC.
 158 BANKFOOT ST. PORTLAND, MAINE 04102
 (207) 775-2655


FILE: 1067_CIVIL
 JN: 1067
 SCALE: NTS
 DESIGNED BY: WHS
 DRAWN BY: OJD
 CHECKED BY: WHS

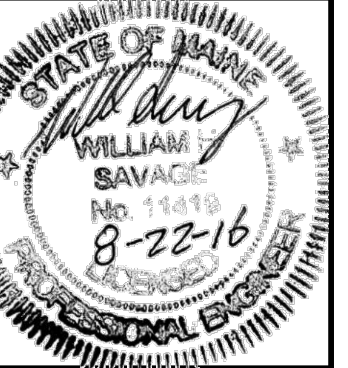


DRAWING NO.
POST





Pre 70 Anderson



POI#1



Fox St



Area Listing (all nodes)

Area (acres)	CN	Description (subcatchment-numbers)
0.101	49	50-75% Grass cover, Fair, HSG A (1S)
0.004	68	<50% Grass cover, Poor, HSG A (1S)
0.002	96	Gravel surface, HSG A (1S)
0.043	98	Building (1S)
0.058	98	Paved parking & roofs (1S)
0.208		TOTAL AREA

Soil Listing (all nodes)

Area (acres)	Soil Goup	Subcatchment Numbers
0.108	HSG A	1S
0.000	HSG B	
0.000	HSG C	
0.000	HSG D	
0.100	Other	1S
0.208		TOTAL AREA

Pre_4-26-16

Prepared by Acorn Engineering, Inc.

HydroCAD® 8.50 s/n 000620 © 2007 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.10"

Printed 8/23/2016

Page 4

Time span=1.00-36.00 hrs, dt=0.02 hrs, 1751 points

Runoff by SCS TR-20 method, UH=SCS

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: Pre 70 Anderson

Runoff Area=9,060 sf 48.30% Impervious Runoff Depth=0.92"

Tc=5.0 min CN=73 Runoff=0.22 cfs 0.016 af

Reach 1R: POI#1

Inflow=0.22 cfs 0.016 af

Outflow=0.22 cfs 0.016 af

Reach 2R: Fox St

Inflow=0.22 cfs 0.016 af

Outflow=0.22 cfs 0.016 af

Total Runoff Area = 0.208 ac Runoff Volume = 0.016 af Average Runoff Depth = 0.92"
51.70% Pervious = 0.108 ac 48.30% Impervious = 0.100 ac

Summary for Subcatchment 1S: Pre 70 Anderson

Runoff = 0.22 cfs @ 12.08 hrs, Volume= 0.016 af, Depth= 0.92"


Runoff by SCS TR-20 method, UH=SCS, Time Span= 1.00-36.00 hrs, dt= 0.02 hrs
 Type III 24-hr 2-year Rainfall=3.10"

Area (sf)	CN	Description
* 1,861	98	Building
75	96	Gravel surface, HSG A
188	68	<50% Grass cover, Poor, HSG A
2,515	98	Paved parking & roofs
4,421	49	50-75% Grass cover, Fair, HSG A
9,060	73	Weighted Average
4,684		Pervious Area
4,376		Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Subcatchment 1S: Pre 70 Anderson

Hydrograph

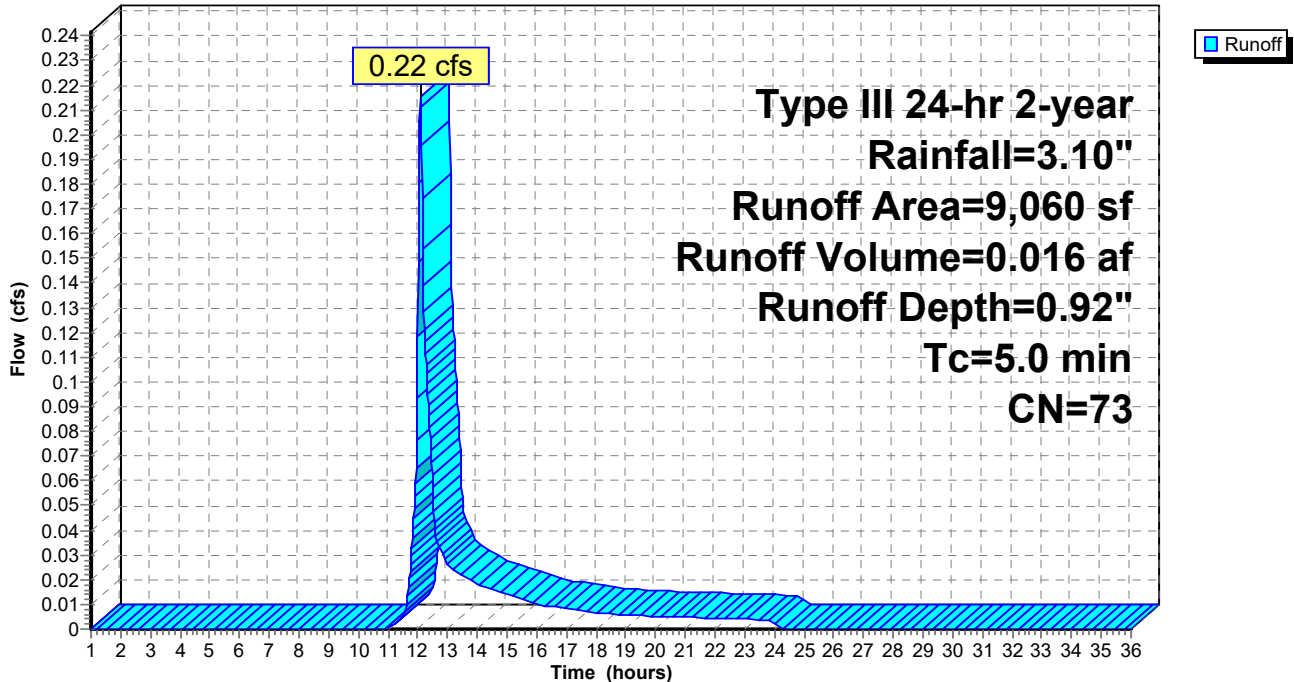


Summary for Reach 1R: POI#1

[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.208 ac, 48.30% Impervious, Inflow Depth = 0.92" for 2-year event
Inflow = 0.22 cfs @ 12.08 hrs, Volume= 0.016 af
Outflow = 0.22 cfs @ 12.08 hrs, Volume= 0.016 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 1.00-36.00 hrs, dt= 0.02 hrs

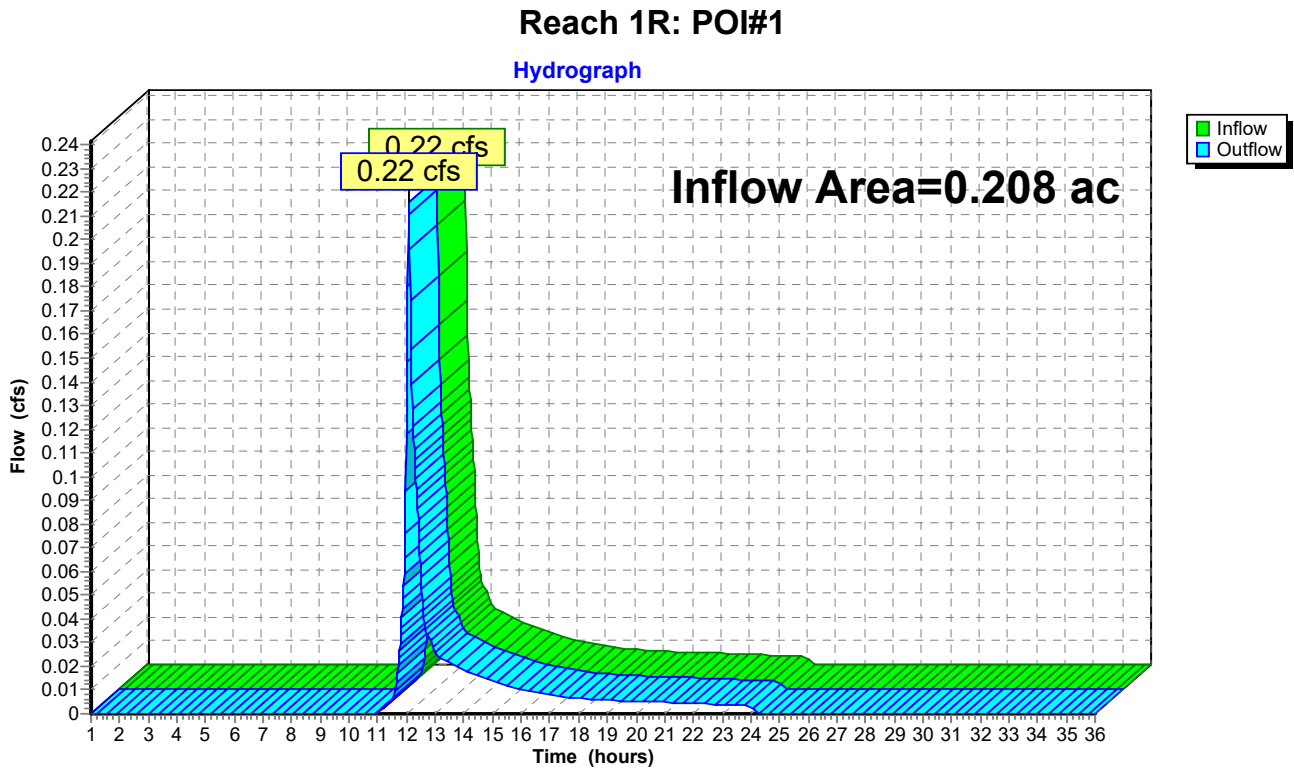


Summary for Reach 2R: Fox St

[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.208 ac, 48.30% Impervious, Inflow Depth = 0.92" for 2-year event
Inflow = 0.22 cfs @ 12.08 hrs, Volume= 0.016 af
Outflow = 0.22 cfs @ 12.08 hrs, Volume= 0.016 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 1.00-36.00 hrs, dt= 0.02 hrs

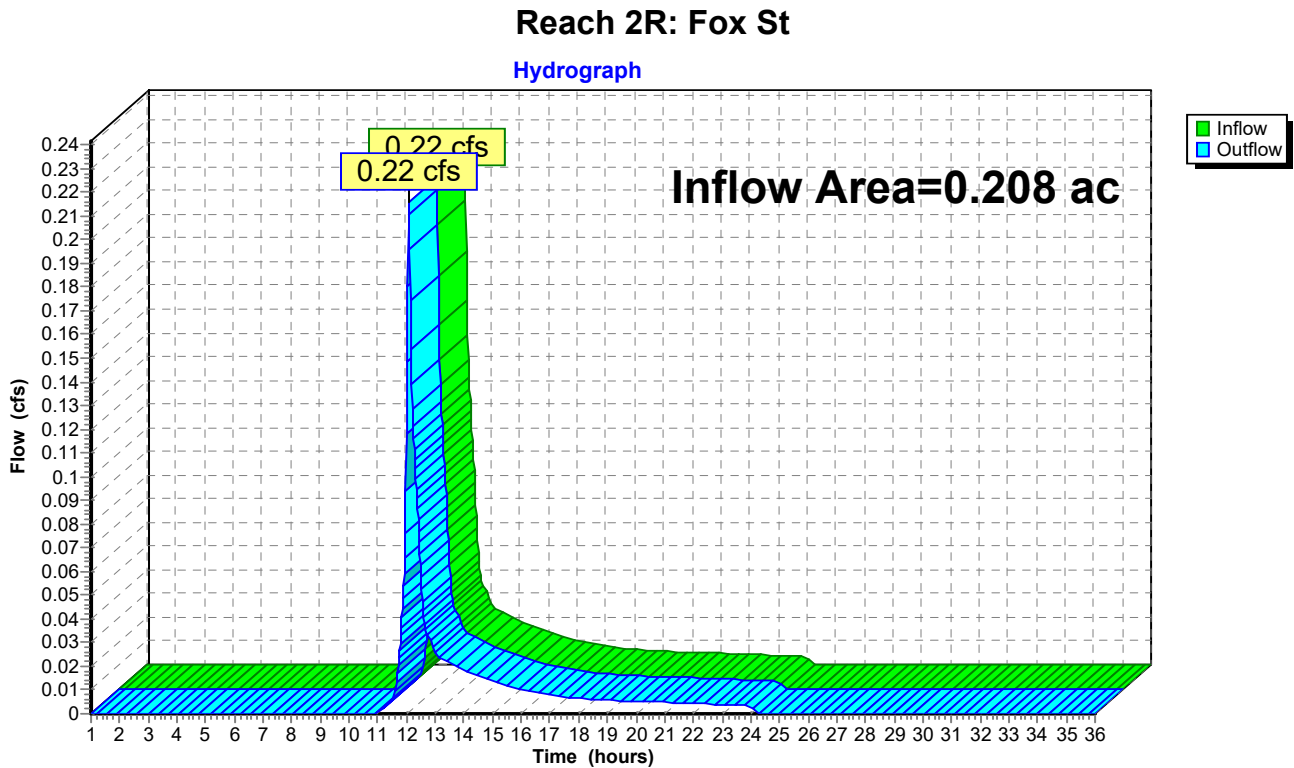

Pre_4-26-16

Prepared by Acorn Engineering, Inc.

HydroCAD® 8.50 s/n 000620 © 2007 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.60"

Printed 8/23/2016

Page 8

Time span=1.00-36.00 hrs, dt=0.02 hrs, 1751 points

Runoff by SCS TR-20 method, UH=SCS

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: Pre 70 Anderson

Runoff Area=9,060 sf 48.30% Impervious Runoff Depth=1.97"

Tc=5.0 min CN=73 Runoff=0.49 cfs 0.034 af

Reach 1R: POI#1

Inflow=0.49 cfs 0.034 af

Outflow=0.49 cfs 0.034 af

Reach 2R: Fox St

Inflow=0.49 cfs 0.034 af

Outflow=0.49 cfs 0.034 af

Total Runoff Area = 0.208 ac Runoff Volume = 0.034 af Average Runoff Depth = 1.97"
51.70% Pervious = 0.108 ac 48.30% Impervious = 0.100 ac

Summary for Subcatchment 1S: Pre 70 Anderson

Runoff = 0.49 cfs @ 12.08 hrs, Volume= 0.034 af, Depth= 1.97"


Runoff by SCS TR-20 method, UH=SCS, Time Span= 1.00-36.00 hrs, dt= 0.02 hrs
Type III 24-hr 10-year Rainfall=4.60"

Area (sf)	CN	Description
* 1,861	98	Building
75	96	Gravel surface, HSG A
188	68	<50% Grass cover, Poor, HSG A
2,515	98	Paved parking & roofs
4,421	49	50-75% Grass cover, Fair, HSG A
9,060	73	Weighted Average
4,684		Pervious Area
4,376		Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Subcatchment 1S: Pre 70 Anderson

Hydrograph

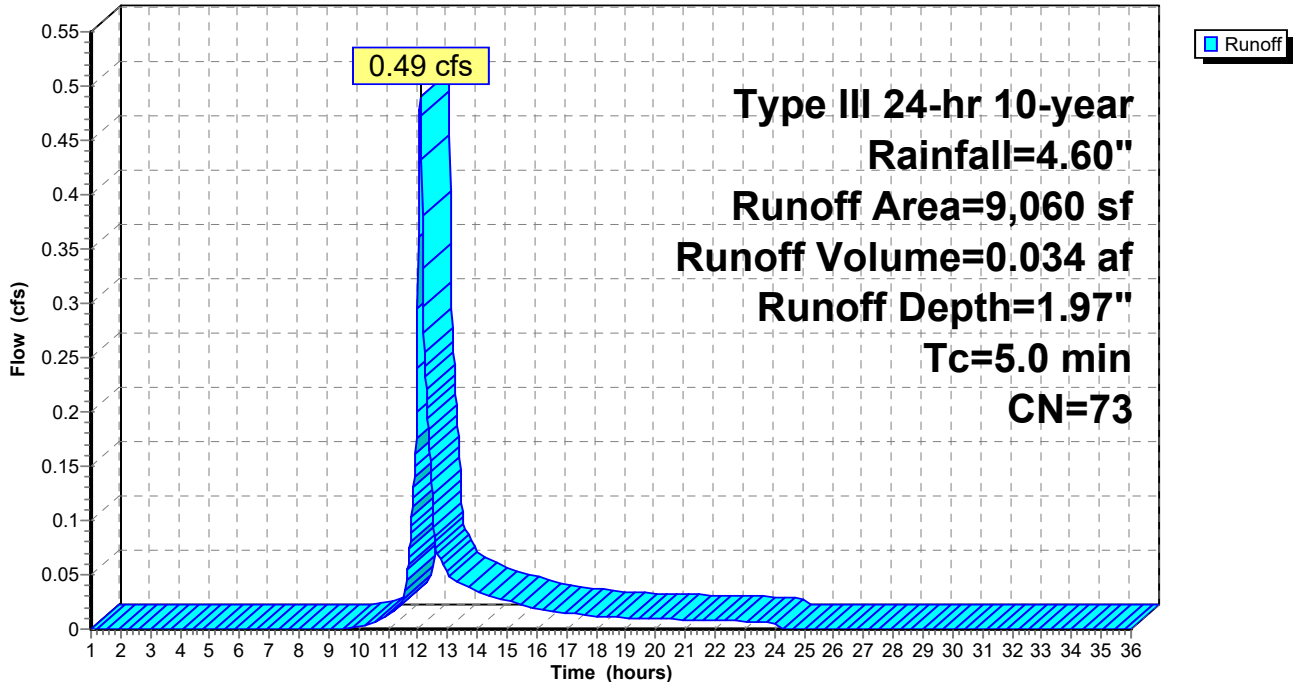


Summary for Reach 1R: POI#1

[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.208 ac, 48.30% Impervious, Inflow Depth = 1.97" for 10-year event
Inflow = 0.49 cfs @ 12.08 hrs, Volume= 0.034 af
Outflow = 0.49 cfs @ 12.08 hrs, Volume= 0.034 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 1.00-36.00 hrs, dt= 0.02 hrs

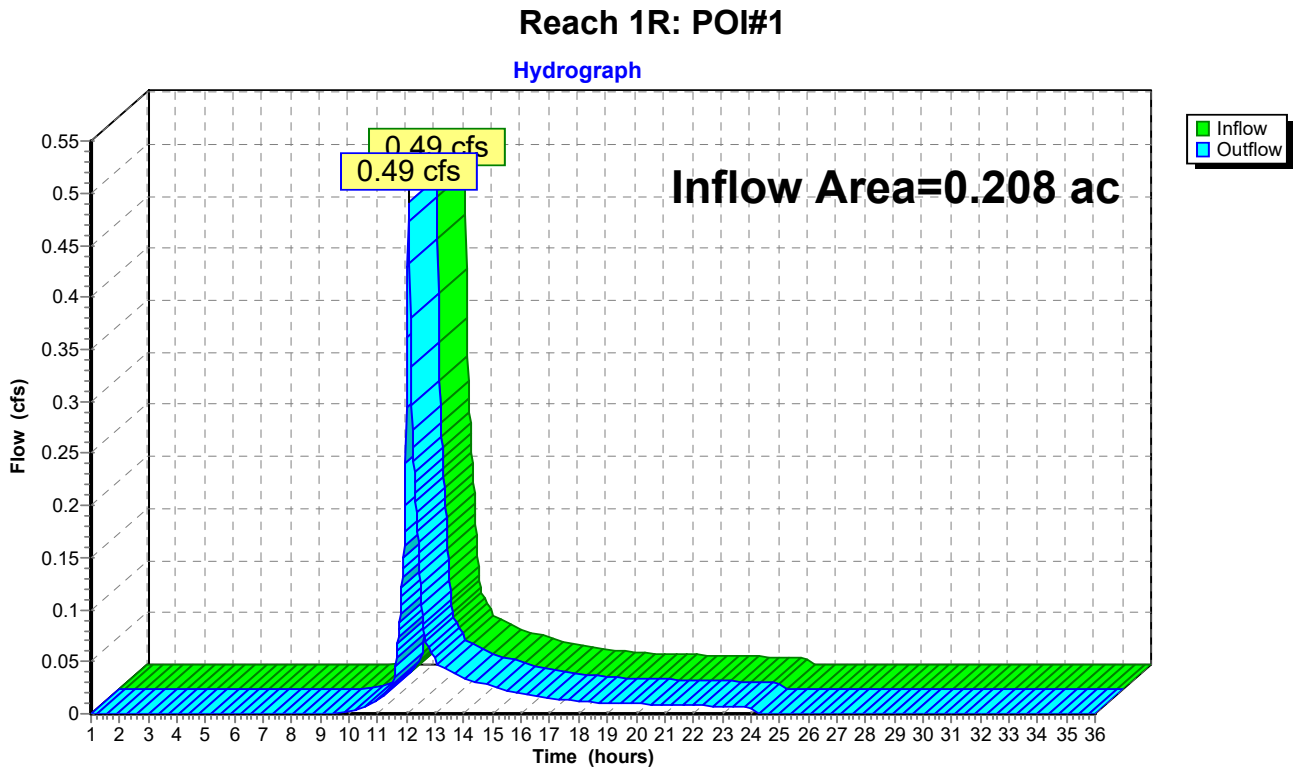


Summary for Reach 2R: Fox St

[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.208 ac, 48.30% Impervious, Inflow Depth = 1.97" for 10-year event
Inflow = 0.49 cfs @ 12.08 hrs, Volume= 0.034 af
Outflow = 0.49 cfs @ 12.08 hrs, Volume= 0.034 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 1.00-36.00 hrs, dt= 0.02 hrs

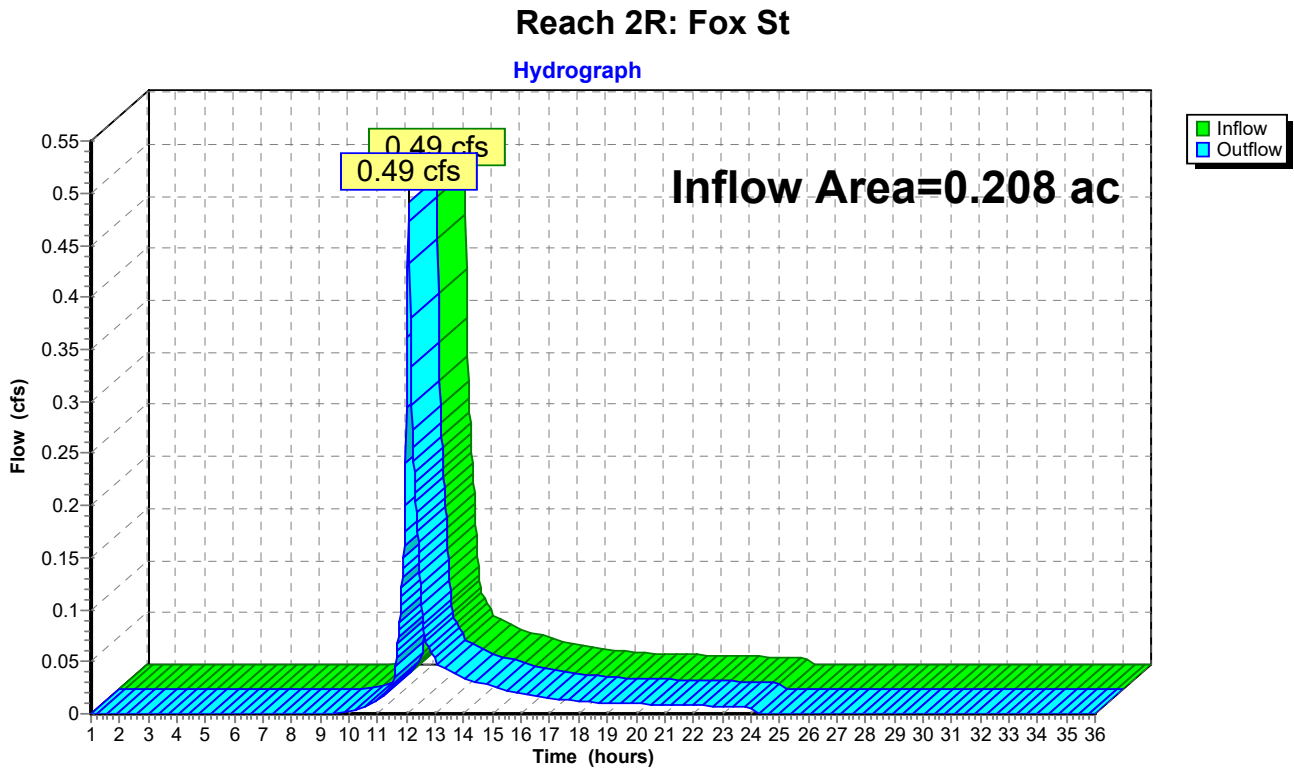

Time span=1.00-36.00 hrs, dt=0.02 hrs, 1751 points

Runoff by SCS TR-20 method, UH=SCS

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: Pre 70 Anderson

Runoff Area=9,060 sf 48.30% Impervious Runoff Depth=2.92"
Tc=5.0 min CN=73 Runoff=0.74 cfs 0.051 af

Reach 1R: POI#1

Inflow=0.74 cfs 0.051 af
Outflow=0.74 cfs 0.051 af

Reach 2R: Fox St

Inflow=0.74 cfs 0.051 af
Outflow=0.74 cfs 0.051 af

Total Runoff Area = 0.208 ac Runoff Volume = 0.051 af Average Runoff Depth = 2.92"
51.70% Pervious = 0.108 ac 48.30% Impervious = 0.100 ac

Summary for Subcatchment 1S: Pre 70 Anderson

Runoff = 0.74 cfs @ 12.08 hrs, Volume= 0.051 af, Depth= 2.92"


Runoff by SCS TR-20 method, UH=SCS, Time Span= 1.00-36.00 hrs, dt= 0.02 hrs
 Type III 24-hr 25-year Rainfall=5.80"

Area (sf)	CN	Description
* 1,861	98	Building
75	96	Gravel surface, HSG A
188	68	<50% Grass cover, Poor, HSG A
2,515	98	Paved parking & roofs
4,421	49	50-75% Grass cover, Fair, HSG A
9,060	73	Weighted Average
4,684		Pervious Area
4,376		Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Subcatchment 1S: Pre 70 Anderson

Hydrograph

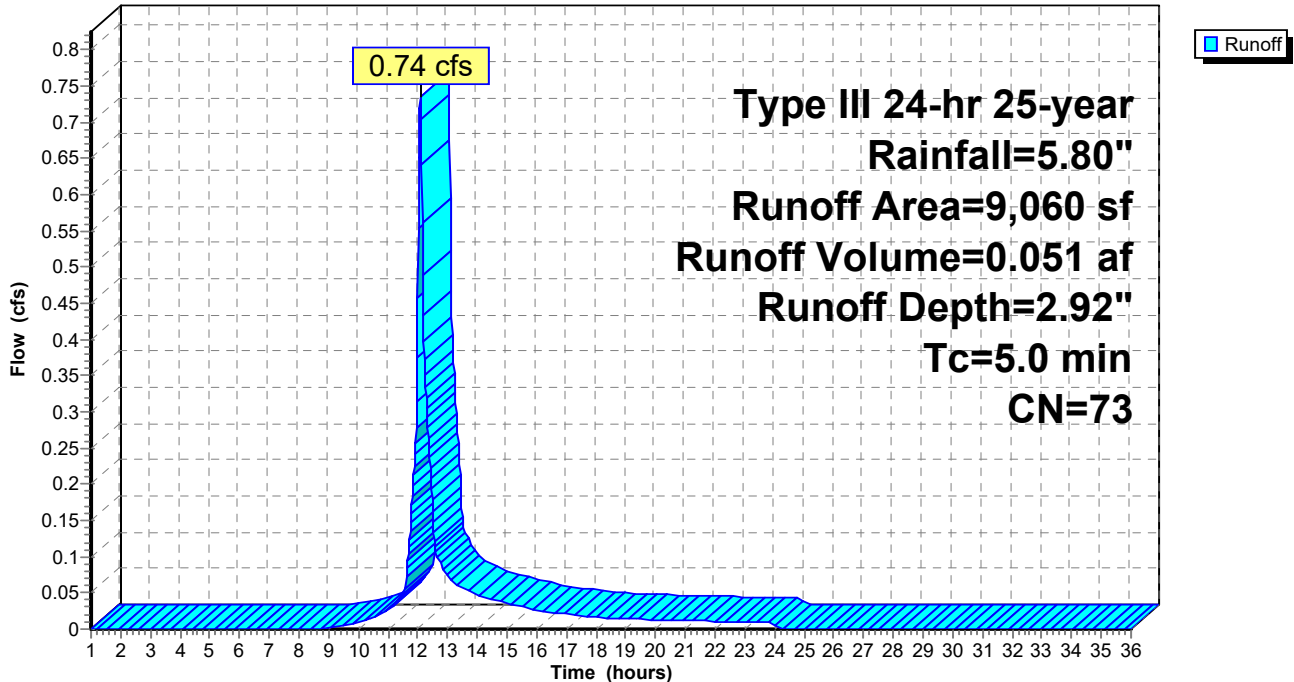


Summary for Reach 1R: POI#1

[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.208 ac, 48.30% Impervious, Inflow Depth = 2.92" for 25-year event
Inflow = 0.74 cfs @ 12.08 hrs, Volume= 0.051 af
Outflow = 0.74 cfs @ 12.08 hrs, Volume= 0.051 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 1.00-36.00 hrs, dt= 0.02 hrs

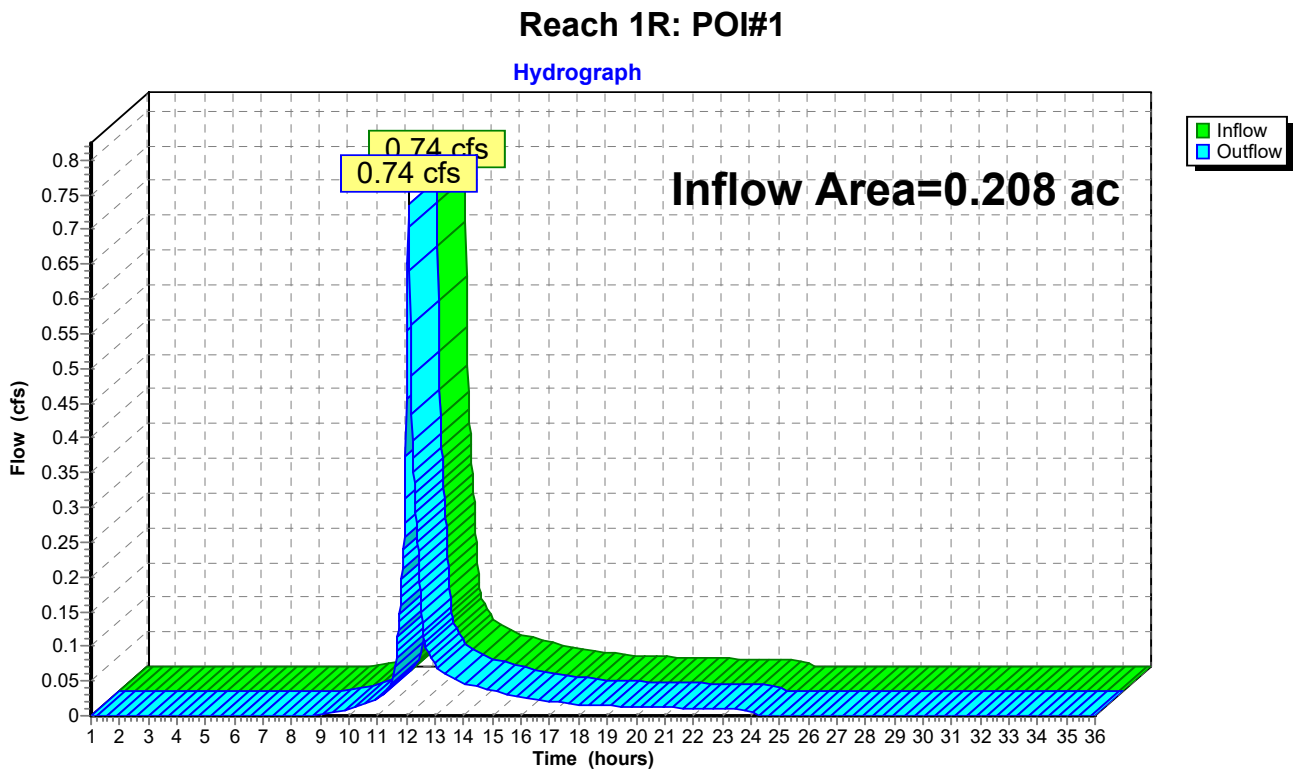





Summary for Reach 2R: Fox St

[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.208 ac, 48.30% Impervious, Inflow Depth = 2.92" for 25-year event
Inflow = 0.74 cfs @ 12.08 hrs, Volume= 0.051 af
Outflow = 0.74 cfs @ 12.08 hrs, Volume= 0.051 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 1.00-36.00 hrs, dt= 0.02 hrs

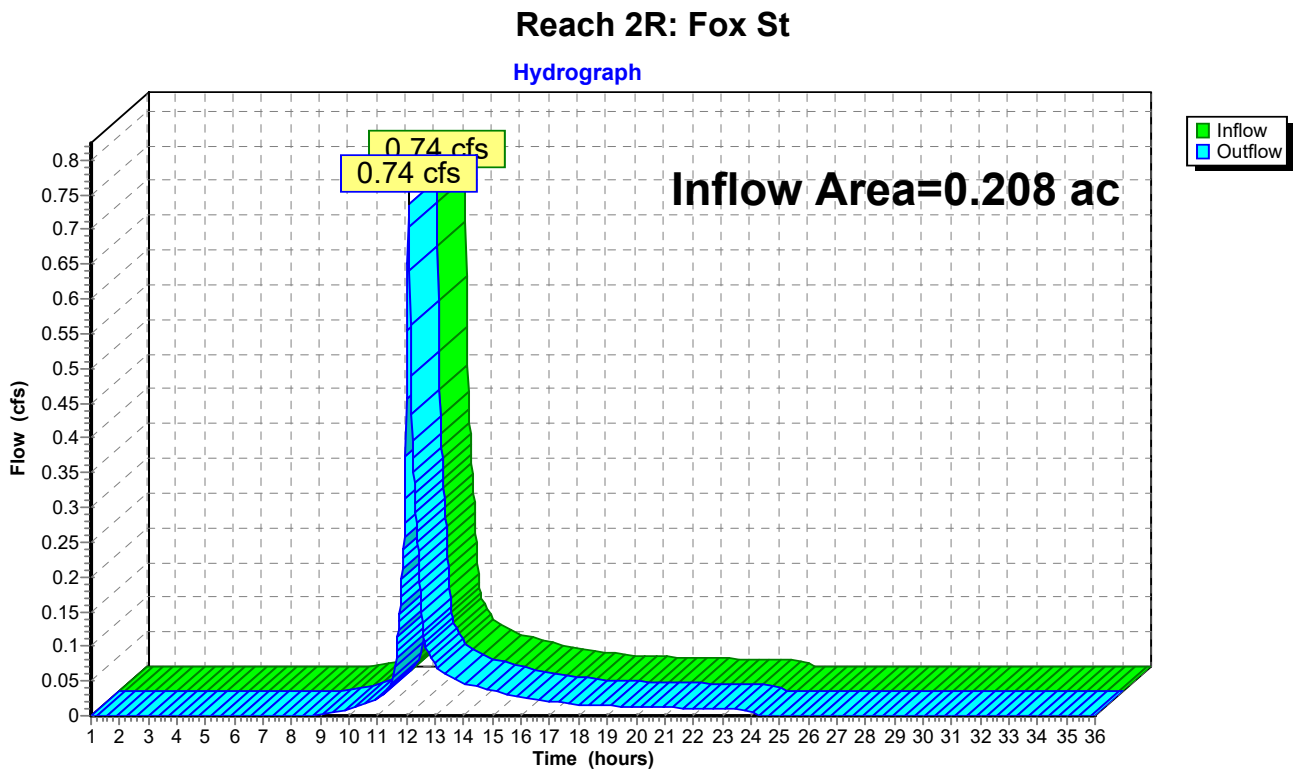

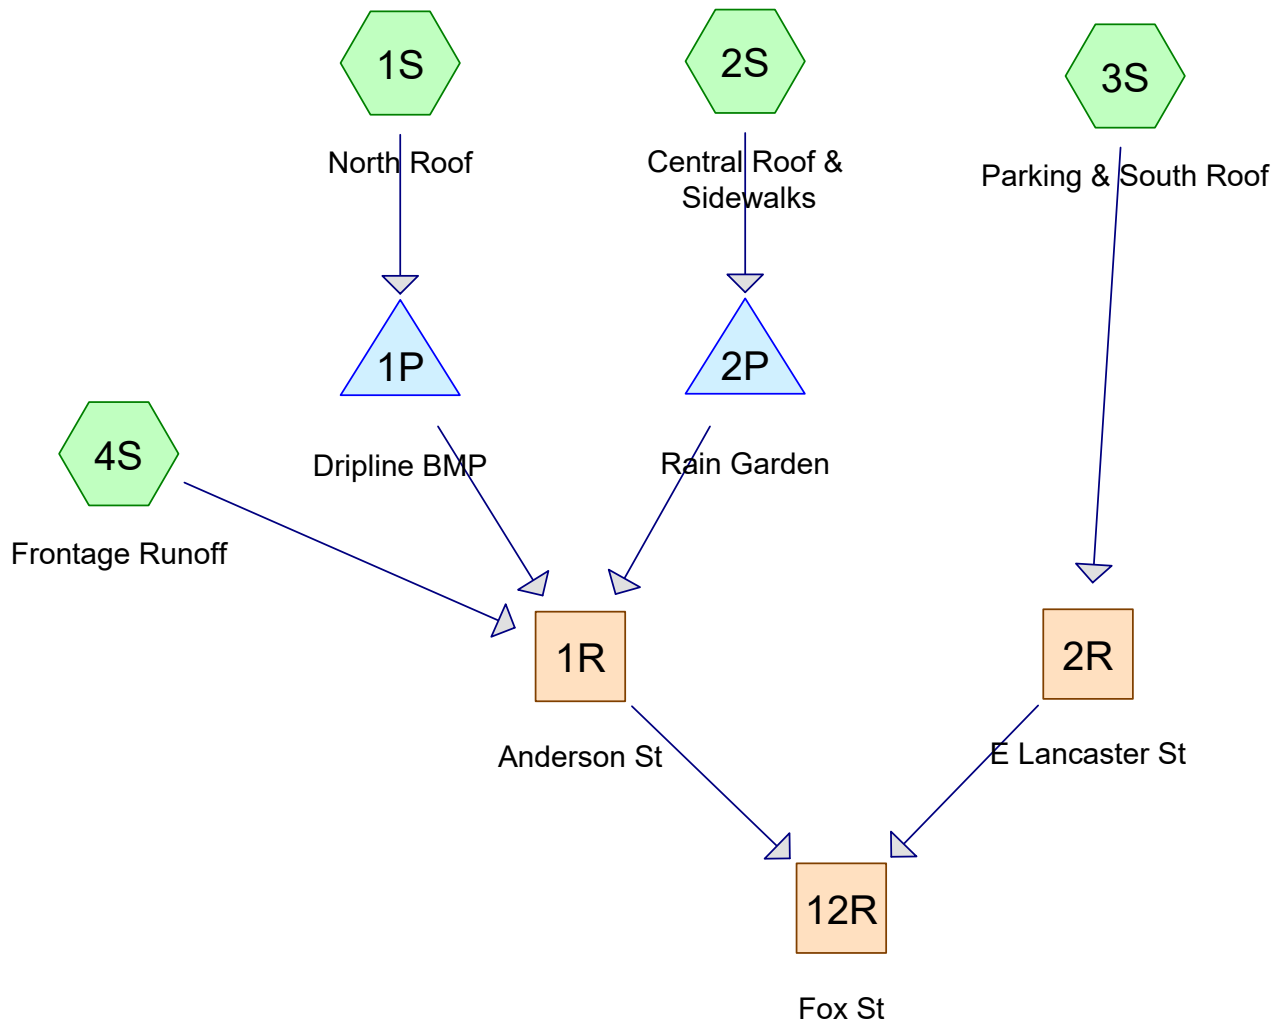

Drainage Diagram for Post_8-22-16
 Prepared by Acorn Engineering, Inc., Printed 8/23/2016
 HydroCAD® 8.50 s/n 000620 © 2007 HydroCAD Software Solutions LLC

Area Listing (all nodes)

Area (acres)	CN	Description (subcatchment-numbers)
0.037	32	Woods/grass comb., Good, HSG A (1S,2S,3S,4S)
0.004	77	Crushed Stone, HSG A (3S)
0.019	96	Brick Pavers, HSG A (2S,3S,4S)
0.001	98	Concrete, HSG A (3S)
0.049	98	Paved Parking, HSG A (3S)
0.097	98	Roofs, HSG A (1S,2S,3S)
0.000	98	Transformer Top, HSG A (3S)
0.208		TOTAL AREA

Soil Listing (all nodes)

Area (acres)	Soil Goup	Subcatchment Numbers
0.208	HSG A	1S, 2S, 3S, 4S
0.000	HSG B	
0.000	HSG C	
0.000	HSG D	
0.000	Other	
0.208		TOTAL AREA

Post_8-22-16

Type III 24-hr 2-year Rainfall=3.10"

Prepared by Acorn Engineering, Inc.

Printed 8/23/2016

HydroCAD® 8.50 s/n 000620 © 2007 HydroCAD Software Solutions LLC

Page 19

Time span=0.00-36.00 hrs, dt=0.01 hrs, 3601 points

Runoff by SCS TR-20 method, UH=SCS

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: North Roof Runoff Area=1,856 sf 67.89% Impervious Runoff Depth=1.14"
Tc=5.0 min CN=77 Runoff=0.06 cfs 0.004 af

Subcatchment 2S: Central Roof & Sidewalks Runoff Area=2,776 sf 60.59% Impervious Runoff Depth=1.60"
Tc=5.0 min CN=84 Runoff=0.12 cfs 0.008 af

Subcatchment 3S: Parking & South Roof Runoff Area=4,270 sf 81.97% Impervious Runoff Depth=2.26"
Tc=5.0 min CN=92 Runoff=0.26 cfs 0.018 af

Subcatchment 4S: Frontage Runoff Runoff Area=163 sf 0.00% Impervious Runoff Depth=0.13"
Tc=5.0 min CN=51 Runoff=0.00 cfs 0.000 af

Reach 1R: Anderson St Inflow=0.00 cfs 0.000 af
Outflow=0.00 cfs 0.000 af

Reach 2R: E Lancaster St Inflow=0.26 cfs 0.018 af
Outflow=0.26 cfs 0.018 af

Reach 12R: Fox St Inflow=0.26 cfs 0.019 af
Outflow=0.26 cfs 0.019 af

Pond 1P: Dripline BMP Peak Elev=11.54' Storage=42 cf Inflow=0.06 cfs 0.004 af
Discarded=0.02 cfs 0.004 af Primary=0.00 cfs 0.000 af Outflow=0.02 cfs 0.004 af

Pond 2P: Rain Garden Peak Elev=15.52' Storage=123 cf Inflow=0.12 cfs 0.008 af
Discarded=0.02 cfs 0.008 af Primary=0.00 cfs 0.000 af Outflow=0.02 cfs 0.008 af

Total Runoff Area = 0.208 ac Runoff Volume = 0.031 af Average Runoff Depth = 1.79"
28.94% Pervious = 0.060 ac 71.06% Impervious = 0.148 ac

Summary for Subcatchment 1S: North Roof

Runoff = 0.06 cfs @ 12.08 hrs, Volume= 0.004 af, Depth= 1.14"


Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs
 Type III 24-hr 2-year Rainfall=3.10"

	Area (sf)	CN	Description
*	1,260	98	Roofs, HSG A
	596	32	Woods/grass comb., Good, HSG A
	1,856	77	Weighted Average
	596		Pervious Area
	1,260		Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Subcatchment 1S: North Roof

Hydrograph

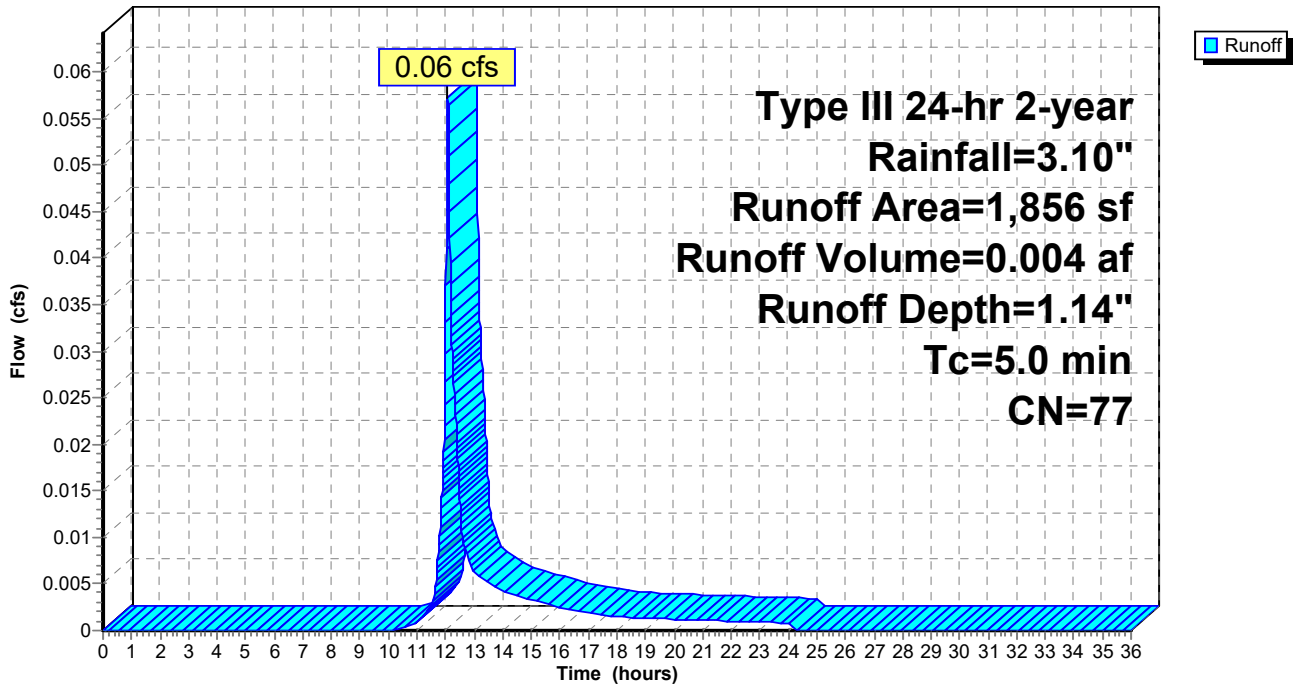

Summary for Subcatchment 2S: Central Roof & Sidewalks

Runoff = 0.12 cfs @ 12.08 hrs, Volume= 0.008 af, Depth= 1.60"


Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs
 Type III 24-hr 2-year Rainfall=3.10"

	Area (sf)	CN	Description
*	839	98	Roofs, HSG A
*	843	98	Roofs, HSG A
*	525	96	Brick Pavers, HSG A
	569	32	Woods/grass comb., Good, HSG A
	2,776	84	Weighted Average
	1,094		Pervious Area
	1,682		Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Subcatchment 2S: Central Roof & Sidewalks

Hydrograph

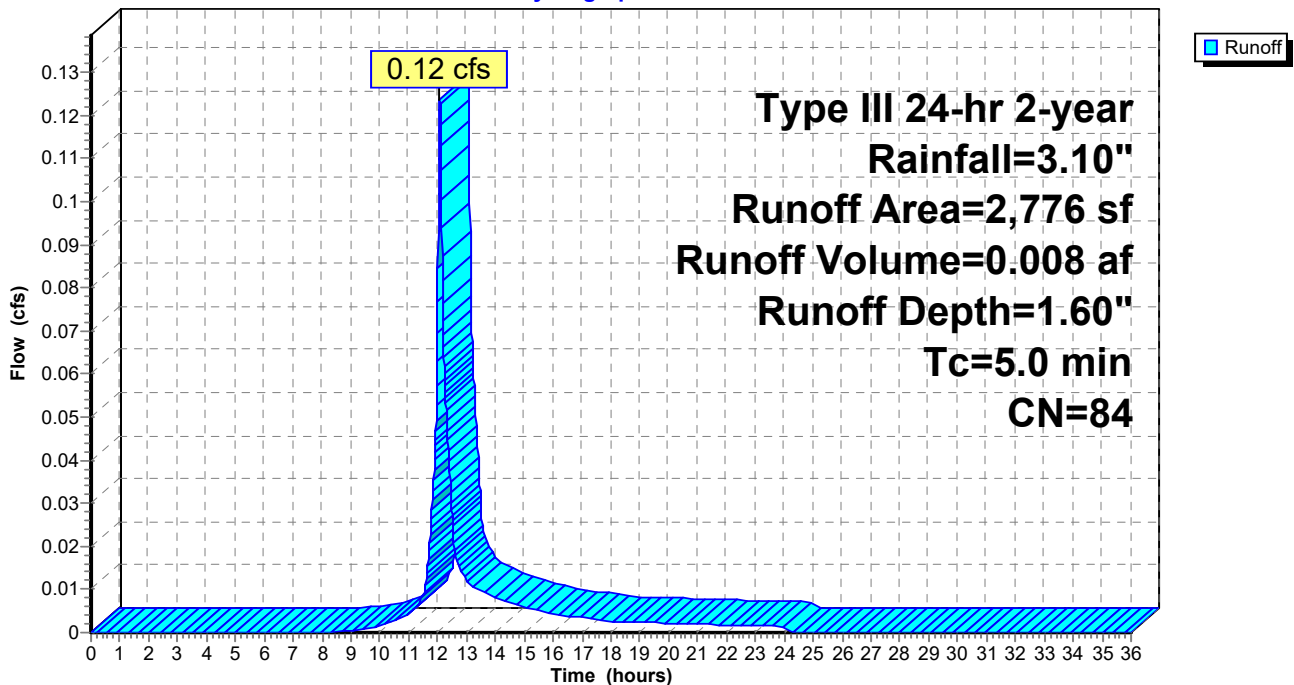

Summary for Subcatchment 3S: Parking & South Roof

Runoff = 0.26 cfs @ 12.07 hrs, Volume= 0.018 af, Depth= 2.26"


Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs
 Type III 24-hr 2-year Rainfall=3.10"

Area (sf)	CN	Description
* 2,150	98	Paved Parking, HSG A
* 257	96	Brick Pavers, HSG A
* 1,270	98	Roofs, HSG A
342	32	Woods/grass comb., Good, HSG A
* 171	77	Crushed Stone, HSG A
* 64	98	Concrete, HSG A
* 16	98	Transformer Top, HSG A
4,270	92	Weighted Average
770		Pervious Area
3,500		Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Subcatchment 3S: Parking & South Roof

Hydrograph

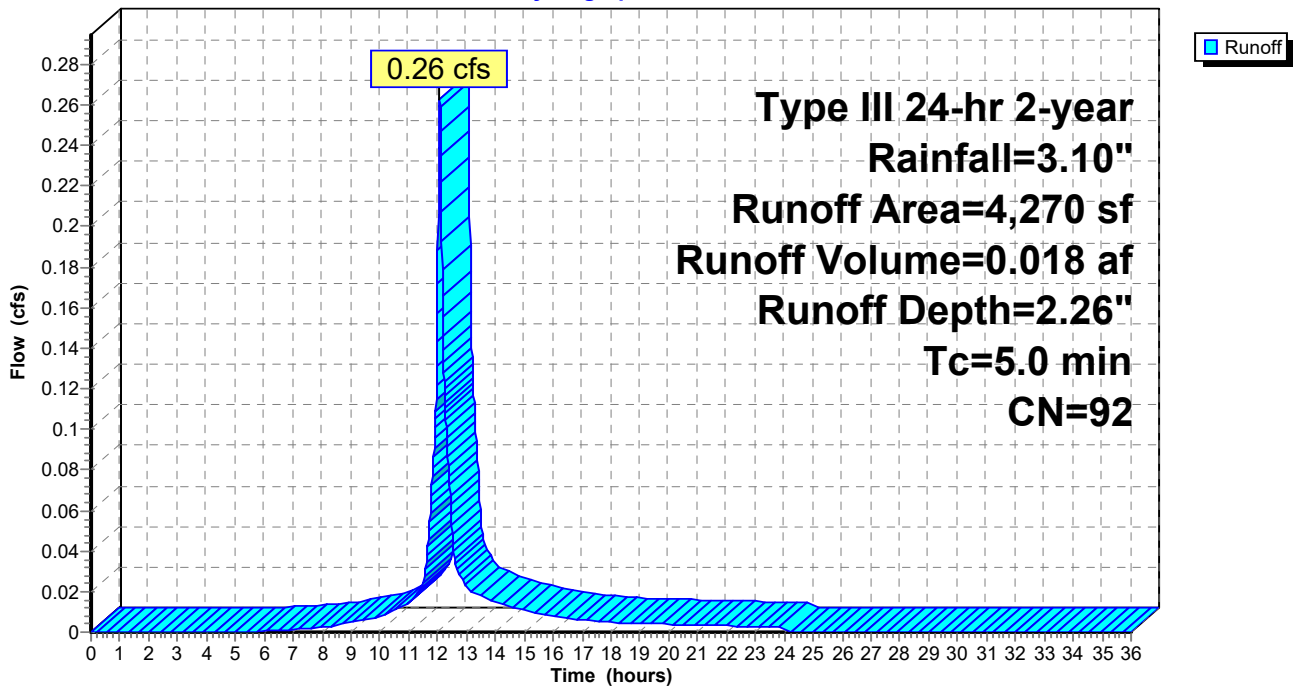

Summary for Subcatchment 4S: Frontage Runoff


Runoff = 0.00 cfs @ 12.45 hrs, Volume= 0.000 af, Depth= 0.13"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs
 Type III 24-hr 2-year Rainfall=3.10"

Area (sf)	CN	Description
115	32	Woods/grass comb., Good, HSG A
* 48	96	Brick Pavers, HSG A
163	51	Weighted Average
163		Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Subcatchment 4S: Frontage Runoff

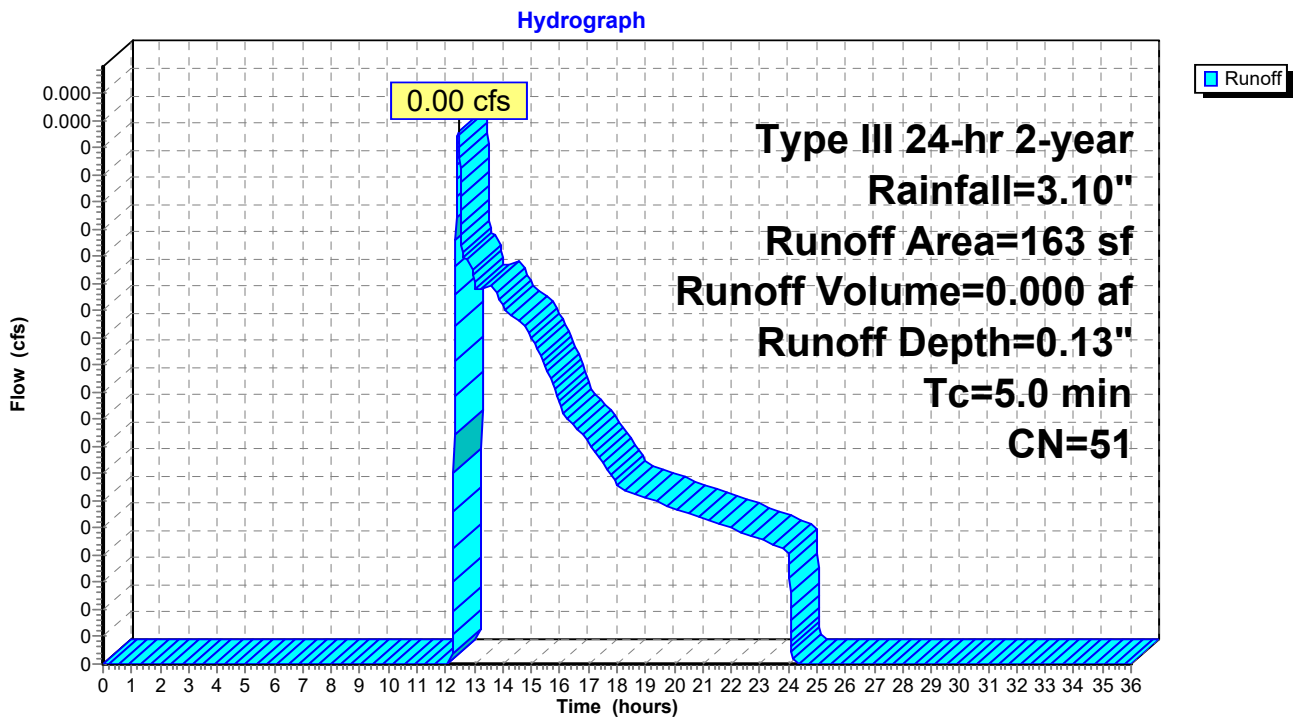

Summary for Reach 1R: Anderson St


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.110 ac, 61.36% Impervious, Inflow Depth = 0.01" for 2-year event
Inflow = 0.00 cfs @ 12.47 hrs, Volume= 0.000 af
Outflow = 0.00 cfs @ 12.47 hrs, Volume= 0.000 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs

Reach 1R: Anderson St

Hydrograph

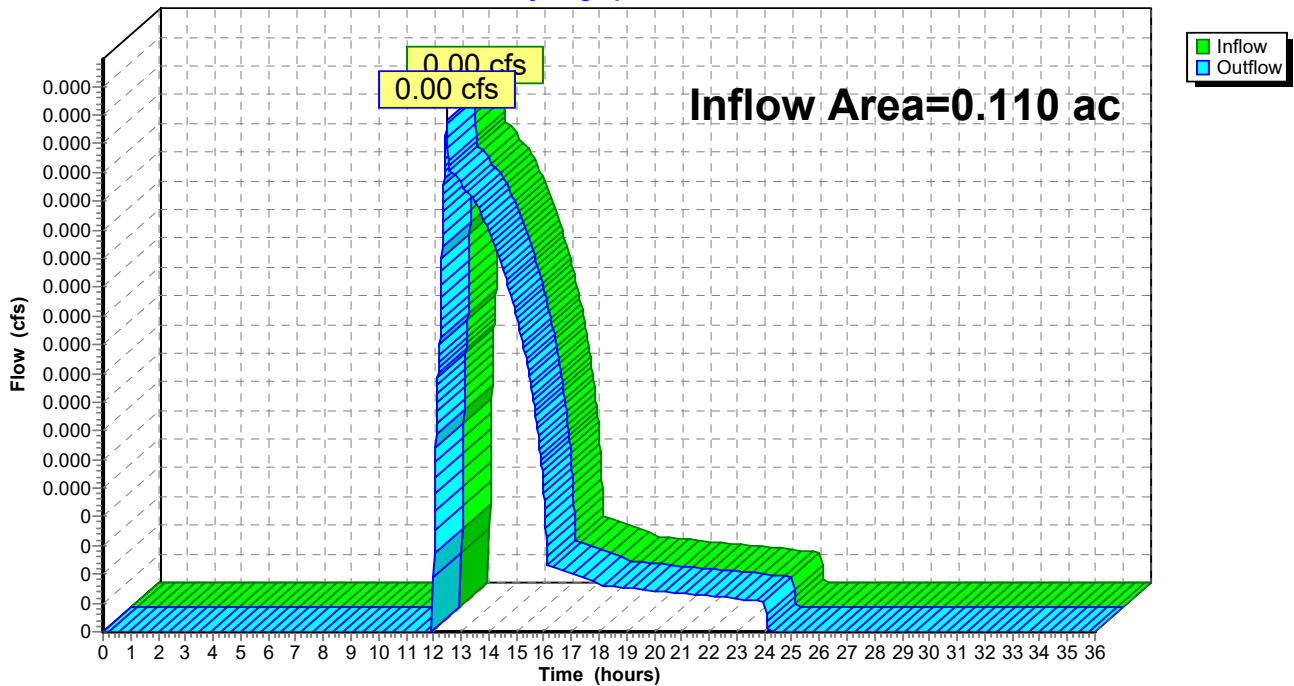

Summary for Reach 2R: E Lancaster St


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.098 ac, 81.97% Impervious, Inflow Depth = 2.26" for 2-year event
Inflow = 0.26 cfs @ 12.07 hrs, Volume= 0.018 af
Outflow = 0.26 cfs @ 12.07 hrs, Volume= 0.018 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs

Reach 2R: E Lancaster St

Hydrograph

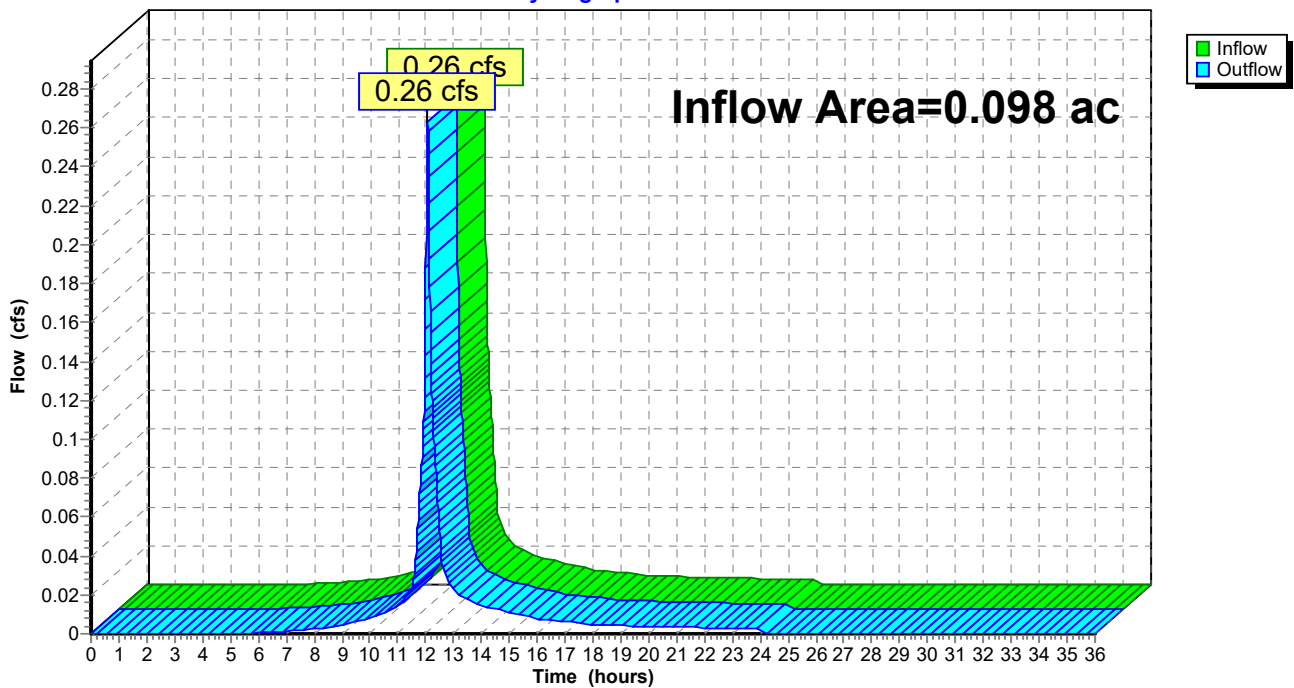


Summary for Reach 12R: Fox St

[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.208 ac, 71.06% Impervious, Inflow Depth = 1.07" for 2-year event
Inflow = 0.26 cfs @ 12.07 hrs, Volume= 0.019 af
Outflow = 0.26 cfs @ 12.07 hrs, Volume= 0.019 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs

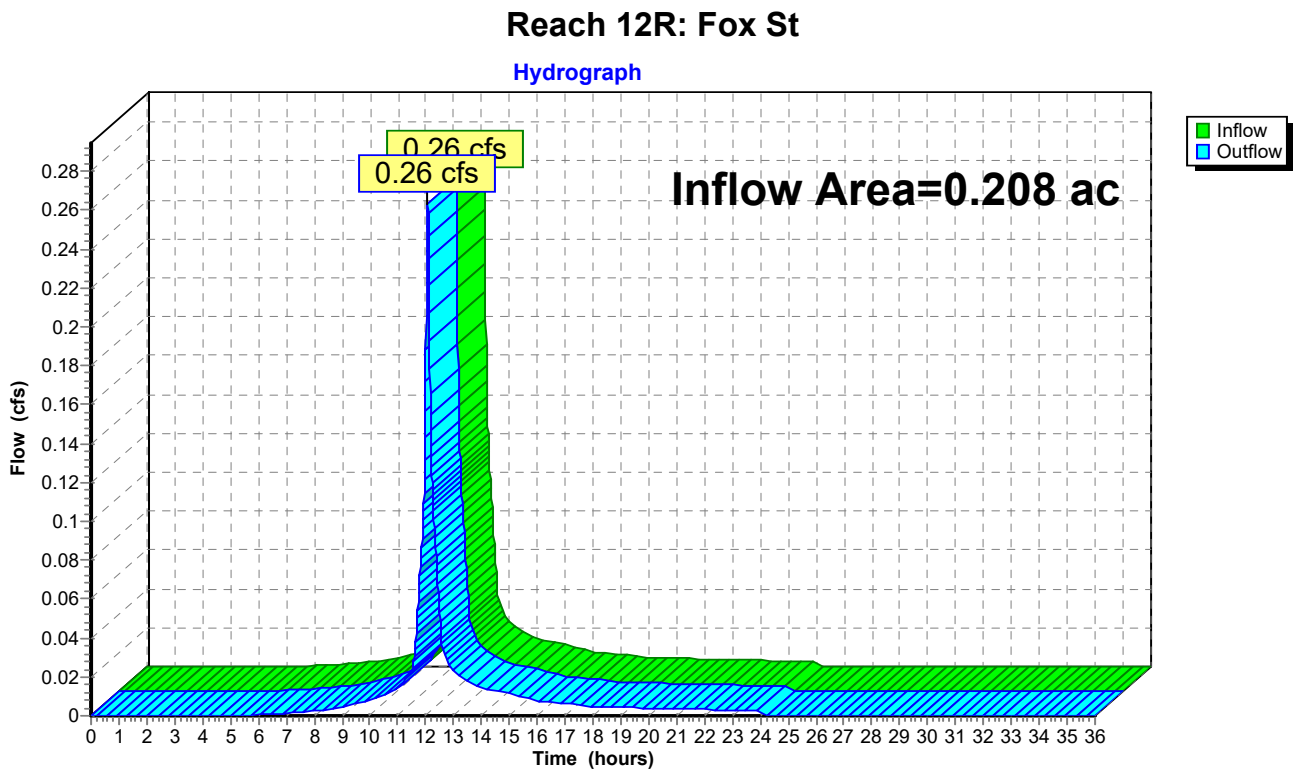

Summary for Pond 1P: Dripline BMP

Inflow Area = 0.043 ac, 67.89% Impervious, Inflow Depth = 1.14" for 2-year event
 Inflow = 0.06 cfs @ 12.08 hrs, Volume= 0.004 af
 Outflow = 0.02 cfs @ 12.48 hrs, Volume= 0.004 af, Atten= 73%, Lag= 23.7 min
 Discarded = 0.02 cfs @ 12.48 hrs, Volume= 0.004 af
 Primary = 0.00 cfs @ 12.48 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs
 Peak Elev= 11.54' @ 12.48 hrs Surf.Area= 135 sf Storage= 42 cf

Plug-Flow detention time= 21.6 min calculated for 0.004 af (100% of inflow)
 Center-of-Mass det. time= 21.6 min (874.9 - 853.3)


Volume	Invert	Avail.Storage	Storage Description
#1	14.08'	126 cf	3.00'W x 90.00'L x 1.17'H Prismaoid - Water Quality Volume 316 cf Overall x 40.0% Voids
#2	13.08'	27 cf	3.00'W x 90.00'L x 1.00'H Prismaoid - Soil Filter Media 270 cf Overall x 10.0% Voids
#3	11.75'	18 cf	6.0"D x 90.00'L 6" Pipe Storage S= 0.0025 '/' Inside #4
#4	10.75'	119 cf	1.50'W x 90.00'L x 2.33'H Prismaoid - Crushed Stone 315 cf Overall - 18 cf Embedded = 297 cf x 40.0% Voids
		290 cf	Total Available Storage

Device	Routing	Invert	Outlet Devices
#1	Primary	11.53'	6.0" x 50.0' long Culvert CMP, mitered to conform to fill, Ke= 0.700 Outlet Invert= 11.40' S= 0.0026 '/' Cc= 0.900 n= 0.010
#2	Device 1	11.53'	1.0" Vert. Orifice/Grate X 0.10 C= 0.600
#3	Discarded	10.75'	2.410 in/hr Exfiltration over Wetted area

Discarded OutFlow Max=0.02 cfs @ 12.48 hrs HW=11.54' (Free Discharge)
 ↳ **3=Exfiltration** (Exfiltration Controls 0.02 cfs)

Primary OutFlow Max=0.00 cfs @ 12.48 hrs HW=11.54' (Free Discharge)
 ↳ **1=Culvert** (Passes 0.00 cfs of 0.00 cfs potential flow)
 ↳ **2=Orifice/Grate** (Orifice Controls 0.00 cfs @ 0.03 fps)

Pond 1P: Dripline BMP

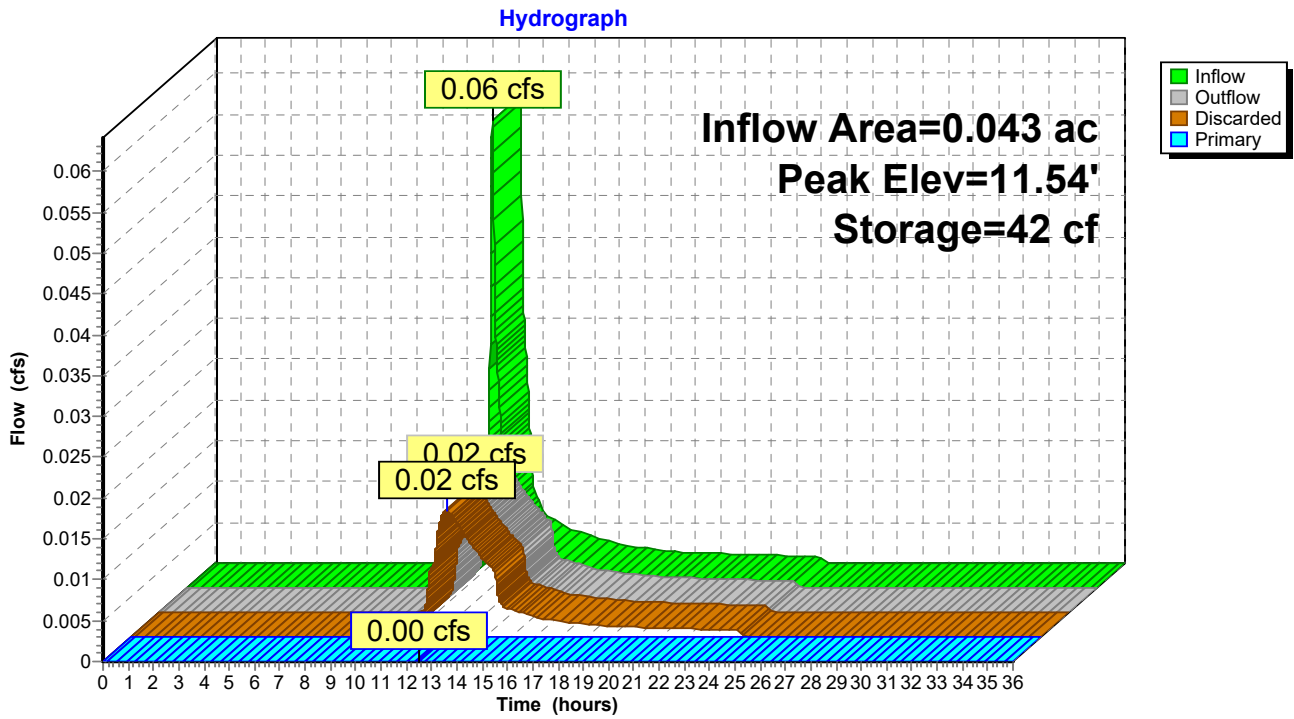

Summary for Pond 2P: Rain Garden

Inflow Area = 0.064 ac, 60.59% Impervious, Inflow Depth = 1.60" for 2-year event
 Inflow = 0.12 cfs @ 12.08 hrs, Volume= 0.008 af
 Outflow = 0.02 cfs @ 12.73 hrs, Volume= 0.008 af, Atten= 87%, Lag= 39.0 min
 Discarded = 0.02 cfs @ 11.73 hrs, Volume= 0.008 af
 Primary = 0.00 cfs @ 12.73 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs
 Peak Elev= 15.52' @ 12.73 hrs Surf.Area= 275 sf Storage= 123 cf

Plug-Flow detention time= 61.3 min calculated for 0.008 af (100% of inflow)
 Center-of-Mass det. time= 61.3 min (891.4 - 830.1)

Volume	Invert	Avail.Storage	Storage Description
#1	17.90'	431 cf	Water Quality Volume (Prismatic) Listed below (Recalc)
#2	15.90'	55 cf	Loam/Soil/Gravel Filter Media (Prismatic) Listed below (Recalc) 550 cf Overall x 10.0% Voids
#3	14.40'	165 cf	Crushed Stone (Prismatic) Listed below (Recalc) 413 cf Overall x 40.0% Voids
		651 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
17.90	275	0	0
18.40	443	180	180
18.90	564	252	431

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
15.90	275	0	0
17.90	275	550	550

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
14.40	275	0	0
15.90	275	413	413

Device	Routing	Invert	Outlet Devices
#1	Primary	14.65'	6.0" x 50.0' long Culvert CMP, mitered to conform to fill, Ke= 0.700 Outlet Invert= 11.51' S= 0.0628 '/' Cc= 0.900 n= 0.010 PVC, smooth interior
#2	Device 1	14.65'	0.1" Vert. WQV C= 0.600
#3	Device 1	18.40'	6.0" Horiz. Atrium Grate (High Flow Outlet) X 2.00 Limited to weir flow C= 0.600
#4	Discarded	14.40'	2.410 in/hr Exfiltration over Surface area

Discarded OutFlow Max=0.02 cfs @ 11.73 hrs HW=14.45' (Free Discharge)

↳4=Exfiltration (Exfiltration Controls 0.02 cfs)

Primary OutFlow Max=0.00 cfs @ 12.73 hrs HW=15.52' (Free Discharge)


↳1=Culvert (Passes 0.00 cfs of 0.66 cfs potential flow)

↳2=WQV (Orifice Controls 0.00 cfs @ 4.48 fps)

↳3=Atrium Grate (High Flow Outlet) (Controls 0.00 cfs)

Pond 2P: Rain Garden

Hydrograph

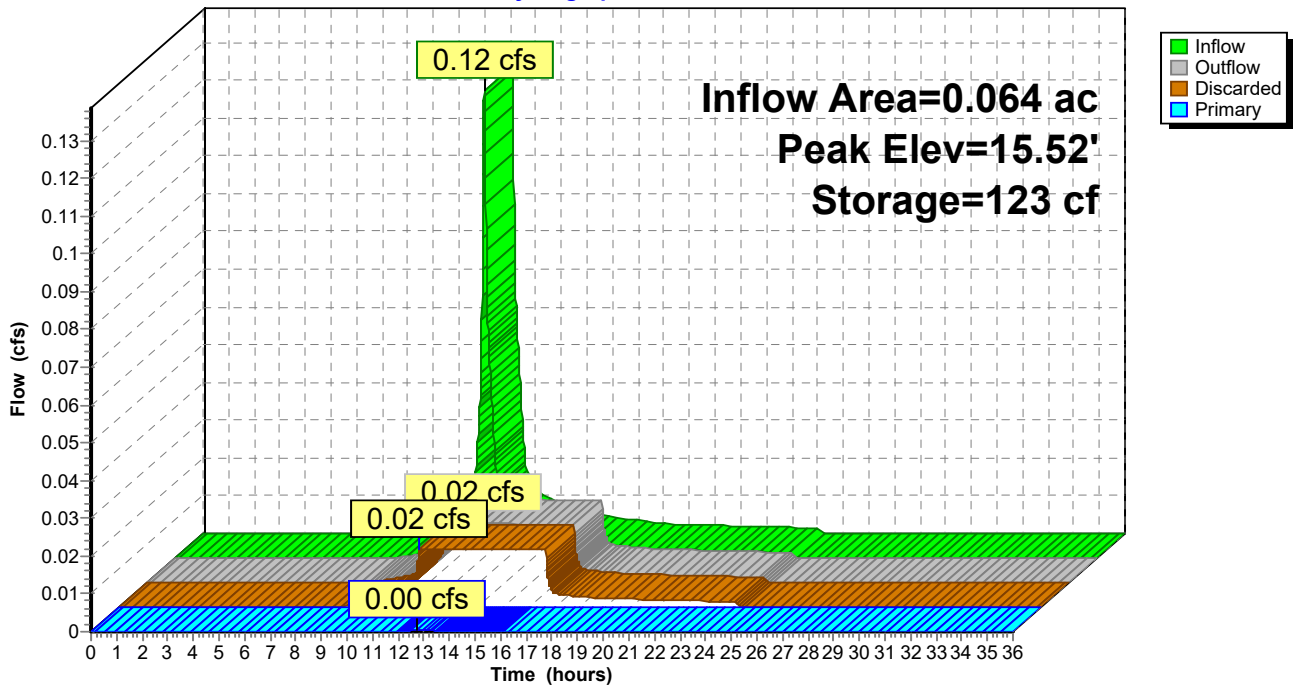

Post_8-22-16

Type III 24-hr 10-year Rainfall=4.60"

Prepared by Acorn Engineering, Inc.

Printed 8/23/2016

HydroCAD® 8.50 s/n 000620 © 2007 HydroCAD Software Solutions LLC

Page 31

Time span=0.00-36.00 hrs, dt=0.01 hrs, 3601 points

Runoff by SCS TR-20 method, UH=SCS

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: North Roof Runoff Area=1,856 sf 67.89% Impervious Runoff Depth=2.29"
Tc=5.0 min CN=77 Runoff=0.12 cfs 0.008 af

Subcatchment 2S: Central Roof & Sidewalks Runoff Area=2,776 sf 60.59% Impervious Runoff Depth=2.91"
Tc=5.0 min CN=84 Runoff=0.22 cfs 0.015 af

Subcatchment 3S: Parking & South Roof Runoff Area=4,270 sf 81.97% Impervious Runoff Depth=3.70"
Tc=5.0 min CN=92 Runoff=0.42 cfs 0.030 af

Subcatchment 4S: Frontage Runoff Runoff Area=163 sf 0.00% Impervious Runoff Depth=0.58"
Tc=5.0 min CN=51 Runoff=0.00 cfs 0.000 af

Reach 1R: Anderson St Inflow=0.00 cfs 0.001 af
Outflow=0.00 cfs 0.001 af

Reach 2R: E Lancaster St Inflow=0.42 cfs 0.030 af
Outflow=0.42 cfs 0.030 af

Reach 12R: Fox St Inflow=0.42 cfs 0.031 af
Outflow=0.42 cfs 0.031 af

Pond 1P: Dripline BMP Peak Elev=12.49' Storage=104 cf Inflow=0.12 cfs 0.008 af
Discarded=0.03 cfs 0.008 af Primary=0.00 cfs 0.000 af Outflow=0.03 cfs 0.008 af

Pond 2P: Rain Garden Peak Elev=17.94' Storage=230 cf Inflow=0.22 cfs 0.015 af
Discarded=0.05 cfs 0.015 af Primary=0.00 cfs 0.000 af Outflow=0.05 cfs 0.015 af

Total Runoff Area = 0.208 ac Runoff Volume = 0.054 af Average Runoff Depth = 3.11"
28.94% Pervious = 0.060 ac 71.06% Impervious = 0.148 ac

Summary for Subcatchment 1S: North Roof

Runoff = 0.12 cfs @ 12.08 hrs, Volume= 0.008 af, Depth= 2.29"


Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs
 Type III 24-hr 10-year Rainfall=4.60"

	Area (sf)	CN	Description
*	1,260	98	Roofs, HSG A
	596	32	Woods/grass comb., Good, HSG A
	1,856	77	Weighted Average
	596		Pervious Area
	1,260		Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Subcatchment 1S: North Roof

Hydrograph

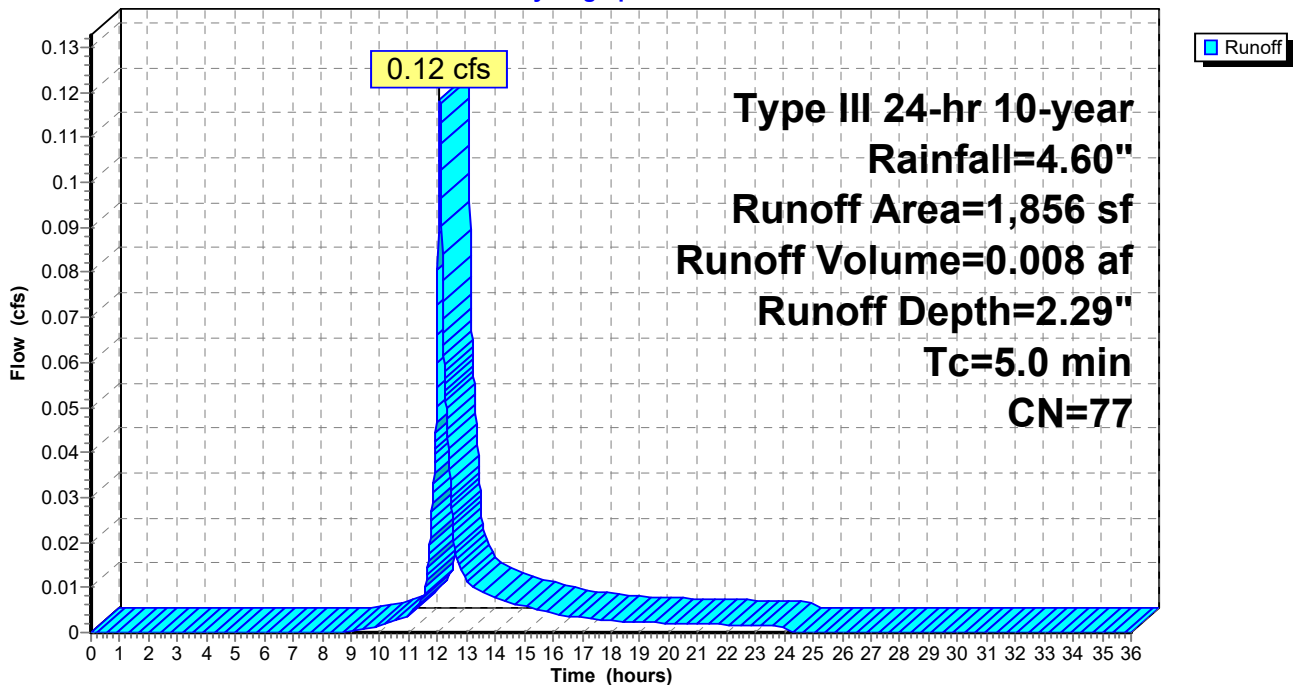

Summary for Subcatchment 2S: Central Roof & Sidewalks

Runoff = 0.22 cfs @ 12.07 hrs, Volume= 0.015 af, Depth= 2.91"


Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs
 Type III 24-hr 10-year Rainfall=4.60"

	Area (sf)	CN	Description
*	839	98	Roofs, HSG A
*	843	98	Roofs, HSG A
*	525	96	Brick Pavers, HSG A
	569	32	Woods/grass comb., Good, HSG A
	2,776	84	Weighted Average
	1,094		Pervious Area
	1,682		Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Subcatchment 2S: Central Roof & Sidewalks

Hydrograph

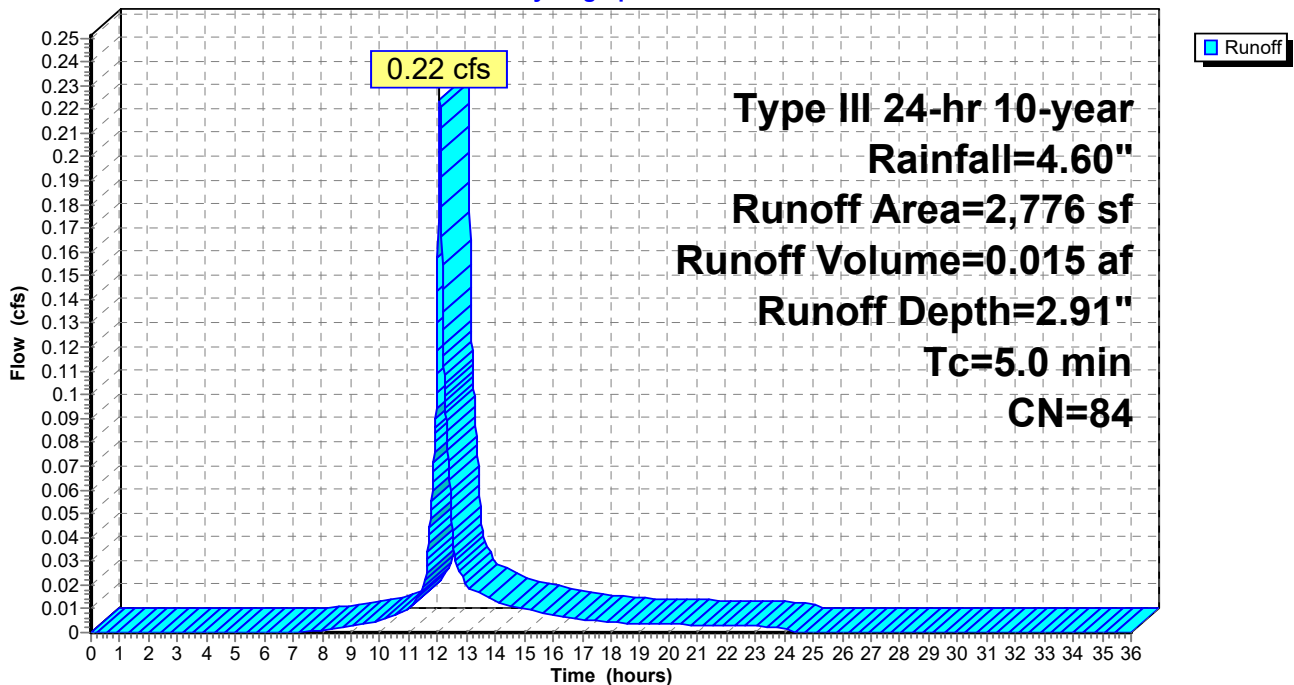

Summary for Subcatchment 3S: Parking & South Roof

Runoff = 0.42 cfs @ 12.07 hrs, Volume= 0.030 af, Depth= 3.70"


Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs
 Type III 24-hr 10-year Rainfall=4.60"

Area (sf)	CN	Description
* 2,150	98	Paved Parking, HSG A
* 257	96	Brick Pavers, HSG A
* 1,270	98	Roofs, HSG A
342	32	Woods/grass comb., Good, HSG A
* 171	77	Crushed Stone, HSG A
* 64	98	Concrete, HSG A
* 16	98	Transformer Top, HSG A
4,270	92	Weighted Average
770		Pervious Area
3,500		Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Subcatchment 3S: Parking & South Roof

Hydrograph

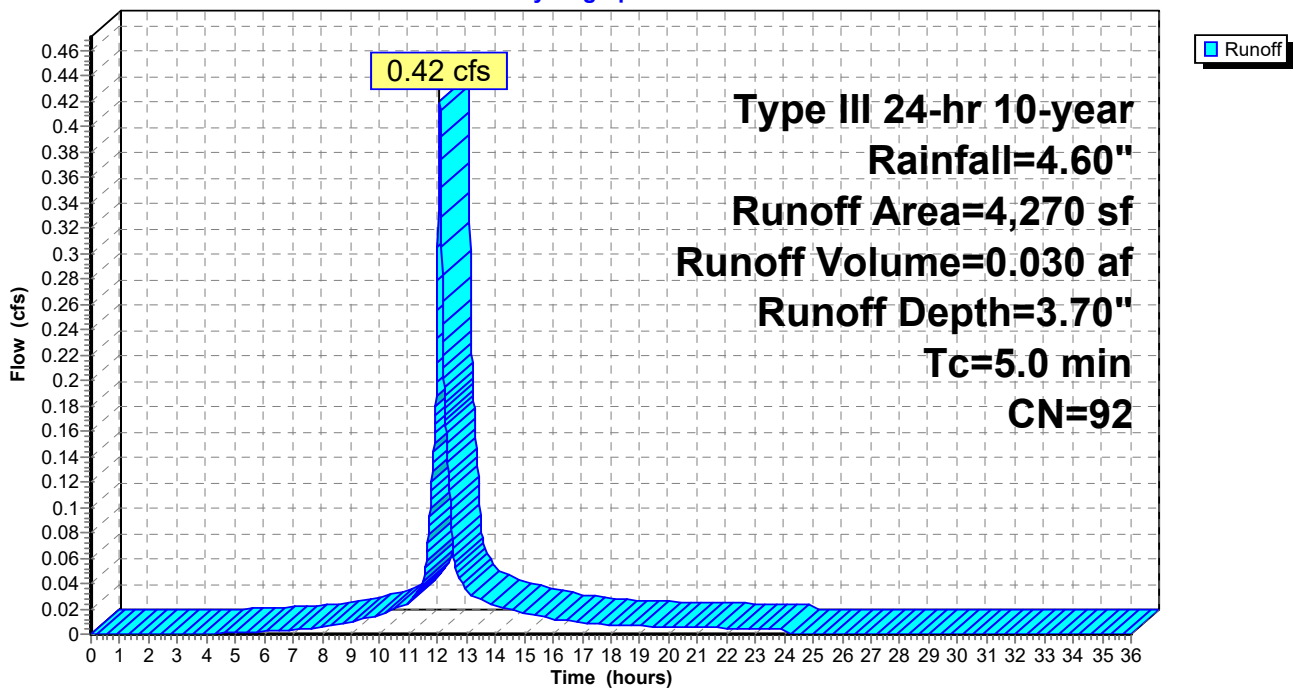

Summary for Subcatchment 4S: Frontage Runoff


Runoff = 0.00 cfs @ 12.11 hrs, Volume= 0.000 af, Depth= 0.58"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs
 Type III 24-hr 10-year Rainfall=4.60"

Area (sf)	CN	Description
115	32	Woods/grass comb., Good, HSG A
* 48	96	Brick Pavers, HSG A
163	51	Weighted Average
163		Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Subcatchment 4S: Frontage Runoff

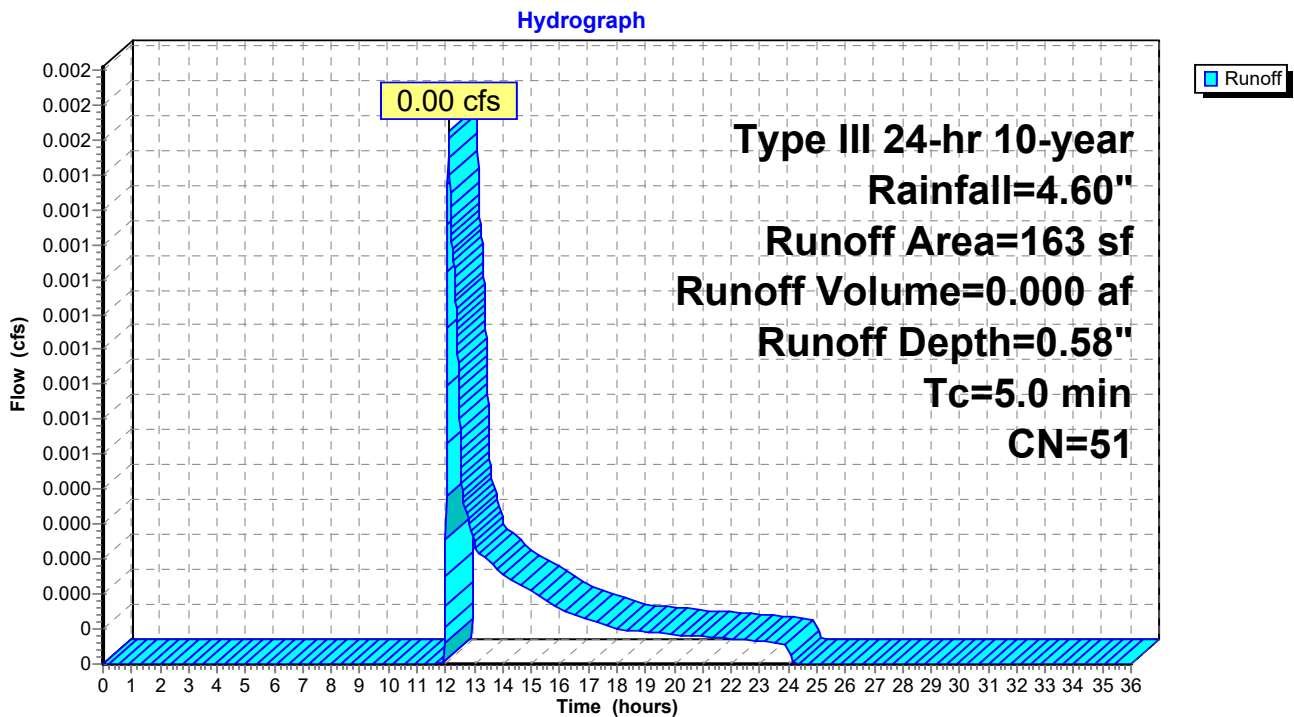

Summary for Reach 1R: Anderson St


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.110 ac, 61.36% Impervious, Inflow Depth = 0.07" for 10-year event
Inflow = 0.00 cfs @ 12.34 hrs, Volume= 0.001 af
Outflow = 0.00 cfs @ 12.34 hrs, Volume= 0.001 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs

Reach 1R: Anderson St

Hydrograph

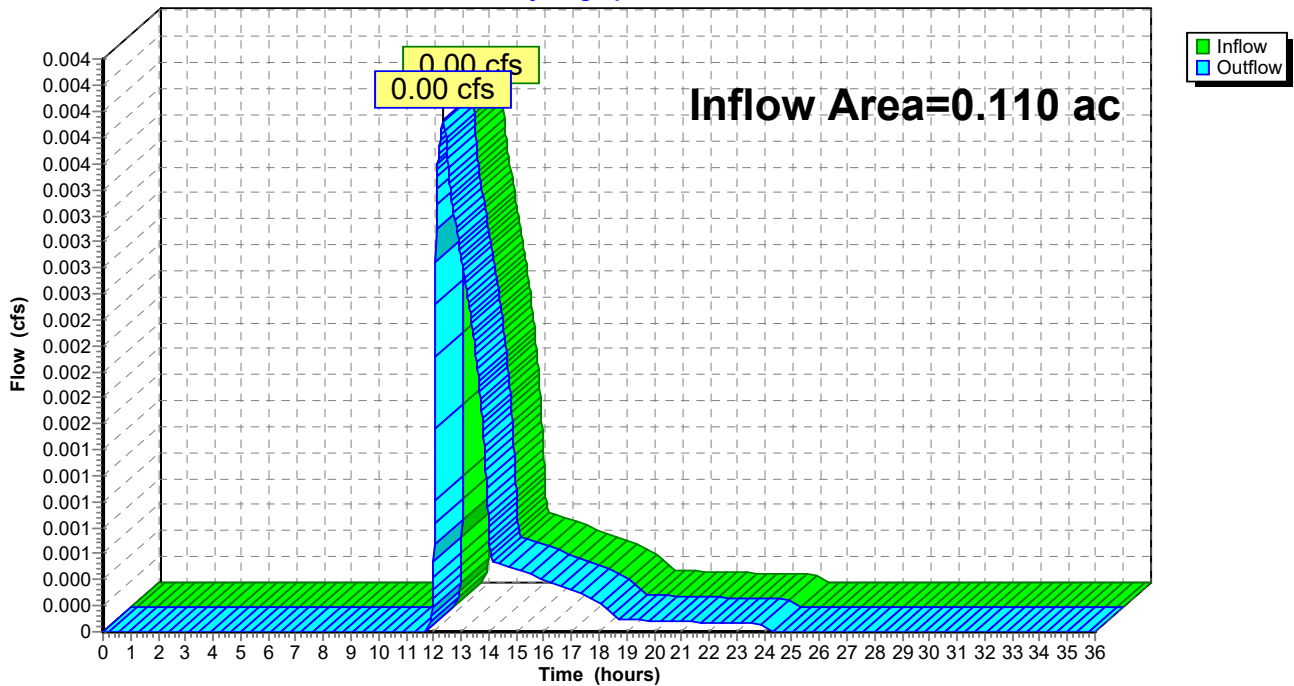

Summary for Reach 2R: E Lancaster St


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.098 ac, 81.97% Impervious, Inflow Depth = 3.70" for 10-year event
Inflow = 0.42 cfs @ 12.07 hrs, Volume= 0.030 af
Outflow = 0.42 cfs @ 12.07 hrs, Volume= 0.030 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs

Reach 2R: E Lancaster St

Hydrograph

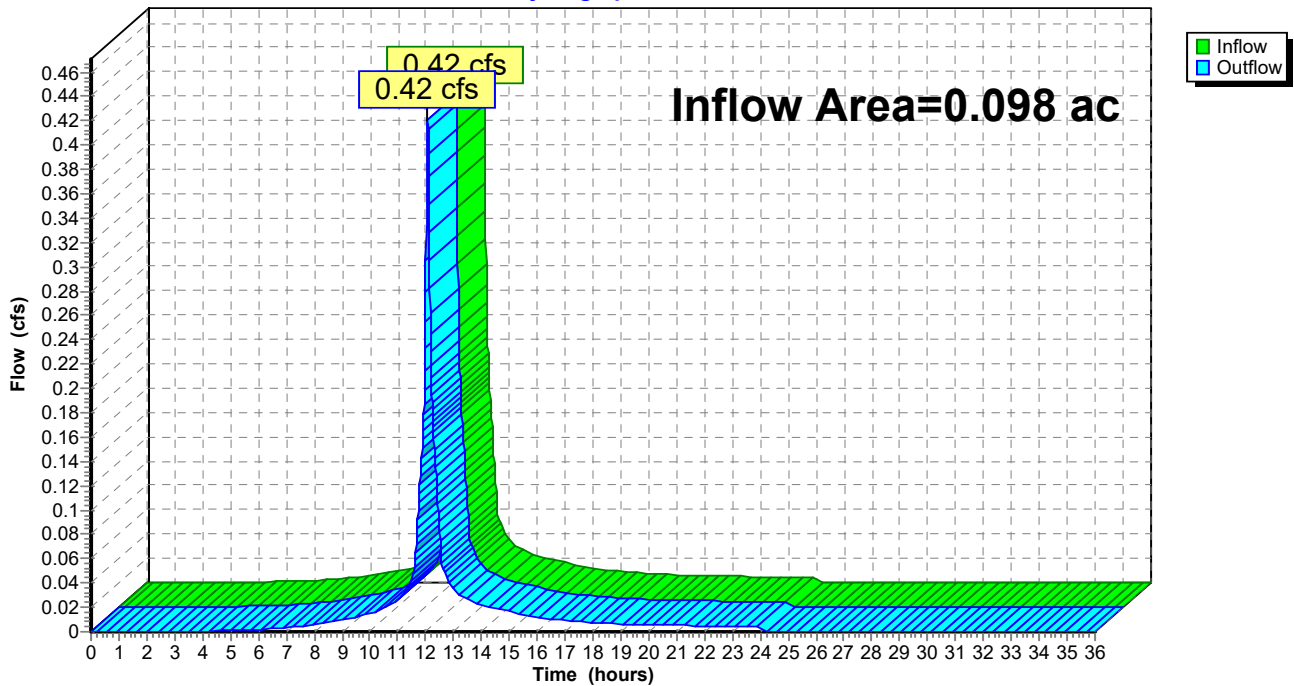


Summary for Reach 12R: Fox St

[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.208 ac, 71.06% Impervious, Inflow Depth = 1.78" for 10-year event
Inflow = 0.42 cfs @ 12.07 hrs, Volume= 0.031 af
Outflow = 0.42 cfs @ 12.07 hrs, Volume= 0.031 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs

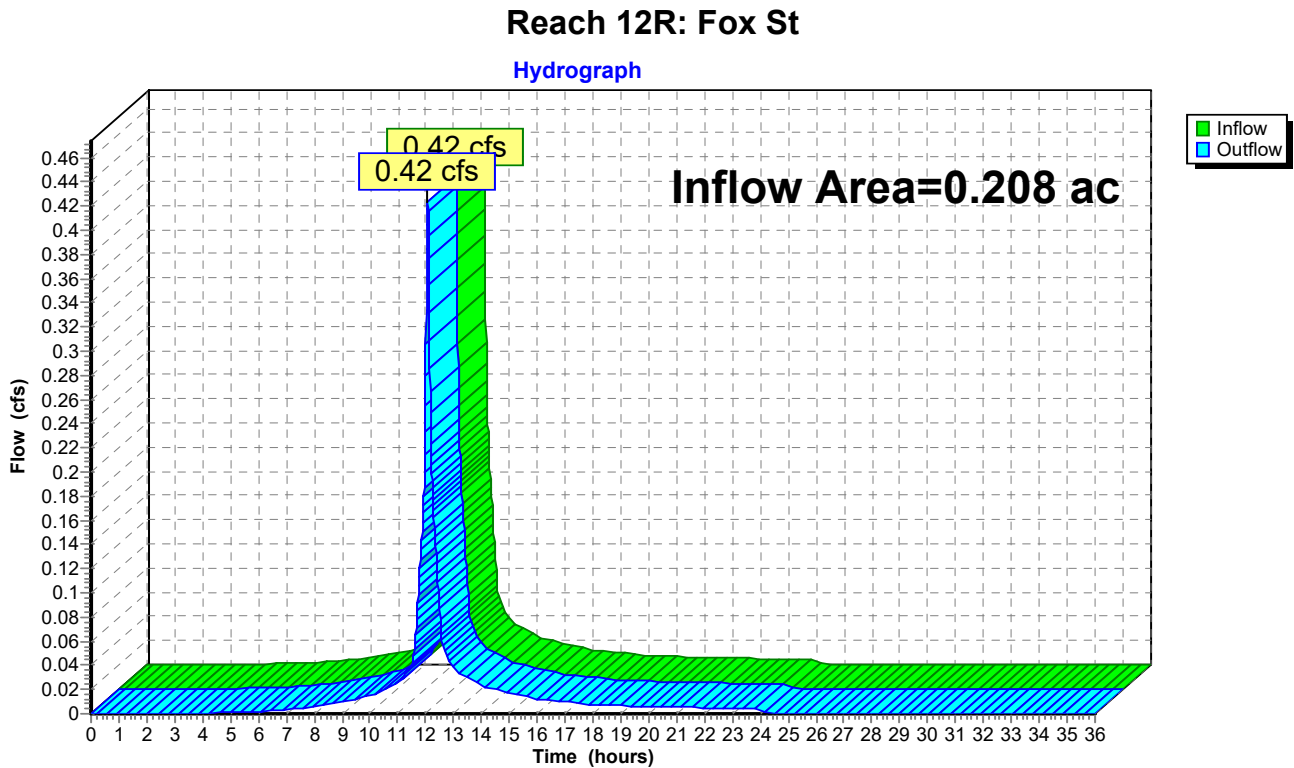

Summary for Pond 1P: Dripline BMP

Inflow Area = 0.043 ac, 67.89% Impervious, Inflow Depth = 2.29" for 10-year event
 Inflow = 0.12 cfs @ 12.08 hrs, Volume= 0.008 af
 Outflow = 0.03 cfs @ 12.49 hrs, Volume= 0.008 af, Atten= 77%, Lag= 24.7 min
 Discarded = 0.03 cfs @ 12.49 hrs, Volume= 0.008 af
 Primary = 0.00 cfs @ 12.49 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs
 Peak Elev= 12.49' @ 12.49 hrs Surf.Area= 135 sf Storage= 104 cf

Plug-Flow detention time= 35.4 min calculated for 0.008 af (100% of inflow)
 Center-of-Mass det. time= 35.4 min (868.1 - 832.7)


Volume	Invert	Avail.Storage	Storage Description
#1	14.08'	126 cf	3.00'W x 90.00'L x 1.17'H Prismaoid - Water Quality Volume 316 cf Overall x 40.0% Voids
#2	13.08'	27 cf	3.00'W x 90.00'L x 1.00'H Prismaoid - Soil Filter Media 270 cf Overall x 10.0% Voids
#3	11.75'	18 cf	6.0"D x 90.00'L 6" Pipe Storage S= 0.0025 '/' Inside #4
#4	10.75'	119 cf	1.50'W x 90.00'L x 2.33'H Prismaoid - Crushed Stone 315 cf Overall - 18 cf Embedded = 297 cf x 40.0% Voids
		290 cf	Total Available Storage

Device	Routing	Invert	Outlet Devices
#1	Primary	11.53'	6.0" x 50.0' long Culvert CMP, mitered to conform to fill, Ke= 0.700 Outlet Invert= 11.40' S= 0.0026 '/' Cc= 0.900 n= 0.010
#2	Device 1	11.53'	1.0" Vert. Orifice/Grate X 0.10 C= 0.600
#3	Discarded	10.75'	2.410 in/hr Exfiltration over Wetted area

Discarded OutFlow Max=0.03 cfs @ 12.49 hrs HW=12.49' (Free Discharge)
 ↳ **3=Exfiltration** (Exfiltration Controls 0.03 cfs)

Primary OutFlow Max=0.00 cfs @ 12.49 hrs HW=12.49' (Free Discharge)
 ↳ **1=Culvert** (Passes 0.00 cfs of 0.60 cfs potential flow)
 ↳ **2=Orifice/Grate** (Orifice Controls 0.00 cfs @ 0.46 fps)

Pond 1P: Dripline BMP

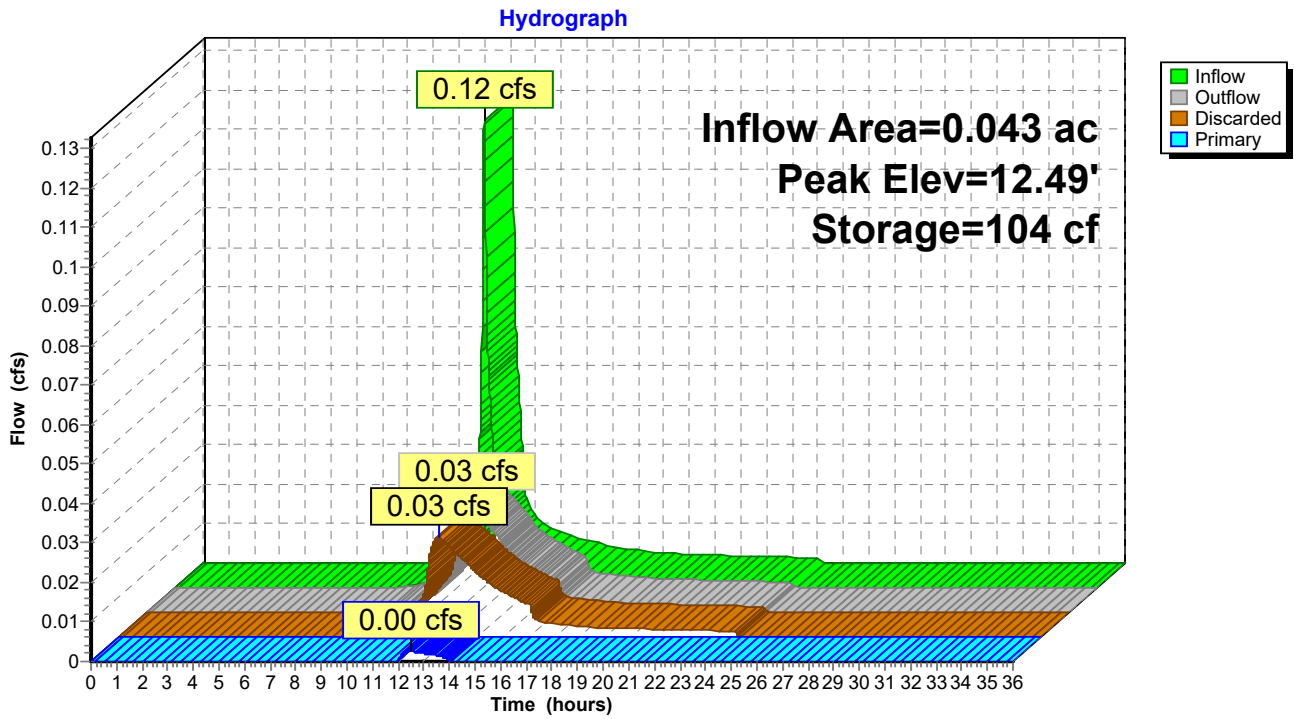

Summary for Pond 2P: Rain Garden

Inflow Area = 0.064 ac, 60.59% Impervious, Inflow Depth = 2.91" for 10-year event
 Inflow = 0.22 cfs @ 12.07 hrs, Volume= 0.015 af
 Outflow = 0.05 cfs @ 12.50 hrs, Volume= 0.015 af, Atten= 79%, Lag= 25.3 min
 Discarded = 0.05 cfs @ 12.50 hrs, Volume= 0.015 af
 Primary = 0.00 cfs @ 12.50 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs
 Peak Elev= 17.94' @ 12.50 hrs Surf.Area= 837 sf Storage= 230 cf

Plug-Flow detention time= 81.4 min calculated for 0.015 af (100% of inflow)
 Center-of-Mass det. time= 81.4 min (894.3 - 813.0)

Volume	Invert	Avail.Storage	Storage Description
#1	17.90'	431 cf	Water Quality Volume (Prismatic) Listed below (Recalc)
#2	15.90'	55 cf	Loam/Soil/Gravel Filter Media (Prismatic) Listed below (Recalc) 550 cf Overall x 10.0% Voids
#3	14.40'	165 cf	Crushed Stone (Prismatic) Listed below (Recalc) 413 cf Overall x 40.0% Voids
		651 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
17.90	275	0	0
18.40	443	180	180
18.90	564	252	431

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
15.90	275	0	0
17.90	275	550	550

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
14.40	275	0	0
15.90	275	413	413

Device	Routing	Invert	Outlet Devices
#1	Primary	14.65'	6.0" x 50.0' long Culvert CMP, mitered to conform to fill, Ke= 0.700 Outlet Invert= 11.51' S= 0.0628 '/' Cc= 0.900 n= 0.010 PVC, smooth interior
#2	Device 1	14.65'	0.1" Vert. WQV C= 0.600
#3	Device 1	18.40'	6.0" Horiz. Atrium Grate (High Flow Outlet) X 2.00 Limited to weir flow C= 0.600
#4	Discarded	14.40'	2.410 in/hr Exfiltration over Surface area

Discarded OutFlow Max=0.05 cfs @ 12.50 hrs HW=17.94' (Free Discharge)

↳4=Exfiltration (Exfiltration Controls 0.05 cfs)

Primary OutFlow Max=0.00 cfs @ 12.50 hrs HW=17.94' (Free Discharge)


↳1=Culvert (Passes 0.00 cfs of 1.45 cfs potential flow)

↳2=WQV (Orifice Controls 0.00 cfs @ 8.72 fps)

↳3=Atrium Grate (High Flow Outlet) (Controls 0.00 cfs)

Pond 2P: Rain Garden

Hydrograph

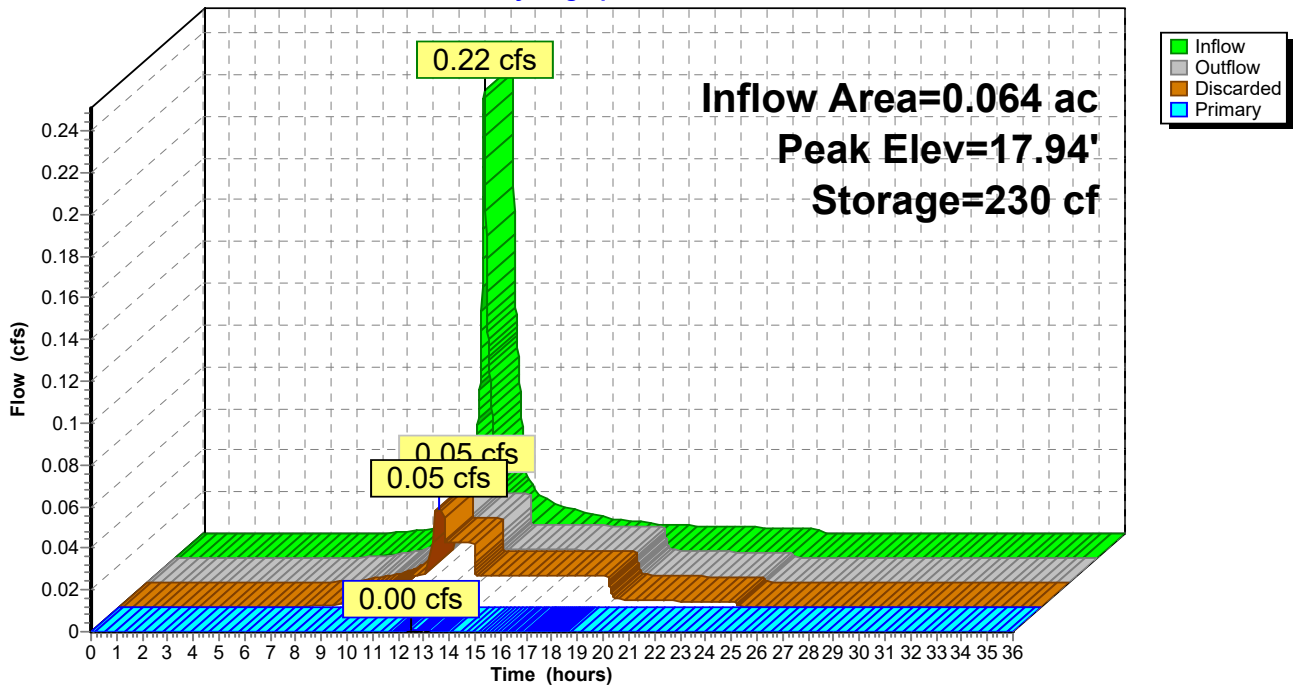

Time span=0.00-36.00 hrs, dt=0.01 hrs, 3601 points
Runoff by SCS TR-20 method, UH=SCS
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: North Roof Runoff Area=1,856 sf 67.89% Impervious Runoff Depth=3.31"
Tc=5.0 min CN=77 Runoff=0.17 cfs 0.012 af

Subcatchment 2S: Central Roof & Sidewalks Runoff Area=2,776 sf 60.59% Impervious Runoff Depth=4.01"
Tc=5.0 min CN=84 Runoff=0.31 cfs 0.021 af

Subcatchment 3S: Parking & South Roof Runoff Area=4,270 sf 81.97% Impervious Runoff Depth=4.87"
Tc=5.0 min CN=92 Runoff=0.55 cfs 0.040 af

Subcatchment 4S: Frontage Runoff Runoff Area=163 sf 0.00% Impervious Runoff Depth=1.12"
Tc=5.0 min CN=51 Runoff=0.00 cfs 0.000 af

Reach 1R: Anderson St Inflow=0.01 cfs 0.001 af
Outflow=0.01 cfs 0.001 af

Reach 2R: E Lancaster St Inflow=0.55 cfs 0.040 af
Outflow=0.55 cfs 0.040 af

Reach 12R: Fox St Inflow=0.55 cfs 0.041 af
Outflow=0.55 cfs 0.041 af

Pond 1P: Dripline BMP Peak Elev=13.48' Storage=147 cf Inflow=0.17 cfs 0.012 af
Discarded=0.05 cfs 0.011 af Primary=0.00 cfs 0.001 af Outflow=0.05 cfs 0.012 af

Pond 2P: Rain Garden Peak Elev=18.24' Storage=332 cf Inflow=0.31 cfs 0.021 af
Discarded=0.05 cfs 0.021 af Primary=0.00 cfs 0.000 af Outflow=0.05 cfs 0.021 af

Total Runoff Area = 0.208 ac Runoff Volume = 0.073 af Average Runoff Depth = 4.22"
28.94% Pervious = 0.060 ac 71.06% Impervious = 0.148 ac

Summary for Subcatchment 1S: North Roof

Runoff = 0.17 cfs @ 12.07 hrs, Volume= 0.012 af, Depth= 3.31"


Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs
 Type III 24-hr 25-year Rainfall=5.80"

	Area (sf)	CN	Description
*	1,260	98	Roofs, HSG A
	596	32	Woods/grass comb., Good, HSG A
	1,856	77	Weighted Average
	596		Pervious Area
	1,260		Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Subcatchment 1S: North Roof

Hydrograph

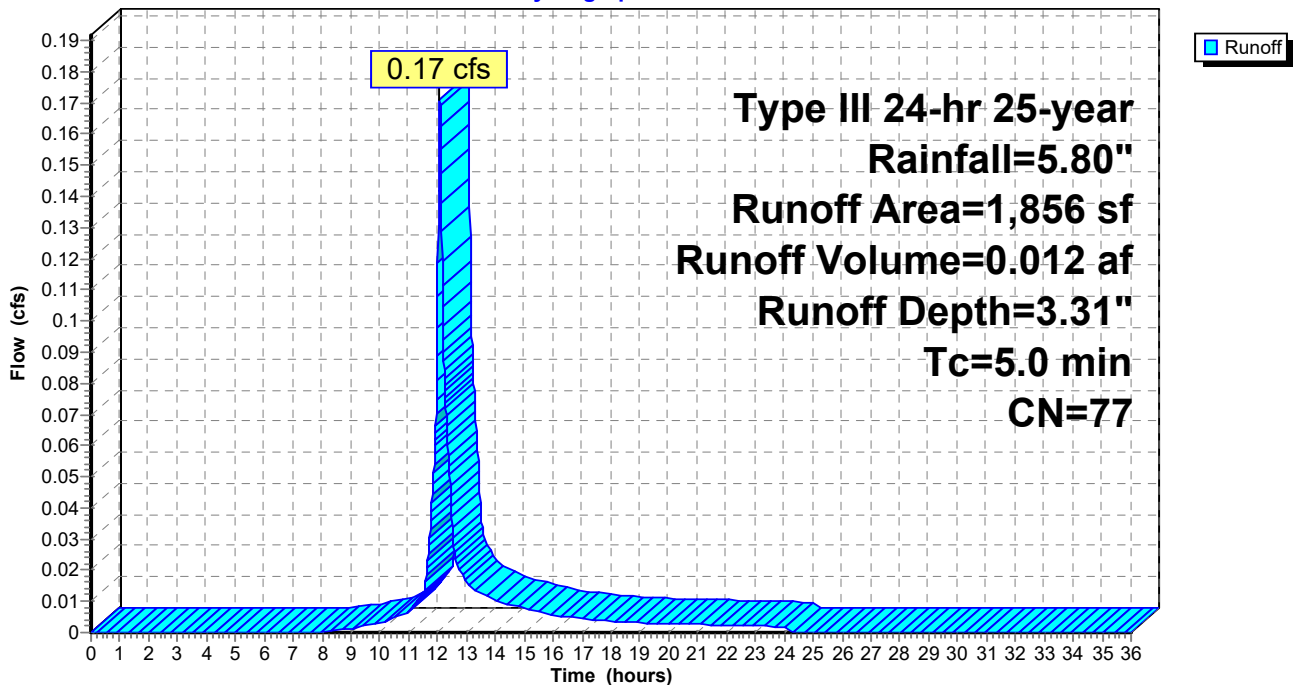

Summary for Subcatchment 2S: Central Roof & Sidewalks

Runoff = 0.31 cfs @ 12.07 hrs, Volume= 0.021 af, Depth= 4.01"


Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs
 Type III 24-hr 25-year Rainfall=5.80"

Area (sf)	CN	Description
* 839	98	Roofs, HSG A
* 843	98	Roofs, HSG A
* 525	96	Brick Pavers, HSG A
569	32	Woods/grass comb., Good, HSG A
2,776	84	Weighted Average
1,094		Pervious Area
1,682		Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Subcatchment 2S: Central Roof & Sidewalks

Hydrograph

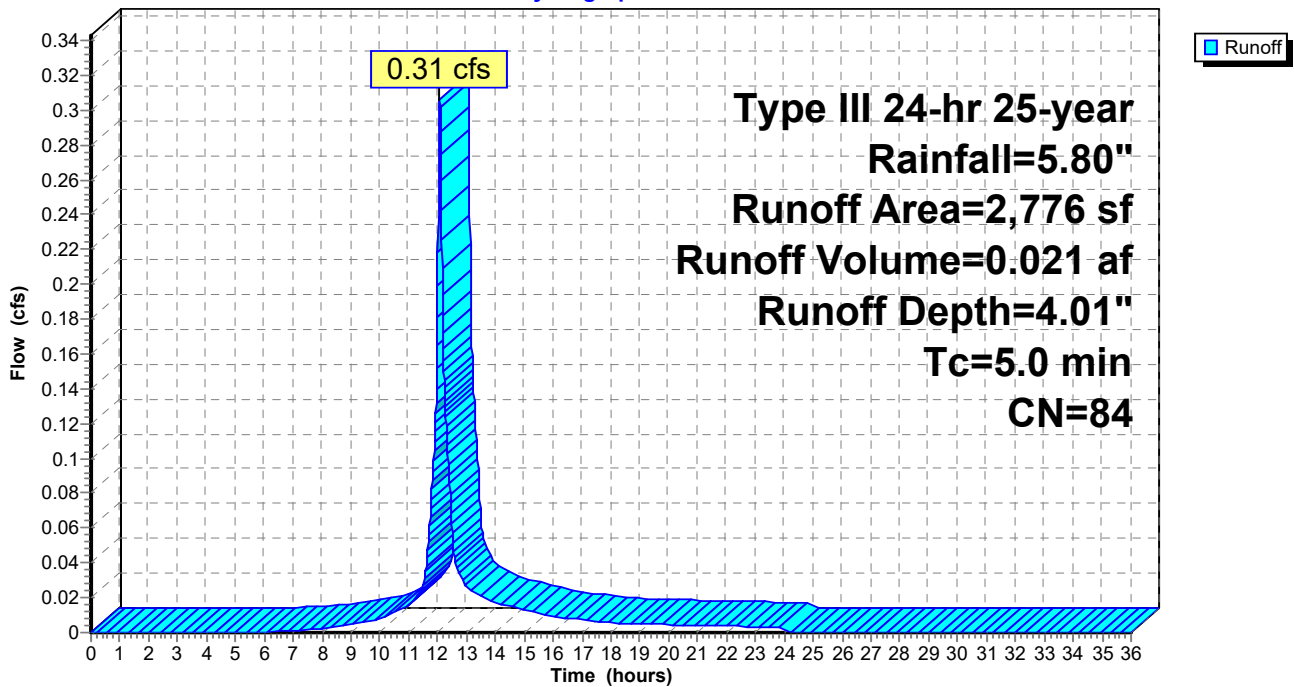

Summary for Subcatchment 3S: Parking & South Roof

Runoff = 0.55 cfs @ 12.07 hrs, Volume= 0.040 af, Depth= 4.87"


Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs
 Type III 24-hr 25-year Rainfall=5.80"

Area (sf)	CN	Description
* 2,150	98	Paved Parking, HSG A
* 257	96	Brick Pavers, HSG A
* 1,270	98	Roofs, HSG A
342	32	Woods/grass comb., Good, HSG A
* 171	77	Crushed Stone, HSG A
* 64	98	Concrete, HSG A
* 16	98	Transformer Top, HSG A
4,270	92	Weighted Average
770		Pervious Area
3,500		Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Subcatchment 3S: Parking & South Roof

Hydrograph

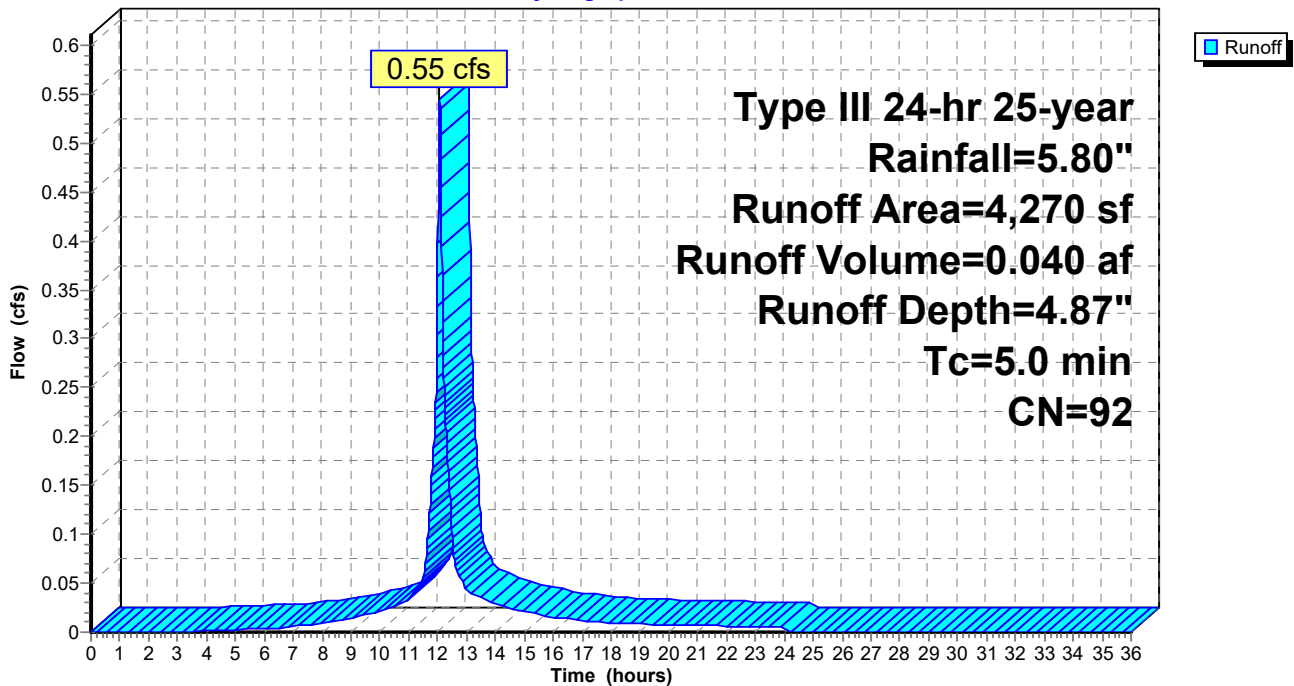

Summary for Subcatchment 4S: Frontage Runoff

Runoff = 0.00 cfs @ 12.09 hrs, Volume= 0.000 af, Depth= 1.12"


Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs
 Type III 24-hr 25-year Rainfall=5.80"

Area (sf)	CN	Description
115	32	Woods/grass comb., Good, HSG A
* 48	96	Brick Pavers, HSG A
163	51	Weighted Average
163		Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry,

Subcatchment 4S: Frontage Runoff

Hydrograph

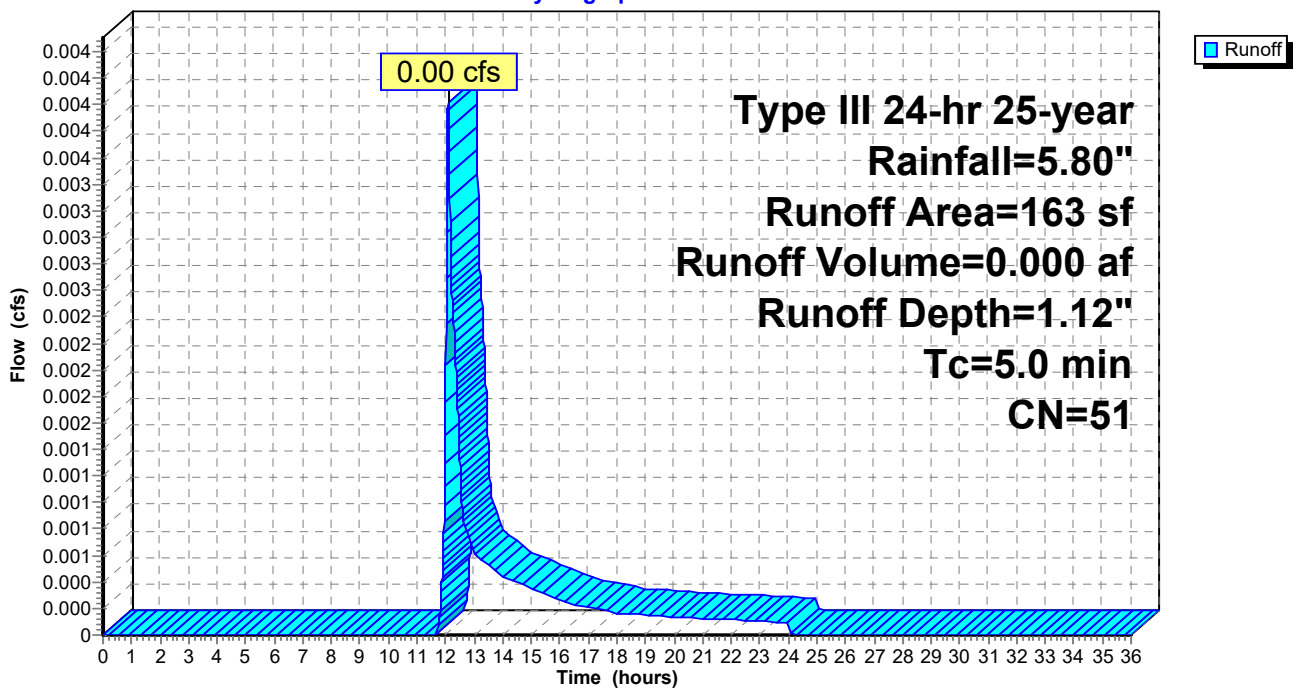

Summary for Reach 1R: Anderson St


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.110 ac, 61.36% Impervious, Inflow Depth = 0.11" for 25-year event
Inflow = 0.01 cfs @ 12.11 hrs, Volume= 0.001 af
Outflow = 0.01 cfs @ 12.11 hrs, Volume= 0.001 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs

Reach 1R: Anderson St

Hydrograph

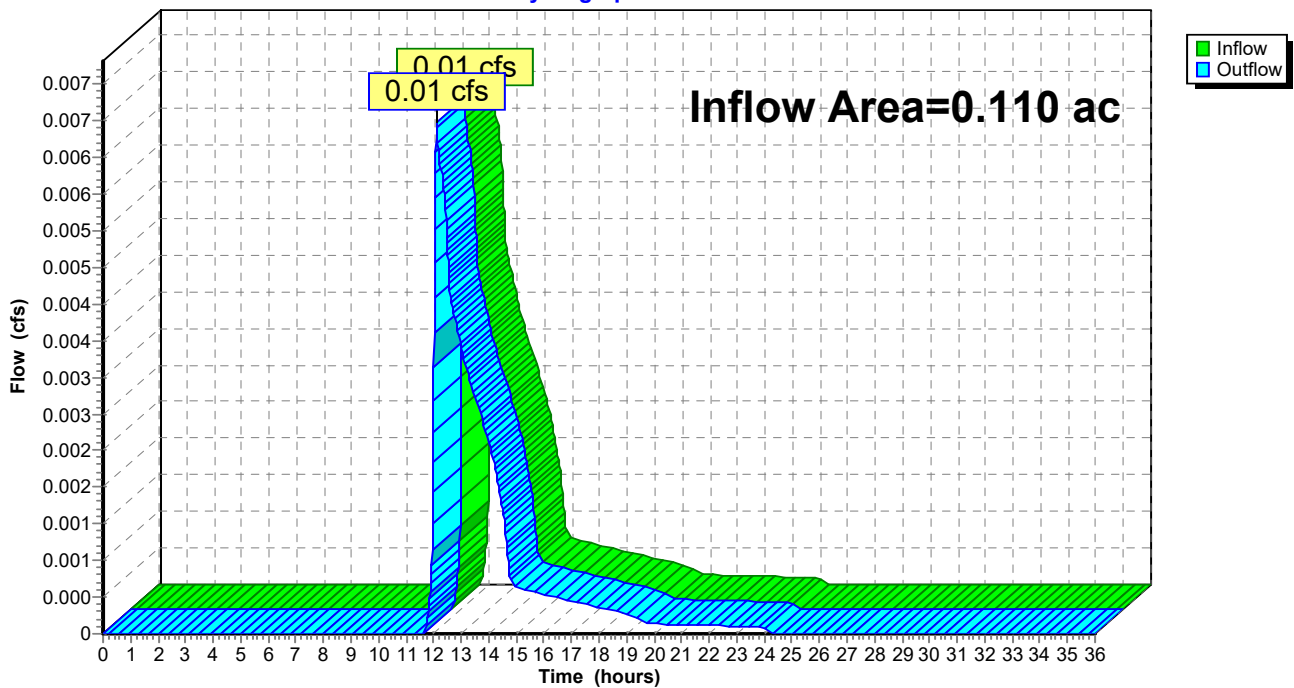

Summary for Reach 2R: E Lancaster St


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.098 ac, 81.97% Impervious, Inflow Depth = 4.87" for 25-year event
Inflow = 0.55 cfs @ 12.07 hrs, Volume= 0.040 af
Outflow = 0.55 cfs @ 12.07 hrs, Volume= 0.040 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs

Reach 2R: E Lancaster St

Hydrograph

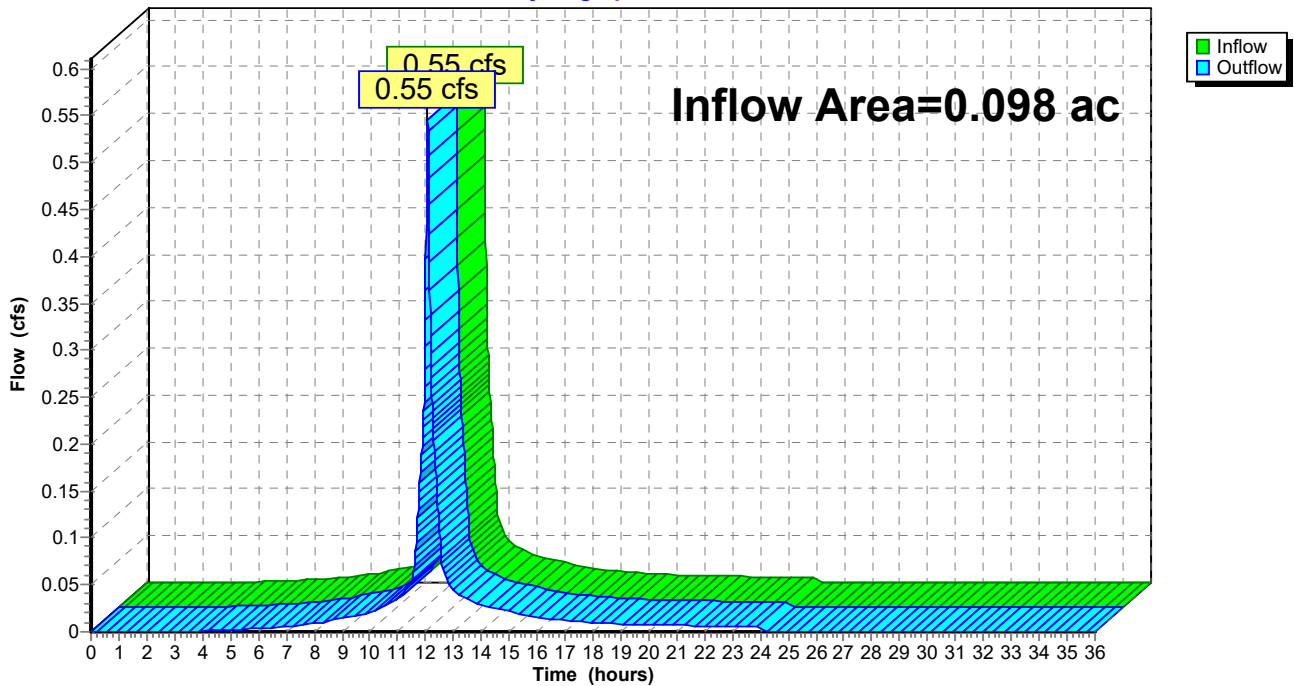


Summary for Reach 12R: Fox St

[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.208 ac, 71.06% Impervious, Inflow Depth = 2.36" for 25-year event
Inflow = 0.55 cfs @ 12.07 hrs, Volume= 0.041 af
Outflow = 0.55 cfs @ 12.07 hrs, Volume= 0.041 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs

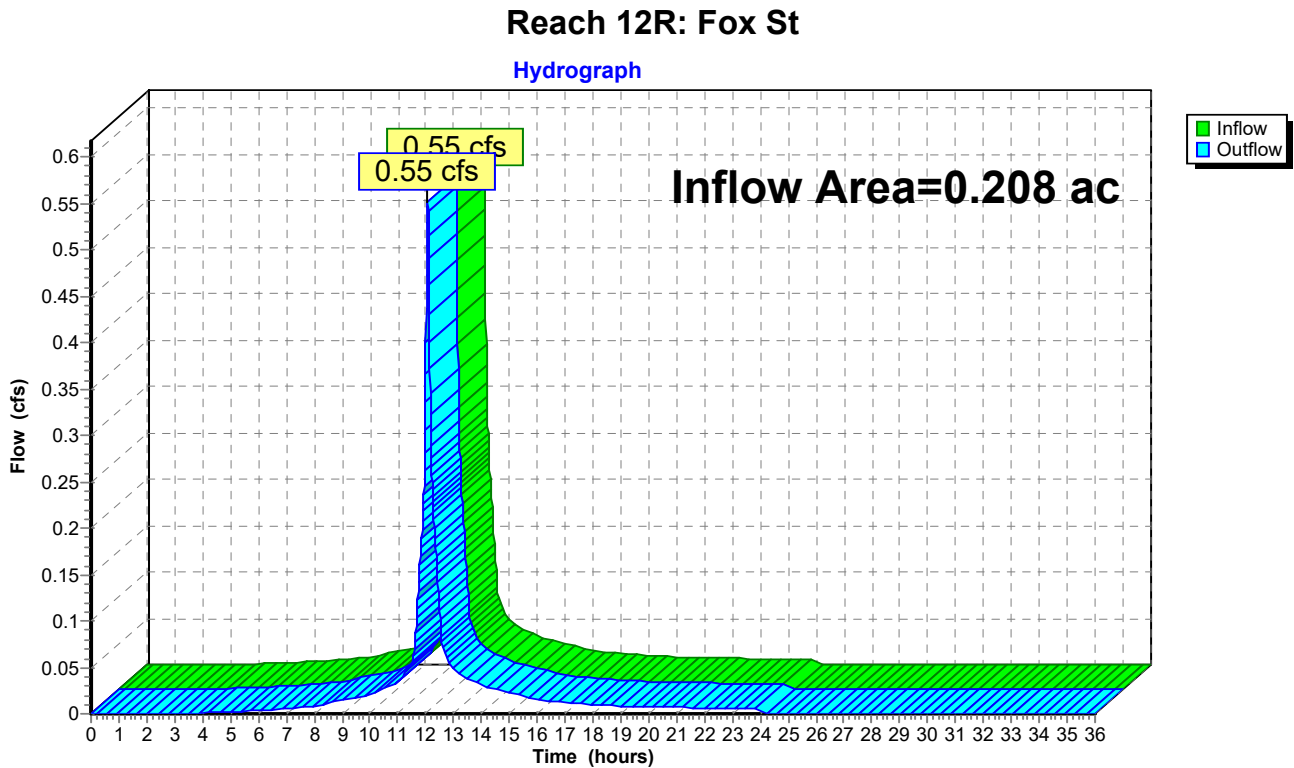

Summary for Pond 1P: Dripline BMP

Inflow Area = 0.043 ac, 67.89% Impervious, Inflow Depth = 3.31" for 25-year event
 Inflow = 0.17 cfs @ 12.07 hrs, Volume= 0.012 af
 Outflow = 0.05 cfs @ 12.39 hrs, Volume= 0.012 af, Atten= 68%, Lag= 19.1 min
 Discarded = 0.05 cfs @ 12.39 hrs, Volume= 0.011 af
 Primary = 0.00 cfs @ 12.39 hrs, Volume= 0.001 af

Routing by Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs
 Peak Elev= 13.48' @ 12.39 hrs Surf.Area= 405 sf Storage= 147 cf

Plug-Flow detention time= 38.5 min calculated for 0.012 af (100% of inflow)
 Center-of-Mass det. time= 38.5 min (860.7 - 822.1)

Volume	Invert	Avail.Storage	Storage Description
#1	14.08'	126 cf	3.00'W x 90.00'L x 1.17'H Prismaoid - Water Quality Volume 316 cf Overall x 40.0% Voids
#2	13.08'	27 cf	3.00'W x 90.00'L x 1.00'H Prismaoid - Soil Filter Media 270 cf Overall x 10.0% Voids
#3	11.75'	18 cf	6.0"D x 90.00'L 6" Pipe Storage S= 0.0025 '/' Inside #4
#4	10.75'	119 cf	1.50'W x 90.00'L x 2.33'H Prismaoid - Crushed Stone 315 cf Overall - 18 cf Embedded = 297 cf x 40.0% Voids
		290 cf	Total Available Storage


Device	Routing	Invert	Outlet Devices
#1	Primary	11.53'	6.0" x 50.0' long Culvert CMP, mitered to conform to fill, Ke= 0.700 Outlet Invert= 11.40' S= 0.0026 '/' Cc= 0.900 n= 0.010
#2	Device 1	11.53'	1.0" Vert. Orifice/Grate X 0.10 C= 0.600
#3	Discarded	10.75'	2.410 in/hr Exfiltration over Wetted area

Discarded OutFlow Max=0.05 cfs @ 12.39 hrs HW=13.48' (Free Discharge)
 ↳ **3=Exfiltration** (Exfiltration Controls 0.05 cfs)

Primary OutFlow Max=0.00 cfs @ 12.39 hrs HW=13.48' (Free Discharge)
 ↳ **1=Culvert** (Passes 0.00 cfs of 0.98 cfs potential flow)
 ↳ **2=Orifice/Grate** (Orifice Controls 0.00 cfs @ 0.66 fps)

Pond 1P: Dripline BMP

Hydrograph

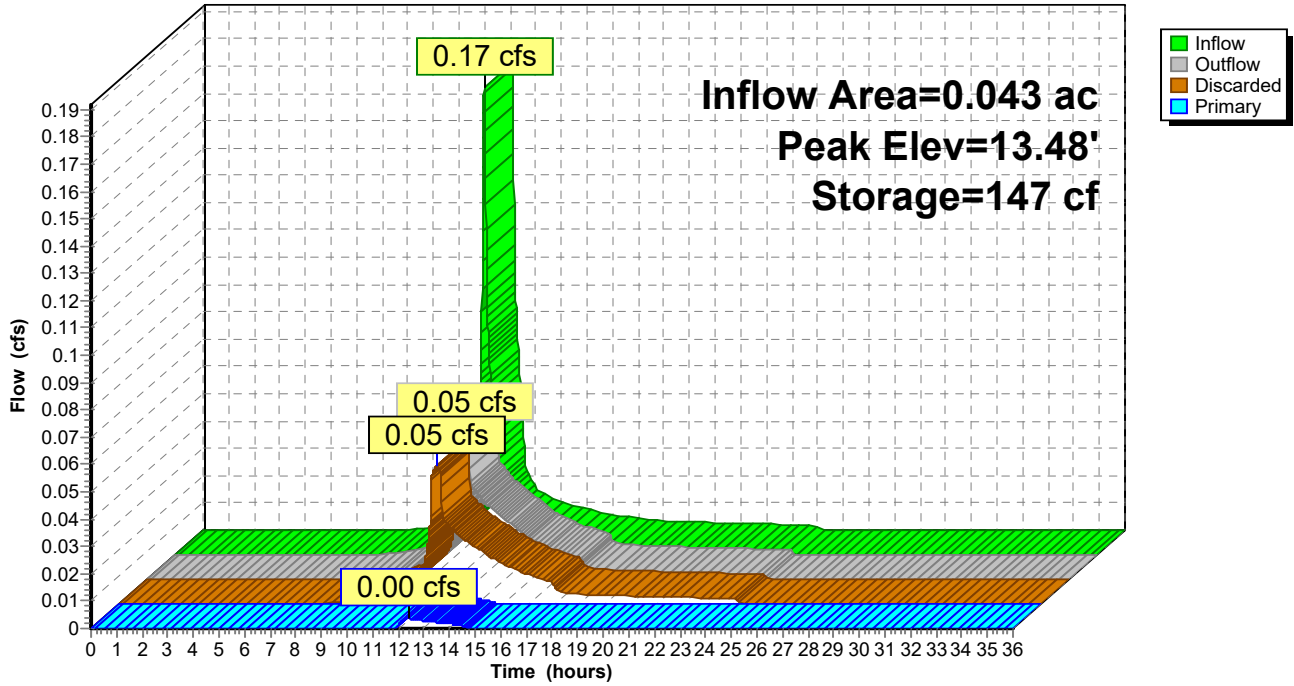

Summary for Pond 2P: Rain Garden

Inflow Area = 0.064 ac, 60.59% Impervious, Inflow Depth = 4.01" for 25-year event
 Inflow = 0.31 cfs @ 12.07 hrs, Volume= 0.021 af
 Outflow = 0.05 cfs @ 12.53 hrs, Volume= 0.021 af, Atten= 83%, Lag= 27.5 min
 Discarded = 0.05 cfs @ 12.53 hrs, Volume= 0.021 af
 Primary = 0.00 cfs @ 12.53 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.01 hrs
 Peak Elev= 18.24' @ 12.53 hrs Surf.Area= 938 sf Storage= 332 cf

Plug-Flow detention time= 82.1 min calculated for 0.021 af (100% of inflow)
 Center-of-Mass det. time= 82.1 min (885.9 - 803.8)

Volume	Invert	Avail.Storage	Storage Description
#1	17.90'	431 cf	Water Quality Volume (Prismatic) Listed below (Recalc)
#2	15.90'	55 cf	Loam/Soil/Gravel Filter Media (Prismatic) Listed below (Recalc) 550 cf Overall x 10.0% Voids
#3	14.40'	165 cf	Crushed Stone (Prismatic) Listed below (Recalc) 413 cf Overall x 40.0% Voids
		651 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
17.90	275	0	0
18.40	443	180	180
18.90	564	252	431

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
15.90	275	0	0
17.90	275	550	550

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
14.40	275	0	0
15.90	275	413	413

Device	Routing	Invert	Outlet Devices
#1	Primary	14.65'	6.0" x 50.0' long Culvert CMP, mitered to conform to fill, Ke= 0.700 Outlet Invert= 11.51' S= 0.0628 '/' Cc= 0.900 n= 0.010 PVC, smooth interior
#2	Device 1	14.65'	0.1" Vert. WQV C= 0.600
#3	Device 1	18.40'	6.0" Horiz. Atrium Grate (High Flow Outlet) X 2.00 Limited to weir flow C= 0.600
#4	Discarded	14.40'	2.410 in/hr Exfiltration over Surface area

Discarded OutFlow Max=0.05 cfs @ 12.53 hrs HW=18.24' (Free Discharge)

4=Exfiltration (Exfiltration Controls 0.05 cfs)

Primary OutFlow Max=0.00 cfs @ 12.53 hrs HW=18.24' (Free Discharge)

1=Culvert (Passes 0.00 cfs of 1.52 cfs potential flow)

2=WQV (Orifice Controls 0.00 cfs @ 9.11 fps)

3=Atrium Grate (High Flow Outlet) (Controls 0.00 cfs)

Pond 2P: Rain Garden

Hydrograph

