



NOTES:


1. REFER TO DRAWING POWER PLAN E2.1 FOR CIRCUIT REQUIREMENTS AND MOUNTING HEIGHTS.




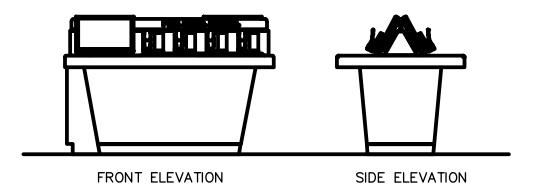

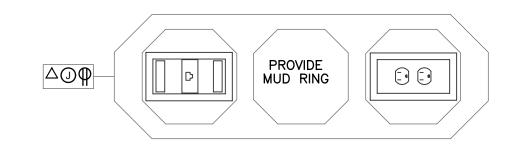



HTVE SHELF: DATA / MUD RING / RECEPTACLE

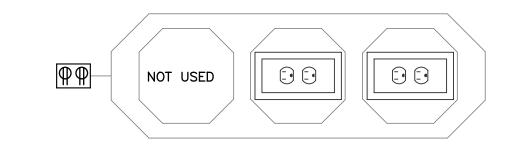


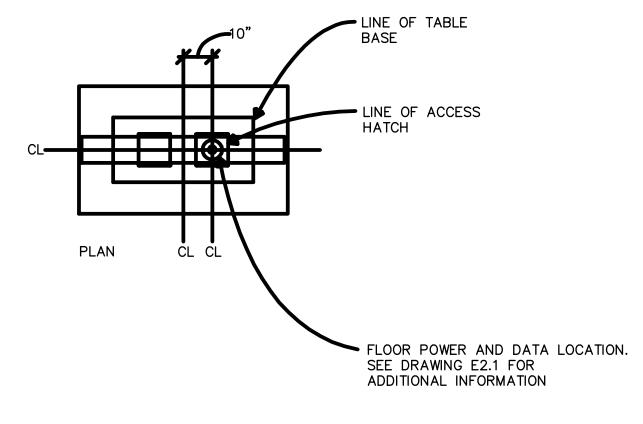



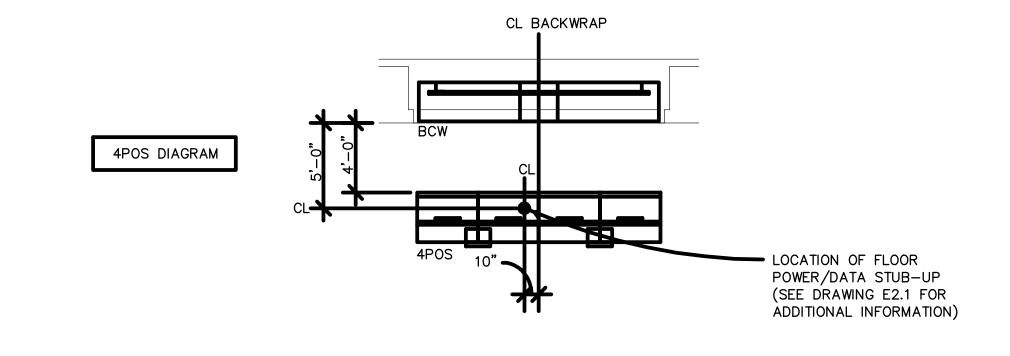

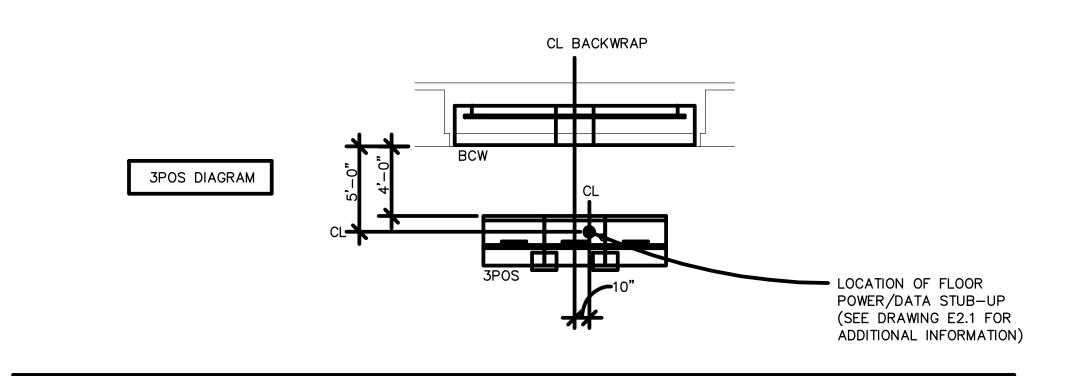

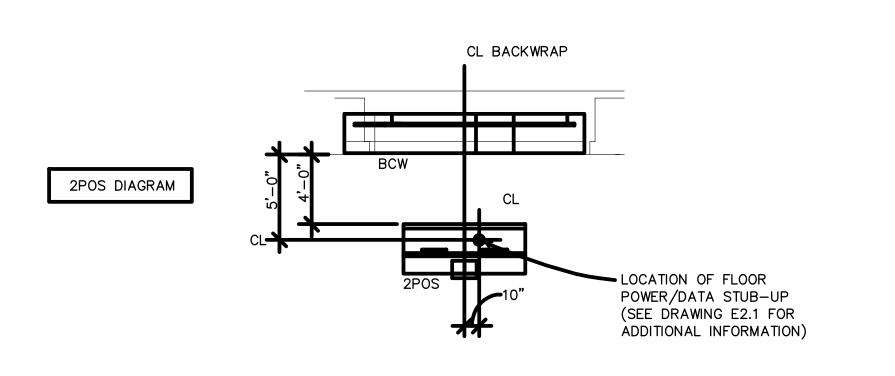

POS POWER/DATA DETAIL

DATE: **Ø8-14-Ø8** JOB NO: **2982** DRAWN: AD

CHECKED:



711 N. FIELDER RD. ARLINGTON, TX 76012 PH: (817) 635-5696 FAX: (817) 635-5699

IAL WAY

MarvinWaxman
CONSULTING ENGINEERS, INC.

30 Walnut Street | 11th Floor hiladelphia, PA 19106 EL 215 923 8270 AX 215 923 8272 ww.mwce.net a subsidiary of URBAN ENGINEERS, INC.

REVISIONS

ELECTRICAL DETAILS-SHEET 2

SHEET NUMBER

E3.2