




PORTLAND, MAINE

HA Project No.	17011
----------------	-------

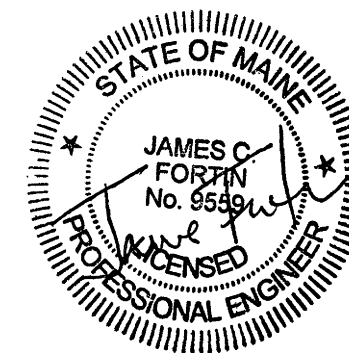


CONSTRUCTION DOCUMENTS

Date	06-21-17
Scale	1/2"=1'-0"

© 2017 Harriman Associates

GRIND2ENERGY TANK
CONCRETE PAD

S1

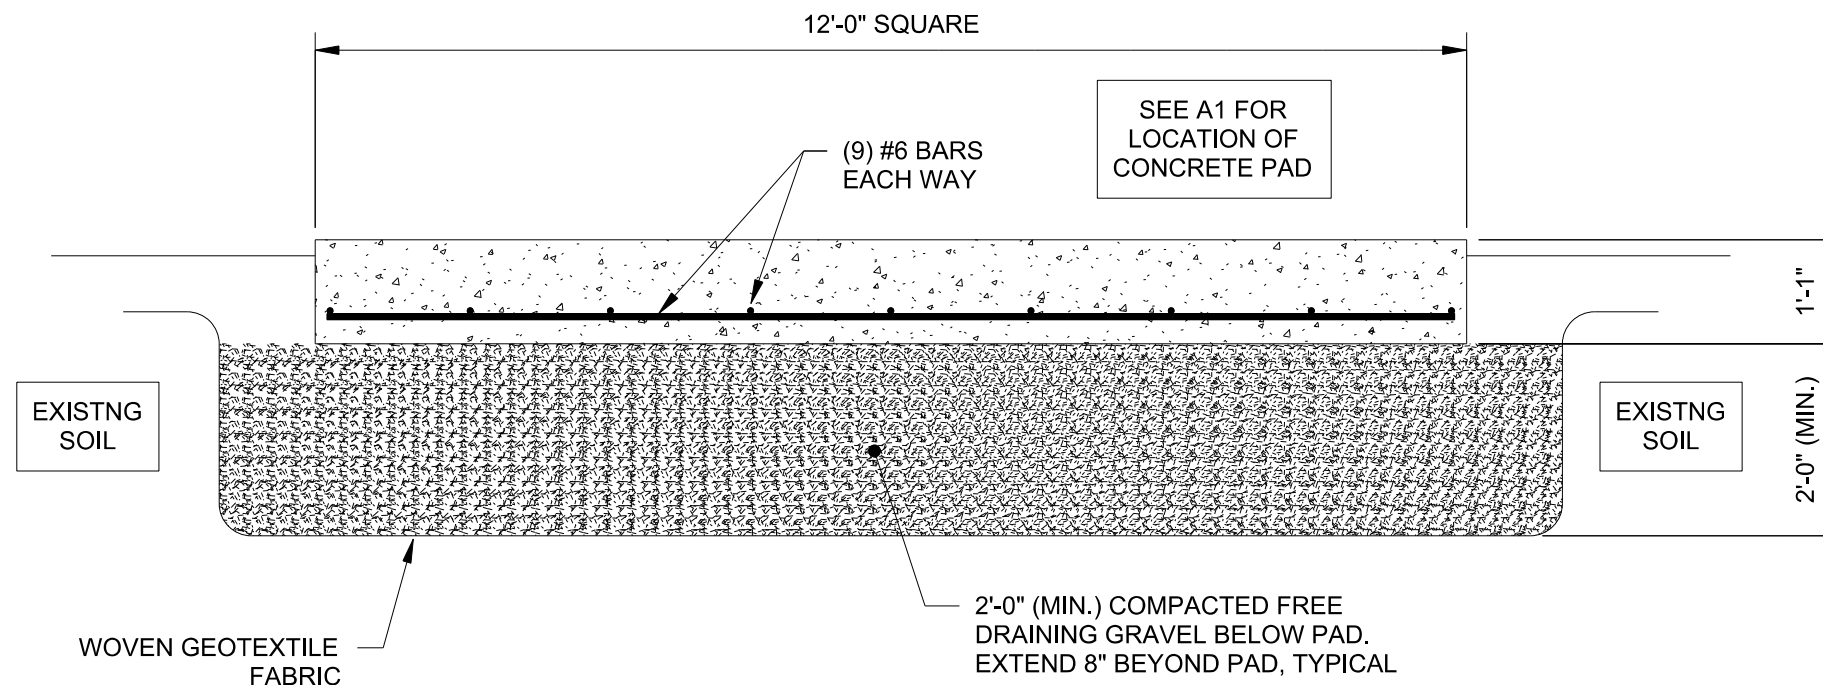

SOIL BEARING

1. TANK PAD DESIGNED FOR AN ASSUMED SOIL BEARING OF 3000 PSF.
2. IF ADEQUATE SOIL BEARING IS NOT ENCOUNTERED AT THE INDICATED BOTTOM OF FOOTING LOCATION, CONTRACTOR IS TO REPORT TO THE ARCHITECT BEFORE PROCEEDING WITH THAT PART OF THE WORK.

CONCRETE

1. STRENGTH OF CONCRETE AT 28 DAYS TO BE 3000 PSI.
2. BOTTOM OF TANK PAD TO BE ON ADEQUATE SOIL BEARING.

CONCRETE REINFORCING

1. ALL REINFORCING STEEL TO BE ASTM-A615 GRADE 60, DETAILED AND FABRICATED IN ACCORDANCE WITH THE "ACI MANUAL OF STANDARD PRACTICE" (ACI-315-LATEST).
2. REINFORCEMENT TO HAVE MIN. CONCRETE COVER AS FOLLOWS:
 - A. CONCRETE DEPOSITED AGAINST GROUND - 3"