

ELECTRICAL GENERAL NOTES

- ALL GENERAL NOTES, SYMBOL LIST & DETAILS ARE TO BE CONSIDERED AS APPLICABLE TO ALL ELECTRICAL DRAWINGS FOR THIS PROJECT. SYMBOLS AND ABBREVIATIONS SHOWN ON THIS SHEET ARE FOR REFERENCE ONLY AND DO NOT INDICATE THEIR INCORPORATION IN THE DESIGN.
- ALL WORK PERFORMED ON THIS CONTRACT SHALL BE DONE IN A NEAT AND WORKMANLIKE MANNER AND SHALL BE IN COMPLIANCE WITH NEC, NFPA, BOCA, OSHA, AND ALL APPLICABLE STATE AND LOCAL CODES AND ORDINANCES.
- THESE DRAWINGS ARE, IN GENERAL, MADE TO SCALE BUT ALL MEASUREMENTS SHALL BE TAKEN FROM FIGURED DIMENSIONS, AND NOT BY SCALING.
- THE ELECTRICAL CONTRACTOR SHALL CONFER WITH ALL OTHER TRADES RELATIVE TO THE LOCATION OF APPARATUS AND EQUIPMENT AND SELECT LOCATIONS SO AS NOT TO CONFLICT WITH WORK OF OTHER TRADES.
- LIGHTING FIXTURE MANUFACTURERS NAME & MODEL NUMBER ARE USED FOR DESCRIPTIVE PURPOSES ONLY AND ARE INTENDED TO INDICATE THE STANDARD OF MATERIAL OR ARTICLES REQUIRED.
- ALL EQUIPMENT SHOWN ON THESE DRAWINGS IS INTENDED TO BE GENERALLY REPRESENTATIVE OF THE EQUIPMENT WHICH WILL BE INSTALLED UNDER THIS CONTRACT, BUT IT SHALL NOT BE ASSUMED THAT THE DRAWINGS INDICATE THE SPECIFIC CONFIGURATION, ARRANGEMENT OR POINTS OF CONNECTION OF THE ACTUAL EQUIPMENT UNLESS NOTED OTHERWISE.
- COORDINATE W/ CONTROLS CONTRACTOR TO PROVIDE POWER FOR ALL MISCELLANEOUS CONTROL OPERATORS AND PANELS.
- CIRCUIT BREAKERS USED FOR LIGHTING CIRCUITS SHALL BE SWITCH DUTY RATED AND APPROVED FOR USE WITH H.I.D. FIXTURES. CIRCUIT BREAKERS USED FOR HVAC AND REFRIGERATION EQUIPMENT SHALL BE "HACR" RATED.
- ALL HOME RUNS FOR LIGHTING OR POWER CIRCUITS LONGER THAN 150 FEET SHALL BE INCREASED ONE SIZE. (IE: #12 TO #10).
- ALL BRANCH CIRCUIT AND FEEDER CONDUCTORS SHALL BE SIZED FOR THE O.C.D. RATING FOR THAT CIRCUIT ACCORDING TO NEC ART 310 UNLESS OTHERWISE INDICATED ON THESE DRAWINGS. NO CASE SHALL CONDUCTORS SMALLER THAN NO. 12 AWG BE USED FOR POWER OR LIGHTING CIRCUITS.
- PROVIDE 3/8" NYLON ROPE IN ALL EMPT SERVICE RACEWAYS.
- ALL SLEEVES AND OTHER PENETRATIONS THRU FIRE RATED ASSEMBLIES SHALL BE SEALED AFTER CABLE INSTALLATION WITH A FIRE RETARDANT COMPOUND.
- ALL FLUSH MOUNTED PANELBOARDS SHALL BE PROVIDED WITH (2) 1-1/4" EMPTY CONDUITS BETWEEN PANEL & SUSPENDED CEILING.
- THE CONTRACTOR IS RESPONSIBLE FOR FIRESTOPPING AROUND ALL CONDUITS, CABLES AND ELECTRICAL EQUIPMENT AT ALL PARTITIONS PER NEC 300-21 AND B.O.C.A.
- THE CONTRACTOR IS RESPONSIBLE FOR MEETING ALL SEISMIC REQUIREMENTS FOR THE INSTALLATION OF ELECTRICAL EQUIPMENT UNDER B.O.C.A.
- GROUNDING SHALL BE PER N.E.C. ARTICLE 250. INSTALL GROUNDING CONDUCTORS WITH ALL FEEDERS AND BRANCH CIRCUITS.
- ALL WIRING SHALL BE IN CONDUIT.
- REMOVE EQUIPMENT, FIXTURES AND DEVICES THAT ARE NOT BEING REUSED AND DISCARD. OWNER HAS THE OPTION TO KEEP ANY MATERIAL DESIRED. EXISTING FIXTURES SCHEDULED FOR REUSE SHALL BE CLEANED.

LIGHTING SYMBOLS

SYMBOLS	DESCRIPTIONS
	2'X2' RECESSED FLUORESCENT FIXTURE (NORMAL POWER)
	2'X2' RECESSED FLUORESCENT FIXTURE (LIFE SAFETY POWER)
	2'X4' RECESSED FLUORESCENT FIXTURE (NORMAL POWER)
	2'X4' RECESSED FLUORESCENT FIXTURE (LIFE SAFETY POWER)
	RECESSED DOWNLIGHT FIXTURE (NORMAL POWER)
	RECESSED DOWNLIGHT FIXTURE (LIFE SAFETY POWER)
	BARE LAMP FLUORESCENT STRIP - AS NOTED ON DRAWINGS.
	EMERGENCY EXIT SIGN. SEE LIGHTING FIXTURE SCHEDULE FOR SPECIFICATION.
	EMERGENCY LIGHTING FIXTURE BATTERY OPERATED. SEE LIGHTING FIXTURE SCHEDULE FOR SPECIFICATION.

GENERAL ABBREVIATIONS

ABBREVIATIONS	DESCRIPTIONS
ACU	AIR CONDITIONING UNIT
AFB	ABOVE FINISHED FLOOR
AFG	ABOVE FINISHED GRADE
AHU	AIR HANDLING UNIT
AIC	AMPERE INTERRUPTING CAPACITY
C	CONDUIT
CS	CONDUIT SLEEVE
CB	CIRCUIT BREAKER
CL	CENTER LINE
CR	CASEWORK RECESSED OUTLET
CLF	CURRENT LIMITING FUSE
CT	CURRENT TRANSFORMER
CTV	CABLE TELEVISION
CUJ	CONDENSING UNIT
CUH	CABINET UNIT HEATER
CWP	CONDENSER WATER PUMP
DW	DISTRIBUTION TRANSFORMER
DW	DISHWASHER
DWG	DRAWING
EBB	ELECTRIC BASEBOARD HEATER
EDH	ELECTRIC DUCT HEATER
EF	EXHAUST FAN
EUH	ELECTRIC UNIT HEATER
EWG	ELECTRIC WATER COOLER
EX	EXISTING EQUIPMENT (AS NOTED)
FACP	FIRE ALARM CONTROL PANEL FURNISHED BY OWNER
FBO	FAN COIL
FC	GARbage DISPOSER
GFCI	GROUNd FAULT CIRCUIT INTERRUPTING
GND	GROUND
GRC	GALVANIZED RIGID STEEL CONDUIT
H	HUMIDIFIER
HD	HEAT DETECTOR
HH	HAND HOLE
HP	HORSEPOWER / HEAT PUMP
HPS	HIGH PRESSURE SODIUM
HRU	HEAT RECOVERY UNIT
HV	HIGH VOLTAGE
HWP	HOT WATER CIRC. PUMP
IG	INFRA-RED
IR	INFRARED
KW	KILOWATT
KWH	KILOWATT HOUR
LIG	LONGINSTANTANEOUS/GROUND FAULT
LTG	LIGHTING
MB	MAIN BREAKER
MC	METAL CLAD
MD	MAIN DISCONNECT
MDP	MAIN DISTRIBUTION PANEL
MH	MAN HOLE / METAL HALIDE
MI	MINERAL INSULATED
MCO	MAIN LOSS ONLY
MCM	MAINE MEDICAL CENTER
MTD	MOUNTED
MW	MICROWAVE
NA	NOT APPLICABLE
NC	NORMALLY CLOSED
NEC	NATIONAL ELECTRICAL CODE (NFPA-70)
NF	NOT FUSED
NIC	NOT IN CONTRACT
NL	NIGHT LIGHT
NM	NON METALLIC
NO	NORMALLY OPEN
NTS	NOT TO SCALE
OC	OVER COUNTER OUTLET
OOD	OVERCURRENT DEVICE
PB	PULL BOX
PM	"PLUGMOLD" UTILIZED
PT	POTENTIAL TRANSFORMER
R	REMOVE
RECIP	RECEPTACLE
REF	REFRIGERATOR
REQD	REQUIRED
RFD	RETURN FAN
RGE	RANGE
RGS	RIGID GALVANIZED STEEL CONDUIT
RH	RANGE HOOD
SF	SUPPLY FAN
SN	SOLID NEUTRAL
TBD	TO BE DETERMINED
TP	TAMPER PROOF
TV	TELEVISION
TYP	TYPICAL
UC	UNDER COUNTER
UNO	UNLESS NOTED OTHERWISE
WP	WEATHERPROOF
WM	INSTALL WITH "WIREMOLD"
XFMR	TRANSFORMER

PANEL & CIRCUIT SYMBOLS

SYMBOLS	DESCRIPTIONS
	PANELBOARD - FLUSH MOUNTED AT 6'-6" TO TOP.
	PANELBOARD - SURFACE MOUNTED AT 6'-6" TO TOP.
	INDICATES PARTIAL CIRCUIT
	INDICATES CIRCUIT NUMBER
	INDICATES PANEL
	ELECTRICAL FEED TO EQUIPMENT; ARROW INDICATES HOMERUN TO PANELBOARD OR AS NOTED.
	INDICATES CIRCUIT IN CONDUIT RUN IN FLOOR OR UNDERGROUND.
	INDICATES CONTROL WIRING BY ELECTRICAL.
	TRANSFORMER, SIZE & TYPE AS INDICATED
	JUNCTION BOX - SIZE IN ACCORDANCE WITH NEC - "C" INDICATES MOUNTING IN CEILING SPACE.
	3 POLE, NON-FUSIBLE DISCONNECT SWITCH
	3 POLE, FUSIBLE DISCONNECT SWITCH
	60" CLIP SIZE, 40" FUSE SIZE, VOLTAGE AS REQD.
	3 POLE WEATHERPROOF DISCONNECT SWITCH SIZE & CONFIGURATION AS NOTED ABOVE
	MANUAL STARTER - SIZE AS REQUIRED
	MOTOR, HP AS INDICATED. COORDINATE W/ ACTUAL EQUIPMENT FURNISHED.
	COMBINATION MAGNETIC STARTER - NEMA SIZE AS REQUIRED. (MINIMUM SIZE 1) PROVIDE W/H-2A SWITCH AND GREEN RUN LIGHT ON COVER.
	MAGNETIC STARTER - NEMA SIZE AS REQUIRED. (MINIMUM SIZE 1) PROVIDE W/H-2A SWITCH AND GREEN RUN LIGHT ON COVER. FURNISHED AND INSTALLED BY ELECTRICAL CONTRACTOR. SIZE AS NOTED.
	MOTOR CONTROLLER - FURNISHED WITH MOTOR.
	AUTOMATIC TRANSFER SWITCH
	JUNCTION BOX IN ACCESSIBLE LOCATION WITH FLEXIBLE CONDUIT CONNECTION TO EQUIPMENT AS NOTED.
	TYPE 'EYA' HAZARDOUS LOCATION SEALING FITTING (U.L. LISTED FOR USE IN VERTICAL OR HORIZONTAL CONDUIT RUNS).

MISCELLANEOUS SYMBOLS

SYMBOLS	DESCRIPTIONS
	SINGLE POLE SWITCH MOUNTED AT +48" OR AS NOTED.
	BI-LEVEL TWO-BUTTON SWITCH
	THREE WAY SWITCH MOUNTED AT +48" OR AS NOTED.
	SLIDE CONTROL DIMMER AT +48" OR AS NOTED, PROVIDE SWITCH FOR FIXTURES ACTUALLY SERVED.
	LOW VOLTAGE SWITCH LIGHT MOUNTED AT +48" OR AS NOTED.
	H.P. RATED MANUAL MOTOR STARTER (WEATHERPROOF WHERE OUTSIDE).
	OS - DUAL TECH. OCCUPANCY SENSOR WALL SWITCH - WATTSTOPPER DSW-100 OS2 - DUAL TECH. OCCUPANCY SENSOR TWO BUTTON/LOAD WALL SWITCH - WATTSTOPPER DSW-200 OR EQUAL.
	OCCUPANCY SENSOR (CEILING MOUNT) (WATTSTOPPER LMRC-210(DIMMING) OR LMRC-100(NONOFF) ROOM CONTROLLER WITH LMDC-100 SENSOR AND LMSW-105 SWITCH ROOM KITS OR EQUAL.
	SPEAKER - CEILING MOUNTED W/ INDICATES WALL MOUNTED SPEAKER
	SECURITY CAMERA
	LINE VOLTAGE DOOR SWITCH. INSTALL IN HINGE SIDE OF DOOR JAMB WIRE TO JUNCTION BOX BEHIND EQUIPMENT IN ROOM
	DOOR PADDLE/PUSHBUTTON
	RECORDER
	KEYPAD
	ELECTRONIC STRIKE
	PROVIDE 3/4" CONDUIT ROUTED CONCEALED TO ABOVE CEILING AND ASSOCIATED JUNCTION BOXES FOR FUTURE DOOR HARDWARE/ELECTRIC STRIKE
	CARD READER
	PROVIDE 3/4" CONDUIT ROUTED CONCEALED TO ABOVE CEILING AND ASSOCIATED JUNCTION BOXES FOR FUTURE CARD READERS WITH BLANK COVER, PROVIDE AS WEATHERPROOF WERE REQUIRED.
	DOOR CONTROLLER
	EMERGENCY PUSH TO EXIT BUTTON
	REQUEST TO EXIT SENSOR
	MAGNETIC LOCK
	DOOR HOLD OPEN, RELEASE ON FIRE ALARM AND DAILY AT NIGHT EXACT TIME PROVIDED BY OWNER.

FIRE ALARM & LIFE SAFETY SYMBOLS

SYMBOLS	DESCRIPTIONS
	FIRE ALARM PULL STATION MTD 48" A.F.F.
	SMOKE DETECTOR. CEILING MOUNTED. "P" DENOTES TO BE USED FOR PRE-ALERT. "E" DENOTES TO BE CONNECTED TO ELEVATOR CONTROLLER. "PR" DENOTES TO BE USED FOR PATIENT ROOM FOR PRE-ALERT TO NURSE STATIONS.
	DUCT MOUNTED SMOKE DETECTOR
	REMOTE TEST STATION
	HEAT DETECTOR - TEMP. AS NOTICATED. CEILING MOUNTED. F = FIXED TEMPERATURE. 151" UNLESS OTHERWISE NOTED. R = RATE OF RISE RF = COMBINATION RATE OF RISE AND FIXED TEMPERATURE
	VISUAL NOTIFICATION APPLIANCE MEETING A.D.A. REQUIREMENTS. MTD AT 6" BELOW CEILING OR +8" AFF, WHICHEVER IS LESS. (75 CANDELA)
	COMBINATION AUDIO/VISUAL NOTIFICATION APPLIANCE MEETING A.D.A. REQUIREMENTS. MTD AT 6" BELOW CEILING OR +8" AFF, WHICHEVER IS LESS. 75cd (CANDELA) OR AS NOTED. HORN/STROBE DEVICE.
	FIRE ALARM SYSTEM MAGNETIC DOOR HOLDER. MATCH EXISTING. PROVIDE 120V FROM NEAREST NORMAL POWER PANEL IF REQUIRED.
	FIRE ALARM SYSTEM DOOR CLOSER
	FIRE ALARM MAIN PANEL
	FIRE ALARM ANUNCIATOR
	4" RED SPRINKLER TROUBLE BELL MTD 80" AFF MOUNT 8" ABOVE GRADE
	SPRINKLER FLOW SWITCH. CONNECT TO FIRE ALARM SYSTEM
	SPRINKLER TAMPER SWITCH. CONNECT TO FIRE ALARM SYSTEM
	SPRINKLER PRESSURE SWITCH. CONNECT TO SPRINKLER TROUBLE BELL
	MASTER BOX
	MONITOR MODULES
	INITIATING RELAY MODULE. COORDINATE W/ OTHER TRADE ITEMS.
	ZONE MONITOR DEVICE

DATA SYMBOLS

SYMBOLS	DESCRIPTIONS
	TELEPHONE OUTLET AT +18" OR AS NOTED. FURNISH (1) 3/4" CONDUIT FROM DEVICE OUTLET BOX TO ACCESSIBLE SPACE ABOVE SUSPENDED CEILING PROVIDE TELEPHONE CABLE COMPLETE. TO TELEPHONE MOUNTING BOARD. WIRING TO BE CATS. COLOR BY OWNER. W - INDICATES WALL MOUNT AT 48" W/POST TYPE PLATE.
	DUAL TELEPHONE/DATA OUTLET AT +18" OR AS NOTED. FURNISH (1) 1" CONDUIT FROM DEVICE OUTLET BOX TO ACCESSIBLE SPACE ABOVE SUSPENDED CEILING PROVIDE TELEPHONE AND DATA CABLE COMPLETE. TO NEW PATCH PANEL IN DATA CLOSET.
	DATA OUTLET AT +18" OR AS NOTED. FURNISH (1) 3/4" CONDUIT FROM DEVICE OUTLET BOX TO ACCESSIBLE SPACE ABOVE SUSPENDED CEILING PROVIDE DATA CABLE COMPLETE. TO PATCH PANEL IN CLOSET.
	DATA OUTLET FOR WIRELESS ACCESS POINT MTD AT 6" BELOW CEILING OR ON CEILING AS NOTED. FURNISH (1) 3/4" CONDUIT FROM DEVICE OUTLET BOX TO ACCESSIBLE SPACE ABOVE SUSPENDED CEILING PROVIDE DATA CABLE COMPLETE. TO PATCH PANEL IN IT CLOSET.
	AUDIO VIDEO MTD AT +18" OR AS NOTED. FURNISH (1) 1-1/4" CONDUIT FROM DEVICE OUTLET BOX TO ACCESSIBLE SPACE ABOVE SUSPENDED CEILING OR TO FLOOR BOX AS SHOWN ON PLAN. PROVIDE COMPLETE WITH CABLE. INCLUDING BUT NOT LIMITED TO: VGA, HDMI, RCA, 3.5MM MINI JACK, AND CAT 5.
	TV OUTLET MTD ADJACENT TO RECEPTACLE AT +72" OR AS NOTED. FURNISH (1) 3/4" CONDUIT FROM DEVICE OUTLET BOX TO ACCESSIBLE SPACE ABOVE SUSPENDED CEILING. PROVIDE COMPLETE WITH CABLE RG 6U - 75 OHM, 18AWG SOLID CONDUCTOR, FRFP DIELECTRIC, FRPC JACKET, CMP RATED WITH FOL - 65% TO BRAND. BELDEN OR EQUAL. ROUTED TO CATV MOUNTING BOARD IN IT CLOSET.
	DATA CONNECTION QUANTITIES AT FLOOR BOX WITH FURNITURE FEED. FURNISH (1) 1-1/2" CONDUIT FROM DEVICE OUTLET BOX TO ACCESSIBLE SPACE ABOVE SUSPENDED CEILING PROVIDE DATA CABLE COMPLETE. TO PATCH PANEL IN IT CLOSET.
	3/4" PLYWOOD TELEPHONE TERMINAL BLOCK MOUNTING BOARD WITH #6 CU GROUND AND DEDICATED DUPLEX CONVENIENCE OUTLET. PAINTED WITH 2 COATS OF FLAME RESISTANT GRAY PAINT. FURNISH IN ACCORDANCE WITH TELEPHONE CO. REQUIREMENTS. SIZE AS NOTED.
	INTERCOM
	INTERCOM SPEAKER FOR USE
	BASE
	HANDS-FREE INTERCOM SPEAKER

RECEPTACLE OUTLET SYMBOLS

SYMBOLS	DESCRIPTIONS
	LETTER IS CIRCUIT CONTROL GROUP. "4P" INDICATES MOUNTED AT 42" A.F.F.
	"GF" / "GFI" / "GFCI" INDICATES GF OUTLET (PROTECTS DOWNSTREAM RECEPTABLES ON SAME CIRCUIT.)
	"WF" INDICATES TAMPER PROOF
	"OC" INDICATES OVER COUNTER
	MOUNT WITH GROUND TERMINAL AT TOP. DEVICES SHALL BE HOSPITAL GRADE. SEE SPEC.
	SIMPLEX CONVENIENCE RECEPTACLE MOUNTED AT +18" OR AS NOTED.
	DUPLEX RECEPTACLE OUTLET NEMA 5-20R, HEAVY DUTY. MOUNTED AT +18" OR AS NOTED. SELF-ILLUMINATING. DEVICES SHALL BE RED WHEN CONNECTED TO CRITICAL OR EQUIPMENT PANELS.
	QUADRUPEX RECEPTACLE OUTLET (DOUBLE DUPLEX) NEMA 5-20R, HEAVY DUTY. MOUNTED AT +18" OR AS NOTED. SELF-ILLUMINATING. AND BACKPLATE. DEVICES SHALL BE RED WHEN CONNECTED TO CRITICAL OR EQUIPMENT PANELS.
	GFCI DUPLEX RECEPTACLE OUTLET
	RANGE OUTLET NEMA 14-50R (17) INDICATES DRYER OUTLET NEMA 14-30R
	SPECIAL PURPOSE CONNECTION
	EUROPEAN 220V DUPLEX RECEPTACLE
	FLOOR SINGLE RECEPTACLE OUTLET W/ COVER. NEMA 5-20R
	FLOOR DUPLEX RECEPTACLE OUTLET W/ COVER. NEMA 5-20R
	FLOOR SPECIAL PURPOSE OUTLET LETTER(S) BESIDE SYMBOL INDICATES ACTUAL EQUIPMENT SERVED.

LIGHTING CONTROL SYMBOLS

SYMBOLS	DESCRIPTIONS
	SWITCHES LOCATED IN THE SAME AREA SHALL BE GANGED UNDER COMMON PLATE WHENEVER PRACTICAL. GROUP SWITCHES, THERMOSTATS ETC. TOGETHER. SWITCHES SHALL BE LOCATED ON STRIKE SIDE OF DOOR, ADJUST TO MINIMIZE CUT OFF BLOCK OR TILE. LOWERCASE LETTER IS SWITCH CONTROL GROUP.
	SINGLE POLE SWITCH MOUNTED AT +48" OR AS NOTED.
	BI-LEVEL TWO-BUTTON SWITCH
	THREE WAY SWITCH MOUNTED AT +48" OR AS NOTED.
	SLIDE CONTROL DIMMER AT +48" OR AS NOTED, PROVIDE SWITCH FOR FIXTURES ACTUALLY SERVED.
	LOW VOLTAGE SWITCH LIGHT MOUNTED AT +48" OR AS NOTED.
	SINGLE POLE SWITCH W/ PILOT LIGHT MOUNTED AT +48" OR AS NOTED.
	H.P. RATED MANUAL MOTOR STARTER (WEATHERPROOF WHERE OUTSIDE).
	OS - DUAL TECH. OCCUPANCY SENSOR WALL SWITCH - WATTSTOPPER DSW-100. OS2 - DUAL TECH. OCCUPANCY SENSOR TWO BUTTON/LOAD WALL SWITCH - WATTSTOPPER DSW-200 OR EQUAL.
	OCCUPANCY SENSOR (CEILING MOUNT) - COMPATIBLE WITH ROOM CONTROLLER/ SWITCHING SYSTEM GRAND LIGHTING CONTROL PANEL. "H" DENOTES HIGH CEILING TYPE.
	ROOM CONTROLLER (ABOVE CEILING MOUNT)
	LRC - LOCAL SWITCH CONTROL. LDC - LOCAL DIMMING CONTROL. THE # INDICATES NUMBER OF LOADS. WATTSTOPPER LMRC-210(DIMMING) OR LMRC-100(NONOFF) ROOM CONTROLLER WITH LMDC-100 SENSOR AND LMSW-105 SWITCH ROOM KITS OR EQUAL.

NURSE CALL SYMBOLS


SYMBOLS	DESCRIPTIONS
	EMERGENCY BATH STATION W/ PULL CORO MTD @ +44" AFF.
	BESIDE STATION TO BE MOUNTED ON 3 GANG OUTLET BOX WITH 2 GANG PLASTER RING.
	ROOM CORRIDOR LIGHT - CEILING MOUNTED OR WALL MOUNTED AT 78" AFF.
	ZONE LIGHT - CEILING MOUNTED.
	CODE CALL PUSH BUTTON STATION MOUNTED @ 54" AFF
	NURSE CALL SYSTEM STAFF ASSIST STATION MOUNTED @ +54" AFF.
	NURSE CALL SYSTEM DUTY STATION MOUNTED @ +54" AFF
	NURSE CALL MONITOR, CEILING MOUNTED
	NURSE CALL SYSTEM CENTRAL EQUIPMENT
	TELEVISION CONTROL WALL MOUNTED AT 90" AFF.
	NURSE CALL SYSTEM DESK CONSOLE



COPYRIGHT
PDT Architects
Re-use or reproduction of the contents of this document is not permitted without written permission of PDT Architects.

MAINE EYE - RETINA & SURGERY CENTER
161 Marginal Way - Portland, Maine 04101

No.	Date	Description
Revision Schedule		

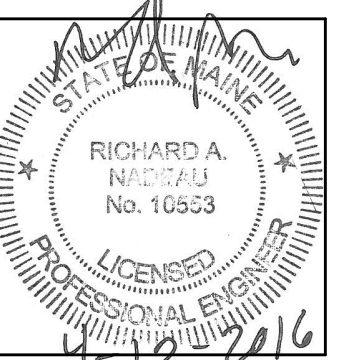

JOB NO.
195210863

DRWN: CHK.
Author Checker

SCALE:

ISSUE:
PERMIT SET - 95%
CONSTRUCTION DOCUMENTS
04.12.16

TITLE:
ELECTRICAL LEGEND AND GENERAL NOTES

SHEET

E001



Stantec Consulting Services Inc.
482 Payne Road Scarborough Court
Scarborough, ME 04074-8929
Tel: (207) 883-3355 / Fax: (207) 883-3376
www.stantec.com