


- NOTES:**
1. SUPPLY AND RETURN TO BE FULL SIZE FOR ALL COIL SECTIONS.
  2. PROVIDE TEMPERATURE GAGES AND WELLS FOR ALL AIR HVAC COILS.
  3. INSTALL ALL VALVES, STRAINER, GAGES, ETC. WITHIN THE PENTHOUSE.
  4. INSTALL DISTRIBUTION PIPING TO/FROM COILS AT HVAC UNITS ENTIRELY WITHIN THE CONFINES OF PIPING CABINET EXTENSION.
  5. INSULATE ALL PIPING AND EQUIPMENT TO PREVENT CONDENSATION AND DRIPPING. SEE SPECIFICATIONS.
  6. THE CHILLED WATER SYSTEM SHALL BE FILLED WITH A 40% INHIBITED PROPYLENE GLYCOL AND WATER SOLUTION.




1 CHILLED WATER FLOW DIAGRAM  
SCALE: NONE

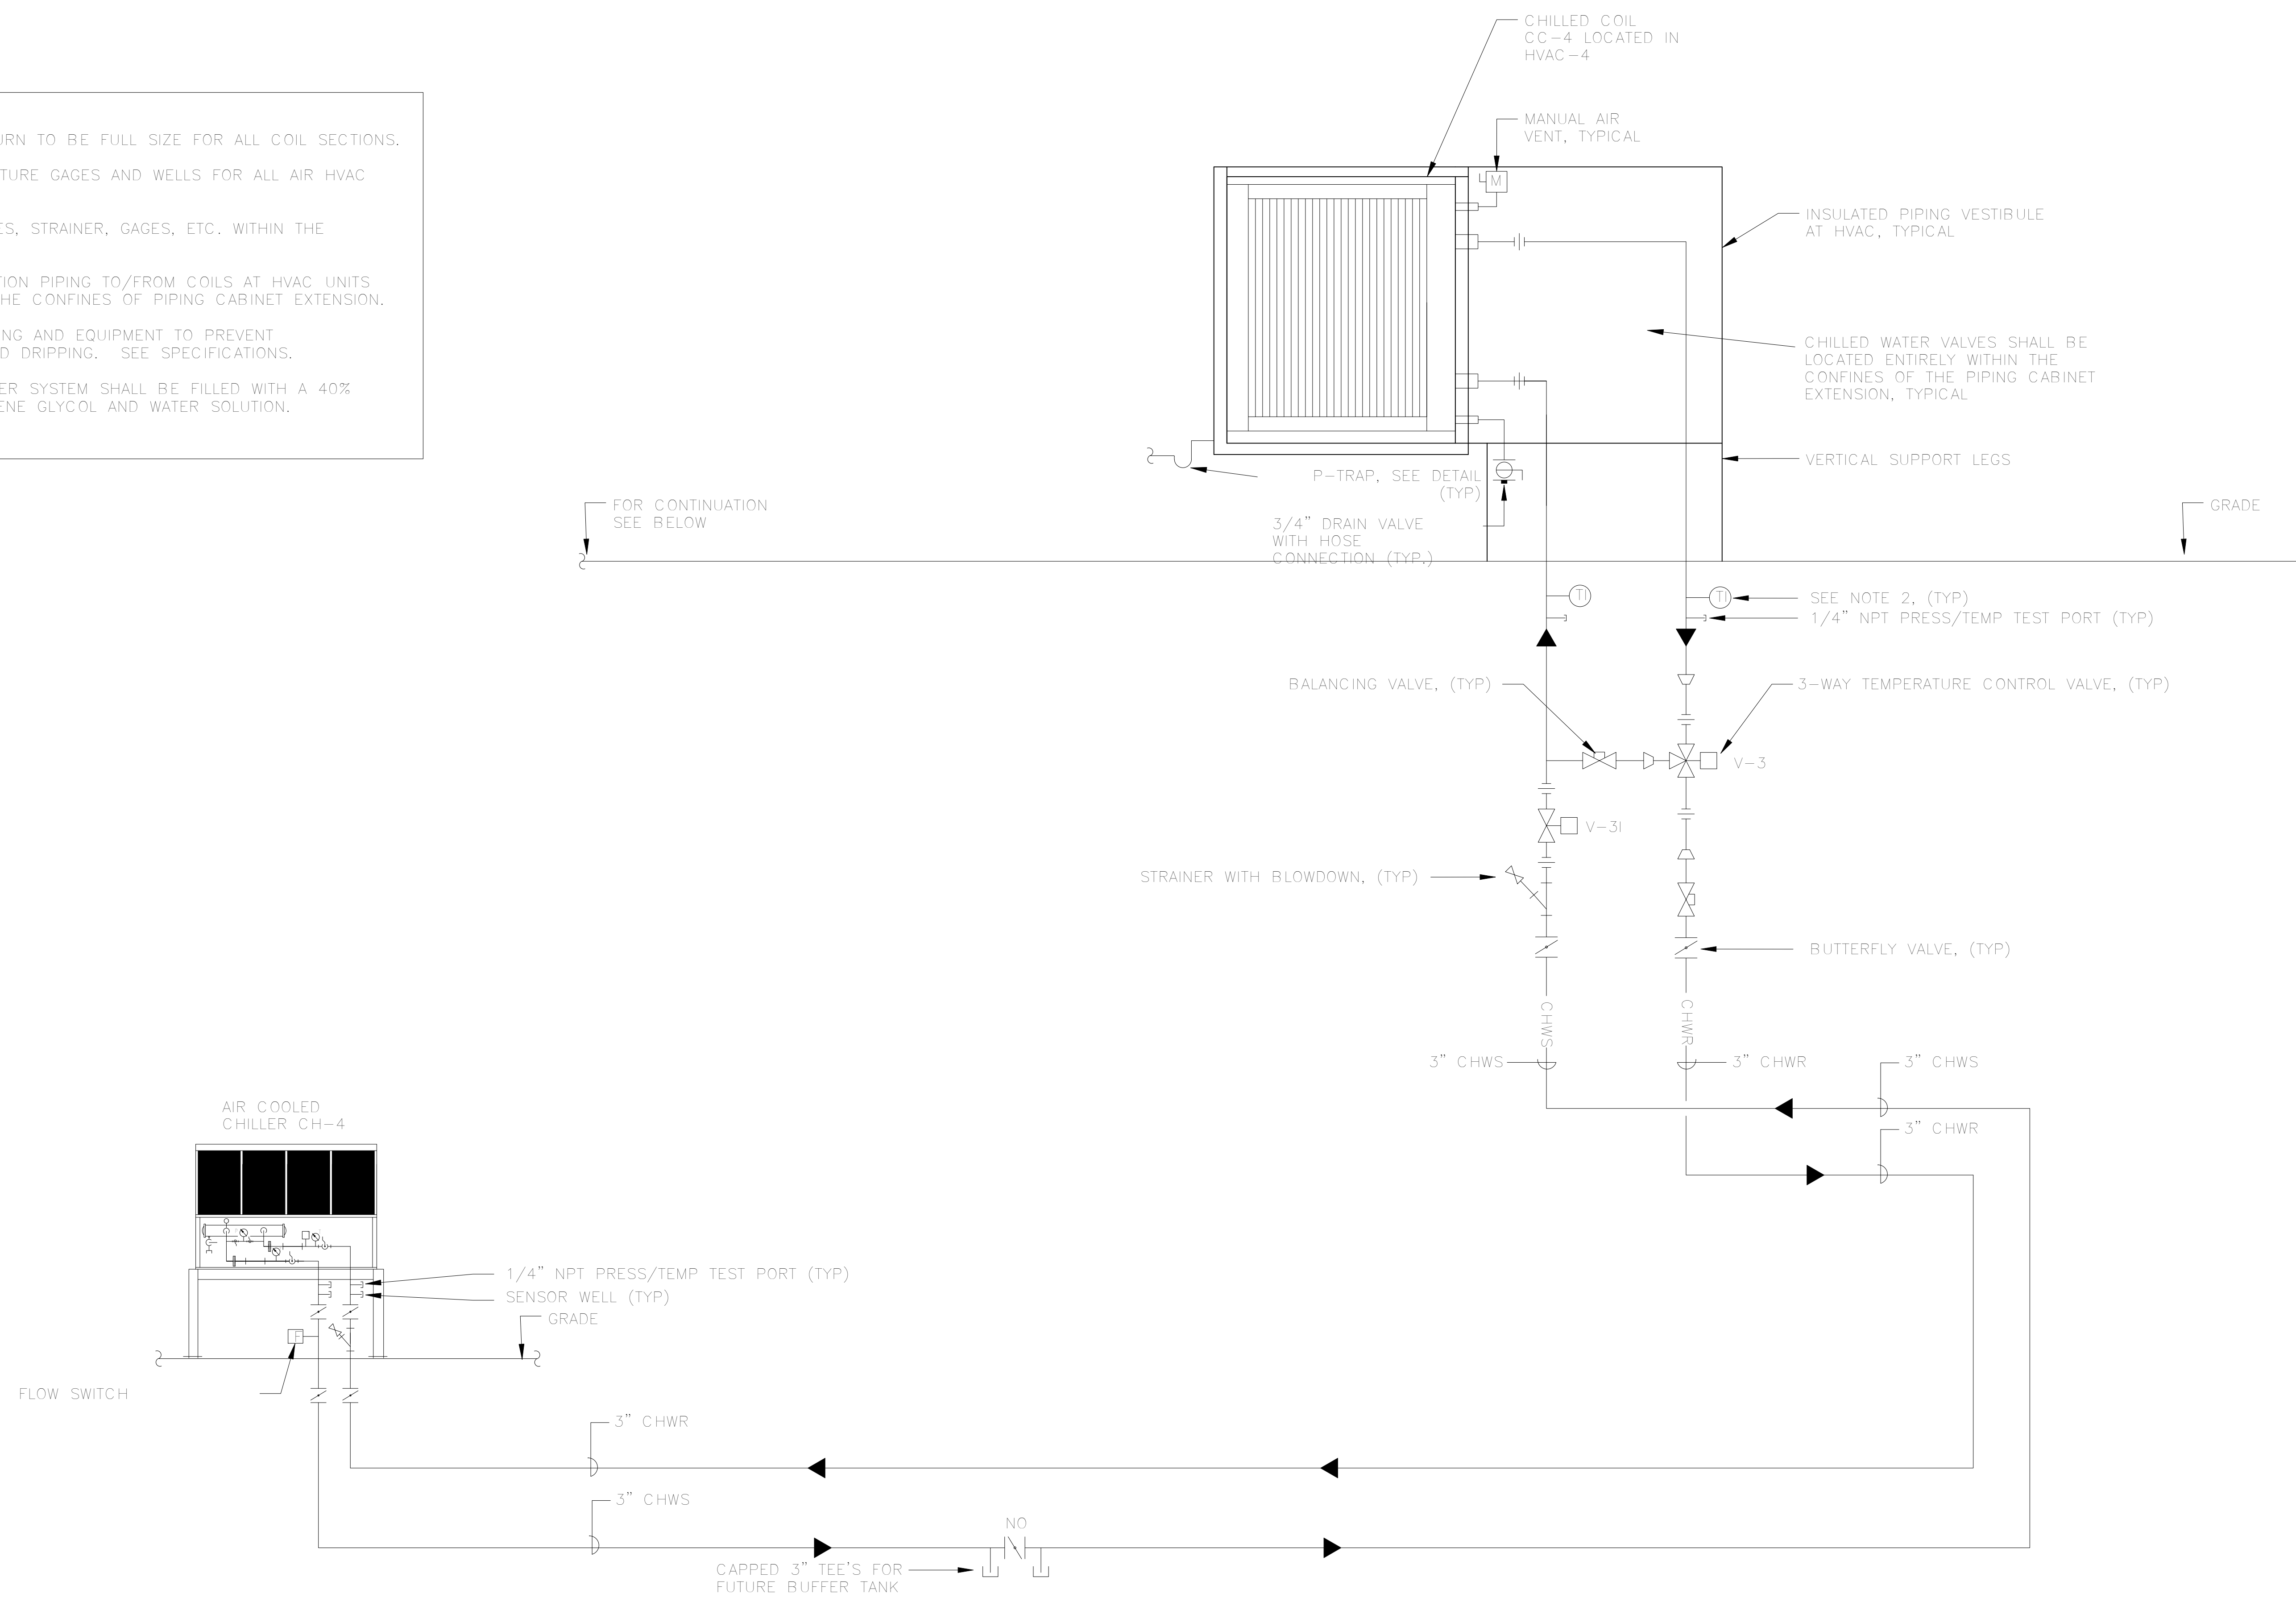

**COPYRIGHT**  
PDT Architects  
Reuse or reproduction of the contents of this document is not permitted without written permission of PDT Architects.

**MAINE EYE - RETINA & SURGERY CENTER**  
161 Marginal Way - Portland, Maine 04101

No.	Date	Description
Revision Schedule		

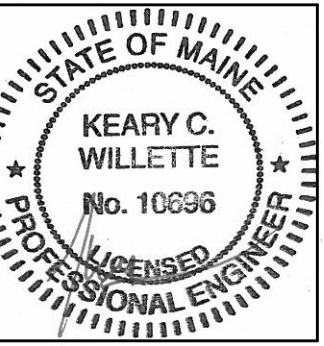

JOB NO.  
195210863

DRWN: CHK:  
ERD KCW

SCALE:

ISSUE:  
PERMIT SET - 95%  
CONSTRUCTION  
DOCUMENTS  
04.12.16

TITLE:  
HVAC FLOW  
DIAGRAMS

SHEET  
**M603**



Stantec Consulting Services Inc.  
482 Payne Road Scarborough Court  
Scarborough, ME 04074-8929  
Tel: (207) 883-3355 / Fax: (207) 883-3376  
www.stantec.com