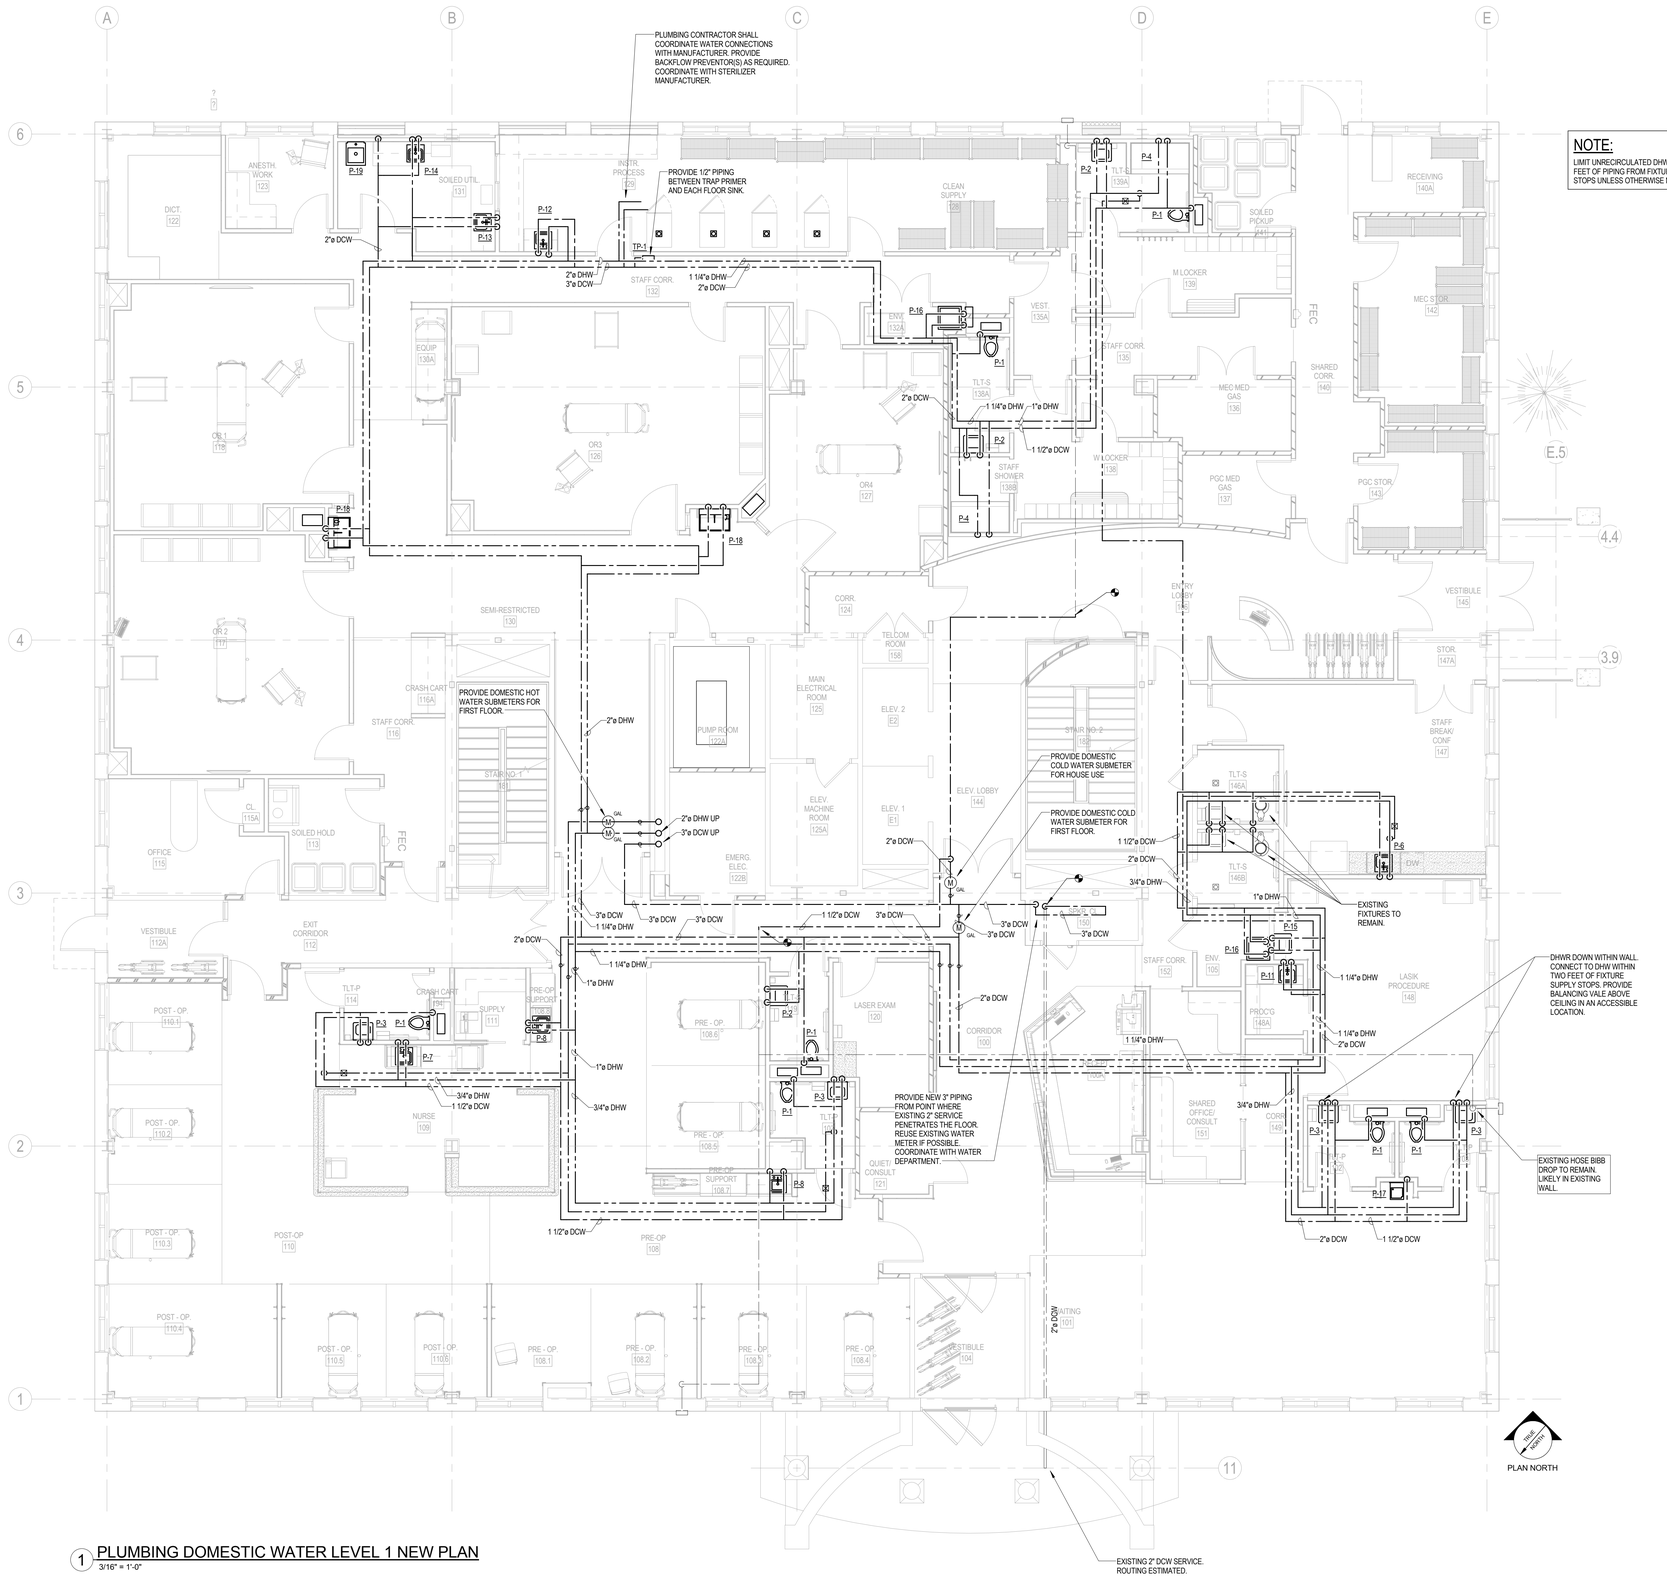

NOTE:
LIMIT UNRECIRCULATED DHW PIPING TO 16 FEET OF PIPING FROM FIXTURE SUPPLY STOPS UNLESS OTHERWISE NOTED.

1 PLUMBING DOMESTIC WATER LEVEL 1 NEW PLAN
3/16" = 1'-0"

PDT ARCHITECTS
49 DARTMOUTH STREET
PORTLAND, MAINE 04101
207-775-1059
www.pdtarchs.com

COPYRIGHT
PDT Architects
Reuse or reproduction of the contents of this document is not permitted without written permission of PDT Architects.

MAINE EYE - RETINA & SURGERY CENTER

161 Marginal Way - Portland, Maine 04101

No.	Date	Description
		Revision Schedule

STATE OF MAINE
KEARY C. WILLETTE
No. 10696
LICENSED
PROFESSIONAL ENGINEER

JOB NO.
195210863

DRWN: ERD
CHK: KCW

SCALE:

ISSUE:
PERMIT SET - 95% CONSTRUCTION DOCUMENTS
04.12.16

TITLE:
PLUMBING DOMESTIC WATER LEVEL 1 NEW PLAN

SHEET
P101

Stantec
Stantec Consulting Services Inc.
482 Payne Road Scarborough Court
Scarborough, ME 04074-8929
Tel: (207) 883-3355 / Fax: (207) 883-3376
www.stantec.com