


Unit Dimensions - Split System Air Conditioning Units (Small)

Item: A1 Qty: 1

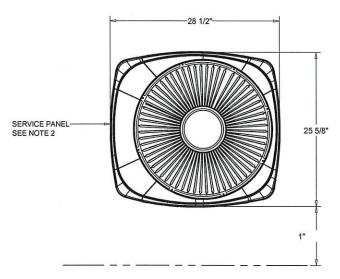

- NOTES
 1. TOP DISCHARGE AREA SHOULD BE
 UNRESTRICTED FOR AT LEAST 60"
 ABOVE UNIT. UNIT SHOULD BE PLACED SO ROOF
 RUN-OFF WATER DOES NOT POUR DIRECTLY ON UNIT, AND SHOULD BE AT LEAST 12" FROM WALL AND ALL SURROUNDING SHRUBBERY ON TWO SIDES. OTHER TWO SIDES UNRESTRICTED.
- 2. ELECTRICAL AND REFRIGERANT COMPONENT CLEARANCES PER PREVAILING CODES.

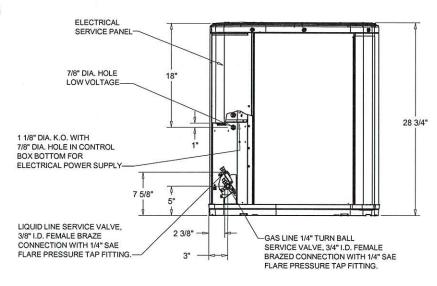




Unit Dimensions - Split System Air Conditioning Units (Small)

Item: A1 Qty: 1

ELECTRICAL / GENERAL DATA

'GENERAL Model: Voltage: Unit Hertz: Unit Phase:	'4TTR4030 '208 - 230 60 1	POWER CONN. Minimum Circuit Ampacity: '17.0 Maximum Circuit Breaker: 25.0 Minimum Protection Rating: 25.0	COMPRESSOR Number: Phase: Rated Load Amps: Locked Rotor Amps:	'1 1 12.8 68.0
OUTDOOR MOTO	R '1	NOTES: 1. Certified in accordance with the Unitary Air-	-Conditioner equipment certification progra	am which is based on
Horsepower: Motor Speed (RPM): Phase: Full Load Amps: Locked Rotor Amps:	0.125 - 1 0.64	AHRI Standard 210/240. 2. Calculated in accordance with N.E.C. Use of the standard line lengths - 60'. Standard lift - 6 For Greater lengths and lifts refer to refrige 4. * = 15, 20, 25, 30, 40 and 50 foot lineset as	only HACR circuit breakers or fuses. "O' Suction and Liquid line. erant piping software Pub# 32-3312-0	an midne sacca di

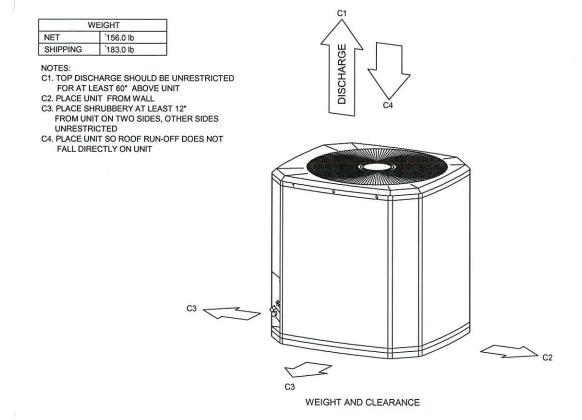

Unit Dimensions - Split System Air Conditioning Units (Small)

Item: A1 Qty: 1

4TXCB004	
DIMENSION (A)	,76 7/8"
DIMENSION (B)	'17 1/2"
DIMENSION (C)	'16 5/8"
DIMENSION (D)	'15 3/4"
MATCHED FURNACE WIDTH	'17 1/2"
GAS CONNECTION	'3/4" BRAZE
LIQUID CONNECTION	'3/8" BRAZE
REFRIGERANT CONTROL	TXV (NON-BLEED)
DRAIN PAN	PLASTIC
WEIGHT NET	49.0 lb

