

FS-ONE High Performance Intumescent Firestop Sealant

Product description

- Intumescent (expands when exposed to fire) firestop sealant that helps protect combustible and non-combustible penetrations for up to 4 hours fire rating

Product features

- Smoke, gas and water resistant after material has cured
- Contains no halogen, solvents or asbestos
- High fire rating properties
- Water based, easy to clean
- Protects most typical firestop penetration applications
- Paintable
- Single component systems available
- Meets LEED™ requirements for indoor environmental quality credit 4.1 Low Emitting Materials, Sealants and Adhesives and 4.2 Paints and Coatings

Areas of application

- Steel, copper and EMT pipes
- Insulated steel and copper pipes
- Cable bundles
- Closed or vented plastic pipes
- HVAC penetrations

For use with

- Concrete, masonry, drywall and wood floor assemblies
- Wall and floor assemblies rated up to 4 hours

Examples


- Sealing around combustible pipe penetrations in fire rated construction
- Sealing around non-combustible penetrations in fire rated construction



Technical Data*	FS-ONE
Chemical basis	Water-based intumescent acrylic dispersion
Color	Red
Application temperature	40°F to 104°F (5°C to 40°C)
Skin forming time	Approx. 20-30 min.
Curing time	Approx. 2 mm / 3 days
Average volume shrinkage (ASTM C1241)	24.1%
Movement capability	Approx. 5%
Expansion rate (unrestricted)	Up to 3-5 times original volume
Temperature resistance (cured)	-40°F to 212°F (-40°C to 100°C)
Surface burning characteristics (ASTM E 84-96)	Flame Spread: 0 Smoke Development: 5
Sound transmission classification (ASTM E 90-99)	56 (Relates to specific construction)

Tested in accordance with
 • UL 1479 • ASTM E 814 • ASTM E 84 • ASTM G21

*At 73°F (23°C) and 50% relative humidity



Installation instructions for FS-ONE

Notice

- Before handling, read Material Safety Data Sheet and product label for safe usage and health information.
- Instructions below are general guidelines — always refer to the applicable drawing in the UL Fire Resistance Directory or Hilti Firestop Systems Guide for complete installation information

Opening

1. Clean the opening. Surfaces to which FS-ONE will be applied should be cleaned of loose debris, dirt, oil, moisture, frost and wax. Structures supporting penetrating items must be installed in compliance with local building and electrical standards.

Application of firestop sealant

2. Install the prescribed backfilling material type and depth to obtain the desired rating (if required). Leave sufficient depth for applying FS-ONE.
3. Application of firestop sealant: Apply FS-ONE to the required depth in order to obtain the desired fire rating. Make sure FS-ONE contacts all surfaces to provide maximum adhesion. For application of FS-ONE use a standard caulking gun, foil pack gun, bulk loader and bulk gun. With FS-ONE buckets, Graco type sealant pumps may be used. (Contact pump manufacturer for proper selection).


4. Smoothing of firestop sealant: To complete the seal, tool immediately to give a smooth appearance. Excess sealant, prior to curing, can be cleaned away from adjacent surfaces and tools with water.
 5. Leave completed seal undisturbed for 48 hours.
 6. For maintenance reasons, a penetration seal could be permanently marked with an identification plate. In such a case, mark the identification plate and fasten it in a visible position next to the seal.
- On materials where oil, plasticizers or solvents may bleed i.e. impregnated wood, oil based seals, green or partially vulcanized rubber
 - In any penetration other than those specifically described in this manual or the test reports

Storage

- Store only in the original packaging in a location protected from moisture at temperatures between 40°F (5°C) and 86°F (30°C)
- Observe expiration date on the package

Not for use

- High movement expansion joints
- Underwater

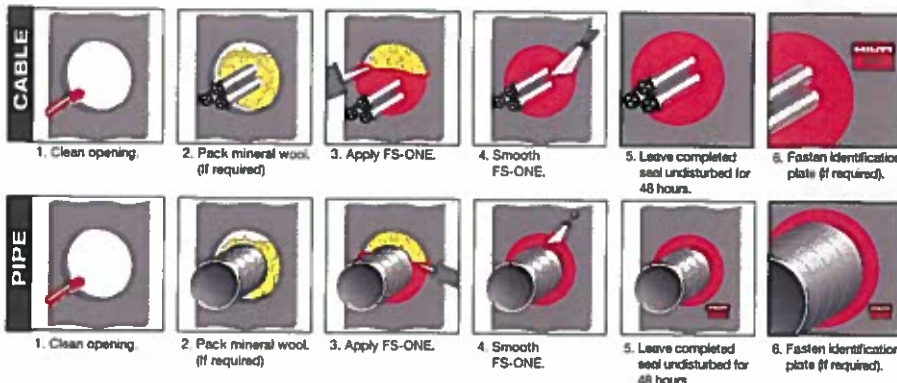

Hilti. Outperform. Outlast.

Certificate of Compliance

Certificate Number 20100512-R13240

Report Reference 2010 May 12

Issue Date 2010 May 12

Page 1 of 1



**Underwriters
Laboratories Inc.®**

Issued to: **Hilti, Inc.**

54 S 122ND East Ave
Tulsa, OK 74146 USA

*This is to certify that
representative samples of*

**Fill, Void or Cavity Materials
FS-ONE**

Have been investigated by Underwriters Laboratories Inc.® (UL) or any authorized licensee of UL in accordance with the Standard(s) indicated on this Certificate.


Standard(s) for Safety:

**ANSI/UL 1479, ANSI/UL 2079, CAN/ULC-S115-05
Third Edition, revised March 1, 2010**

Additional Information:

**FS-ONE Sealant for use in Joint Systems and FS-ONE for use in
Through-Penetration Firestop Systems as currently described in the UL Fire
Resistance Directory.**

Only those products bearing the UL Classification Mark should be considered as being covered by UL's Classification and Follow-Up Service.

The UL Classification Mark includes: UL in a circle symbol:  with the word "CLASSIFIED" (as shown); a control number (may be alphanumeric) assigned by UL; a statement to indicate the extent of UL's evaluation of the product; and, the product category name (product identity) as indicated in the appropriate UL Directory.

Look for the UL Classification Mark on the product

Issued by:

Mona Couloute
Mona Couloute

Underwriters Laboratories Inc.

Reviewed by:

Chris J. Johnson
Chris J. Johnson

Underwriters Laboratories Inc.

Any information and documentation involving UL Mark services are provided on behalf of Underwriters Laboratories Inc. (UL) or any authorized licensee of UL.



MSDS No.: 259
Revision No.: 011
Revision Date: 02/29/12
Page: 1 of 2

MATERIAL SAFETY DATA SHEET

Product name: FS-ONE High Performance Intumescent Firestop Sealant
Description: One-part acrylic-based sealant
Supplier: Hilti, Inc. P.O. Box 21148, Tulsa, OK 74121
Emergency # (Chem-Trec.): 1 800 424 9300 (USA, PR, Virgin Islands, Canada); 001 703 527 3887 (other countries)

INGREDIENTS AND EXPOSURE LIMITS

Ingredients:	CAS Number:	PEL:	TLV:	STEL:
Polyacrylate dispersion	Mixture	NE	NE	NE
Calcium carbonate	001317-65-3	5 mg/m ³ (R)	NE	NE
Zinc borate	138265-88-0	NE	NE	NE
Talc	014807-96-6	20 mppcf	2 mg/m ³ (R)	NE
Ethylene glycol	000107-21-1	NE	NE	C:100 mg/m ³ (A)
Iron oxide	001309-37-1	10 mg/m ³ (F)	5 mg/m ³ (R)	NE

Abbreviations: PEL = OSHA Permissible Exposure Limit. TLV = ACGIH Threshold Limit Value. C = Ceiling. STEL = Short Term Exposure Limit. NE = None Established. NA = Not Applicable. (T) indicates "as total dust". (R) indicates "as respirable fraction". (A) indicates "as an aerosol". mppcf = million particles per cubic foot. F = Fume

PHYSICAL DATA

Appearance:	Red paste.	Odor:	Odorless.
Vapor Density: (air = 1)	Not determined.	Vapor Pressure:	23mbar @ 20C / 68F
Boiling Point:	Not applicable.	VOC Content:	75.0 g/L.
Evaporation Rate:	Not applicable.	Solubility in Water:	Soluble.
Specific Gravity:	1.5	pH:	Not determined.

FIRE AND EXPLOSION HAZARD DATA

Flash Point:	Non-flammable.	Flammable Limits:	Not applicable.
Extinguishing Media:	Not applicable. Use extinguishing media as appropriate for surrounding fire.		
Special Fire Fighting Procedures:	None known. Use a self-contained breathing apparatus when fighting fires involving chemicals.		
Unusual Fire and Explosion Hazards:	None known. Thermal decomposition products can be formed such as oxides of carbon, sulfur and phosphorous.		

REACTIVITY DATA

Stability:	Stable.	Hazardous Polymerization:	Will not occur.
Incompatibility:	Strong acids, peroxides, and oxidizing agents.		
Decomposition Products:	Thermal decomposition can yield CO and CO ₂ .		
Conditions to Avoid:	None known.		

HEALTH HAZARD DATA

Known Hazards:	None known.
Signs and Symptoms of Exposure:	Possibly irritating upon contact with the eyes or upon repeated contact with the skin.
Medical Conditions Aggravated by Exposure:	Eye and skin conditions.
Routes of Exposure:	Dermal.
Carcinogenicity:	No ingredients are classified as carcinogens.

EMERGENCY AND FIRST AID PROCEDURES

Eyes:	Immediately flush with plenty of water. Contact a physician if symptoms occur.
Skin:	Immediately wipe off material and wash with soap and water. Contact a physician if symptoms occur.
Inhalation:	Move victim to fresh air if discomfort develops. Contact a physician if symptoms occur, persist.
Ingestion:	Seek medical attention. Do not induce vomiting unless directed by a physician.
Other:	Referral to a physician is recommended if there is any question about the seriousness of the injury/exposure.

CONTROL MEASURES AND PERSONAL PROTECTIVE EQUIPMENT

Ventilation:	General (natural or mechanically induced fresh air movements).
Eye Protection:	Safety glasses with side shields.
Skin Protection:	Impermeable gloves. Other protective clothing as required to prevent skin contact.
Respiratory Protection:	None normally required. Where ventilation is inadequate to control vapors, use a NIOSH-approved respirator with organic vapor cartridges. Never enter a confined space without an appropriate air-supplied respirator.

PRECAUTIONS FOR SAFE HANDLING AND USE

Handling and Storing Precautions:	Store in a cool, dry area preferably between 40° and 77° F. Keep from freezing. Do not store in direct sunlight. Avoid contact with the eyes or skin. Practice good hygiene; i.e. always wash thoroughly after handling and before eating or smoking. For industrial use only. Keep out of reach of children. Follow label/use instructions.
Spill Procedures:	Immediately wipe away spilled material before it hardens. Place in a container for proper disposal in accordance with all applicable local, state, or federal requirements.

REGULATORY INFORMATION

Hazard Communication:	This MSDS has been prepared in accordance with the federal OSHA Hazard Communication Standard 29 CFR 1910.1200.
HMIS Codes:	Health 1, Flammability 0, Reactivity 0, PPE B
DOT Shipping Name:	Not regulated.
IATA / ICAO Shipping Name:	Not regulated.
TSCA Inventory Status:	Chemical components listed on TSCA inventory.
SARA Title III, Section 313:	This product contains < 3% ethylene glycol (CAS 107-21-1) and < 15% zinc borate (re: zinc compounds) which are subject to reporting under Section 313 of SARA Title III (40 CFR Part 372).
EPA Waste Code(s):	Not regulated by EPA as a hazardous waste.
Waste Disposal Methods:	Consult with regulatory agencies or your corporate personnel for disposal methods that comply with local, state, and federal safety, health and environmental regulations.

CONTACTS

Customer Service:	1 800 879 8000	Technical Service:	1 800 879 8000
Health / Safety:	1 800 879 6000	Jerry Metcalf	(x71003704)
Emergency # (Chem-Trec):	1 800 424 9300 (USA, PR, Virgin Islands, Canada); 001 703 527 3887 (other countries)		

The information and recommendations contained herein are based upon data believed to be correct; however, no guarantee or warranty of any kind expressed or implied is made with respect to the information provided.




Classified by
Underwriters Laboratories, Inc.
to UL 1479 and CAN/ULC-S115

System No. W-L-1054

WL 1054

ANSI/UL1479 (ASTM E814)	CAN/ULC S115
F Ratings — 1 and 2 Hr (See Items 1 and 3)	F Ratings — 1 and 2 Hr (See Items 1 and 3)
T Rating — 0 Hr	FT Rating — 0 Hr
L Rating at Ambient — Less Than 1 CFM/sq ft	FH Ratings — 1 and 2 Hr (See Items 1 and 3)
L Rating at 400 F — Less Than 1 CFM/sq ft	FTH Rating — 0 Hr
	FTH Rating — 0 Hr
	L Rating at Ambient — Less Than 1 CFM/sq ft L Rating at 400 F — Less Than 1 CFM/sq ft

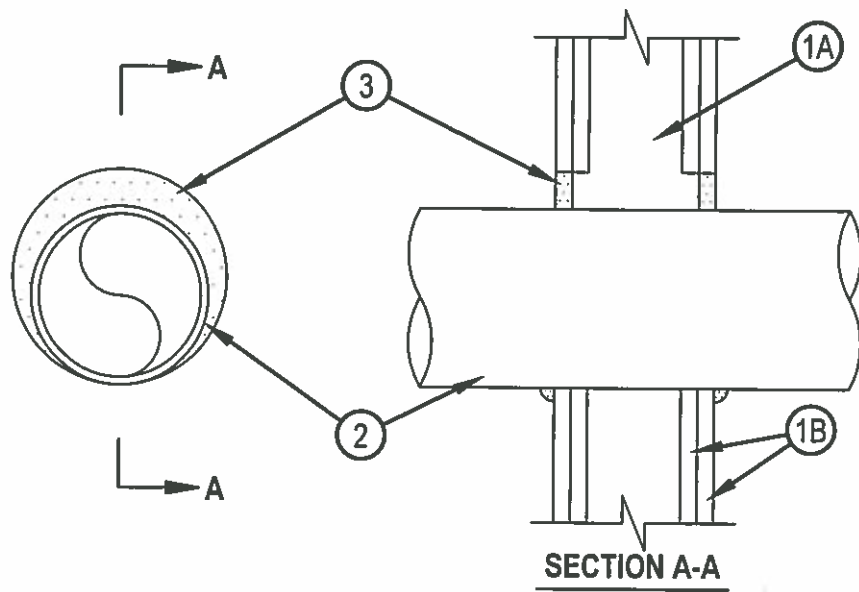

Hilti Firestop Systems

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
November 26, 2012

System No. W-L-1054

WL 1054

1. Wall Assembly — The 1 or 2 hr fire-rated gypsum wallboard/stud wall assembly shall be constructed of the materials and in the manner specified in the individual U300 or U400 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the following construction features:

A. Studs — Wall framing may consist of either wood studs or steel channel studs. Wood studs to consist of nom 2 by 4 in. lumber spaced 16 in. OC. Steel studs to be min 2-1/2 in. wide and spaced max 24 in. OC. When steel studs are used and the diam of opening exceeds the width of stud cavity, the opening shall be framed on all sides using lengths of steel stud installed between the vertical studs and screw-attached to the steel studs at each end. The framed opening in the wall shall be 4 to 6 in. wider and 4 to 6 in. higher than the diam of the penetrating item such that, when the penetrating item is installed in the opening, a 2 to 3 in. clearance is present between the penetrating item and the framing on all four sides.

B. Gypsum Board* — 5/8 in. thick, 4 ft wide with square or tapered edges. The gypsum board type, thickness, number of layers, fastener type and sheet orientation shall be as specified in the individual U300 or U400 Series Design in the UL Fire Resistance Directory. Max diam of opening is 32-1/4 in. for steel stud walls. Max diam of opening is 14-1/2 in. for wood stud walls.

The F Rating of the firestop system is equal to the fire rating of the wall assembly.

2. Through-Penetrants — One metallic pipe, conduit or tubing to be installed either concentrically or eccentrically within the firestop system. The annular space shall be min 0 in. to max 2-1/4 in. Pipe may be installed with continuous point contact. Pipe, conduit or tubing may be installed at an angle not greater than 45 degrees from perpendicular. Pipe, conduit or tubing to be rigidly supported on both sides of wall assembly. The following types and sizes of metallic pipes, conduits or tubing may be used:

A. Steel Pipe — Nom 30 in diam (or smaller) Schedule 10 (or heavier) steel pipe.

B. Iron Pipe — Nom 30 in. diam (or smaller) cast or ductile iron pipe.

C. Conduit — Nom 4 in diam (or smaller) steel electrical metallic tubing or 6 in. diam steel conduit.

D. Copper Tubing — Nom 6 in. diam (or smaller) Type L (or heavier) copper tubing.

E. Copper Pipe — Nom 6 in. diam (or smaller) regular (or heavier) copper pipe.

3. Fill, Void or Cavity Material* — Sealant — Min 5/8 in. thickness of fill material applied within the annulus, flush with both surfaces of wall. At the point or continuous contact locations between pipe and wall, a min 1/2 in. diam bead of fill material shall be applied at the pipe wall interface on both surfaces of wall.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — FS-One Sealant


*Bearing the UL Classification Mark



Hilti Firestop Systems

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
November 26, 2012

Page: 2 of 2

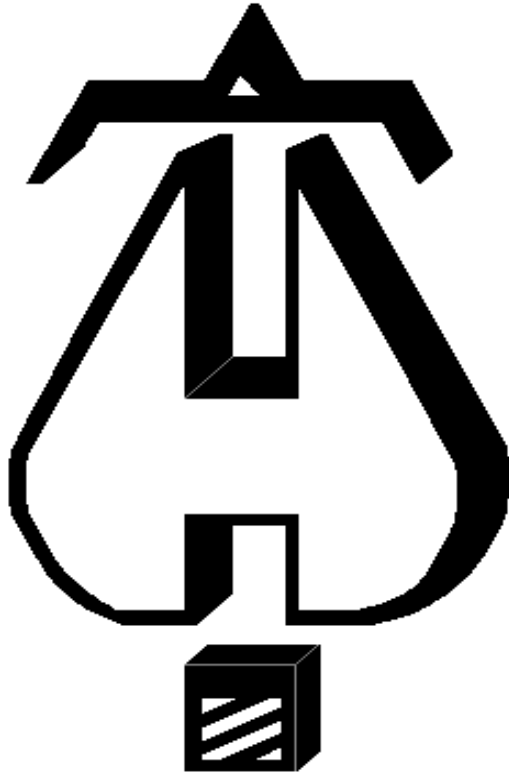

. . . Fire Protection by Computer Design

Eastern Fire Protection
170 Kitty Hawk Ave.
P.O. Box 1390
Auburn, Maine, 04211
207-784-1507

Job Name : PORTLAND GASTRO. FOURTH FLOOR REMOTE AREA
Drawing : 1 OF 2
Location : 161 MARGINAL WAY, PORTLAND, MAINE
Remote Area : ONE
Contract : 5458-16
Data File : PORTLAND GASTRO FOURTH FLOOR PROOF.WXF