


THA
ARCHITECTS, LLC
ARCHITECTURE DESIGN PLANNING INTERIOR DESIGN
105 WILLLOW BROOK AVENUE
SOUTHAMPTON, NEW HAMPSHIRE 03885
Tel: (603) 770-2491 Fax: (603) 773-0288
www.thaarc.com

These drawings and specifications were prepared for use at the location indicated. Publication and use in any other project, location, or in part, is prohibited without the written permission of THA Architects, LLC.
© 2016 THA Architects, LLC.

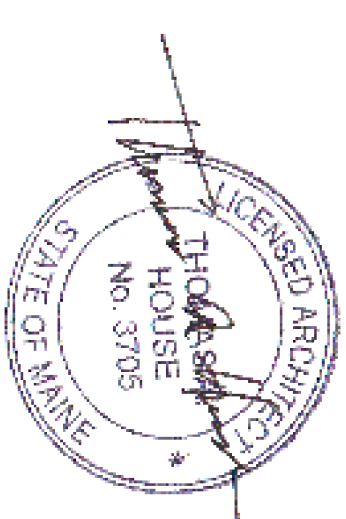

midtown Portland

Somerset Street
Elm Street
Portland, ME

Building 2
Level Six
Floor Plan

Structural Engineer
Becker Engineering
MEP Engineer
McCabe & Associates
FP Engineer
McCabe & Associates


SCALE:
ISSUED / DRAWN BY
February 8, 2016

REVISED / REVISED BY
April 13, 2016

JOB NO.: 15001

SHEET NUMBER

A-1.6

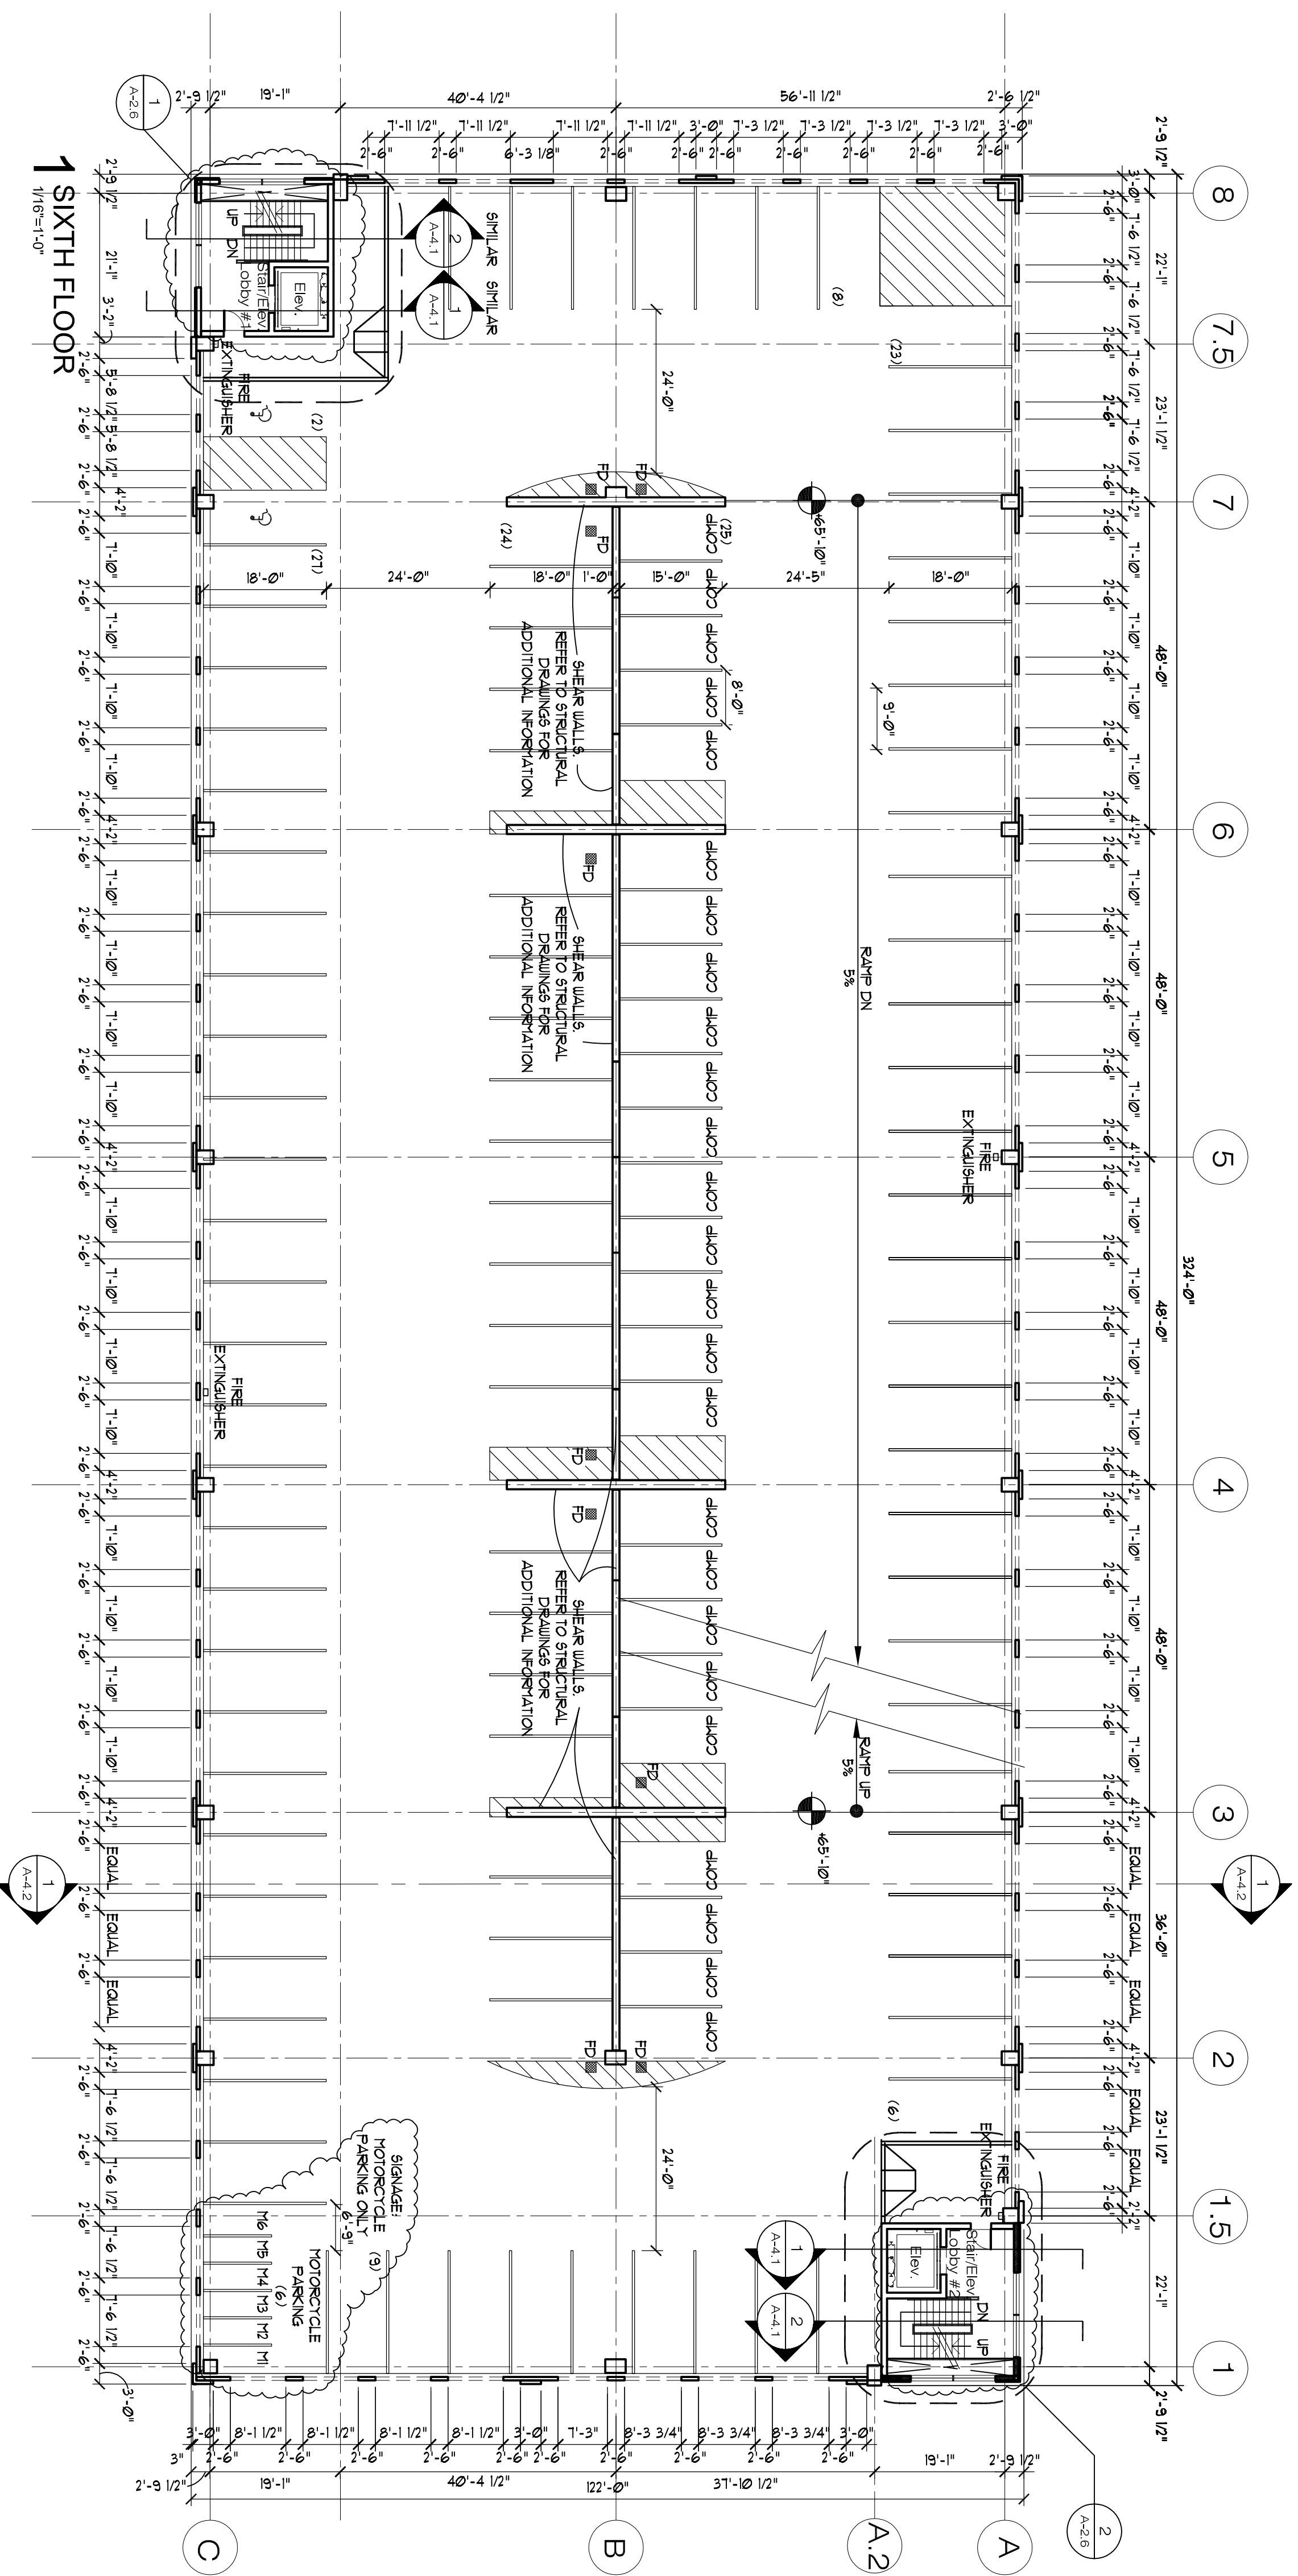

- GENERAL NOTES**
1. UNLESS OTHERWISE NOTED, ALL DIMENSIONS INDICATED ARE TO THE FACE OR CENTERLINE OF THE WALL, STUDS, NOT THE WALL ASSEMBLY.
 2. ALL INTERIOR WALLS ARE TO BE IUC WALL TYPE UNLESS OTHERWISE NOTED.
 3. ALL EXTERIOR WALLS ARE TO BE BU-A UNLESS OTHERWISE NOTED.
 4. FIRE RATED PARTITIONS SHALL BE USED THROUGHOUT TOILET ROOMS AND STAIRWAYS. ALL STAIRWAYS SHALL BE FIRE RATED AND FINISHED WITH A MINIMUM 1 HOUR RATED ASSEMBLY. ALL LOCATIONS WHERE TILE IS LOCATED AS DIRECTED BY THE OWNER.
 5. REFER TO A-6.1 FOR FIVE RESISTANCE RATINGS FOR WALLS, FLOORS AND ROOF ASSEMBLIES.
 6. REFER TO UL LISTINGS FOR PIPE AND DUCT PENETRATIONS IN RATED WALLS.
 7. REFER TO A-6.1 FOR FIVE RESISTANCE RATINGS FOR WALLS, FLOORS AND ROOF ASSEMBLIES.
 8. REFER TO A-6.1 FOR FIVE RESISTANCE RATINGS FOR WALLS, FLOORS AND ROOF ASSEMBLIES.
 9. REFER TO A-6.1 FOR FIVE RESISTANCE RATINGS FOR WALLS, FLOORS AND ROOF ASSEMBLIES.
 10. REFER TO A-6.1 FOR FIVE RESISTANCE RATINGS FOR WALLS, FLOORS AND ROOF ASSEMBLIES.
 11. BLOCKING SHALL BE ADEQUATE TO PROPERLY SUPPORT GRADE BARS INSTALLED AS INDICATED IN TYPICAL ACCESSIBILITY GUIDELINES AND DIMENSIONS USING A LOAD RATED BLOCKING OF 200 LBS PER LINEAL FOOT.
 12. ALL FLOORING SHALL BE INSTALLED ON A ONE HOUR RATED ASSEMBLY SHALL NOT PENETRATE THE TWO HOUR ASSEMBLY.
 13. ALL FLOORING SHALL BE INSTALLED ON A ONE HOUR RATED ASSEMBLY SHALL NOT PENETRATE THE TWO HOUR ASSEMBLY.
 14. APPROPRIATE SEALANT.
 15. FIRE EXTINGUISHER CABINET V.C. DENOTES A FIRE EXTINGUISHER CABINET.
 16. FIRE EXTINGUISHER HOSE CABINET V.C. DENOTES A FIRE EXTINGUISHER HOSE CABINET.
 17. FIRE EXTINGUISHER HOSE CABINET V.C. DENOTES A FIRE EXTINGUISHER HOSE CABINET.
 18. CONSTRUCTION JOINT LOCATION AND DETAILS.
 19. PARKING GARAGE STRUCTURE IS TO BE A PRECAST CONCRETE JOINT FACILITY.
 20. REFER TO ARCHITECTURAL DRAWINGS FOR ADDITIONAL SOILS INFORMATION.
 21. REFER TO GEOTECHNICAL REPORT FOR ADDITIONAL SOILS INFORMATION.

Permit Set