


KEYED NOTES

- ① INSTALL GROUNDED (NEUTRAL) CONDUCTOR SAME SIZE AS THE LARGEST PHASE CONDUCTOR IF THE LINE-TO-NEUTRAL LOAD EXCEEDS 5% OF THE CONNECTED LOAD. IF NEUTRAL LOAD IS SMALLER, INSTALL THE NEC MINIMUM GROUNDED CONDUCTOR.
 - ② INSTALL GROUNDING ELECTRODE CONDUCTOR, SIZED BASED ON NEC TABLE 250.66 USING THE SERVICE PHASE CONDUCTOR SIZE, BUT NOT SMALLER THAN 4 AWG.
 - ③ INSTALL EQUIPMENT GROUNDING CONDUCTOR SIZED BASED ON NEC TABLE 250.122 USING THE FEEDER OVERCURRENT DEVICE SIZE.
 - ④ BOND TO GAS PIPE ON THE BUILDING SIDE OF THE GAS METER.
 - ⑤ INSTALL GROUNDING ELECTRODE CONDUCTOR THAT IS SIZED BASED ON NEC TABLE 250.66 USING THE SEPARATELY DERIVED SYSTEM PHASE CONDUCTOR SIZE.
 - ⑥ INSTALL A CONCRETE-ENCASED MAIN GROUNDING ELECTRODE IN THE BUILDING FOUNDATION AROUND THE ENTIRE PERIMETER OF THE BUILDING. LOCATE ELECTRODE IN THE BOTTOM ONE-THIRD OF THE FOUNDATION WITH AT LEAST 3 INCHES OF CONCRETE COVER. USE EITHER OF THE FOLLOWING MATERIALS FOR THE ELECTRODE:
BARE COPPER CABLE NOT SMALLER THAN THE GROUNDING ELECTRODE CONDUCTOR REQUIRED BY THE NEC AND NOT SMALLER THAN 4 AWG.
BARE OR GALVANIZED REBARS THAT ARE MADE ELECTRICALLY CONTINUOUS USING COPPER JUMPERS NOT SMALLER THAN THE NEC REQUIRED GROUNDING ELECTRODE CONDUCTOR AND NOT SMALLER THAN 4 AWG. USE REINFORCING BARS NOT SMALLER THAN THE FOLLOWING BASED ON THE TOTAL LENGTH OF THE INTERCONNECTED AND PARALLELED REBARS:
- | TOTAL LENGTH | MINIMUM REBAR SIZE |
|--------------|--------------------|
| 112 FT | 1 3/8" (#11 BAR) |
| 150 FT | 1" (#8 BAR) |
| 192 FT | 3/4" (#6 BAR) |
| 223 FT | 5/8" (#5 BAR) |
| 268 FT | 1/2" (#4 BAR) |
- ⑦ BOND EACH PERIMETER STRUCTURAL STEEL COLUMN TO THE CONCRETE-ENCASED MAIN GROUNDING ELECTRODE. USE COMPRESSION CONNECTORS THAT MEET IEEE 837 REQUIREMENTS OR USE EXOTHERMIC WELDS.
 - ⑧ INSTALL A "MAIN GROUND ELECTRODE GROUND BAR" FOR SINGLE POINT GROUNDING. LOCATE AT AN ACCESSIBLE AND VISIBLE POINT NEAR THE SERVICE ENTRANCE EQUIPMENT. MAKE CONNECTIONS TO THE GROUND BAR USING TWO-HOLE COMPRESSION SPADE LUGS THAT MEET IEEE 837 REQUIREMENTS. LABEL EACH CONNECTION TO THE GROUND BAR.
 - ⑨ LIGHTNING PROTECTION GROUNDING COUNTERPOISE - 4/0 AWG COPPER.
 - ⑩ BOND THE LIGHTNING PROTECTION SYSTEM GROUNDING COUNTERPOISE TO THE MAIN GROUND ELECTRODE GROUND BAR. USE 4/0 AWG COPPER CABLE WITH 600 VOLT INSULATION. AT THE UNDERGROUND CONNECTION USE A COMPRESSION CONNECTOR THAT MEETS IEEE 837 REQUIREMENTS OR USE AN EXOTHERMIC WELD.
 - ⑬ INSTALL A COPPER GROUNDING BAR IN EACH TELECOMMUNICATIONS ROOM. CONNECT TO THE "MAIN GROUNDING ELECTRODE GROUND BAR" USING 600V INSULATED 4/0 AWG COPPER CABLE AND COMPRESSION SPADE LUGS.
 - ⑭ INSTALL GROUNDED (NEUTRAL) CONDUCTOR THAT IS NOT LESS THAN THE PHASE CONDUCTOR AMPACITY. IF HIGH-HARMONICS ARE PRESENT MAKE NEUTRAL AMPACITY 200% OF THE PHASE CONDUCTOR.
 - ⑮ INSTALL BONDING CONDUCTOR THAT IS SIZED BASED ON NEC TABLE 250.66 USING THE SERVICE OR SEPARATELY-DERIVED SYSTEM PHASE CONDUCTOR SIZE.
 - ⑯ INSTALL IRREVERSIBLE COMPRESSION CONNECTOR WITH TAMPER-PROOF HARDWARE OR INSTALL EXOTHERMIC WELD.
 - ⑰ BOND TO METAL PIPING SYSTEMS IN THE AREA SERVED BY THE SEPARATELY DERIVED SYSTEM.
 - ⑱ INSTALL BONDING JUMBER THAT IS SIZED BASED ON NEC TABLE 250.66 USING THE LARGEST SERVICE OR SEPARATELY DERIVED SYSTEM PHASE CONDUCTOR.

GENERAL NOTES

2. CONDUCTOR SIZES SHOWN ARE MINIMUM AND MAY BE LARGER THAN THE MINIMUM SIZES REQUIRED BY NEC.
3. INSTALL GROUNDING CONNECTIONS TO BUILDING STRUCTURE AND WATER PIPES AT LOCATIONS THAT ARE VISIBLE AND ACCESSIBLE FOR INSPECTION, MAINTENANCE, AND TESTING.
4. INSTALL AN INSULATED THROAT GROUNDING BUSHING ON EACH METALLIC SERVICE ENTRANCE CONDUIT. BOND TO GROUND BUS USING CONDUCTOR THAT IS SIZED BASED ON NEC TABLE 250.66 USING THE SERVICE PHASE CONDUCTOR SIZE.

Revised Permit Set April 15, 2016
Permit Set February 8, 2016

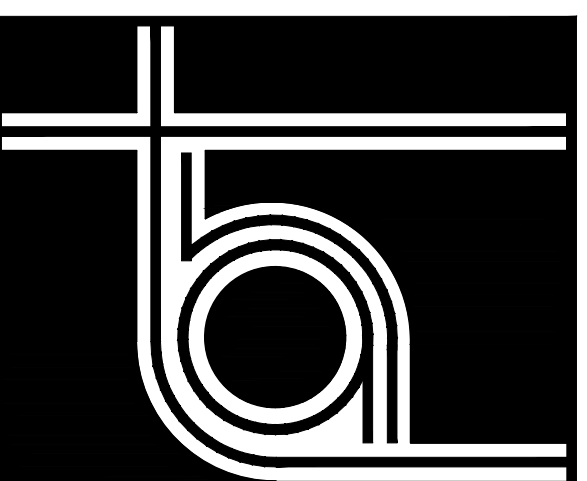


THA ARCHITECTS, LLC

ARCHITECTURE • DESIGN • PLANNING • INTERIOR DESIGN

105 WILLOW BROOK AVENUE
STRATHAM, NEW HAMPSHIRE 03885

Tel: (603) 770-2491 Fax: (603) 773-0238
www.thaarc.com

These drawings and specifications were prepared for use at the location indicated. Publication and use is expressly limited to the identified location. Reuse or reproduction by any method, in whole or in part, is prohibited without the written permission of THA Architects, LLC.
© THA Architects, LLC.

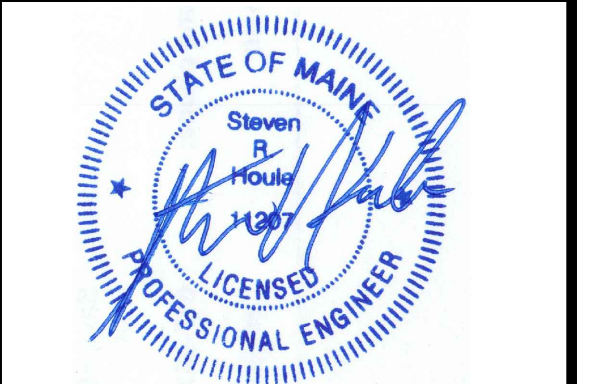

midtown Portland

Somerset Street
Elm Street
Portland, ME

**Building 2
Electrical
GROUNDING**

Structural Engineer
Becker Engineering
MEP ENGINEER
McCabe Associates
FP Engineer
McCabe Associates

SCALE: NONE

ISSUED / DRAWN BY _____

2/8/16

© THA Architects, LLC

REVISED / REVISED BY _____

JOB NO: 15001

SHEET NUMBER

E-4.1