



SCHEDULE OF SCUPPERS BEHIND RAMPS AND PLANTERS

LOCATION	RIM	INVERT OUT	CONNECT TO
11+92, 30' LT	11.70	7.70	F-3
12+17, 30' LT	11.70	7.45	F-3
12+50, 31' LT	11.81	7.70	F-2
12+81, 31' LT	11.81	7.70	F-2

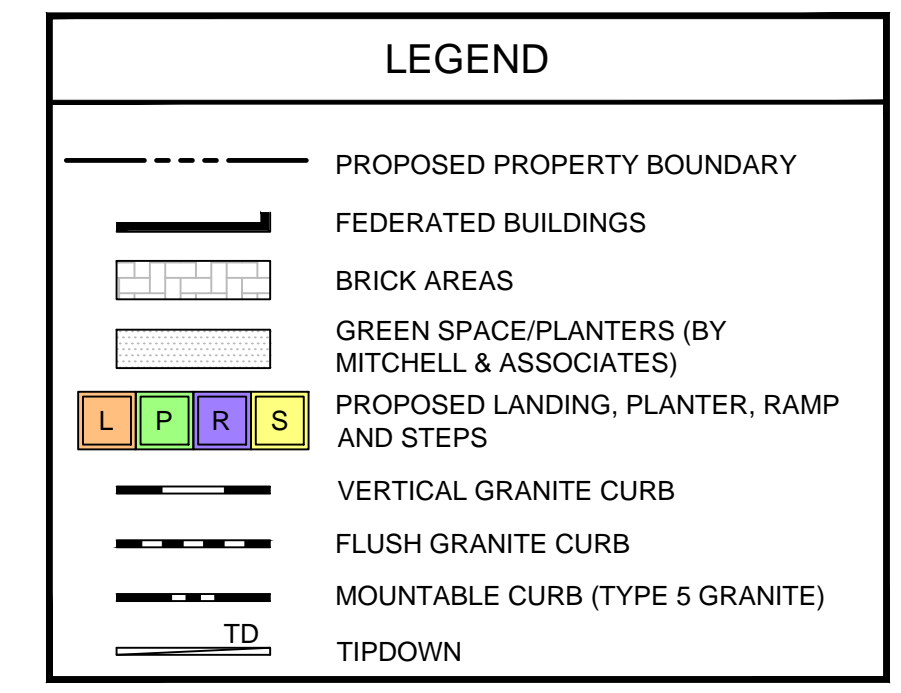

- NOTES:**
- THE GAS LINE WILL BE UPGRADED AND REPLACED BY UNITL. CONTRACTOR RESPONSIBLE FOR COORDINATION OF THE WORK AND ALL TRENCHING, BACKFILL & SURFACE RESTORATION.
 - THE FILTERRA TREE BOX FILTERS REQUIRE CONNECTIONS TO UNDERGROUND STORAGE AND CONNECTION TO STORM DRAIN IN SOMERSET STREET. REFER TO SCHEDULES ON SHEETS C-3.10 THROUGH C-3.13.
 - EXISTING MANHOLES AND CATCH BASINS TO BE EXAMINED IN THE FIELD TO DETERMINE THE SCOPE OF WORK TO RAISE THEM TO PROPOSED GRADES AND/OR CONNECT TO NEW STORM DRAIN LINES.
 - THE SURFACE TREATMENT AND LIGHTING FOR THE AREA TO THE NORTH OF THE CURB LINE ARE SHOWN ON PLANS PREPARED BY MITCHELL & ASSOCIATES.
 - THE SURFACE TREATMENT SOUTH OF THE SOUTHERLY CURB LINE ON SOMERSET STREET WILL BE UNIMPROVED AND STABILIZED WITH EROSION CONTROL SEED MIXES.
 - TEL, ELEC & COMM TO BE PLACED (UNDERGROUND AND TO BE LOCATED ON THE NORTHERLY SIDE OF SOMERSET STREET.
 - ELEVATIONS AND INVERTS FOR WATER QUALITY SYSTEMS ARE PROVIDED IN THE DRAINAGE SCHEDULES OF SHEET C-3.10, C-3.11, C-3.12, AND C-3.13.
 - UNDERGROUND STORAGE FOR 'ISOLATOR ROW' ARE BASED UPON THE BRENTWOOD STORAGE SYSTEM. STORMTECH® SC 740 CHAMBERS ARE AN ACCEPTABLE ALTERNATIVE. IF THE STORMTECH® SC 740 CHAMBERS ARE USED, THE WEIR IN THE OVERFLOW CONTROL MANHOLE SHALL BE RAISED 6" ABOVE THE ELEVATION LISTED IN THE DRAINAGE SCHEDULES ON SHEETS C-3.10 THROUGH C-3.13.
 - ALL BUILDING FOUNDATION DRAINS SHALL BE PIPED TO THE WQ UNIT 'ISOLATOR' ROWS. (MAY NOT BE SHOWN ON PLAN VIEW).

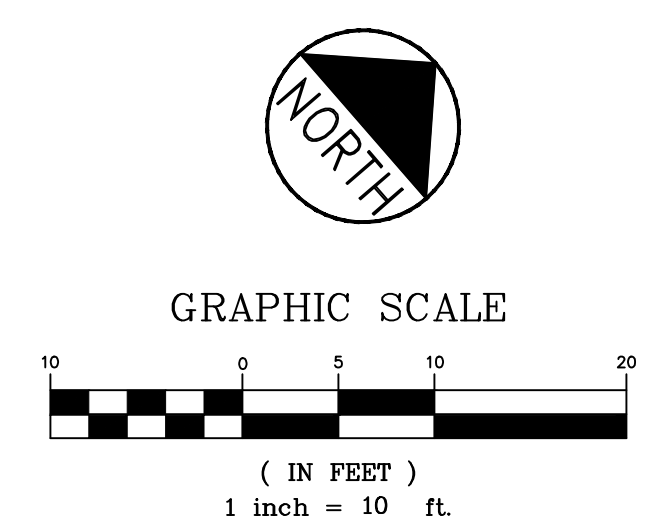

PRELIMINARY - NOT FOR CONSTRUCTION

PROJECT midtown PORTLAND, MAINE	SHEET TITLE PROPOSED SPOT GRADES FOR EAST SIDE SOMERSET STREET	CLIENT THE FEDERATED COMPANIES	DRAWN: KEWLA DESIGNED: WGH/BK CHECKED: WGH/SRB FILE NAME: 3062-GRADE	DATE: OCTOBER 2014 SCALE: 1" = 10' JOB NO. SP-M037B
			SHEET C-3.3	