


- NOTES:
1. CIRCUITS IN INDIVIDUAL UNITS REFER TO UNIT LOAD CENTERS.
 2. ALL RECEPTACLES LOCATED IN KITCHENS AND IN BATHROOMS EXCEPT REFRIGERATOR SHALL BE GFI RATED.
 3. USE #12 AWG WIRE SIZE MINIMUM FOR ALL BRANCH CIRCUITS.
 4. MINIMUM PANEL CIRCUIT BREAKER SIZE SHALL BE 20 AMPERES.
 5. PROVIDE PATIO RECEPTACLES ONLY AT FIRST FLOOR UNITS.
 6. PROVIDE PATIO RECEPTACLE AT UNIT J ONLY AT SECOND FLOOR UNIT.

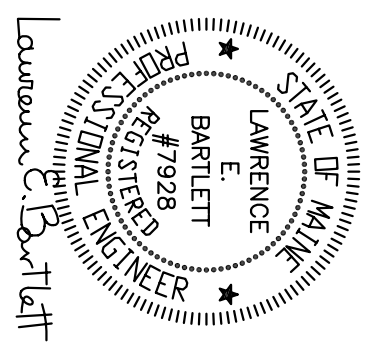

Bartlett Design
LIGHTING & ELECTRICAL ENGINEERING
942 WASHINGTON STREET, BATH, ME 04530
TEL (207) 443-5447 FAX (207) 443-5560

Pearl Place Building 1 & 2 Portland Maine

Developer
Avesta Pearl Street One, L.P.

- Architect: Winston Scott Architects
- Landscape Architect: Carroll Associates
- Civil: Gorill Palmer Consulting Engineers
- Structural: Becker Structural
- Mechanical / Plumbing: Mechanical Systems Engineers
- Electrical: Bartlett Designs

UNIT PLANS
A, B, C, H & J
E3.1

Scale: As Shown
SEPTEMBER 1, 2006