


NOTE:
ALL DIMENSIONS ARE REFERENCE ONLY. ALL DIMENSIONS SHALL BE
FIELD VERIFIED BEFORE CONSTRUCTION BEGINS.

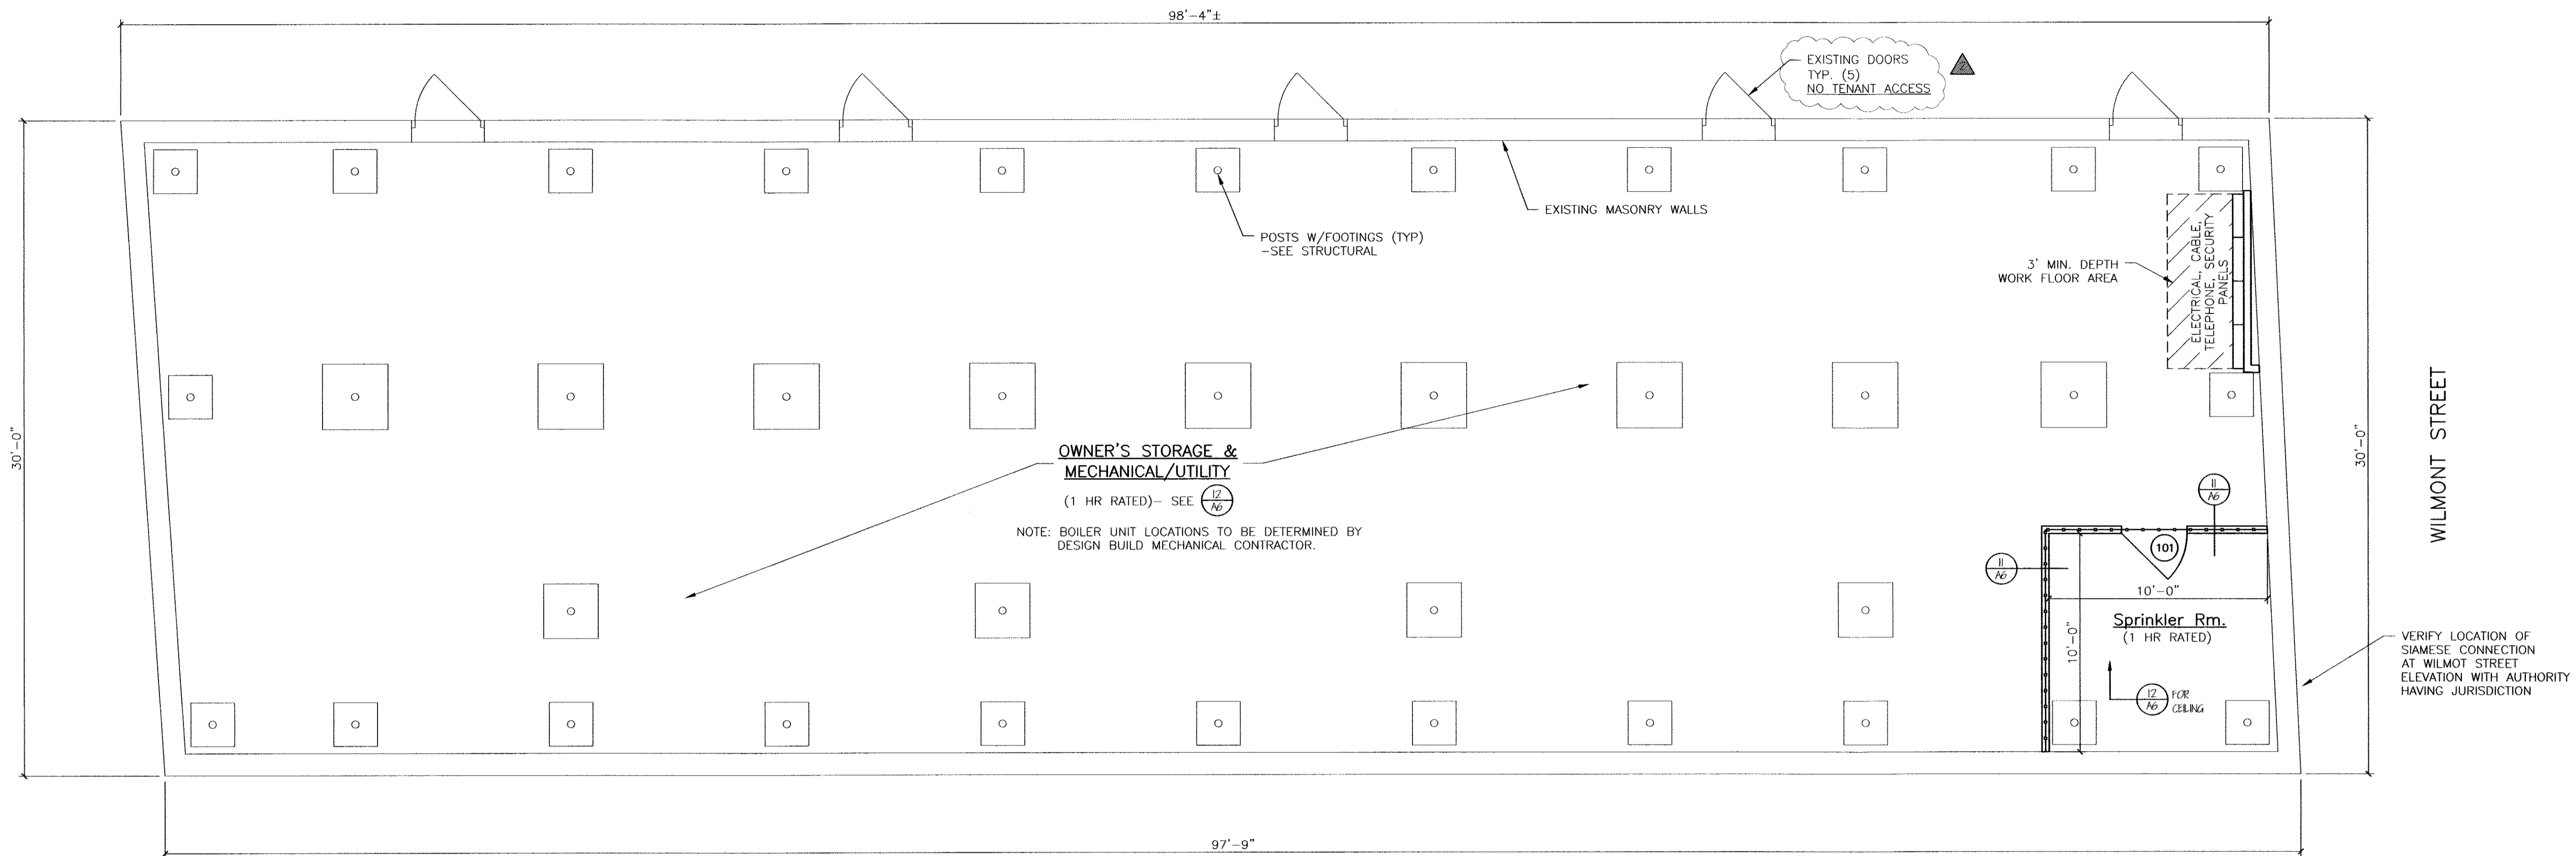

BASEMENT PLAN



NOTE: FIRE RATED SEPARATION AT CEILING/FLOOR ASSEMBLY
REQUIRED PER NFPA (MECH/UTILITY/STORAGE OVER 100 SF)
& EIBC (STORAGE/MECHANICAL/UTILITY)

NFPA LEGEND	
	EXIT LIGHT
	FIRE EXTINGUISHER
	FIRE ALARM PULL MANUAL PULL STATION
	FIRE ALARM PANEL
	EMERGENCY LIGHT
	FIRE ALARM HORN
	SMOKE DETECTOR W/ SOUNDER BASE & STROBE (INTERCONNECTED)
	COMBINATION CARBON MONOXIDE/ SMOKE DETECTOR W/ SOUNDER BASE & STROBE (INTERCONNECTED)
	HEAT DETECTOR
	ANNUNCIATOR PANEL
	KNOX BOX
	1 HR RATED PARTITION
	1 HR RATED SEPARATION PARTITION

LIFE SAFETY NOTES	
1.	THE BUILDING SHALL HAVE AN NFPA IBC FIRE SUPPRESSION SPRINKLER SYSTEM INSTALLED. SPRINKLER SYSTEM SHALL BE INSTALLED BY A CERTIFIED SPRINKLER CONTRACTOR AND SHALL BE REVIEWED AND APPROVED BY THE STATE OF MAINE FIRE MARSHAL AS WELL AS THE LOCAL AUTHORITY HAVING JURISDICTION. THE CONTRACTOR SHALL BEAR SOLE RESPONSIBILITY FOR THE DESIGN AND INSTALLATION OF THE SYSTEM FOR OCCUPANCY.
2.	THE BUILDING SHALL HAVE A FIRE ALARM SYSTEM AS REQUIRED FOR COMPLIANCE WITH NFPA IBC LIFE SAFETY CODE COORDINATE WITH SPRINKLER SYSTEM. VERIFY LOCATION OF ALARM AND NOTIFICATION PANELS WITH THE AUTHORITY HAVING JURISDICTION.
3.	SEE ACCESSIBILITY DETAILS FOR MOUNTING HEIGHTS OF LIFE SAFETY DEVICES.
4.	ALL ALARMS AND DETECTORS SHALL BE INTERCONNECTED WITHIN EACH LIVING UNIT.
5.	REFER TO THE WINDOW SCHEDULE FOR EGRESS WINDOWS.

GENERAL NOTES	
1.	ALL HORIZONTAL UNIT SEPARATIONS (FLOOR/CEILING/ROOF) ASSEMBLIES SHALL BE 1 HR. FIRE RATED/ SIC 50. -SEE (10/16) & (12/16)
2.	ALL VERTICAL UNIT SEPARATIONS (TENANT WALLS) SHALL BE 1 HR. FIRE RATED/ SIC 50. -SEE (7/16)
3.	ALL STAIR ENCLOSURES SHALL BE 1 HR. FIRE RATED. -SEE (1/16) & (9/16)
4.	THREE FIRST FLOOR UNITS SHALL BE ADA ADAPTABLE. -SEE ADA UNIT PLAN (10/16)
5.	SEE SHEET A6 FOR STAIR DETAILS
6.	REMOVE EXISTING DECKS & FIRE ESCAPES IN THEIR ENTIRETY.
7.	SEE SHEET A7 FOR ACCESSIBILITY DETAILS AND ADAPTABLE ADA UNITS.

LEGEND	
SYMBOL	DESCRIPTION
	NEW WALL
	NEW WALL/EXISTING WALL W/INFILL
	EXISTING WALL
	THIN LINEWEIGHT DENOTES EXISTING CONDITIONS
	HEAVY LINEWEIGHT DENOTES NEW CONDITIONS
	DEMOLISHED OR REMOVED STRUCTURE OR EQUIPMENT

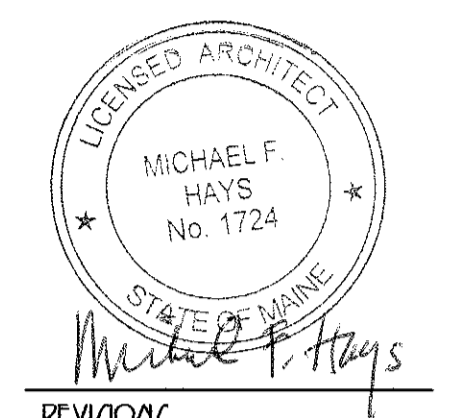

REVISIONS
▲ 08/22/15
▲ 03/02/15
▲ 09/21/15

PROJECT NAME

15 UNIT APARTMENT BUILDING
48 WILMONT STREET
48 WILMONT STREET LLC,
477 CONGRESS STREET
PORTLAND, MAINE 04101

SHEET

BASEMENT PLAN

DATE: 26 JUNE 2015
SCALE: 1/4"=1'-0"
DRAWN: JAM/MFH
JOB NO: 150605

A1
COPYRIGHT
REPRODUCTION OR RELY/T OF THIS
DOCUMENT WITHOUT WRITTEN
PERMISSION FROM GRANT HAYS
ASSOCIATES IS PROHIBITED.