


J/TAL

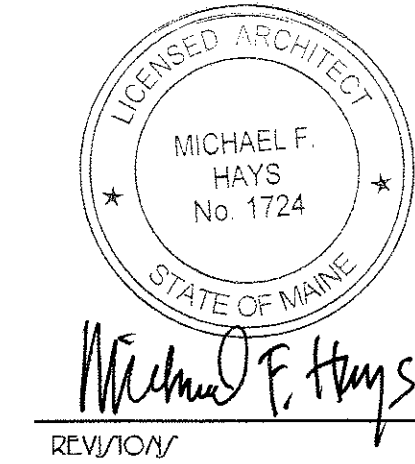

REVISION

PROJECT NAME

6 UNIT APARTMENT/COMMERCIAL
223 CUMBERLAND AVENUE
223 CUMBERLAND AVENUE LLC.
477 CONGRESS STREET
PORTLAND, MAINE 04101


J/MLT

BASEMENT
FLOOR PLAN

DATE: 29/EPT 2015
SCALE: 1/4" = 1'-0"
DRAWN: JAM/MFH
JOB NO.: 150904
SHEET

A1

COPYRIGHT REPRODUCTION OR REVUE OF THIS DOCUMENT WITHOUT WRITTEN PERMISSION FROM GRANT HAYS ASSOCIATES IS PROHIBITED.

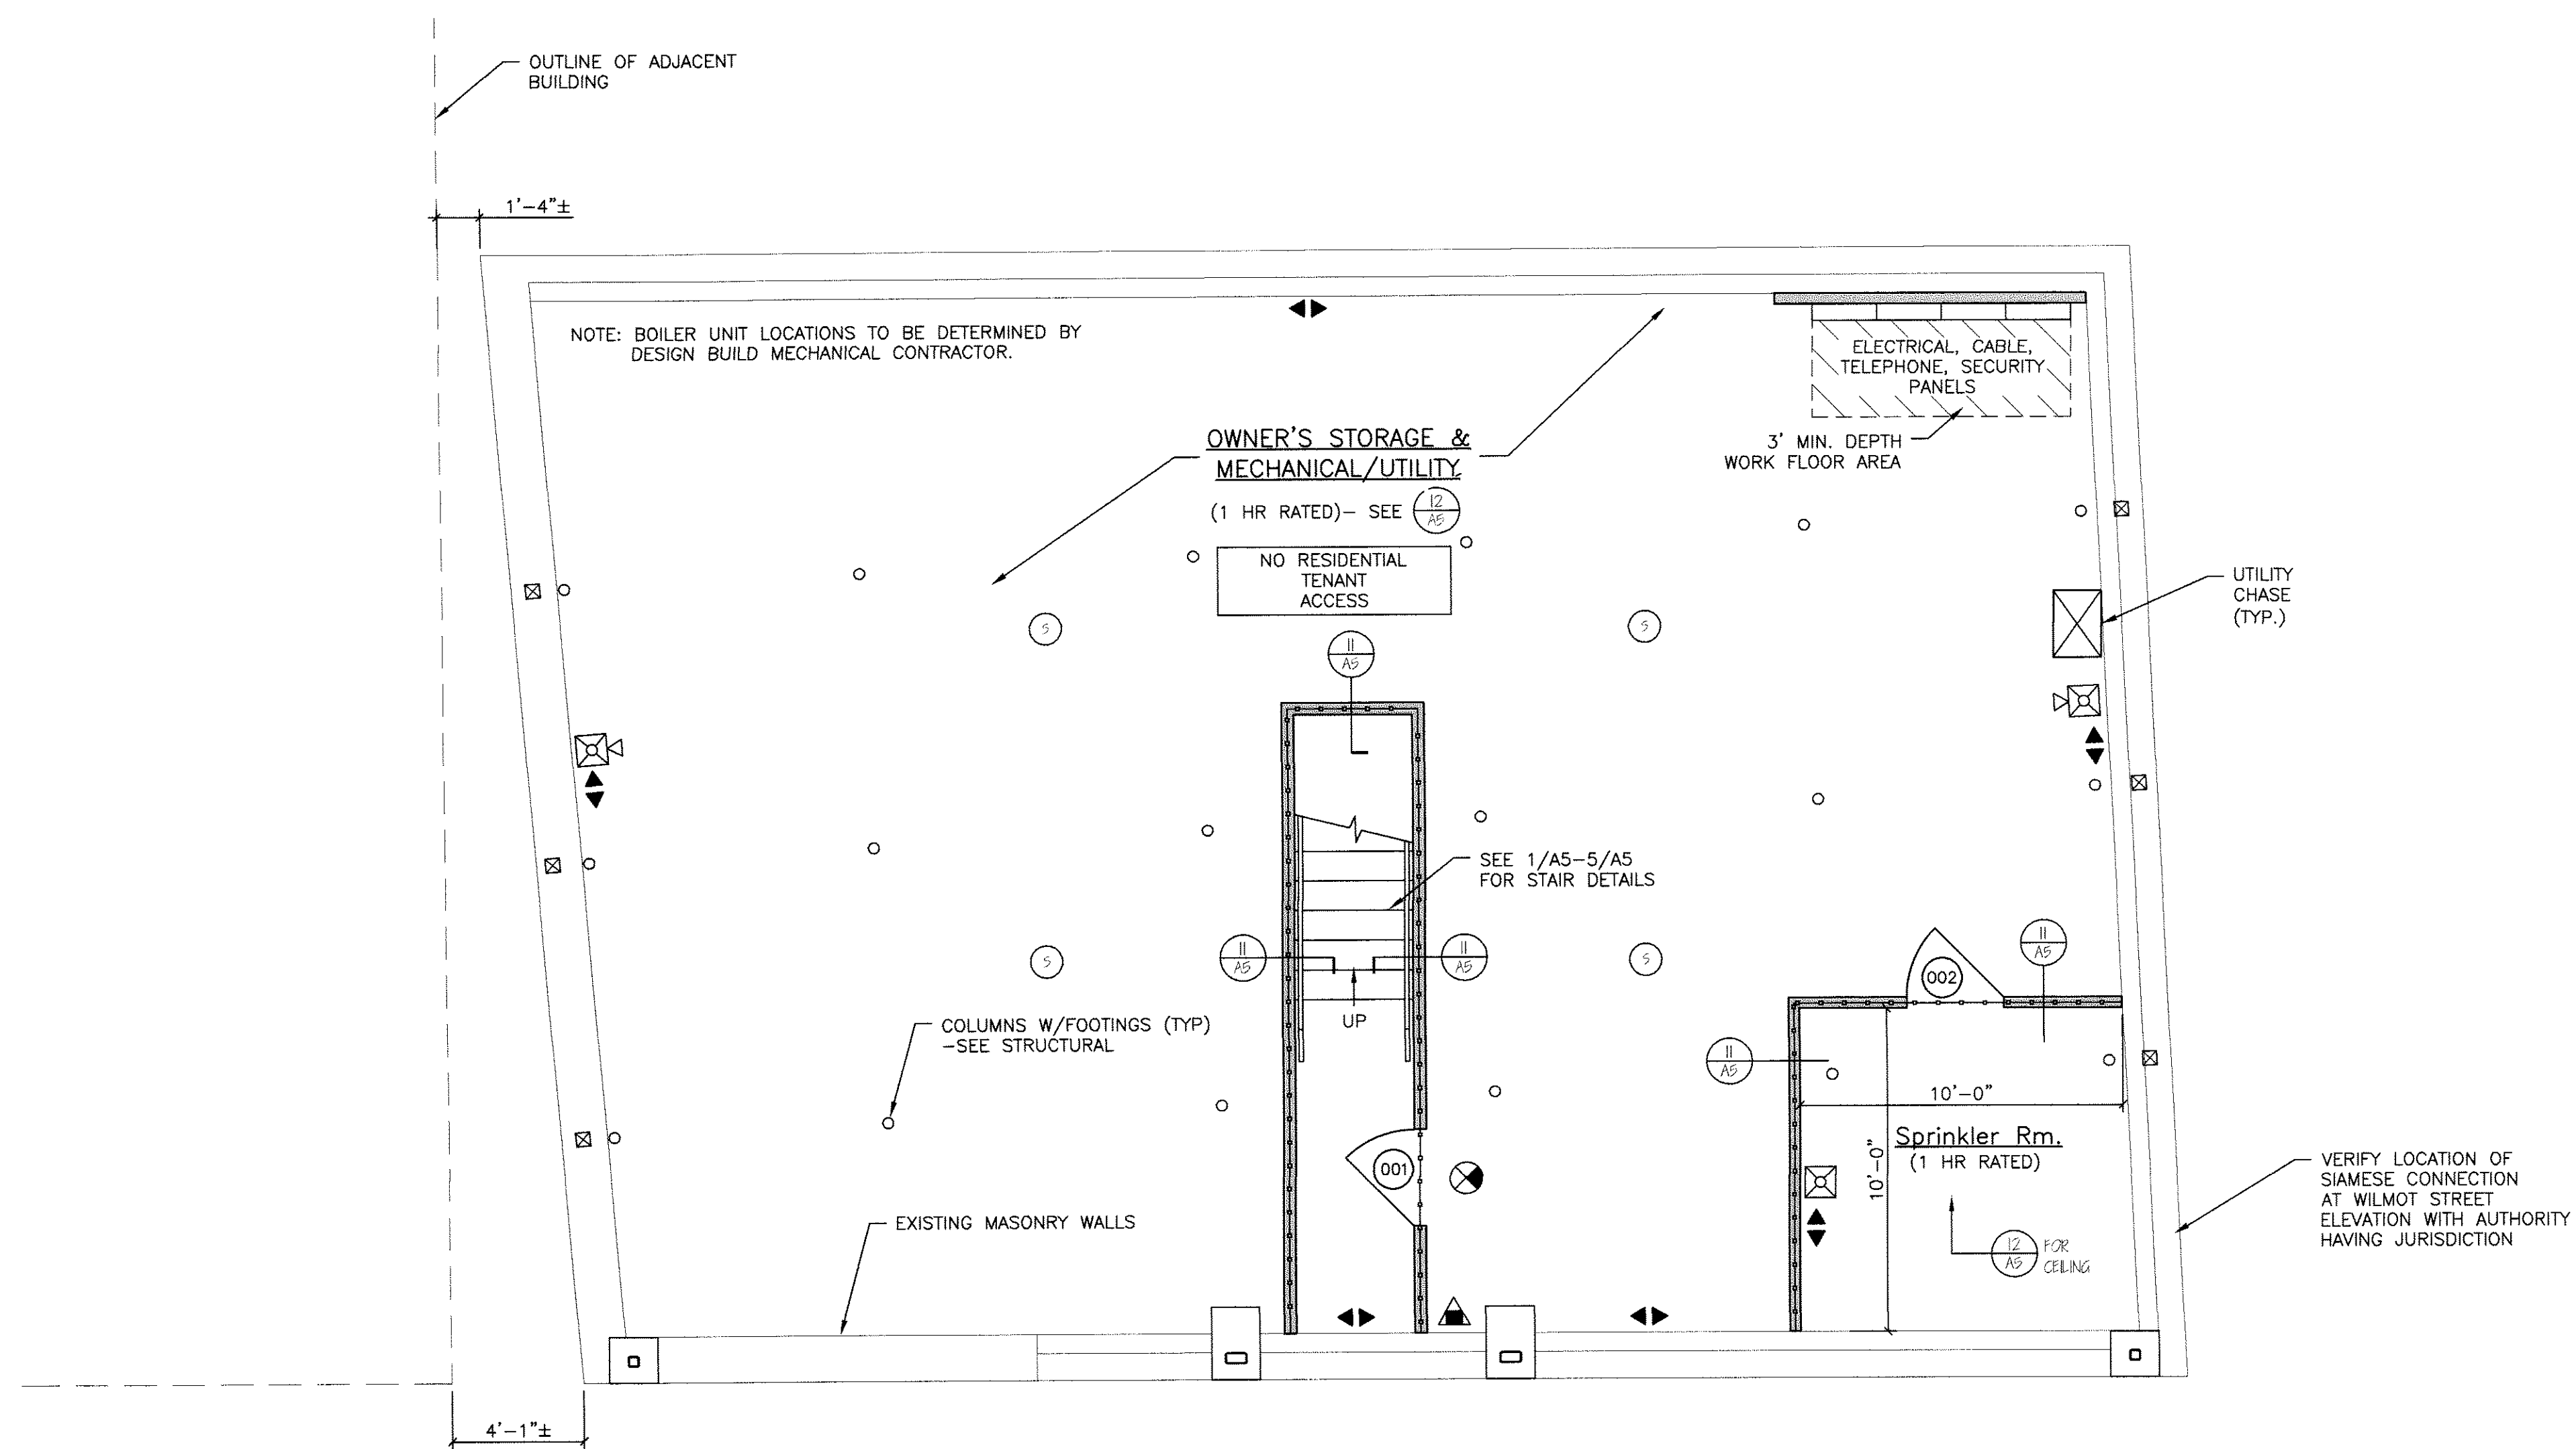

BASEMENT PLAN
SCALE: 1/4" = 1'-0"

NOTE: FIRE RATED SEPARATION AT CEILING/FLOOR ASSEMBLY REQUIRED PER NFPA (MECH/UTILITY/STORAGE OVER 100 SF) & EIBC (STORAGE/MECHANICAL/UTILITY)

NOTE:
ALL DIMENSIONS ARE REFERENCE ONLY. ALL DIMENSIONS SHALL BE FIELD VERIFIED BEFORE CONSTRUCTION BEGINS.

NFPA LEGEND	
	EXIT LIGHT
	FIRE EXTINGUISHER
	FIRE ALARM PULL MANUAL PULL STATION
	FIRE ALARM PANEL
	EMERGENCY LIGHT
	FIRE ALARM HORN SIRENE UNIT
	FIRE ALARM STROBE UNIT
	SMOKE DETECTOR W/ SOUNDER BASE & STROBE (INTERCONNECTED)
	COMBINATION CARBON MONOXIDE/ SMOKE DETECTOR W/ SOUNDER BASE & STROBE (INTERCONNECTED)
	HEAT DETECTOR
	ANNUNCIATOR PANEL
	KNOCK BOX
	2 HR FIRE RATED PARTITION
	1 HR FIRE RATED PARTITION
	1 HR FIRE RATED SEPARATION PARTITION
	"NO EXIT" SIGN

LIFE SAFETY NOTES	
1.	THE BUILDING SHALL HAVE AN NFPA 15 FIRE SUPPRESSION SPRINKLER SYSTEM INSTALLED. SPRINKLER SYSTEM SHALL BE INSTALLED BY A CERTIFIED SPRINKLER CONTRACTOR AND SHALL BE REVIEWED AND APPROVED BY THE STATE OF MAINE FIRE MARSHAL AS WELL AS THE LOCAL AUTHORITY HAVING JURISDICTION. THE CONTRACTOR SHALL BEAR SOLE RESPONSIBILITY FOR THE DESIGN AND INSTALLATION OF THE SYSTEM FOR OCCUPANCY.
2.	THE BUILDING SHALL HAVE A FIRE ALARM SYSTEM AS REQUIRED FOR COMPLIANCE WITH NFPA 72 LIFE SAFETY CODE. COORDINATE WITH SPRINKLER SYSTEM. VERIFY LOCATION OF ALARM AND NOTIFICATION PANELS WITH THE AUTHORITY HAVING JURISDICTION.
3.	SEE ACCESSIBILITY DETAILS FOR MOUNTING HEIGHTS OF LIFE SAFETY DEVICES.
4.	ALL ALARMS AND DETECTORS SHALL BE INTERCONNECTED WITHIN EACH LIVING UNIT.
5.	REFER TO THE WINDOW SCHEDULE FOR EGRESS WINDOWS.

GENERAL NOTES	
1.	ALL HORIZONTAL UNIT SEPARATIONS (FLOOR/CEILING/ROOF) ASSEMBLIES SHALL BE 1 HR. FIRE RATED/STC 90. -SEE 6/A5 & 10/A5 & 1/24
2.	ALL VERTICAL UNIT SEPARATIONS (TENANT WALLS) SHALL BE 1 HR. FIRE RATED/STC 90. -SEE 7/A5
3.	ALL SEPAR ENCLOSURES SHALL BE 1 HR. FIRE RATED. -SEE 1/A5 & 9/25
4.	STAIR DETAILS -SEE 1/A5 THRU 5/25
5.	REMOVE EXISTING DECKS & FIRE ESCAPES IN THEIR ENTIRETY.
6.	SEE SHEET AS FOR ACCESSIBILITY DETAILS AND NOTES.
7.	FIRE RATED PARTITIONS AT ROOF ASSEMBLY -SEE 6/24 & 7/24
8.	SEE SHEET AA FOR FIRE RATED CONTINUITY DETAILS AT FLOOR/ WALL ASSEMBLIES.

LEGEND	
SYMBOL	DESCRIPTION
	NEW WALL
	NEW WALL/EXISTING WALL W/INFILL
	EXISTING WALL
	THIN LINEWEIGHT DENOTES EXISTING CONDITIONS
	HEAVY LINEWEIGHT DENOTES NEW CONDITIONS
	DEMOLISHED OR REMOVED STRUCTURE OR EQUIPMENT

