

KEYPLAN

PART B NOTES:

1. INTERIOR LIGHTS WITH SHADED PATTERNS SHALL BE CIRCUITED TO PANEL P-EL1. ALL OTHER INTERIOR LIGHTS IN AREA B SHALL BE CIRCUITED TO PANEL P1.
2. EXTERIOR LIGHTS AROUND PLAN AREA B SHALL BE CIRCUITED TO PANEL P5.
3. LIGHT SWITCHES INDICATED BY So6, So7, So8, So9, So10 SHALL BE LOW VOLTAGE CONTROL SWITCHES WIRED TO THE LIGHTING CONTROL PANEL THAT IS LOCATED IN ELEC/DATA CLOSET 135.

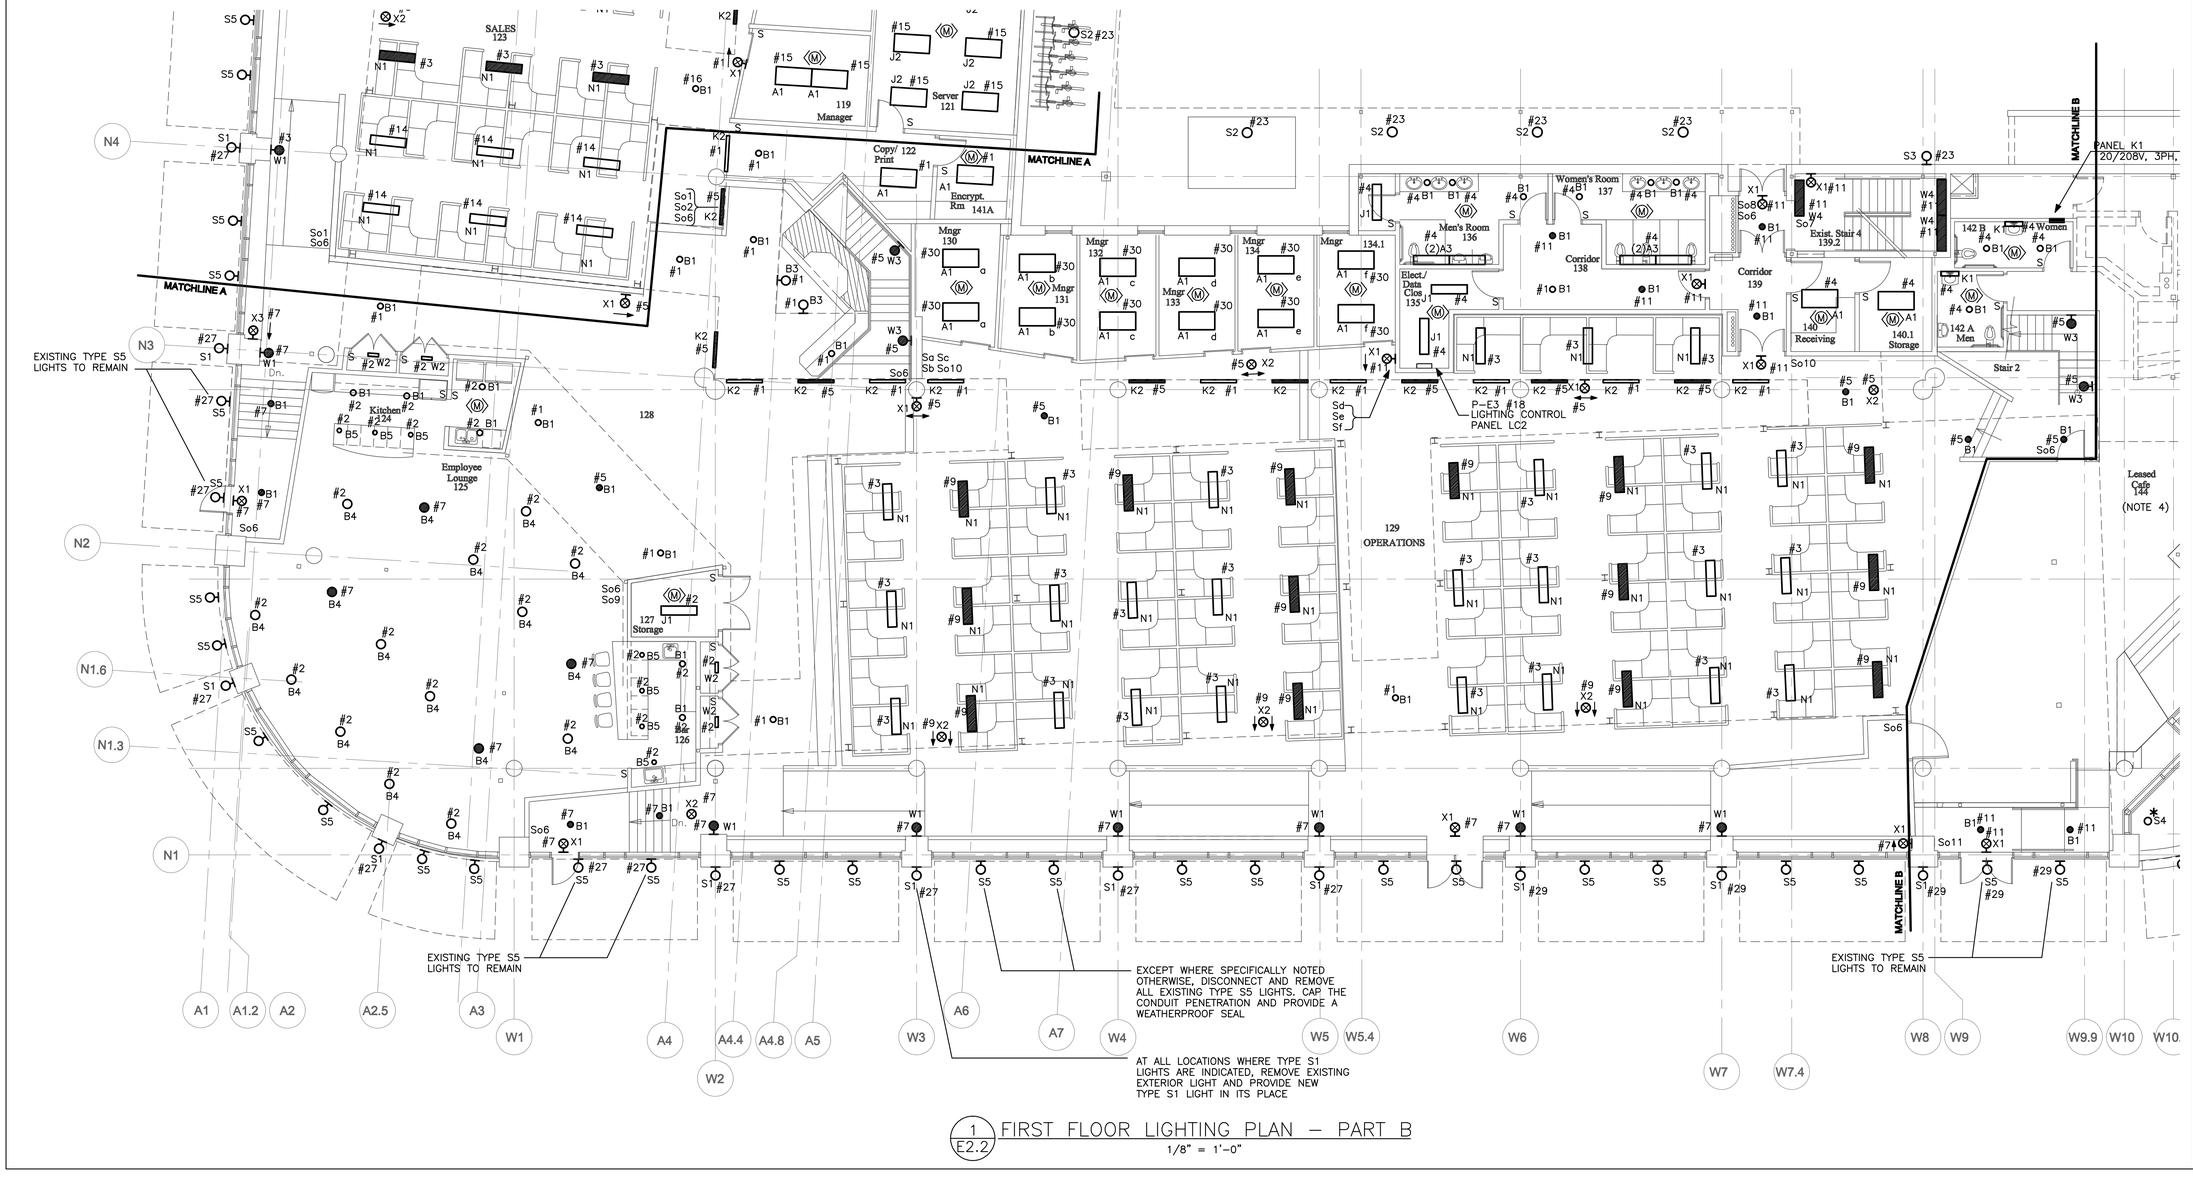

1 E2.2 FIRST FLOOR LIGHTING PLAN – PART B

1/8" = 1'-0"

STATE OF MAINE
LAWRENCE E. BARTLETT
No. 7928
LICENSED PROFESSIONAL ENGINEER

POWERPAY OFFICE FIT UP

Winton Scott Architects
5 Milk Street
Portland, ME 04101

Wright Ryan Construction, Inc.
10 Danforth Street
Portland, ME 04101

Becker Structural Engineers, Inc.
75 York Street
Portland, Maine 04101

Mechanical Systems Engineers
10 Royal River Center
Yarmouth, Maine 04096

Bartlett Design
942 Washington St.
Bath, Maine 04530

Fore Solutions
386 Fore Street
Portland, Maine 04101

FIRST FLOOR LIGHTING PLAN-PART B

E2.2

Includes all revisions and changed up to and including 10-28-09

Scale: 1/8" = 1'-0" | Date: 03-20-09