

KEYPLAN

NOTES:
1. INTERIOR LIGHTS WITH SHADED PATTERNS WILL BE CIRCUITED TO PANEL P-EL1. ALL OTHER INTERIOR LIGHTS IN AREA C SHALL BE CIRCUITED TO PANEL P3.
2. LIGHT SWITCHES INDICATED BY So15, So17, So18, & So19 SHALL BE LOW VOLTAGE CONTROL SWITCHES WIRED TO TO THE LIGHTING CONTROL PANEL LOCATED IN ELEC/DATA CLOSET 135.

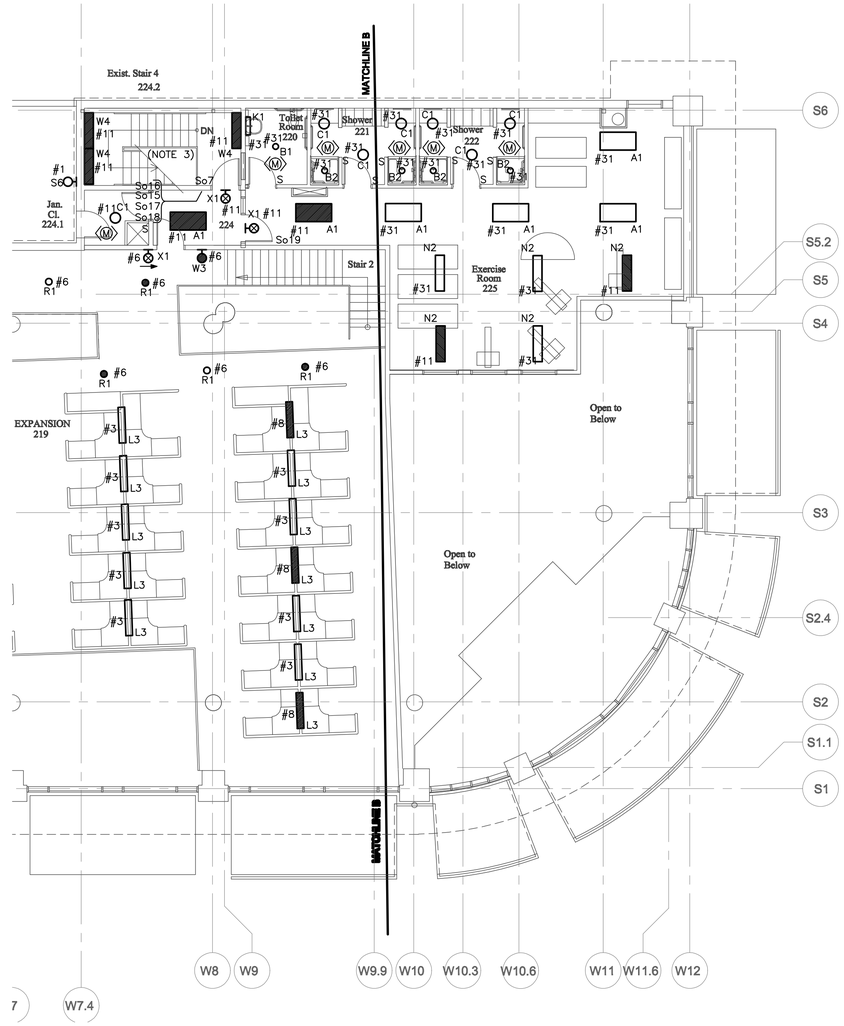

1 / E2.6 SECOND FLOOR LIGHTING PLAN – PART C
1/8" = 1'-0"

LAWRENCE E. BARTLETT No. 7928 LICENSED PROFESSIONAL ENGINEER STATE OF MAINE

POWERPAY OFFICE FIT UP

Winton Scott Architects
5 Milk Street
Portland, ME 04101

Wright Ryan Construction, Inc.
10 Danforth Street
Portland, ME 04101

Becker Structural Engineers, Inc.
75 York Street
Portland, Maine 04101

Mechanical Systems Engineers
10 Royal River Center
Yarmouth, Maine 04096

Bartlett Design
942 Washington St.
Bath, Maine 04530

Fore Solutions
386 Fore Street
Portland, Maine 04101

SECOND FLOOR LIGHTING PLAN-PART C

E2.6

Includes all revisions and changed up to and including 10-26-09

Scale: 1/8" = 1'-0" | Date: 03-20-09