


6/16/2015 2:44 PM I:\401-1100\401100 PORTLAND HIGH SCHOOL FIRE ALARM SYSTEM\2 DESIGN\DWG\PORTLAND SCHOOL EXISTING DRAWINGS\SHEETS\FA501 ELECTRICAL DETAILS.DWG KJLEA.HAR


N1	--	N5	--
NTS	--	NTS	--
J1	--	J5	--
NTS	--	NTS	--

FIRE ALARM SEQUENCE OF OPERATIONS		SYSTEM OUTPUTS												
SYSTEM INPUTS		ACTIVATE COMMON ALARM SIGNAL	IDENTIFY ALARM AT FIRE ALARM CONTROL PANEL	IDENTIFY ALARM AT FIRE ALARM ANNUNCIATOR	IDENTIFY INITIATION DEVICE IN ALARM AT FIRE ALARM CONTROL PANEL	IDENTIFY INITIATION DEVICE IN ALARM AT FIRE ALARM ANNUNCIATOR	TRANSMIT FIRE ALARM TO REMOTE ALARM RECEIVING STATION	RELEASE DOORS HELD OPEN BY MAGNETIC DOOR HOLDERS	ACTIVATE EMERGENCY SHUTOFF FOR GAS AND FUEL SUPPLIES	RECORD EVENTS IN FIRE ALARM CONTROL PANEL MEMORY	TRANSMIT SUPERVISORY SIGNAL TO REMOTE ALARM RECEIVING STATION	RECALL ASSOCIATED ELEVATOR TO DESIGNATED RECALL FLOOR (PRIMARY OR ALTERNATE)	SHUNT TRIP ASSOCIATED ELEVATOR (DISCONNECT ALL AC POWER)	SHUT DOWN ASSOCIATED EQUIPMENT
MANUAL FIRE ALARM PULL STATIONS		X	X	X	X	X	X	X	X	X				
HEAT DETECTORS - ELEVATOR MACHINE ROOMS		X	X	X	X	X	X	X	X	X			X	
HEAT DETECTORS (OTHER)		X	X	X	X	X	X	X	X	X				
SPOT SMOKE DETECTORS - ELEVATOR MACHINE ROOMS		X	X	X	X	X	X	X	X	X		X		
SPOT SMOKE DETECTORS @ MAGNETIC DOOR HOLDER(S)		X	X	X	X	X	X	X	X	X				
SPRINKLER WATERFLOW		X	X	X	X	X	X	X	X	X				
KITCHEN HOOD FIRE-EXTINGUISHING SYSTEM OPERATION		X	X	X	X	X	X	X	X	X				
SPRINKLER CONTROL VALVE					X	X					X	X		
ELEVATOR SHUNT TRIP					X	X					X	X		X
DISABLED DEVICE					X	X					X	X		
LOST COMMUNICATION WITH AUXILIARY PANEL					X	X					X	X		
DUCT SMOKE DETECTORS		X	X	X	X	X					X	X		X
OPEN CIRCUIT					X	X					X	X		
SHORT CIRCUIT					X	X					X	X		
GROUND FAULT					X	X					X	X		
LOST COMMUNICATION WITH PERIPHERAL DEVICE					X	X					X	X		
FIRE ALARM AC POWER FAILURE					X	X					X	X		
ABNORMAL AC VOLTAGE AT FIRE ALARM CONTROL PANEL					X	X					X	X		
FIRE ALARM SYSTEM LOW BATTERY					X	X					X	X		
ABNORMAL SWITCH POSITION AT FIRE ALARM CONTROL PANEL					X	X					X	X		
ABNORMAL SWITCH POSITION AT FIRE ALARM ANNUNCIATOR					X	X					X	X		
VOICE SIGNAL AMPLIFIER FAILURE					X	X					X	X		

J8 FIRE ALARM SEQUENCE FOR OPERATIONS

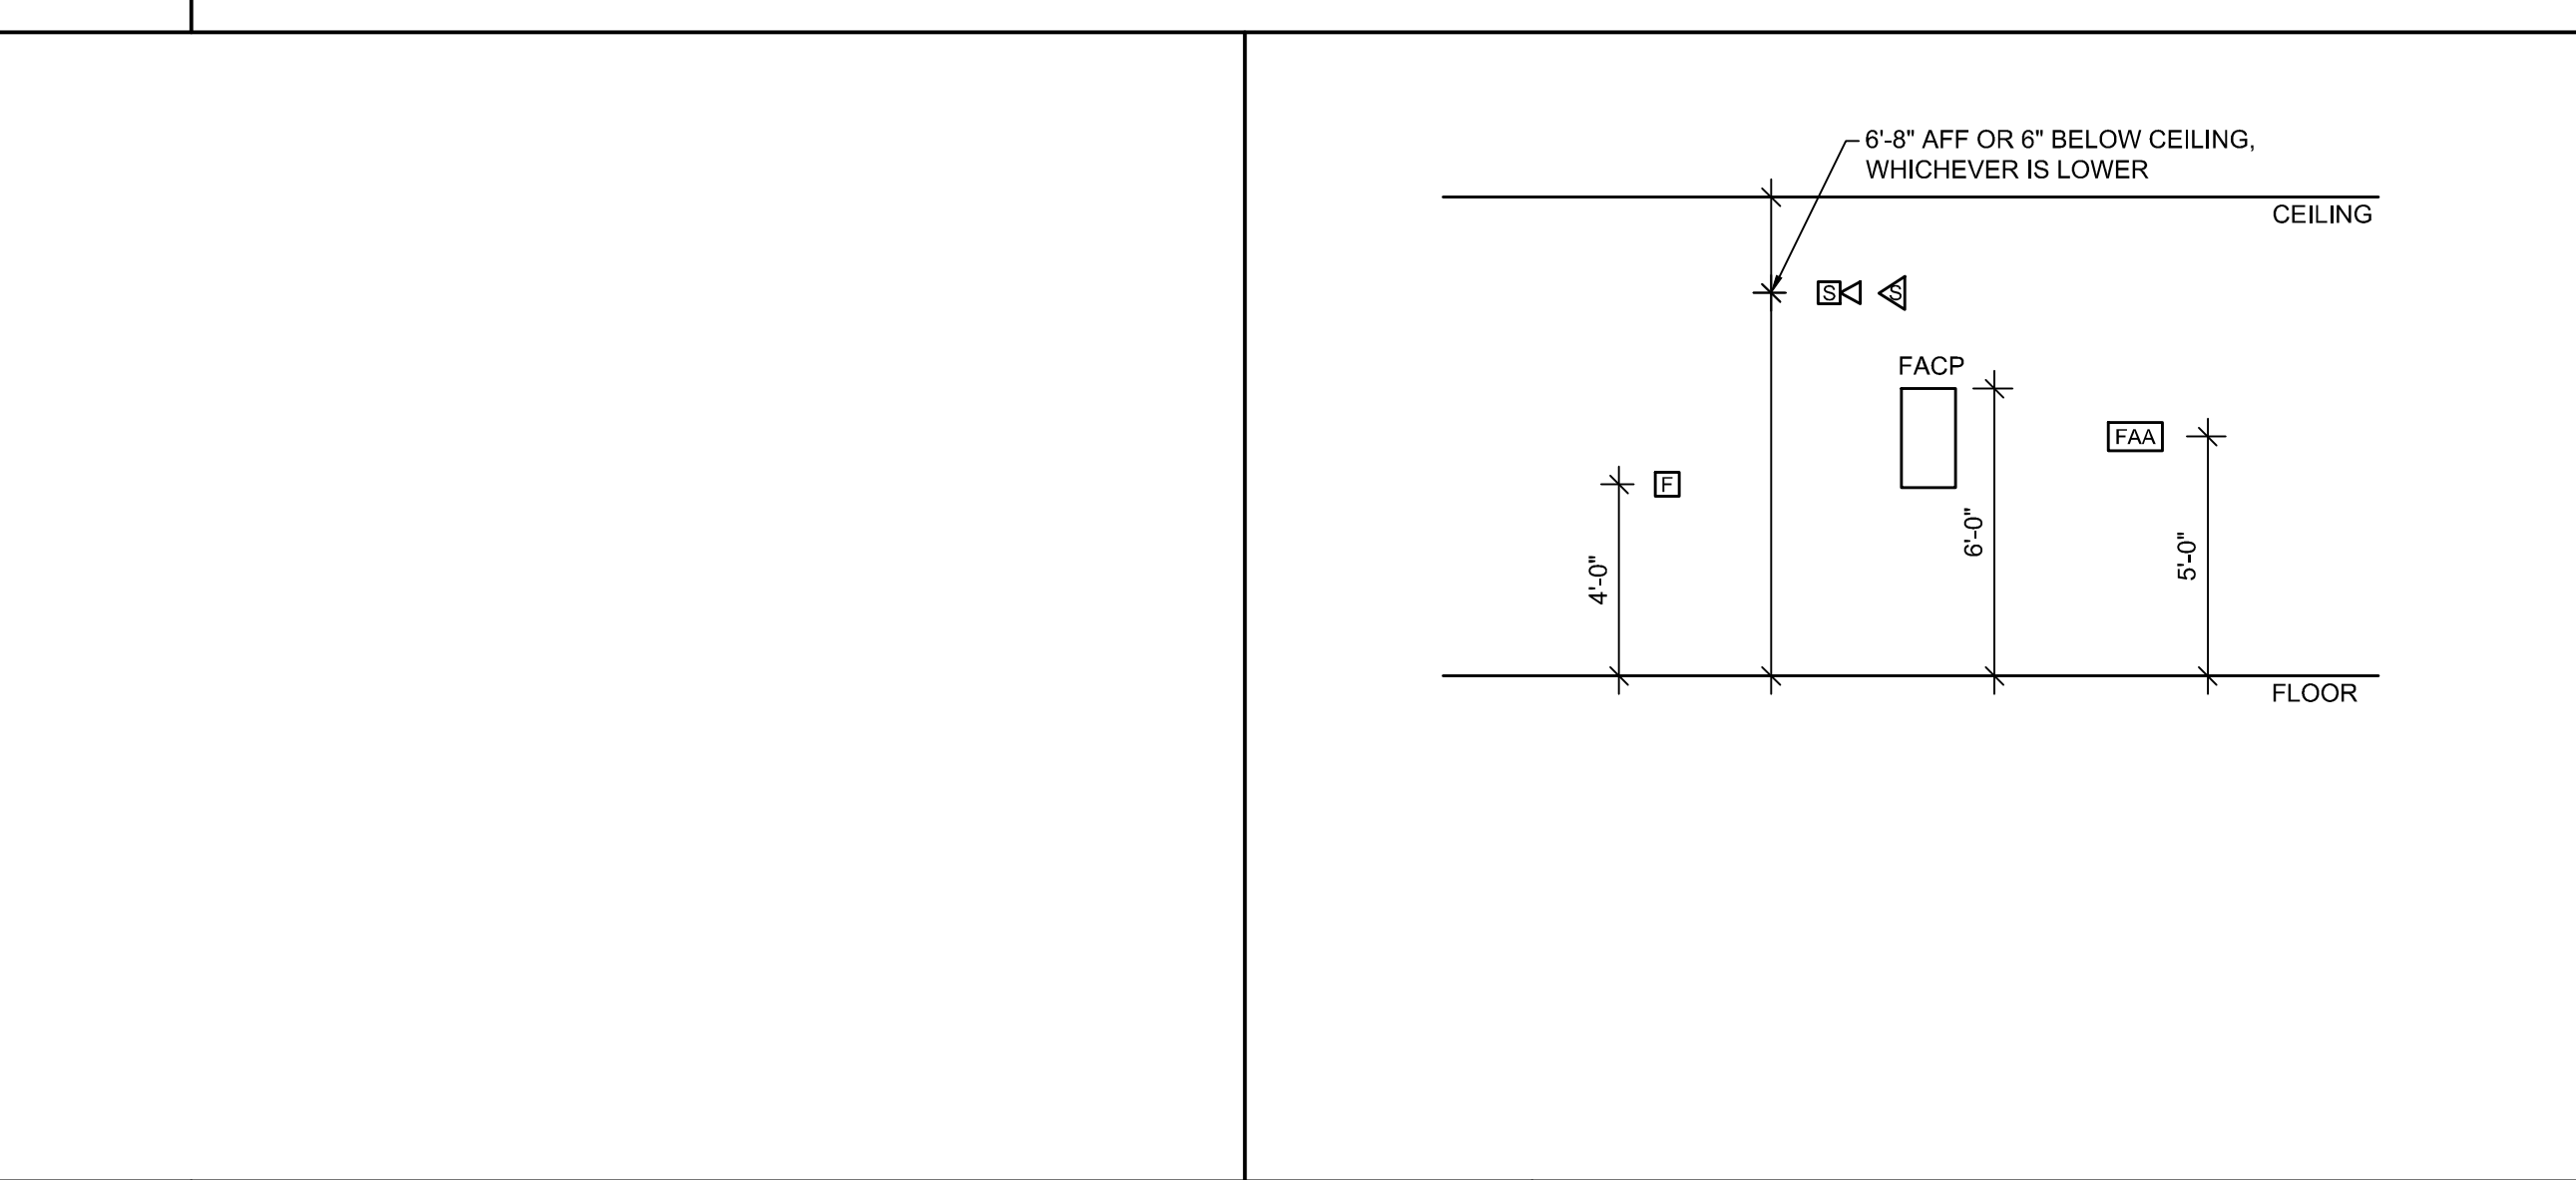


E12 MOUNTING HEIGHT DETAIL

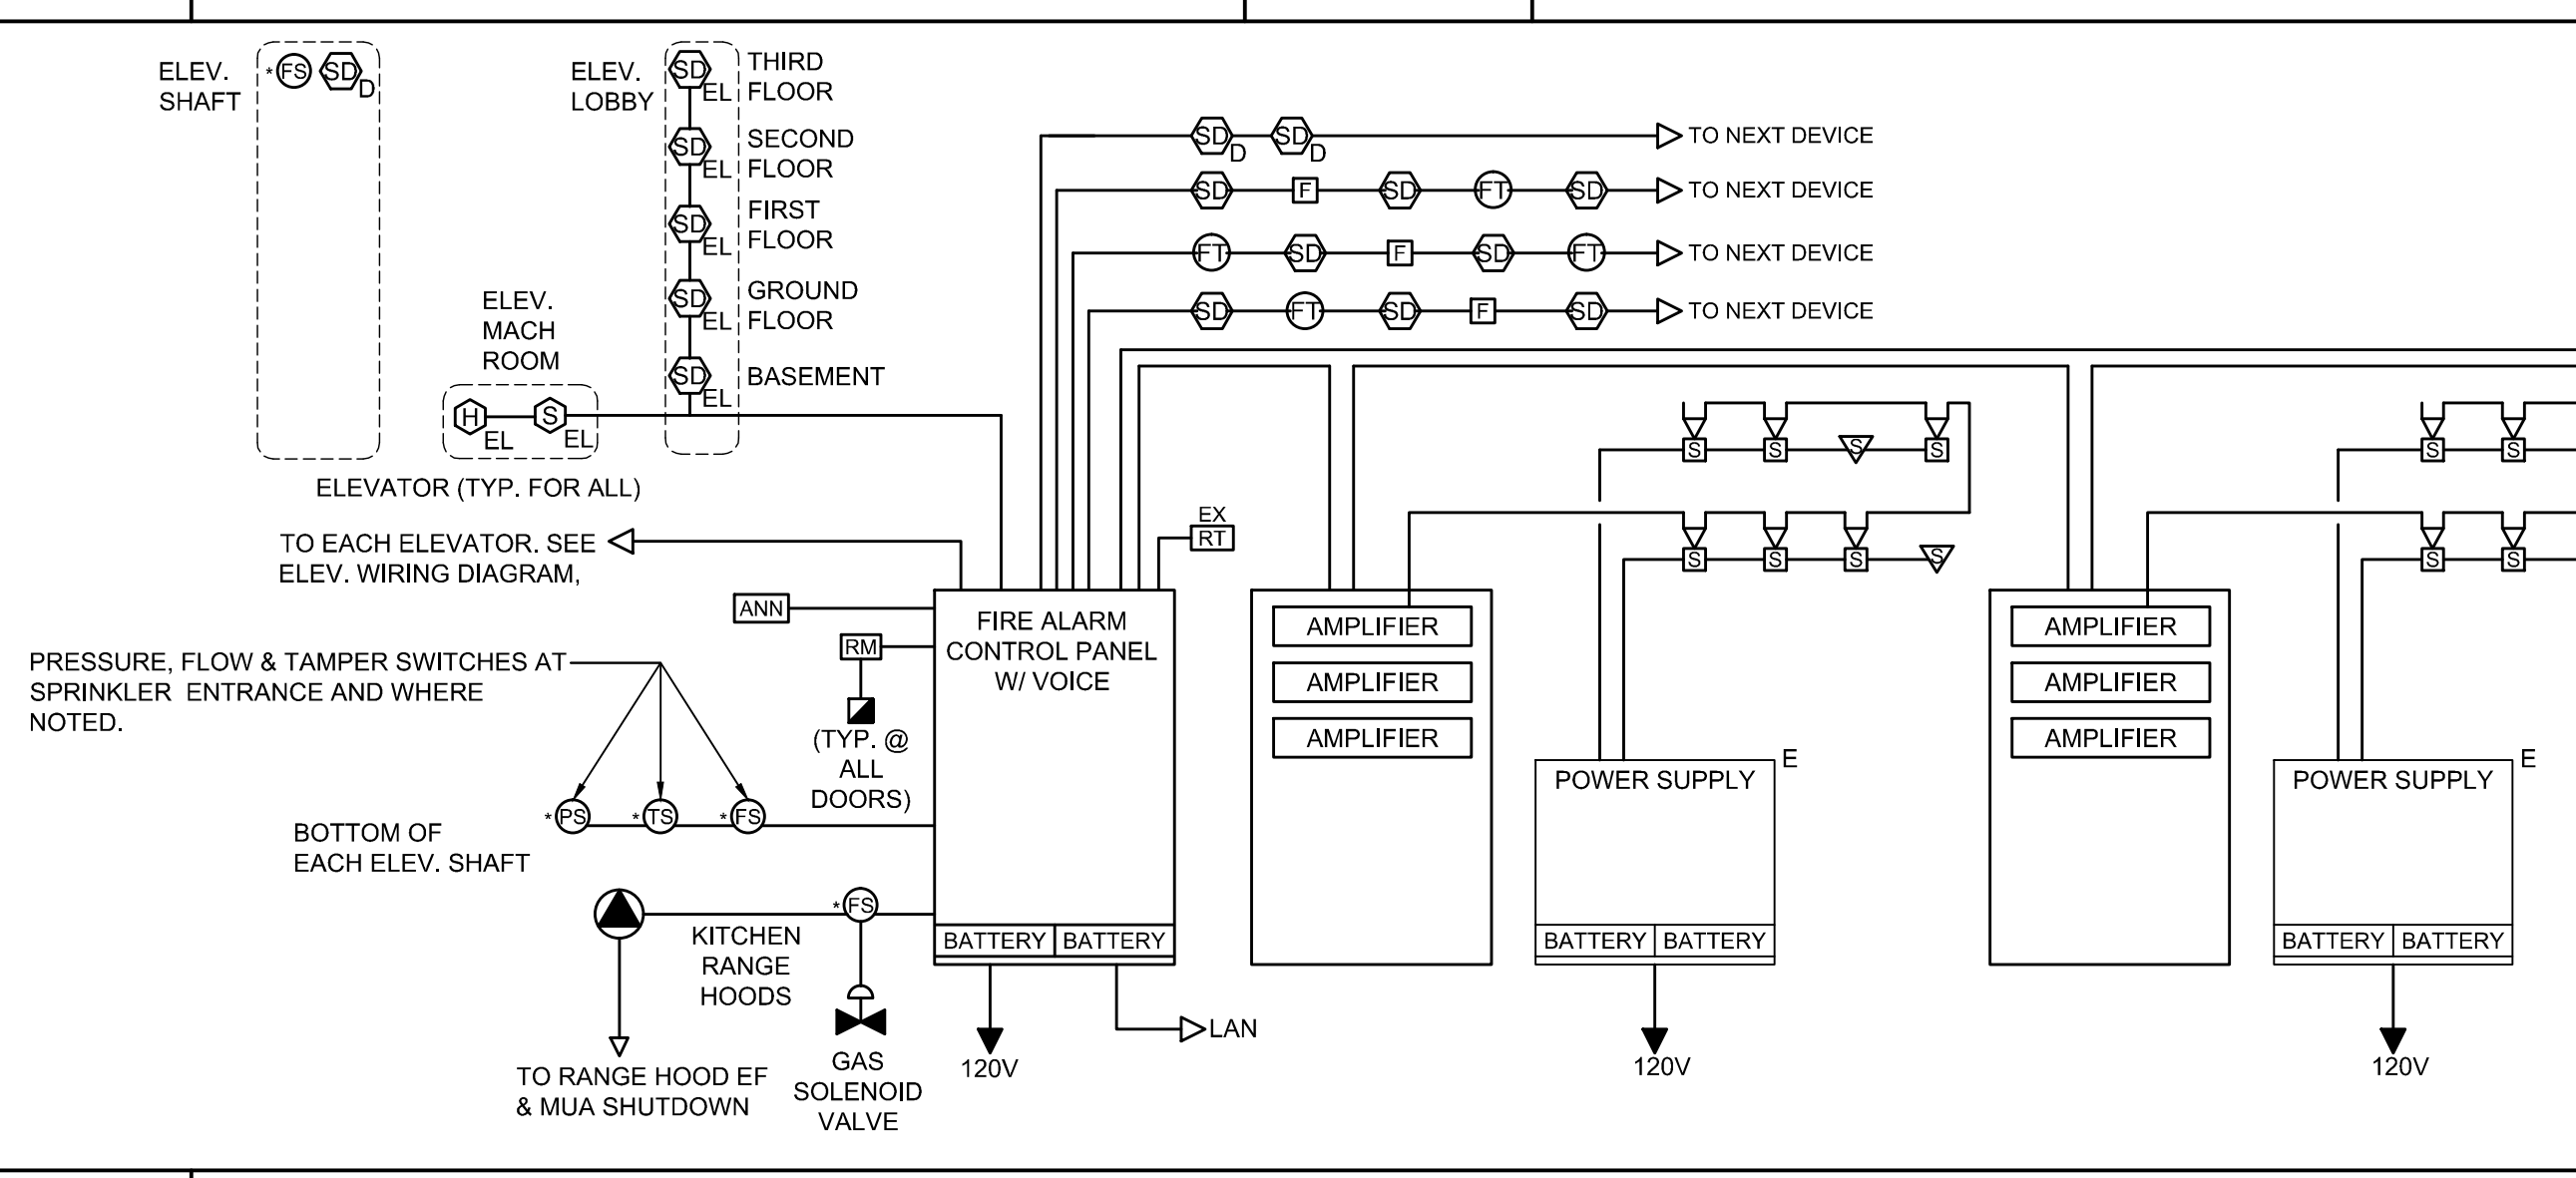


A8 FIRE ALARM RISER DIAGRAM

N15	--
NTS	--

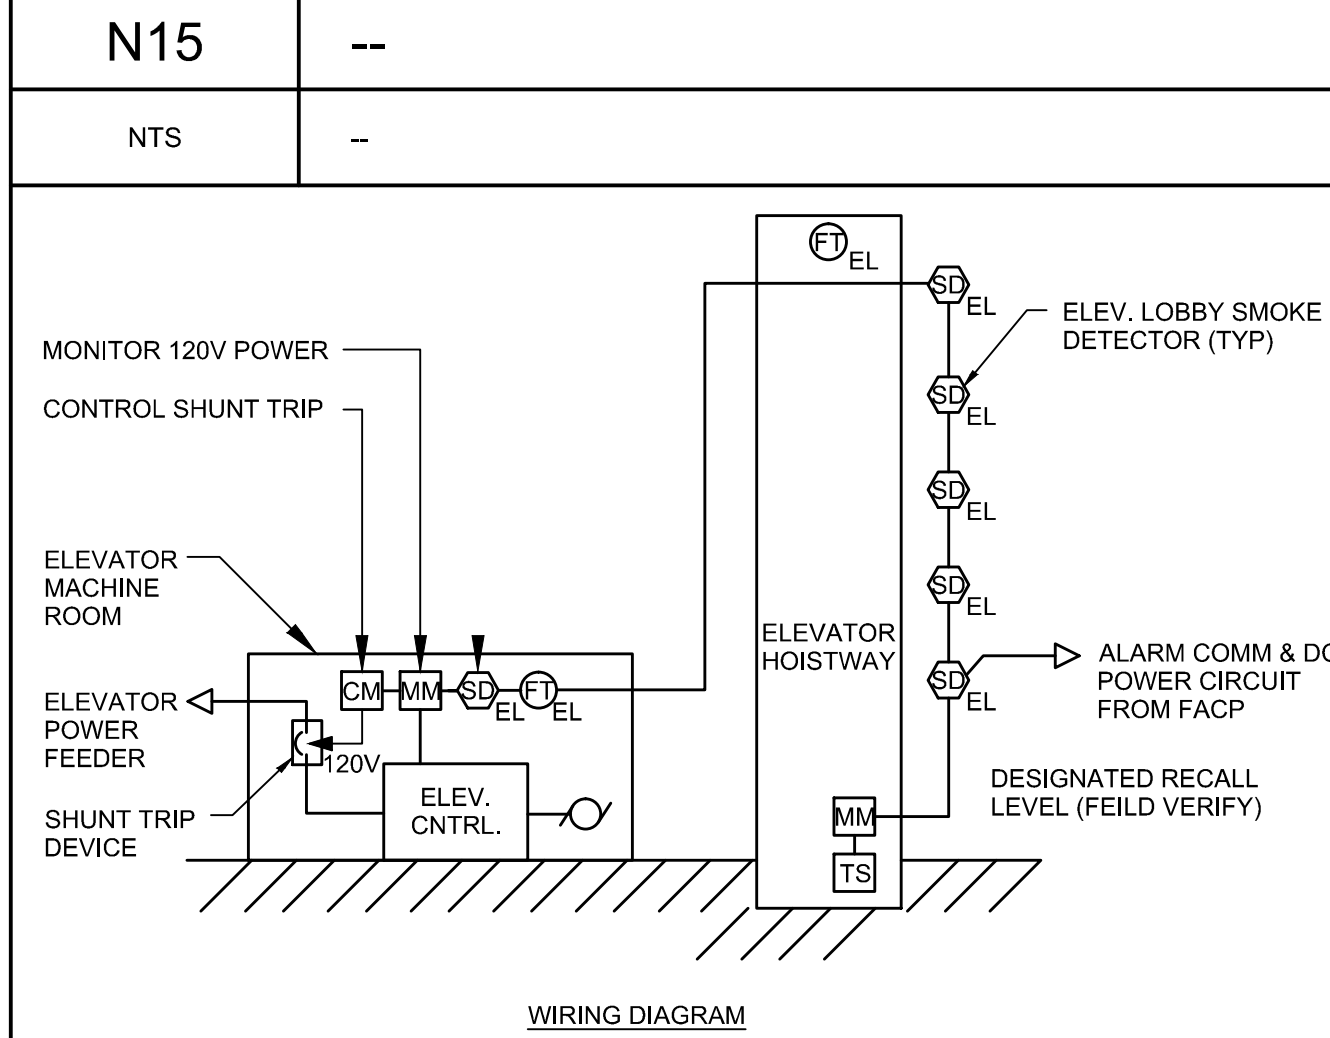

WIRING DIAGRAM

- NOTES:
1. MAINTAIN EXISTING SHUNT TRIP DEVICE.
 2. REFER TO NFPA 72-2013 SECTION 21.3 FOR SMOKE DETECTOR ELEVATOR CONTROL CIRCUIT REQUIREMENTS. ACTIVATION OF SMOKE DETECTORS TO CAUSE ELEVATOR CONTROL TO RECALL CAR TO DESIGNATED FLOOR AND OPEN DOORS.
 3. FIRE ALARM SYSTEM SHALL BE ADDRESSABLE TYPE. PROVIDE ANY NECESSARY INTERFACE RELAYS BETWEEN 120V AND FIRE ALARM COMPONENTS. LOBBY AND MACHINE DETECTORS MAY BE 4-WIRE TYPE HARDWIRED TO ELEV. CNTRL OR USE ADDRESSABLE CONTROL MODULES TO PROVIDE CONTROL OUTPUTS TO ELEVATOR MACHINE.
 4. HEAT DETECTOR ALARM TEMPERATURE TO BE MINIMUM 10°F LOWER THAN SPRINKLER HEAD, PER NFPA 72-2013. MOUNT HEAT DETECTOR WITHIN 2'-0" OF SPRINKLER HEAD.
 5. REFER TO NFPA 72-2013 SECTION 21.4 FOR ELEVATOR SHUTDOWN SEQUENCE. ACTIVATION OF ANY HEAT DETECTOR TO ACTIVATE SHUNT TRIP TO POWER DOWN ELEVATOR EQUIPMENT AND ELEVATOR BATTERY POWER, MONITOR 120V AND INITIATE FIRE ALARM TROUBLE IN EVENT OF LOSS OF SHUNT TRIP POWER.

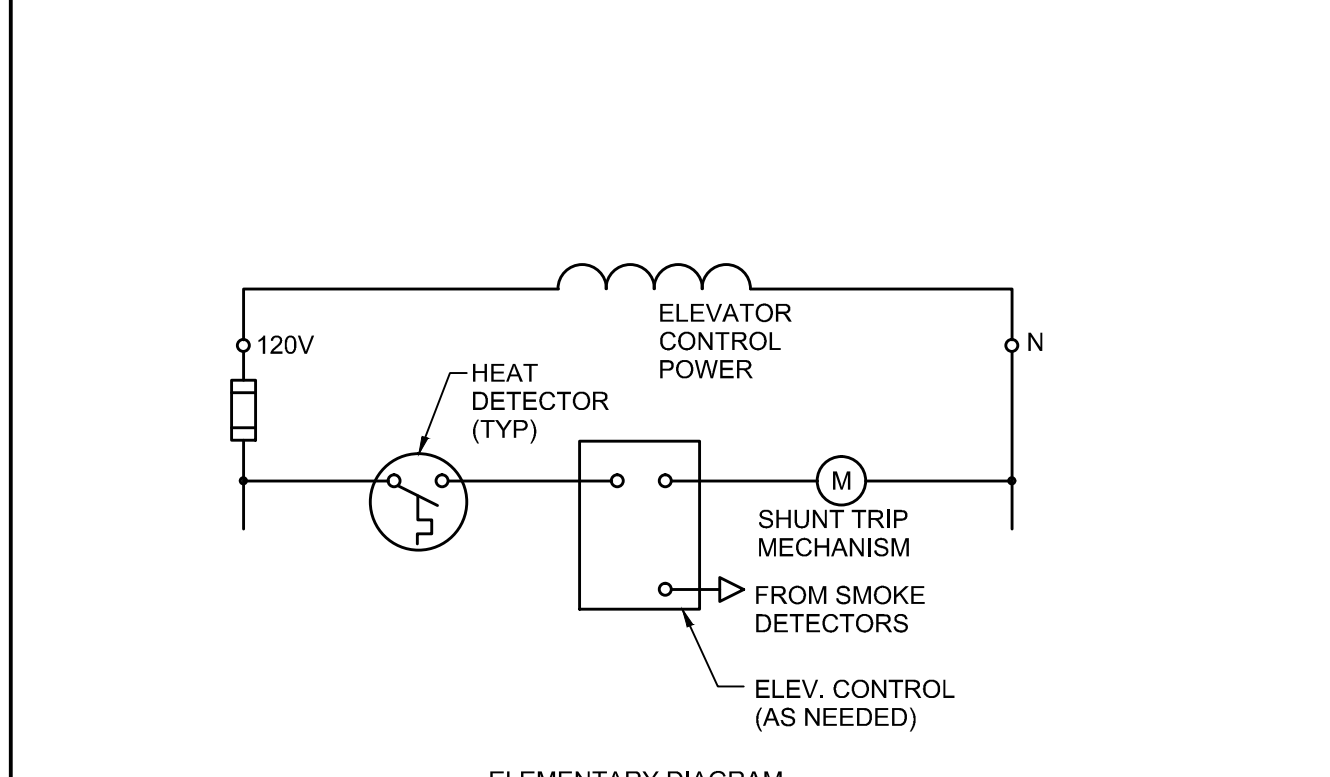

ELEMENTARY DIAGRAM


E15 ELEVATOR SHUNT TRIP WIRING DIAGRAM

E1	--	E5	--
NTS	--	NTS	--

- GENERAL PROJECT NOTES:**
1. ALL DEVICES SHALL BE NEW UNLESS OTHERWISE NOTED.
 2. ALL WORK SHALL BE INSTALLED IN A NEAT AND WORKMAN LIKE MANNER, RECTILINEAR TO BUILDING STRUCTURE, AND IN ACCORDANCE WITH ALL APPLICABLE CODES, INCLUDING, BUT NOT LIMITED TO NFPA 70, 72, 90A, AND DIRECTION OF AUTHORITY HAVING JURISDICTION.
 3. EXISTING AND NEW FIRE ALARM DEVICES ARE SHOWN IN THEIR APPROXIMATE LOCATION. CONTRACTOR SHALL REVIEW THE BUILDING, AND FIELD VERIFY, TO DETERMINE EXACT MOUNTING LOCATIONS FOR FIRE ALARM DEVICES AND EQUIPMENT. CARE SHALL BE TAKEN TO AVOID EXISTING ELECTRICAL, MECHANICAL, SPRINKLER AND OTHER CEILING AND WALL MOUNTED DEVICES AND EQUIPMENT.
 4. ALL PENETRATION THROUGH FLOORS, RATED WALLS AND PARTITIONS SHALL BE SEALED WITH A U.L. LISTED AND APPROVED FIRE SEALANT MATERIAL TO MAINTAIN THE RATING OF THE SEPARATION.

0	ISSUED FOR BID	06.12.15
REV.	DESCRIPTION	DATE

ISSUED FOR BID
06.12.15

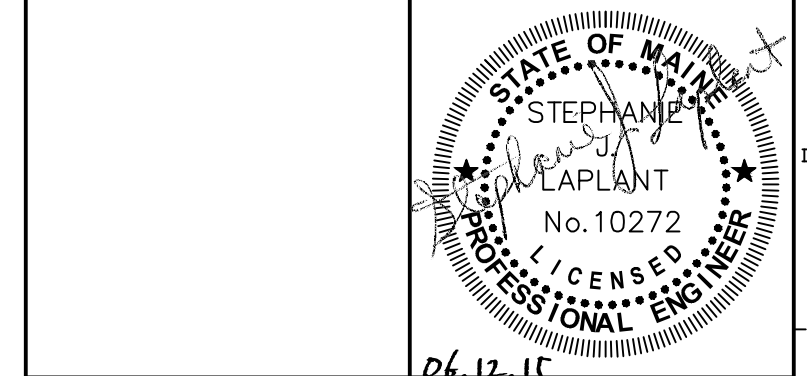

WBRC
ARCHITECTS • ENGINEERS
WWW.WBRC.AE.COM
BANGOR, MAINE 207-647-4511
PORTLAND, MAINE 207-239-4511
SUWANEE, FLORIDA 941-556-0073

**PORTLAND HIGH SCHOOL
FIRE ALARM UPGRADES**

PROJECT: PORTLAND, ME
ELECTRICAL DETAILS

SHEET TITLE:	404100 - FA501
WBRC CAD FILE:	404100 GRAPHIC SCALE: 0"
PROJECT No.:	AS NOTED
SCALE:	AS NOTED
PROJECT MANAGER:	SJL SHEET No. FA501
DRAWN BY:	KRM
CHECKED BY:	SJL