


5/4/2016 1:08 PM 11:02 PROJECTS - WAREHOUSE - 1100 N. 1000 - PORTLAND HIGH SCHOOL - FIRE ALARM SYSTEM - 3. DECORATIVE SHEETS - FLOOR BACKGROUND - KYLE MANN

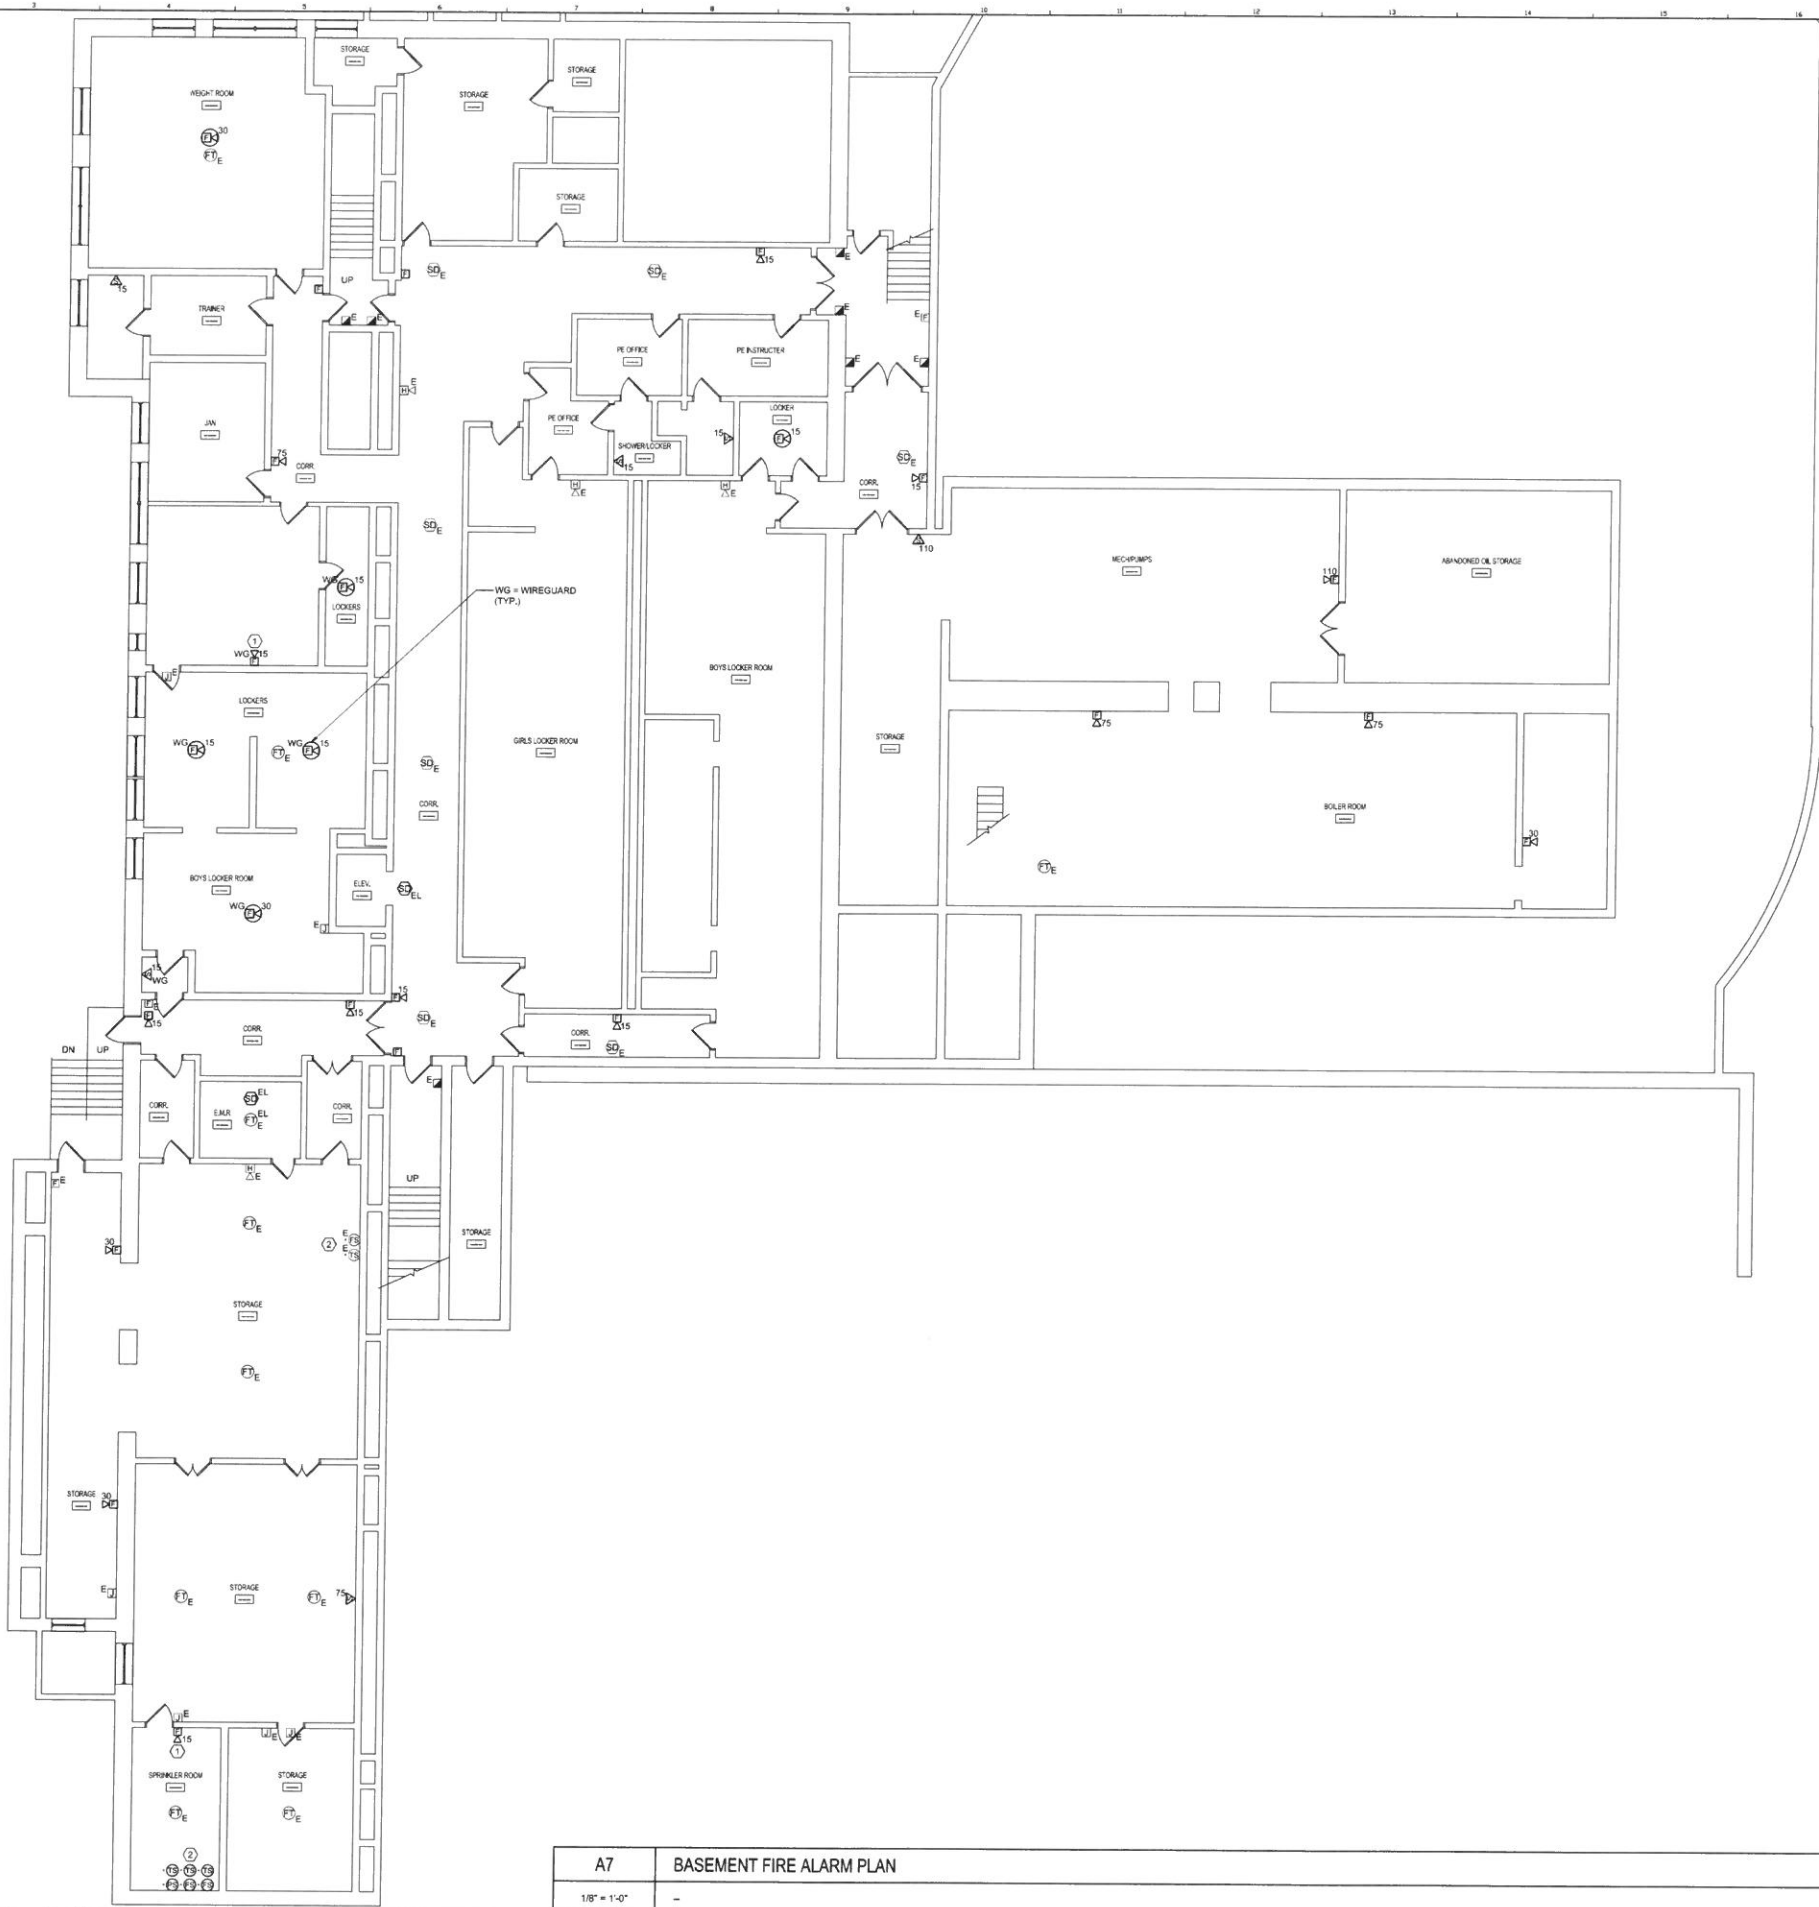


**GENERAL NOTES:**

- TO THE EXTENT POSSIBLE, INSTALL FIRE ALARM CABLES IN SPECIFIED UNENCLOSED WIRING METHOD ABOVE ACCESSIBLE CEILING.

**TECHNICAL NOTES:**


- UTILIZE EXISTING JUNCTION BOX AT THIS LOCATION FOR NEW FIA DEVICE.
- MAINTAIN EXISTING SPRINKLER FLOW, TAMPER AND/OR PRESSURE SWITCHES WITHIN THIS SPACE. INSTALL MONITOR MODULES AS REQUIRED TO CONNECT TO FIRE ALARM SYSTEM ADDRESSABLE LOOP.



- KEY PLAN:**
- LEGEND:**
- E EXISTING TO REMAIN
  - ER EXISTING RELOCATED
  - NR NEW TO REPLACE EXISTING IN EXISTING LOCATION
  - RR EXISTING TO BE REMOVED
  - RRR REMOVE & RELOCATE EXISTING
  - ☐ FIRE ALARM HORN / LIGHT
  - ☐ MULTI-CANDELA STROBE
  - ☐ MULTI-CANDELA HORN/STROBE
  - ☐ CEILING MOUNTED MULTI-CANDELA HORN/STROBE
  - ☐ FIRE ALARM SYSTEM CEILING MOUNTED HEAT DETECTOR - 'EL' FOR ELEVATOR SHUNT TRIP
  - ☐ FIRE ALARM SYSTEM CEILING MOUNTED SMOKE DETECTOR - 'EL' FOR ELEVATOR RECALL
  - ☐ WALL MOUNTED FIRE ALARM SYSTEM MANUAL PULL STATION
  - ☐ KNOX BOX
  - ☐ JUNCTION BOX
  - ☐ DOOR HOLD-OPEN DEVICE CONNECTION
  - ☐ FIRE ALARM SYSTEM/SPRINKLER SYSTEM PRESSURE SWITCH
  - ☐ FIRE ALARM SYSTEM/SPRINKLER SYSTEM FLOW SWITCH
  - ☐ FIRE ALARM SYSTEM/SPRINKLER SYSTEM TAMPER SWITCH
  - ☐ FIRE ALARM SYSTEM DUCT MOUNTED SMOKE DETECTOR
  - ☐ FIRE ALARM SYSTEM CONTROL PANEL
  - ☐ FIRE ALARM ANNUNCIATOR
  - ☐ GAS SHUT-OFF
  - ☐ RADIO TRANSMITTER BOX
  - ☐ MONITOR MODULE
  - ☐ TEST STATION
  - ☐ RELAY MODULE
  - ☐ ANSUL GAS TANK
  - ☐ FIRE ALARM AMPLIFIER

---	---	---
---	---	---
---	---	---
0	ISSUED FOR BID	05.04.16
REV.	DESCRIPTION	DATE

ISSUED FOR BID  
05.04.16



**WBRC**  
ARCHITECTS • ENGINEERS  
WWW.WBRC-ENG.COM  
BANGOR, MAINE 05401-4511  
PORTLAND, MAINE 04106-3461  
SARASOTA, FL ORLA 34413-6671

PORTLAND HIGH SCHOOL  
FIRE ALARM UPGRADES - PHASE 1  
PROJECT: PORTLAND, ME  
BASEMENT FIRE ALARM PLAN

SHEET TITLE:	404100 - FA100
PROJECT NO.:	404100
SCALE:	AS NOTED
PROJECT MANAGER:	SUL
DRAWN BY:	KRM
CHECKED BY:	SUL
SHEET NO.:	FA100

**A7** BASEMENT FIRE ALARM PLAN  
1/8" = 1'-0"