



**THIRD FLOOR LANDING**  
 SCALE 1/4"=1'-0"  
 NOTES:  
 1. ALL NEW STEEL SHALL HAVE (1) COAT OF PRIMER AND (2) COATS BLACK ENAMEL -TYP UNO  
 2. CONTRACTOR SHALL REVIEW STEEL SHOP DRAWINGS PRIOR TO FABRICATION.  
 3. ALL BAR GRATE TO BE WELDED TO SUPPORTS @ 6" MAX -TYP  
 4. ALL EPOXY SHALL BE SIMPSON AT OR EQUAL -TYP  
 5. VERIFY ALL FIELD CONDITIONS PRIOR TO FABRICATION OR ERECTION -TYP

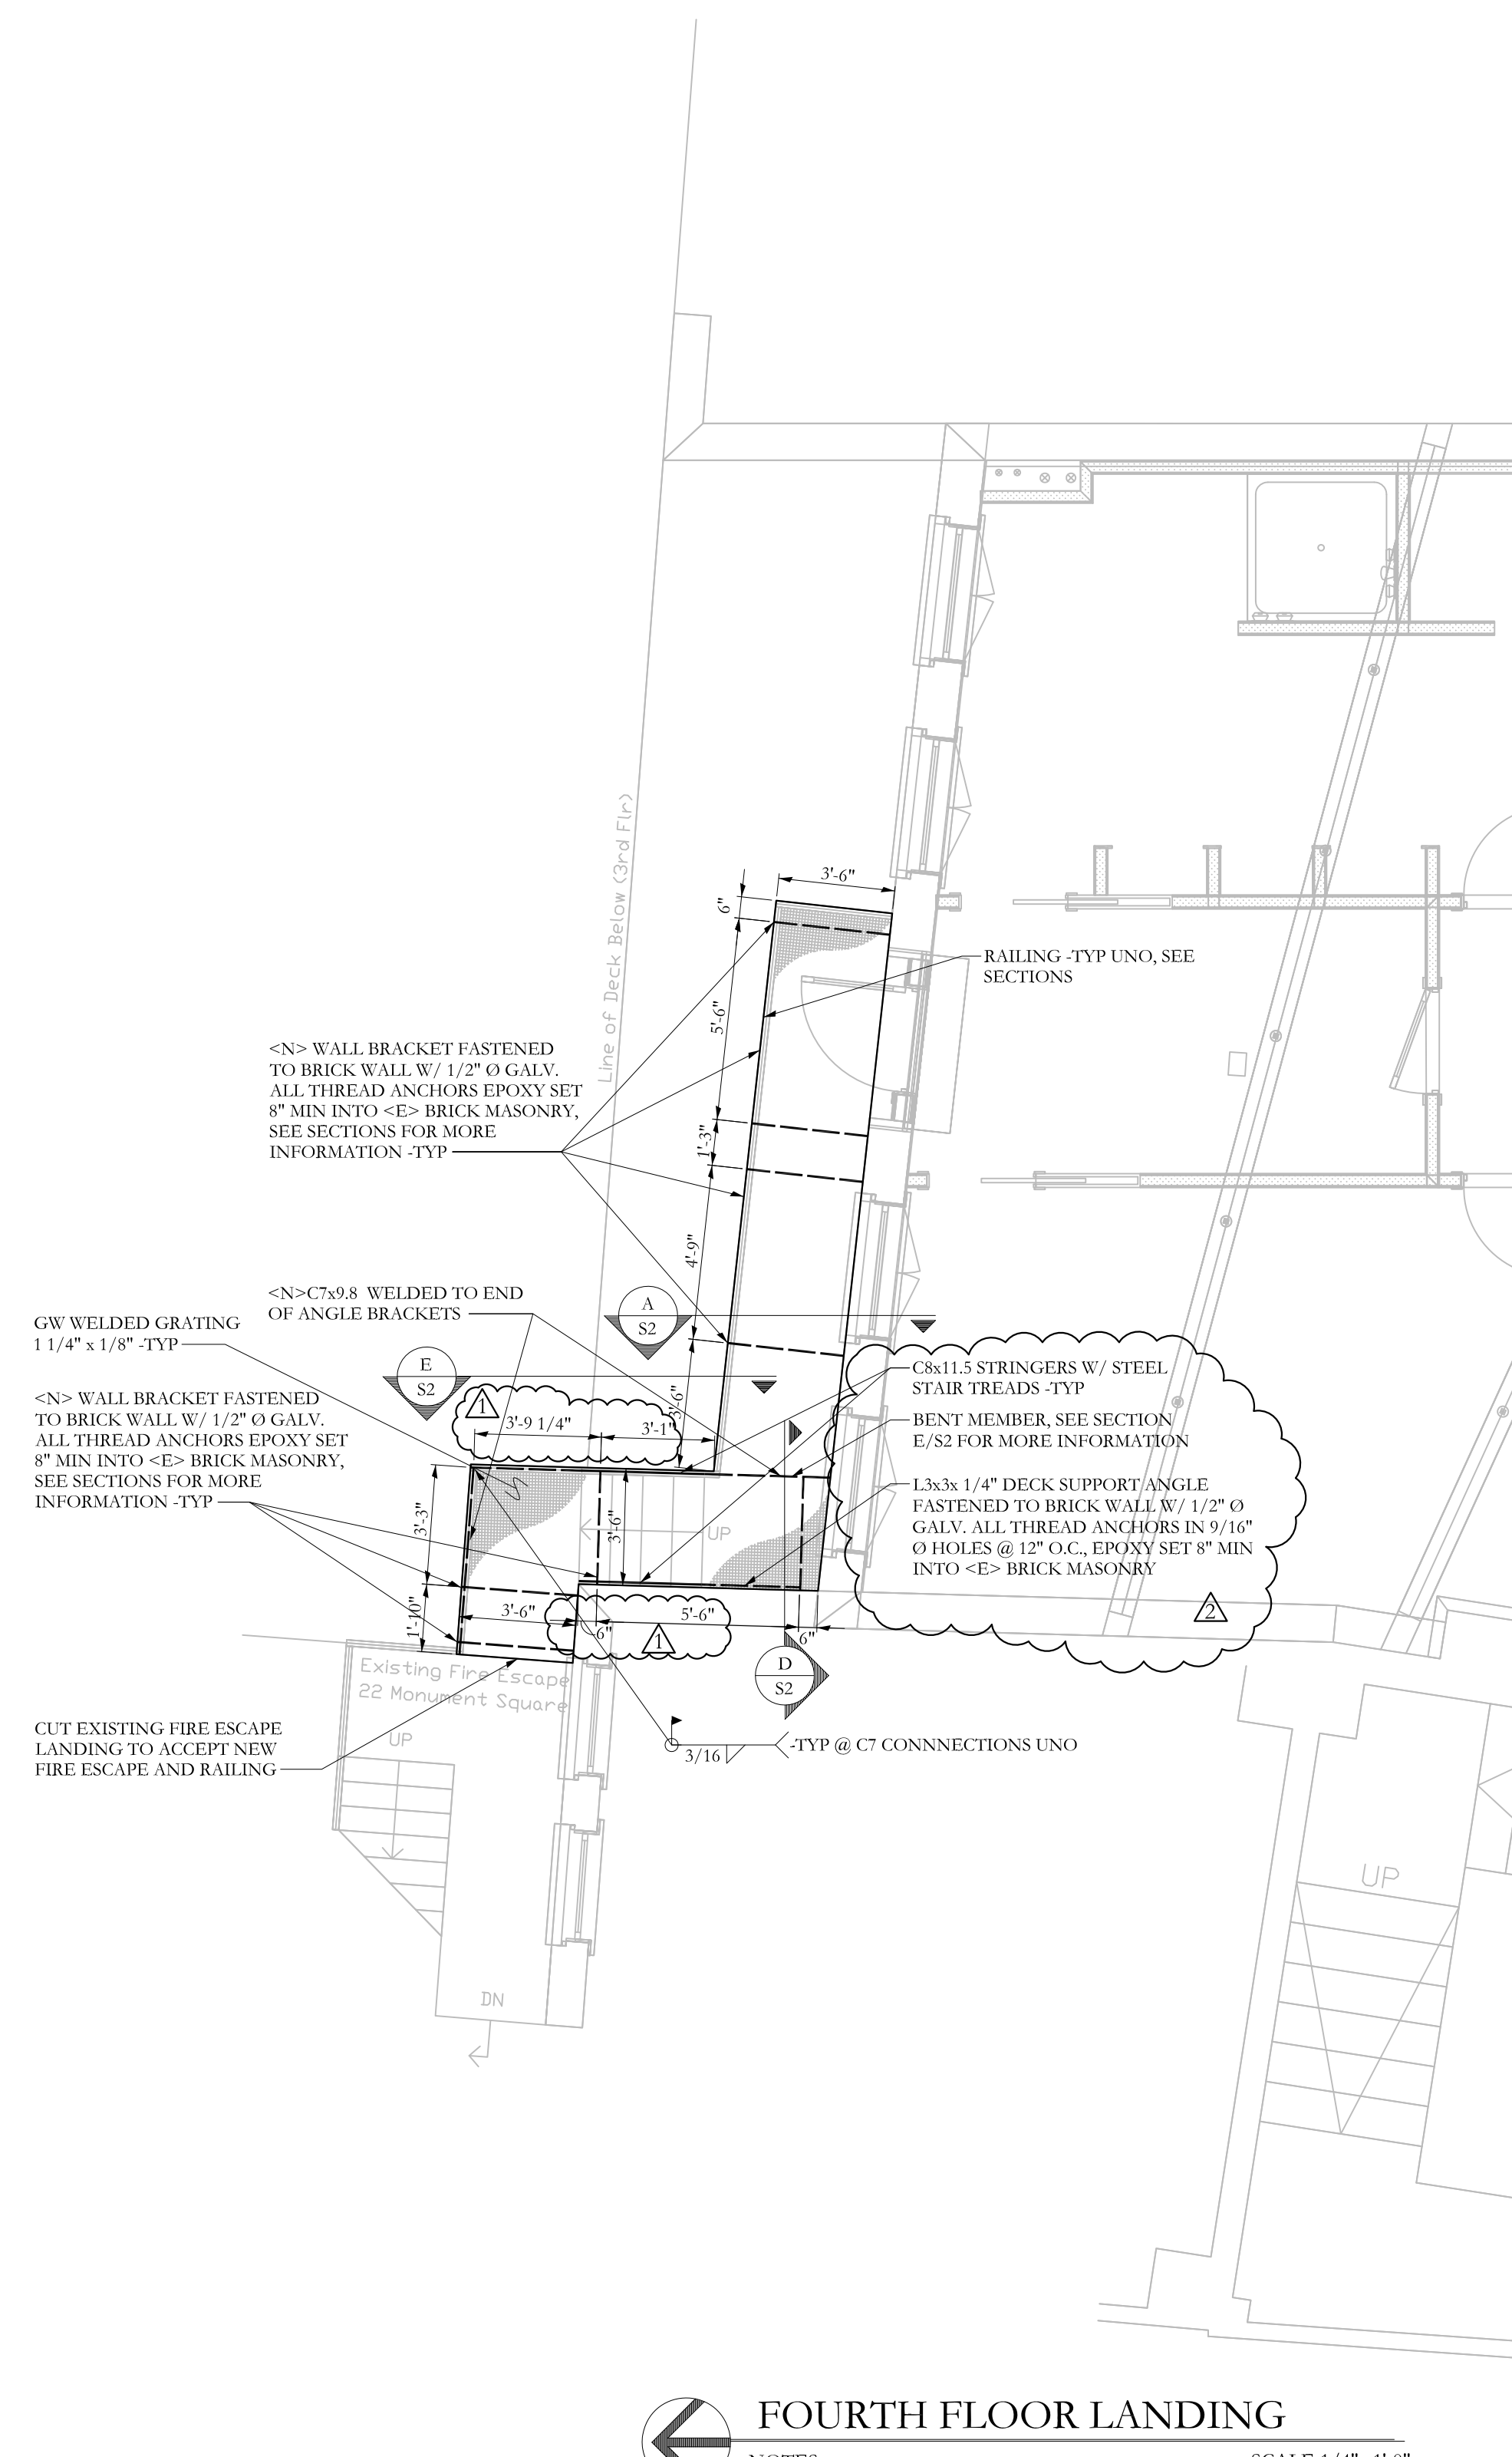

**FOURTH FLOOR LANDING**  
 SCALE 1/4"=1'-0"  
 NOTES:  
 1. ALL NEW STEEL SHALL HAVE (1) COAT OF PRIMER AND (2) COATS BLACK ENAMEL -TYP UNO  
 2. CONTRACTOR SHALL REVIEW STEEL SHOP DRAWINGS PRIOR TO FABRICATION.  
 3. ALL BAR GRATE TO BE WELDED TO SUPPORTS @ 6" MAX -TYP  
 4. ALL EPOXY SHALL BE SIMPSON AT OR EQUAL -TYP  
 5. VERIFY ALL FIELD CONDITIONS PRIOR TO FABRICATION OR ERECTION -TYP

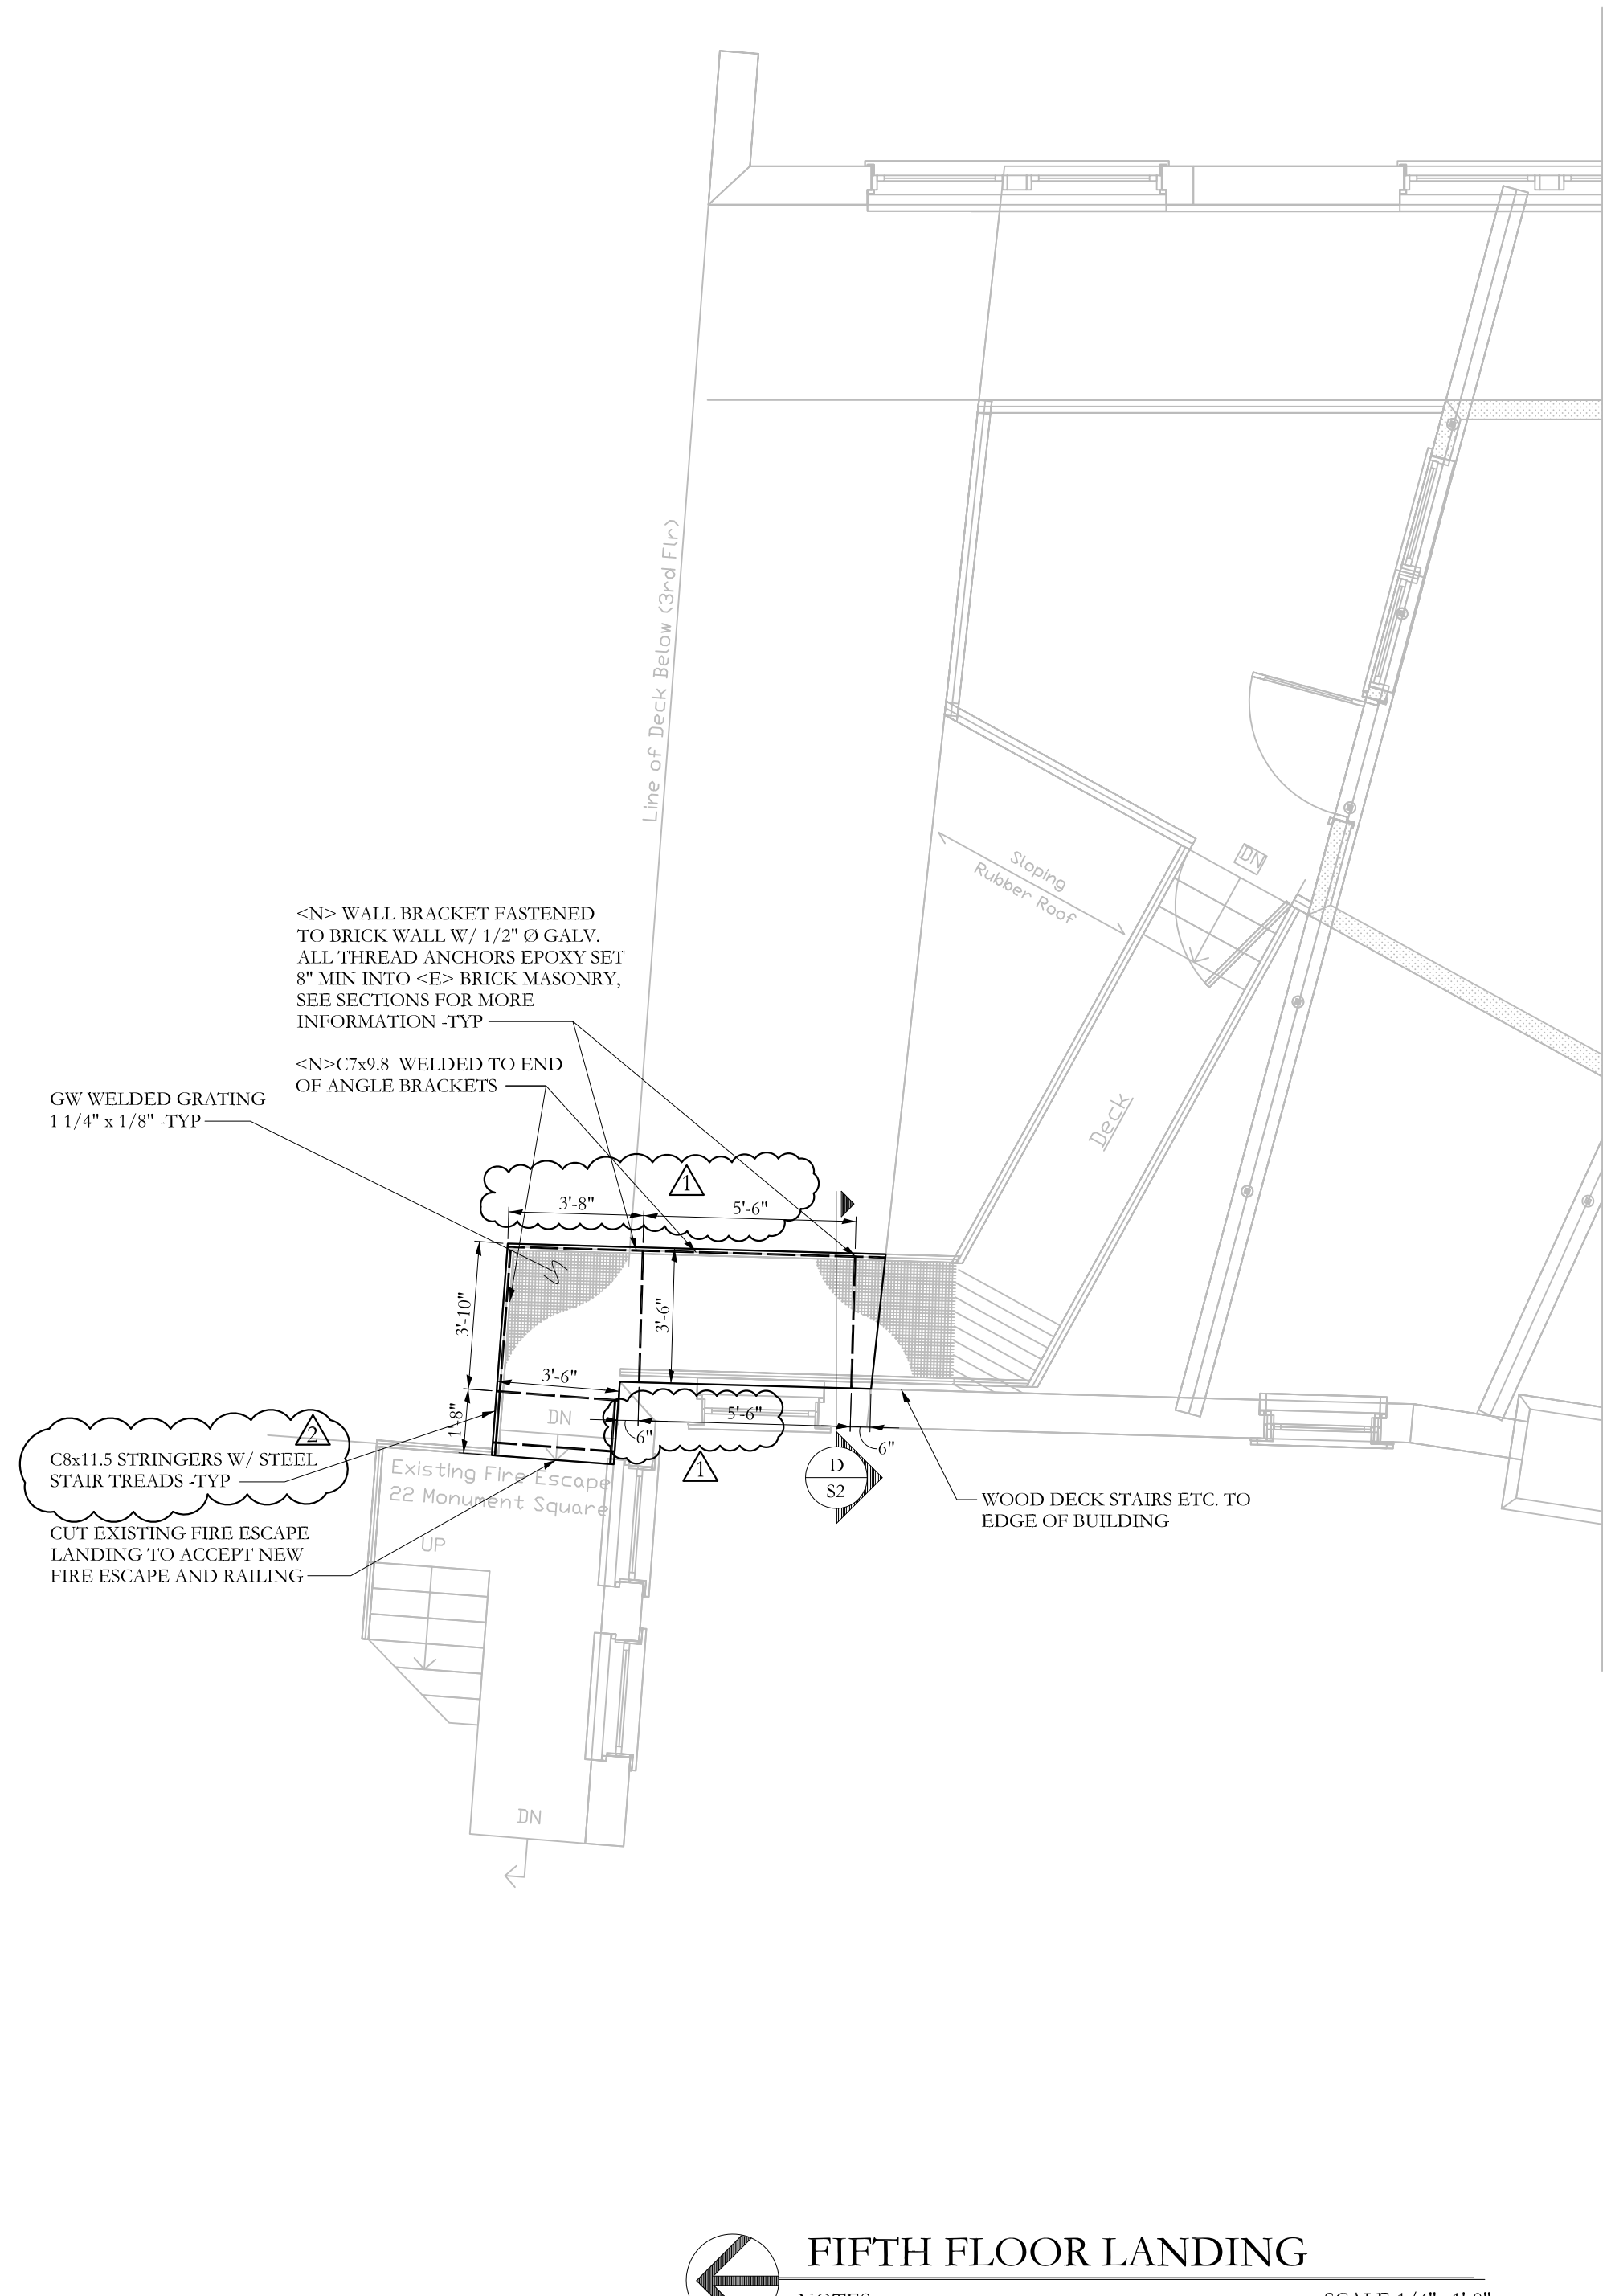

**FIFTH FLOOR LANDING**  
 SCALE 1/4"=1'-0"  
 NOTES:  
 1. ALL NEW STEEL SHALL HAVE (1) COAT OF PRIMER AND (2) COATS BLACK ENAMEL -TYP UNO  
 2. CONTRACTOR SHALL REVIEW STEEL SHOP DRAWINGS PRIOR TO FABRICATION.  
 3. ALL BAR GRATE TO BE WELDED TO SUPPORTS @ 6" MAX -TYP  
 4. ALL EPOXY SHALL BE SIMPSON AT OR EQUAL -TYP  
 5. VERIFY ALL FIELD CONDITIONS PRIOR TO FABRICATION OR ERECTION -TYP

