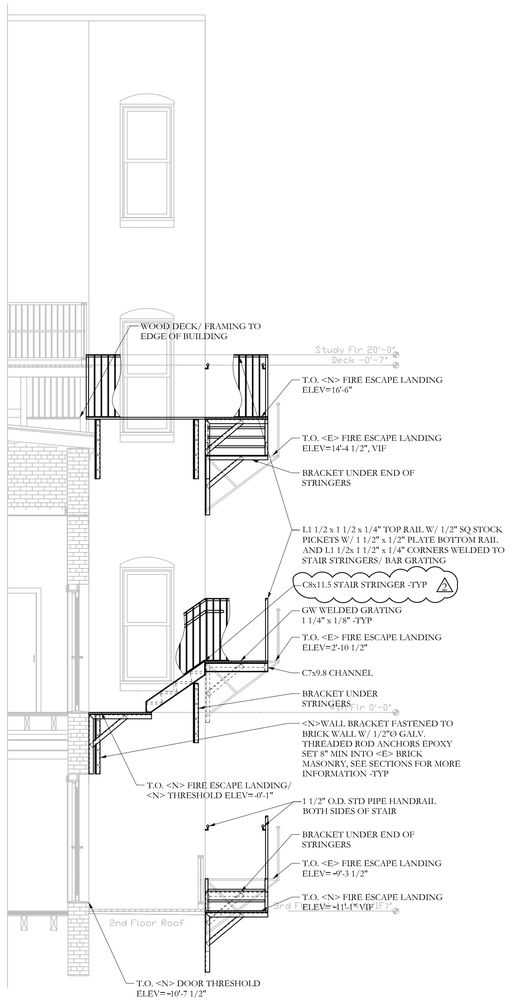

ELEVATION

SCALE 1/4"=1'-0"

NOTES:

1. ALL NEW STEEL SHALL HAVE (1) COAT OF PRIMER AND (2) COATS BLACK ENAMEL -TYP UNO
2. CONTRACTOR SHALL REVIEW STEEL SHOP DRAWINGS PRIOR TO FABRICATION.
3. ALL BAR GRATE TO BE WELDED TO SUPPORTS @ 6" MAX -TYP
4. ALL EPOXY SHALL BE SIMPSON AT OR EQUAL -TYP
5. VERIFY ALL FIELD CONDITIONS PRIOR TO FABRICATION OR ERECTION -TYP

NOTE: ALL EPOXT SET ANCHORS SHALL HAVE HOLES DRILLED WITH ROTARY HAMMERS, NOT HAMMER DRILLS. SCREEN TUBES SHOULD BE USED IF VOIDS ARE FOUND IN MASONRY. REPAIR ALL LOOSE BRICK WORK WITHIN 16" OF ANY ANCHOR.

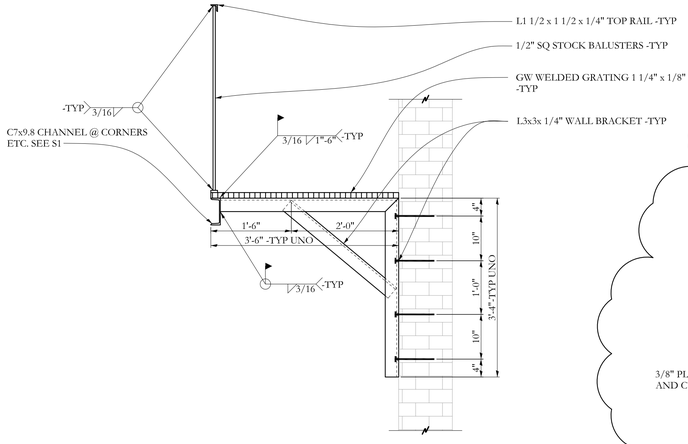

SECTION D/S2 3/4"=1'-0

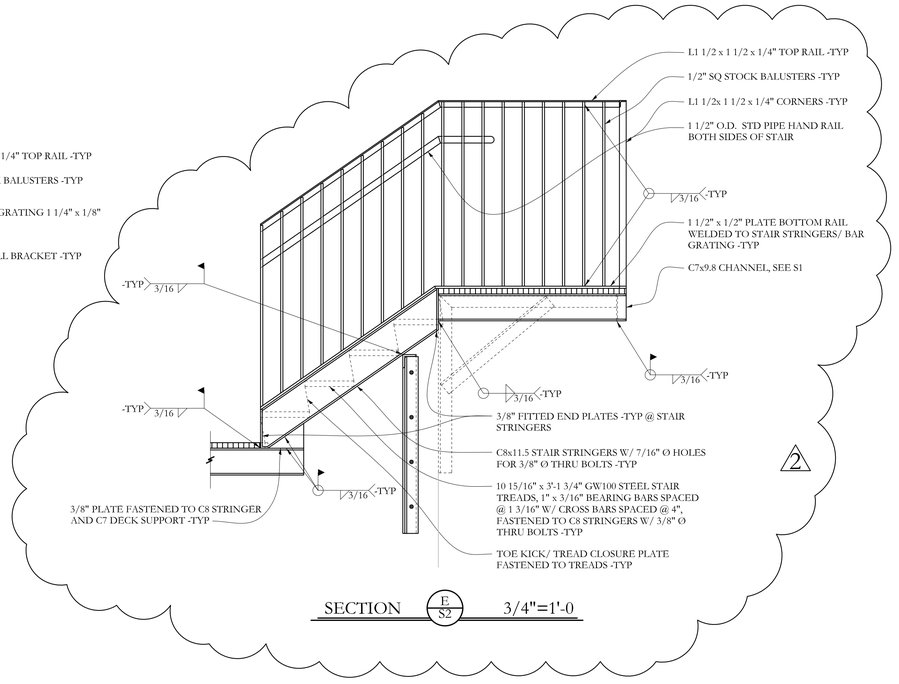

SECTION E/S2 3/4"=1'-0

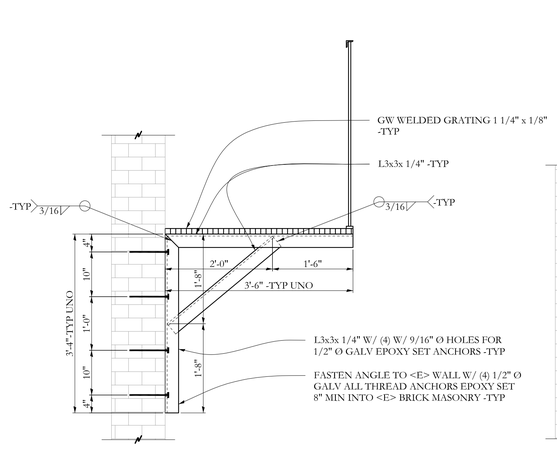

SECTION A/S2 3/4"=1'-0

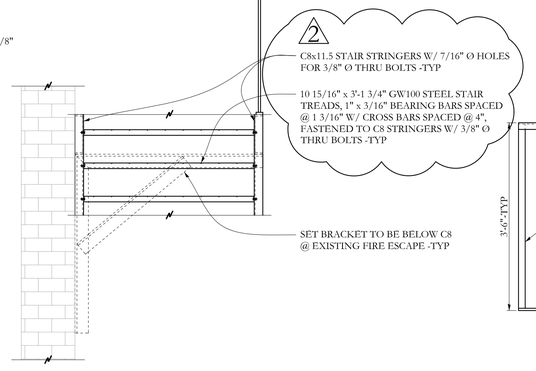

SECTION B/S2 3/4"=1'-0

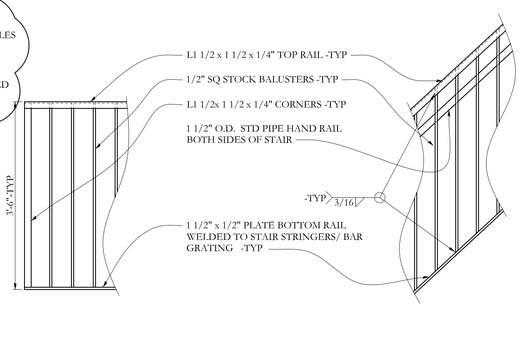

SECTION C/S2 3/4"=1'-0

77 Oak Street
Portland, ME 04101
(207) 772-2891
F. 866-795-7830
www.structuralintegrity.com
BUILD WITH CONFIDENCE
© 2007 Structural Integrity Consulting Engineers, Inc.
Structural Integrity
CONSULTING ENGINEERS
SI# 09-0084

REVISIONS:
1 10/5/09 DIMENSION MODIFICATIONS
2 10/26/09 STAIR MODIFICATIONS

28 Monument Square Fire Escape
Portland, Maine

DATE: 9/23/09

ELEVATION and SECTIONS

S2

STATE OF MAINE
AARON C. JONES
No. 10968
LICENSED PROFESSIONAL ENGINEER
9/23/09