

# LEGEND:

	NIGHT LIGHT
	FLUORESCENT FIXTURE - UPPERCASE LETTER IS TYPE, LOWERCASE LETTER IS SWITCH CONTROL GROUP RECTANGLES INDICATE NUMBER FIXTURES IN A ROW.
	CEILING MOUNTED FIXTURE - NOTES SAME AS ABOVE
	WALL MOUNTED FIXTURE - NOTES SAME AS ABOVE
	WALL MOUNTED LINEAR FIXTURE - NOTES SAME AS ABOVE
	TRACK LIGHTING - NOTES SAME AS ABOVE
	CEILING MOUNTED EXIT SIGN - ARROW INDICATES DIRECTIVE ARROW ON SIGN
	WALL MOUNTED EXIT SIGN - ARROW INDICATES DIRECTIVE ARROW ON SIGN EMERGENCY LIGHTING
	BATTERY PACK WITH EMERGENCY LAMPS AS SHOWN
	REMOTE EMERGENCY LAMP LIGHT FIXTURES
	SPST FLUSH WALL TOGGLE SWITCH - MOUNT AT 48" A.F.F TO CENTER - LETTER INDICATES SWITCH GROUP
	THREE-WAY TOGGLE SWITCH - NOTES SAME AS SPST SWITCH ABOVE
	DIMMER SWITCH - NOTES SAME AS SPST SWITCH ABOVE
	FOUR-WAY TOGGLE SWITCH - NOTES SAME AS SPST SWITCH ABOVE
	WALL KEY SWITCH - NOTES SAME AS ABOVE
	PILOT LIGHT SWITCH - NOTES SAME AS ABOVE
	VACANCY SENSOR - MANUAL ON / AUTOMATIC OFF OPERATION - NOTES SAME AS ABOVE. "a/b" DENOTES DUAL RELAY SENSOR (SINGLE SWITCH W/ (2) RELAYS IS REQUIRED)
	VOLUME CONTROL SWITCH - NOTES SAME AS ABOVE
	LOW VOLTAGE SWITCH - NOTES SAME AS ABOVE
	PROJECTION SCREEN CONTROL SWITCH
	FADER STATION SWITCH
	CEILING MOUNTED OCCUPANCY SENSOR - "LN" INDICATES LINE VOLTAGE, "HB" INDICATES HIGH BAY TYPE.
	CORNER MOUNTED OCCUPANCY SENSOR
	POWER PACK FOR LOW VOLTAGE LIGHTING CONTROL DEVICES
	EMERGENCY LIGHTING CONTROL UNIT
	PHOTO CELL
	PLUGMOLD
	20 AMP DUPLEX CONVENIENCE RECEPTACLE - MOUNT AT 18" A.F.F. TO CENTER UNLESS INDICATED OTHERWISE - "GF" INDICATES GROUND FAULT DEVICE. "WF" INDICATES GFI PROTECTED BY UPSTREAM DEVICE. "WP" INDICATES WEATHERPROOF. "IG" INDICATES INSULATED/ISOLATED RATED, "C" INDICATES CEILING MOUNTED, "F" INDICATES FLOOR MOUNTED, "WR" INDICATES WEATHER RESISTANT GRADE, "H" INDICATED HORIZONTALLY MOUNTED.
	20 AMP QUADRAPLEX (DOUBLE DUPLEX) - NOTES SAME AS ABOVE
	SPECIAL PURPOSE OUTLET OR EQUIPMENT CONNECTION - COORDINATE LOCATION AND TYPE OF CONNECTION WITH EQUIPMENT BEING SERVED.
	JUNCTION BOX WITH COVER
	MOTOR - SIZE AS INDICATED - COORDINATE W/ ACTUAL EQUIPMENT BEING SERVED
	MANUAL STARTER - COORDINATE WITH EQUIPMENT BEING SERVED SINGLE THROW
	FUSED DISCONNECT SWITCH - NEMA ENCLOSURE AS REQUIRED REMOTE CONTROL
	MAGNETIC STARTER - COORDINATE W/ EQUIPMENT BEING SERVED
	FUSED DISCONNECT SWITCH / MAGNETIC STARTER - NOTES SAME AS ABOVE
	GROUND
	ADA ELECTRICALLY-ASSISTED DOOR OPENER PUSHBUTTON
	BRANCH CIRCUIT RUN IN CEILING OR IN WALLS
	LOW VOLTAGE OR CONTROL WIRING - #12 MINIMUM OR AS NOTED
	MULTI-CONDUCTOR BRANCH CIRCUIT - NUMBER OF HASHMARKS IS NUMBER OF WIRES INDICATES NUMBER OF BLANK PORTS/PROVIDE (1) EACH UNLESS NOTED OTHERWISE - "U" INDICATES 48" TO CENTER A.F.F. (NOT INCLUDING GROUND WIRE) WITHOUT HASHMARKS IS TWO WIRE
	HOMERUN TO CIRCUIT AND PANEL INDICATED - NUMBER OF ARROWS IS NUMBER OF PHASE WIRES - NUMBER OF WIRES AS INDICATED ABOVE
	PANELBOARD NAME - # INDICATES CIRCUIT HOMERUN
	PANELBOARD NAME - #, RELAY # INDICATES CIRCUIT HOMERUN VIA INDICATED RELAY
	CONTINUATION OF CIRCUIT
	DIRECTIVE ARROW
	PANELBOARD - SEE PANELBOARD SCHEDULE(S)
	COMBINATION VOICE/DATA JACK - "V" INDICATES NUMBER OF VOICE LINES, "D" INDICATES NUMBER OF DATA LINES, "B" VOICE JACK - NOTES SAME AS VOICE/DATA JACK ABOVE - "W" INDICATES WALL PHONE, (1) VOICE LINE ONLY
	DATA JACK - NOTES SAME AS VOICE/DATA JACK ABOVE
	WIRELESS ACCESS PORT- PROVIDE (2) DATA JACKS FOR OWNER SUPPLIED ANTENNA
	TELEVISION JACK - NOTES SAME AS RECEPTACLES
	RECESSED FLOOR OR CEILING MOUNTED BOX - POWER & COMMUNICATIONS AS SHOWN- "F" INDICATES FLOOR MOUNTED, "C" INDICATES CEILING MOUNTED - NOTES SAME AS VOICE/DATA JACK ABOVE
	CEILING ROUND SPEAKER (SOUND OR INTERCOM SYSTEM AS SHOWN)
	CEILING 2x2 LAY-IN SPEAKER (SOUND OR INTERCOM SYSTEM AS SHOWN)
	WALL SPEAKER (SOUND OR INTERCOM SYSTEM AS SHOWN)- "H" INDICATES HORN TYPE
	MICROPHONE
	INTERCOM SYSTEM CALL STATION
	INTERCOM SYSTEM CONTROL PANEL
	TELEPHONE/INTERCOM SYSTEM HAND SET
	EMERGENCY PULL STATION
	CABLE TRAY
	LADDER TRAY
	FIRE ALARM SYSTEM CONTROL PANEL
	FIRE ALARM ANNUNCIATOR
	FIRE ALARM SYSTEM CEILING MOUNTED HEAT DETECTOR
	FIRE ALARM SYSTEM CEILING MOUNTED SMOKE DETECTOR
	FIRE ALARM SYSTEM CEILING MOUNTED CARBON MONOXIDE DETECTOR
	FIRE ALARM SYSTEM DUCT MOUNTED SMOKE DETECTOR
	WALL MOUNTED FIRE ALARM SYSTEM MANUAL PULL STATION
	FIRE ALARM SYSTEM WALL MOUNTED AUDIO/VISUAL DEVICE WITH VISUAL DEVICE CANDELA RATING AS NOTED
	FIRE ALARM SYSTEM WALL MOUNTED AUDIO DEVICE
	FIRE ALARM SYSTEM WALL MOUNTED VISUAL DEVICE ONLY - CANDELA RATING AS NOTED FIRE ALARM SYSTEM
	DOOR HOLD-OPEN DEVICE CONNECTION
	FIRE ALARM SYSTEM/SPRINKLER SYSTEM PRESSURE SWITCH
	FIRE ALARM SYSTEM/SPRINKLER SYSTEM FLOW SWITCH
	FIRE ALARM SYSTEM/SPRINKLER SYSTEM TAMPER SWITCH

# LIGHT FIXTURE SCHEDULE

TYPE	DESCRIPTION	SIZE	MANUFACTURER CAT. NO.	LENS/LOUVER	LAMPS (1)	DRIVER (1)	MINIM UM EFF...	LISTING	WATTS PER FIXTURE	VOLT.	NOTES
A	CEILING RECESSED DOWNLIGHT	4" X 4" SQ.	PHILIPS LIGHTOLIER C4X4L10NUVBZ10V / C4X4L10DL35KCCLWVB	OPEN	WHITE LED	0-10V DIMMING	100	---	13	UNV	(2)
B	CEILING RECESSED LINEAR	VARIES	PINNACLE LIGHTING EV3A-35K-**-G-G-UNV-1C-**-	DIFFUSE ACRYLIC	WHITE LED	FIXED OUTPUT	68	--	5 W PER FOOT	UNV	FINISH TBD BY ARCH. COORDINATE EXACT CEILING TYPE WITH SUBMITTAL. REFER TO DETAIL E1E-502 FOR CONFIGURATIONS.
C	NOT USED										
D	CEILING SURFACE STRIPLIGHT	4' L	PHILIPS DAY-BRITE LF4FR313SUDZT	FROSTED ACRYLIC	WHITE LED	0-10V DIMMING	122	DLC	33	UNV	DIMMING DRIVER IS STANDARD IN SPECIFIED FIXTURE BUT NOT REQUIRED.
D1	CEILING/WALL SURFACE STRIPLIGHT	2' L	PHILIPS DAY-BRITE LF2FR203SUDZT	FROSTED ACRYLIC	WHITE LED	0-10V DIMMING	113	DLC	18	UNV	DIMMING DRIVER IS STANDARD IN SPECIFIED FIXTURE BUT NOT REQUIRED.
D2	CEILING SURFACE STRIPLIGHT	4' L	PHILIPS DAY-BRITE LF4FR603SUDZT	FROSTED ACRYLIC	WHITE LED	0-10V DIMMING	113	DLC	52	UNV	DIMMING DRIVER IS STANDARD IN SPECIFIED FIXTURE BUT NOT REQUIRED.
E	EXISTING LIGHT FIXTURE TO REMAIN										
F	CEILING RECESSED VOLUMETRIC	2' X 4'	PHILIPS DAY-BRITE 2AVEG43L835-4-ACR-UNV-SDIM	RIBBED ACRYLIC	WHITE LED	STEP-DIMMING	110	DLC	39	UNV	
F1	CEILING RECESSED VOLUMETRIC	2' X 4'	PHILIPS DAY-BRITE 2AVEG43835-4-ACR-UNV-DIM	RIBBED ACRYLIC	WHITE LED	FIXED OUTPUT	110	DLC	39	UNV	DIMMING DRIVER IS STANDARD IN SPECIFIED FIXTURE BUT NOT REQUIRED.
F2	CEILING RECESSED VOLUMETRIC	2' X 2'	PHILIPS DAY-BRITE 2AVEG32835-2-ACR-UNV-DIM	RIBBED ACRYLIC	WHITE LED	FIXED OUTPUT	110	DLC	32	UNV	DIMMING DRIVER IS STANDARD IN SPECIFIED FIXTURE BUT NOT REQUIRED.
G	EXTERIOR BUILDING MOUNTED WALLWASHER	4' L	EMERGE LIGHTING WGV-48-120-CF-40K-06-RFC-DL-FM	DIFFUSE ACRYLIC	WHITE LED	FIXED OUTPUT	52	--	26	UNV	FINISH TBD BY ARCHITECT. INTENT IS FOR FIXTURES TO BE INSTALLED END TO END IN ONE CONTINUOUS 56' RUN.
H	WALL MOUNTED LINEAR STAIRWELL	4' L	LITHONIA LIGHTING WL4 20L.SLD LP835 N100 NESPD77 DIM10 EL7L	FROSTED ACRYLIC	WHITE LED	STEP-DIMMING	115	DLC	19	UNV	PROVIDE FIXTURE WITH INTEGRAL OCCUPANCY SENSOR AND EMERGENCY BATTERY PACK.
J	ELEVATOR PIT LIGHT	--	TRACE-LITE TLED804-20-VS-1W	CLEAR GLASS/ CAGE	WHITE LED	FIXED OUTPUT	35	--	20	UNV	
K	WALL MOUNTED MIRROR/LIGHT	2' X 3'	EDGE LIGHTING PLAZA-L-LED.	FROSTED GLASS	WHITE LED	ELEC. LOW VOLTAGE DIM.	17	--	115	UNV	REFER TO INTERIOR ELEVATIONS FOR ADDITIONAL MOUNTING INFORMATION.
L	UNDERCABINET MOUNTED TASK LIGHTING	VARIES	EDGE LIGHTING LCSM-24V-**-D NW-SA/PSB-96W-010-24VDC	DIFFUSE ACRYLIC	WHITE LED	0-10V DIMMING	N/A	--	3 W PER FOOT	UNV	PROVIDE FIXTURE WILL ALL NECESSARY ACCESSORIES FOR OPERATION AND MOUNTING AS SHOWN ON DRAWINGS.
M	NOT USED										
N	EXTERIOR WALL PACK	--	PHILIPS STONCO WRN2WLU-FWT-**-	TEMPERED GLASS	WHITE LED	FIXED OUTPUT	22		21	UNV	FINISH TBD BY ARCHITECT.
P	CEILING RECESSED GASKETED TROFFER	2' X 4'	HE WILLIAMS 50G-S24-L62/835-FAF12125-DG/MYLAR-SD40-UNV	FROSTED ACRYLIC	WHITE LED	STEP-DIMMING	86		76	UNV	PROVIDE FIXTURE WITH DOUBLE GASKETING.
P1	CEILING RECESSED GASKETED TROFFER	2' X 4'	HE WILLIAMS 50G-S24-L62/835-FAF12125-DG/MYLAR-DRV-UNV	FROSTED ACRYLIC	WHITE LED	FIXED OUTPUT	86		76	UNV	PROVIDE FIXTURE WITH DOUBLE GASKETING.
Q	CEILING RECESSED LINEAR	VARIES	PINNACLE LIGHTING EV3A-RGB-XX-G*-UNV-1DX-*	FROSTED ACRYLIC	RGB LED	DMX	26	--	6 W PER FOOT	UNV	REFER TO PLANS FOR ACTUAL LENGTHS OF FIXTURES. FINISH TBD BY ARCH. COORDINATE CEILING WITH SUBMITTED PRODUCT.
Q1	CEILING/WALL RECESSED LINEAR	VARIES	PINNACLE LIGHTING EV3A-RGB-XX-G*-UNV-1DX-**-EVCHI	FROSTED ACRYLIC	RGB LED	DMX	26	--	6 W PER FOOT	UNV	REFER TO PLANS FOR ACTUAL LENGTHS OF FIXTURES. PROVIDE ALL NECESSARY COMPONENTS REQUIRED TO ALLOW FIXTURE TO WRAP FROM CEILING TO WALL WITH LENGTH AS SHOWN ON PLANS. FINISH TBD BY ARCH. COORDINATE CEILING WITH SUBMITTED PRODUCT.
R	EXISTING LIGHT FIXTURE TO BE REMOVED										
S	CEILING RECESSED ARCHITECTURAL DOWNLIGHT	4" X 4" SQ.	SPECTRUM LIGHTING SDF04LEDLU18L40CMMXXWDMX1/SD4F**S...	SOLITE	TUNABLE LED	DMX	56	--	32	UNV	PROVIDE FIXTURE WITH 4-CHANNEL DMX CONTROLLER. FINISH TBD BY ARCHITECT.
T	CEILING RECESSED RGB DOWNLIGHT	4" X 4" SQ.	PHILIPS LIGHTOLIER 302MREX / 348**X/302MREX	OPEN	RGB LED	DMX	6.6	--	5	UNV	PROVIDE FIXTURE WITH PHILIPS COLOR KINETICS, ICOLOR MR GEN3 LAMP (ITEM #101-00074-02) AND ASSOCIATED PDS-70MR POWER/DATA SUPPLY (ITEM #109-00018-01).
U	CEILING RECESSED LINEAR WALL GRAZER	VARIES	EDGE LIGHTING LCMG-24V-**-RGB-SA/PSB-200W-24VDC-RGB	OPEN	RGB LED	DMX	N/A	--	6 W PER FOOT	120VAC/24VDC	REFER TO DETAIL E4E-502 FOR ADDITIONAL CONFIGURATION INFORMATION.
V-XX	CEILING RECESSED RGB PATTERN	VARIES	PINNACLE LIGHTING EV3A-RGB-PTTRN-XX-UNV-1DX-W-EV3CH-CRF16XXXX	FROSTED ACRYLIC	RGB LED	DMX	26	--	VARIES	UNV	REFER TO DETAIL A1E-502 FOR ADDITIONAL CONFIGURATION INFORMATION. XX SYMBOLIZES WIDTH AND HEIGHT OF FIXTURE NOTED ON PLANS.
W	CEILING SUSPENDED RGB PATTERN - DIRECT/INDIRECT	VARIES	PINNACLE LIGHTING EX3B-A-O-RGB-RGB-PTTRN-XX-AC48**-UNV-1DX-**-EX3CH-CRF16XXXX	FROSTED ACRYLIC	RGB LED/ RGB LED	(2) DMX	26	--	VARIES	UNV	REFER TO ELECTRICAL ELEVATIONS A9/E-302 FOR ADDITIONAL CONFIGURATION INFORMATION. PROVIDE FIXTURES WILL ALL ACCESSORIES/ MOUNTING OPTIONS TO ENABLE FIXTURES TO BE MOUNTED AS SHOWN. FIXTURE HOUSING FINISH SHALL BE DETERMINED BY ARCH.
W1	CEILING SUSPENDED RGB PATTERN - DIRECT/INDIRECT	VARIES	PINNACLE LIGHTING EX3B-A-O-RGB-RGB-PTTRN-XX-MAC48**-UNV-1DX-**-EX3CH-CRF16XXXX	FROSTED ACRYLIC	RGB LED/ RGB LED	(2) DMX	26	--	VARIES	UNV	REFER TO ELECTRICAL ELEVATIONS A9/E-302 FOR ADDITIONAL CONFIGURATION INFORMATION. PROVIDE ALL ACCESSORIES/ MOUNTING OPTIONS TO ENABLE FIXTURES TO BE MOUNTED AS SHOWN. FIXTURE HOUSING FINISH SHALL BE DETERMINED BY ARCH.
X	DISPLAY CASE LIGHTING	VARIES	EDGE LIGHTING LC45C-24V-**-C NW-**-	CLEAR ACRYLIC	WHITE LED	0-10V DIMMING	43	--	2.3 W PER FOOT	UNV	REFER TO ELECTRICAL ELEVATION A6/E-302 FOR ADDITIONAL INFORMATION. PROVIDE ALL NECESSARY ACCESSORIES FOR MOUNTING AND OPERATION OF FIXTURES AS SHOWN.
Y	STAIR TREAD LIGHT	VARIES	CALI LIGHTING - STEPLITE STL6550-1.5"-LED-5.0K-SL-DRY	FROSTED ACRYLIC	WHITE LED	ELECT. TRANSFORMER	N/A	--	4 W PER FOOT	UNV	PROVIDE ASSOCIATED TRANSFORMER EQUAL TO CALI LIGHTING, CAT. NO. TRA150-120-12V-DC AND ALL OTHER ACCESSORIES REQUIRED FOR MOUNTING AS SHOWN. REFER TO DETAIL D13/AE508 FOR MORE INFORMATION.
Z	CANOPY RECESSED STRIPLIGHT	VARIES	CALI LIGHTING - LIPLLED LLED8000-SR-F-3.6W-DMX-LED-RGB-WET-**-	FROSTED ACRYLIC	RGB LED	ELECT. TRANSFORMER	85	--	4 W PER FOOT	UNV	PROVIDE ASSOCIATED TRANSFORMER EQUAL TO CALI LIGHTING, CAT. NO. TRA150-120-24V-DC AND ALL OTHER ACCESSORIES REQUIRED FOR MOUNTING AS SHOWN. FINISH TBD BY ARCH.
	EMERGENCY BATTERY PACK	--								UNV	
INV-X	EMERGENCY INVERTER	--	LVS, INC CEPS-A-2000W-120V-XCB	RED LETTERS	WHITE LED	--	--	--	5	UNV	REFER TO FLOOR PLANS FOR MOUNTING.
	EXIT SIGNAGE	--	PHILIPS CHLORIDE CXL3R	RED LETTERS	WHITE LED	--	--	--	5	UNV	REFER TO FLOOR PLANS FOR MOUNTING.
	EXIT SIGNAGE-BLACK HOUSING	--	PHILIPS CHLORIDE CXL3RB	RED LETTERS	WHITE LED	--	--	--	5	UNV	REFER TO FLOOR PLANS FOR MOUNTING.
	EXIT SIGNAGE-EDGE LIT	--	PHILIPS CHLORIDE ER45VXL**RC*	RED LETTERS	WHITE LED	--	--	--	4	UNV	REFER TO FLOOR PLANS FOR MOUNTING, NUMBER OF FACES AND DIRECTION ARROWS.

NOTES:  
 (1) ALL FIXTURES (WHERE INDICATED) SHALL BE EITHER DESIGN LIGHT CONSOTIUM (DLC) OR ENERGY STAR (ES) LISTED AND ELIGIBLE FOR EFFECENCY MAINE.  
 (2) PROVIDE FIXTURE WITH 1% 0-10V DIMMING LED DRIVER

ALL DEVICES, FIXTURES, ETC. SHALL BE NEW UNLESS DESIGNATED WITH THE FOLLOWING TAGS:  
 E EXISTING TO REMAIN  
 ER EXISTING RELOCATED  
 NR NEW TO REPLACE EXISTING IN EXISTING LOCATION  
 R EXISTING TO BE REMOVED  
 RR REMOVE & RELOCATE EXISTING

## ABBREVIATIONS:

A AMPERES	GND GROUND
AFF ABOVE FINISHED FLOOR	HP HORSEPOWER, HEAT PUMP
AFG ABOVE FINISHED GRADE	JB JUNCTION BOX
ATS AUTOMATIC TRANSFER SWITCH	KVA KILO VOLT AMPS
BATT BATTERY	KW KILOWATT(S)
BKR BREAKER	LTG LIGHTING
BLDG BUILDING	MAX MAXIMUM
CB CIRCUIT BREAKER	MIN MINIMUM
CKT CIRCUIT	N NEW
CLG CEILING	OC ON CENTER
CT CURRENT TRANSFORMER	OS/OI OWNER SUPPLIED, OWNER INSTALLED ITEM
DN DOWN	PAR PARTIAL CIRCUIT
DWG DRAWING	PVC POLYVINYL CHLORIDE
EMERG EMERGENCY	REC/RECEP RECEPTACLE
EMT ELECTRICAL METALLIC TUBING	TEL TELEPHONE
EQUIP EQUIPMENT	TYP TYPICAL
FA FIRE ALARM	UG UNDERGROUND
FAA FIRE ALARM ANNUNCIATOR	V VOLTS
FACP FIRE ALARM CONTROL PANEL	W WATTS
FA-PE FIRE ALARM SYSTEM POWER EXTENDER	WG WIRE GUARD
FIN FINISH, FINISHED	WM WIREMOLD
FLR FLOOR	WP WEATHERPROOF


## GENERAL ELECTRICAL DEMO NOTES:

- ELECTRICAL CONTRACTOR SHALL REVIEW ALL TRADE'S DRAWINGS. AREAS NOTED TO BE DEMOLISHED ARE SHOWN ON ARCHITECTURAL PLANS. THIS SHALL INCLUDE ALL ELECTRICAL DEVICES, FIXTURES AND/OR SWITCHGEAR. ALL EXISTING EQUIPMENT SHALL REMAIN ON EXISTING SURFACES UNLESS SPECIFICALLY NOTED OTHERWISE.
- WIRING FOR EXISTING BRANCH CIRCUIT DEVICES TO BE DEMOLISHED SHALL BE REMOVED BACK TO THE PANELBOARD. THE ASSOCIATED CIRCUIT BREAKER SHALL BE TURNED OFF AND MARKED AS SPARE IN THE PANELBOARD DIRECTORY. DO NOT ABANDON BRANCH CIRCUIT WIRING ABOVE CEILINGS OR IN WIREWAYS.
- ALL EXPOSED RACEWAYS & CABLES, NO LONGER IN USE, SHALL BE REMOVED.
- MAINTAIN, OR RESTORE IF INTERRUPTED BY REMOVALS OR IN PATH OF NEW CONSTRUCTION, ALL CONDUITS, BRANCH CIRCUITS, AND FEEDERS PASSING THROUGH AND SERVING UNDISTURBED AREAS (SHOWN OR NOT SHOWN).
- EXISTING CONDUITS STUBBED THROUGH FLOOR SERVING ITEMS TO BE REMOVED (SHOWN OR NOT SHOWN) AND NOT REQUIRED TO BE REUSED SHALL BE CUT OFF FLUSH WITH THE SLAB DECK AND SEALED.
- IN ANY AREA REQUIRING THE PERFORMANCE OF ANY TRADES WORK, THIS ELECTRICAL CONTRACTOR SHALL CAREFULLY REMOVE AND STORE ANY ELECTRICAL ITEMS IN THE PATH OF WORK, REINSTALLING AND RECONNECTING SAME AS REQUIRED IN ACCORDANCE WITH THE PLANS AND/OR AS DIRECTED AFTER COMPLETION OF OTHER TRADES WORK IN THAT AREA.
- ENSURE REMOVAL OF ELECTRICAL DEVICES IN CONSTRUCTION ARE DOES NOT EFFECT ADJACENT AREAS.

## GENERAL NOTES:

- ALL WORK SHALL BE INSTALLED IN A NEAT AND WORKMAN LIKE MANNER, RECTILINEAR TO BUILDING STRUCTURE, AND IN ACCORDANCE WITH ALL APPLICABLE CODES, INCLUDING, BUT NOT LIMITED TO NFPA 70, 90A, 101 AND DIRECTION OF AUTHORITY HAVING JURISDICTION.
- EXACT LOCATION OF MECHANICAL EQUIPMENT THAT REQUIRES ELECTRICAL CONNECTION IS SHOWN ON THE MECHANICAL PLANS.
- CONTRACTOR SHALL REVIEW ALL TRADES CONTRACT DOCUMENTS, AND FIELD VERIFY TO DETERMINE SPECIFIC MOUNTING LOCATIONS FOR ELECTRICAL EQUIPMENT AND CONDUITS.
- COORDINATE ARRANGEMENT, MOUNTING, AND SUPPORT OF ELECTRICAL CONDUIT AND EQUIPMENT TO PROVIDE FOR EASE OF DISCONNECTING THE EQUIPMENT WITH MINIMUM INTERFERENCE TO OTHER INSTALLATIONS; TO ALLOW RIGHT OF WAY FOR PIPING INSTALLED AT A REQUIRED SLOPE; AND SO CONNECTING RACEWAYS SHALL BE CLEAR OF OBSTRUCTIONS AND OF THE WORKING AND ACCESS SPACE OF OTHER EQUIPMENT.
- RUN SEPARATE NEUTRAL WIRE FOR EACH DEDICATED BRANCH CIRCUIT SHOWN ON THE PLANS.
- DEVICES SHALL NOT BE INSTALLED BACK-TO-BACK IN ADJACENT ROOMS. ADJUST LOCATIONS AS NECESSARY TO AVOID THIS CONDITION.
- ALL ELECTRONIC SECURITY DEVICES AND WIRING SHALL BE PROVIDED BY OWNERS VENDOR. SOME DEVICING IS NOTED HEREIN FOR COORDINATION AND ROUGH-IN. PROVIDE EMPTY CONDUITS AND BOXES AS NOTED. COORDINATE WITH VENDOR.
- FIRE ALARM DRAWINGS ARE INCLUDED FOR COORDINATION AND PERMITTING. ALL FIRE ALARM DEVICES AND WIRING SHALL BE PROVIDED BY OWNERS VENDOR. PROVIDE CONDUIT, BOXES, AND LINE VOLTAGE POWER PACK. COORDINATE WITH VENDOR.

0	ISSUED FOR BID	06 JUNE 2016
REV.	DESCRIPTION	DATE

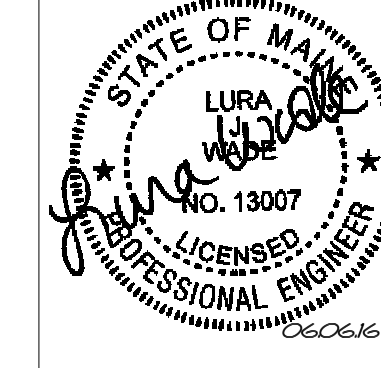

**WBRC**  
 ARCHITECTS ENGINEERS  
 WWW.WBRC.AE.COM  
 BANGOR, MAINE 207-947-4511  
 PORTLAND, MAINE 207-828-4511  
 SARASOTA, FLORIDA 941-556-0757

**ASYLUM**

PROJECT: ELECTRICAL LEGEND & LIGHT FIXTURE SCHEDULE

SHEET TITLE:

WBRC CAD FILE: C:\Users\jkm\Documents\407110 - ASYLUM DANCE CLUB - ELEC. lyle.mahar.rvt

PROJECT No. 4071.10 GRAPHIC SCALE: 0" = 1"

SCALE: NOT TO SCALE SHEET No.:

PROJECT MANAGER: JRB

DRAWN BY: KRM

CHECKED BY: SJL

**E-001**