



- TECHNICAL NOTES:**
- 1 LIGHTING CONTROL SYSTEM TOUCHSCREEN - PROVIDE CAT. 5 TO DMX CONTROLLER IN ELECT. 009. REFER TO DETAIL A7/E-502 FOR LIGHTING CONTROL SYSTEM RISER.
 - 2 NOT USED.
 - 3 EMERGENCY LIGHTING UL924 SWITCHING RELAY - RELAY SHALL BE EQUAL TO LVS, CAT. NO. EPC-A-1/ REFER TO DETAIL A7/E-502 FOR ADDITIONAL WIRING INFORMATION.
 - 4 OCCUPANCY SENSOR CONNECTED TO LIGHTING CONTROL SYSTEM. LOW VOLTAGE WIRING NOT SHOWN FOR CLARITY. REFER TO DETAIL A7/E-502 FOR ADDITIONAL CONNECTION INFORMATION.
 - 5 STAIR TREAD LIGHTING TRANSFORMER - WALL MOUNT ABOVE ACCESSIBLE CEILING. TRANSFORMER SHALL BE CALI LIGHTING, CAT. NO. TRA150-120V-12V. LOW VOLTAGE WIRING TO TREADS SHALL BE CONCEALED WITHIN WALL.
 - 6 LIGHTING CONTROL SYSTEM SWITCHING CONTROLLER - WALL MOUNT ABOVE ACCESSIBLE CEILING. REFER TO LIGHTING CONTROL SCHEDULES FOR MORE INFORMATION.
 - 7 DECORATIVE CEMENT COUNTERTOP WITH INTEGRAL LED LIGHTING - COUNTER, POWER SUPPLY AND CONTROLLER BY DIV. 12. ALL POWER AND CONTROLS CONNECTIONS BY DIV. 26.
 - 8 CANOPY RECESSED STRIP LIGHT TRANSFORMER - WALL MOUNT ABOVE ACCESSIBLE CEILING. TRANSFORMER SHALL BE CALI LIGHTING, CAT. NO. TRA150-120V-12V. LOW VOLTAGE WIRING TO LIGHTS SHALL BE CONCEALED WITHIN WALL.

DUE TO LENGTH OF CANOPY, THIS FIXTURE RUN WILL BE COMPRISED OF (2) INDIVIDUAL RUNS. ENSURE SEEM BETWEEN RUNS IS SMOOTH

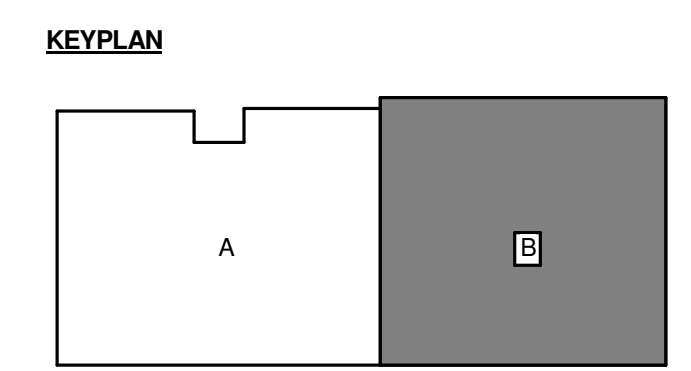

REV.	DESCRIPTION	DATE
0	ISSUED FOR BID	06 JUNE 2016

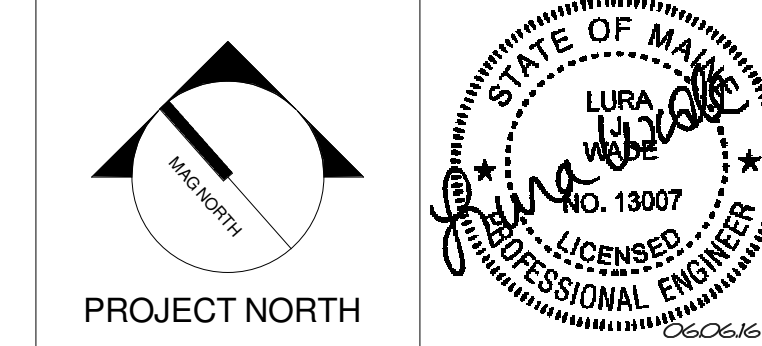

WBRC
ARCHITECTS ENGINEERS
WWW.WBRCAE.COM
BANGOR, MAINE 207-947-4511
PORTLAND, MAINE 207-828-4511
SARASOTA, FLORIDA 941-556-0757

PROJECT:
ASYLUM

SHEET TITLE:
FIRST FLOOR LIGHTING PLAN - SEGMENT B

WBRC CAD FILE: C:\Users\lyfe.mahar\Documents\407110 - ASYLUM DANCE CLUB - ELEC.lyfe.mahar.rvt	GRAPHIC SCALE: 0" = 1"
PROJECT No: 4071.10	SHEET No.:
SCALE: 1/4" = 1'-0"	EL102B
PROJECT MANAGER: JRB	CHECKED BY: LW
DRAWN BY: KRM	

A1 FIRST FLOOR LIGHTING PLAN - SEGMENT B
1/4" = 1'-0"

6/3/2016 4:04:11 PM C:\Users\lyfe.mahar\Documents\407110 - ASYLUM DANCE CLUB - ELEC.lyfe.mahar.rvt