
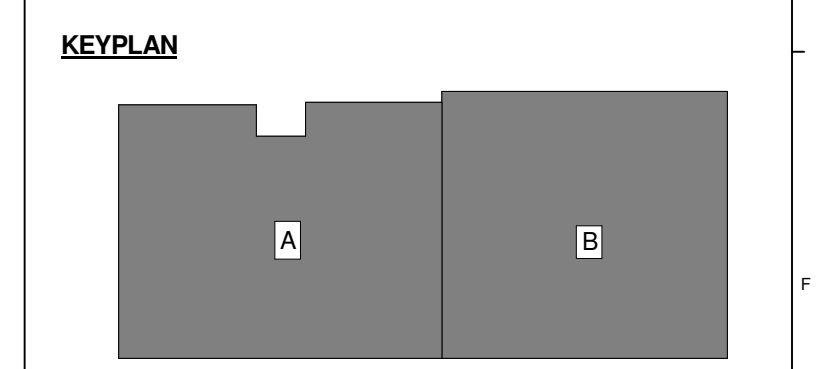


GROUND EXCAVATION RETENTION MEASURES WILL BE REQUIRED FOR NEW FOUNDATION EXCAVATIONS. SEE SPEC. SEC. 315000

----- EXCAVATION RETENTION LIMIT

- FOUNDATION AND SLAB PLAN NOTES:**
1. TOP OF SLAB = XX'-YY" SHOWN ON PLAN AS:
 2. SEE PLANS FOR TOP OF FOOTING, PIER, WALL AND BRICK SHELF ELEVATIONS AT ALL EXTERIOR WALLS. SEE PLAN FOR TOP OF FOOTING AND SLAB ELEVATIONS AT INTERIOR WALLS.
 3. SLAB-ON-GRADE CONSTRUCTION IS 5" THICK (U.N.C.), CAST-IN-PLACE 3,500 PSI CONCRETE w/ #4@16" EACH WAY. SEE SECTIONS AND TYPICAL DETAILS FOR REINFORCEMENT AT SLAB EDGES.
 4. PROVIDE SAWCUT CONTROL JOINTS AT 12'-6" o/c MAXIMUM EACH WAY BETWEEN COLUMN LINES AND DIAGONALLY OFF ALL INSIDE SLAB-ON-GRADE CORNERS WITHIN 12 HOURS OF PLACING SLAB.
 5. [ELEV.] INDICATES TOP OF FOOTING ELEVATION. COORDINATE REQUIRED TOP OF EXCAVATION WITH FOOTING THICKNESS PER SCHEDULE AND SECTIONS. NOTE: COLUMN/PIER FOOTINGS TO BEAR ON NATIVE GRANULAR SOIL. BUILD UP AS REQ'D w/ STRUCTURAL FILL TO ACHIEVE BOTTOM OF FOOTING ELEVATION.
 - 5A. -ELEV > INDICATES ASSUMED BOTTOM OF EXISTING FOOTING ELEVATION VERIFY IN FIELD.
 6. FOUNDATION WALL PENETRATIONS NOT SHOWN. COORD. w/ OTHER TRADES AND PROVIDE SLEEVES AND/OR CORES THROUGH WALLS AS REQUIRED.
 7. SEE S-300 SERIES OF DRAWINGS FOR ALL TYPICAL CONCRETE SECTIONS AND DETAILS.
 8. "ETR" INDICATES EXISTING TO REMAIN STRUCTURE
 9. DRILL CLEAN AND EPOXY DOWEL ALL FOUNDATION REINFORCING 6" INTO EXISTING FOUNDATIONS

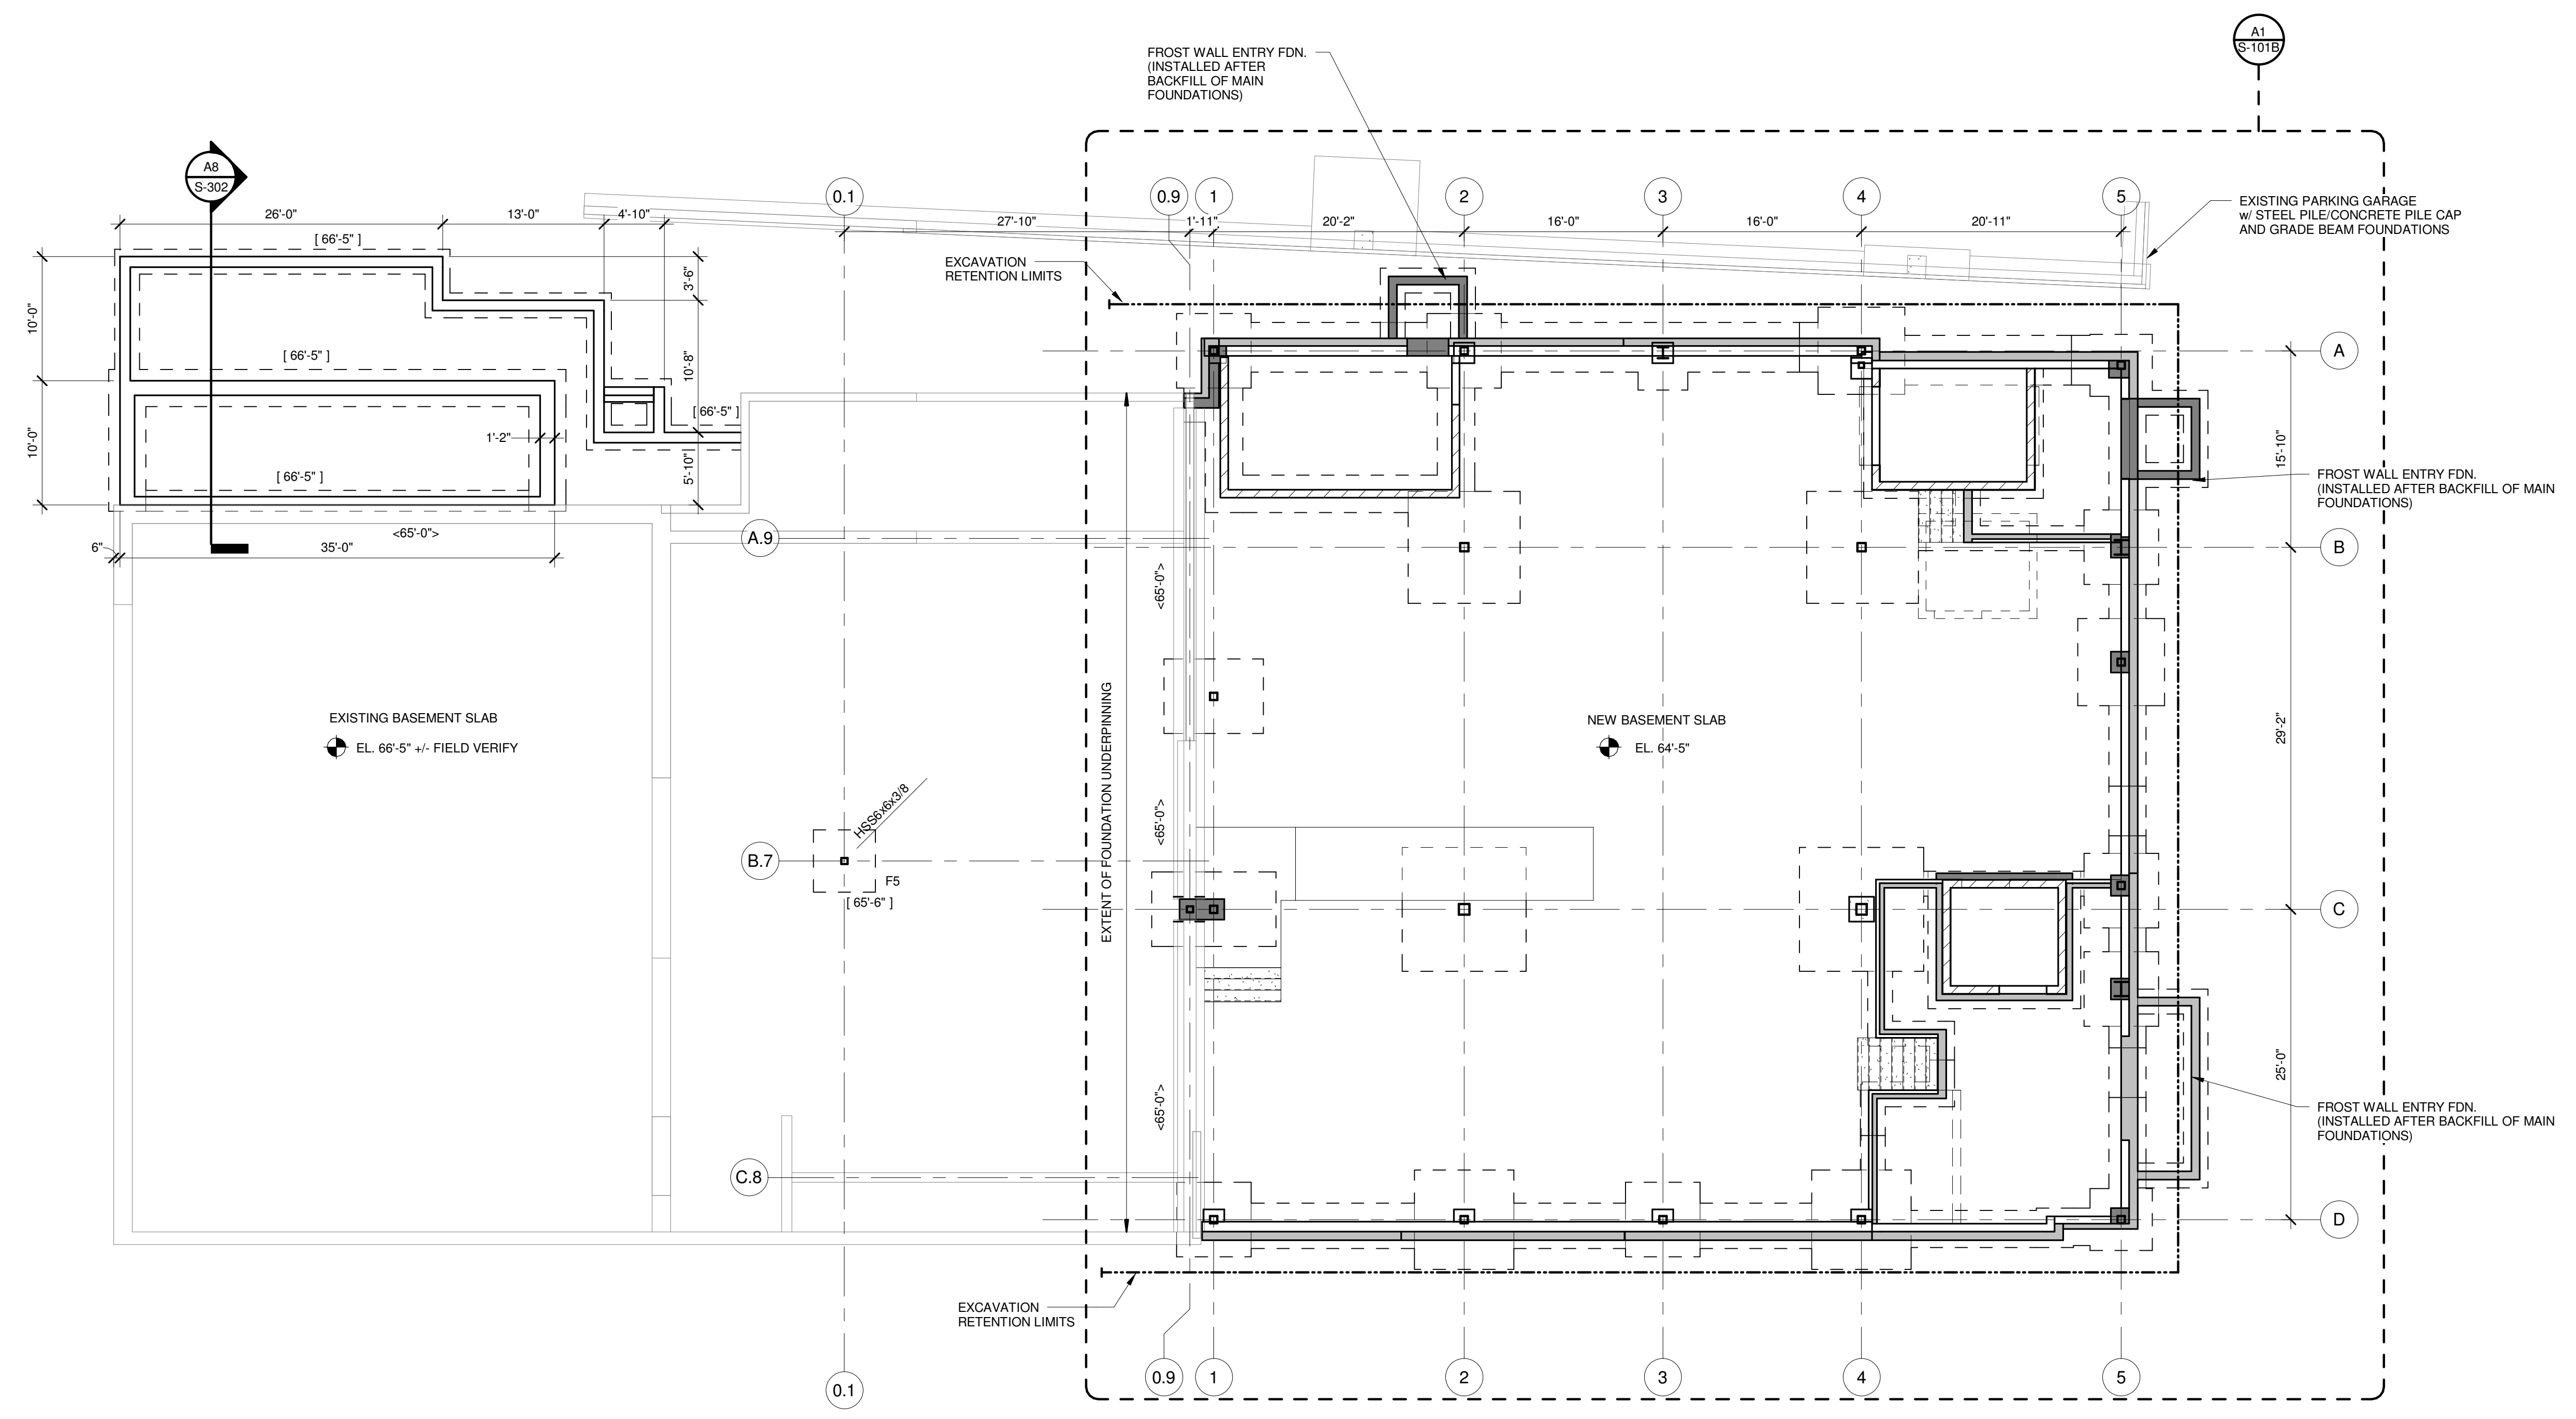

0	ISSUED FOR BID	06 JUNE 2016
REV.	DESCRIPTION	DATE

PROJECT NORTH

WBRC
ARCHITECTS • ENGINEERS

WWW.WBRCAE.COM
BANGOR, MAINE 207-947-4511
PORTLAND, MAINE 207-838-4511
SARASOTA, FLORIDA 941-556-0757

ASYLUM

FOUNDATION AND FLOOR SLAB PLAN

SHEET TITLE:

WBRC CAD FILE: C:\Users\jpc\Documents\40710 - ASYLUM DANCE CLUB - STRUCT_3000.dwg

PROJECT No: 4071.10

SCALE: As indicated

PROJECT MANAGER: JRB

DRAWN BY: ADG/RAD/JHW

CHECKED BY: JPC

GRAPHIC SCALE: 0" = 1"

SHEET No: **S-101**