



- FIRE SUPPRESSION SYSTEM LEGEND:**
- EXISTING WET PIPE SPRINKLER RISER: Circle with 'X'
- GENERAL FIRE SUPPRESSION SYSTEM NOTES:**
- MODIFY EXISTING WET SYSTEM SPRINKLER SYSTEM AS REQUIRED FOR NEW RENOVATIONS. EXTEND EXISTING MAINS, BRANCHES, AS REQUIRED FOR NEW WORK. PROVIDE NEW PIPING MAINS, AND BRANCHES AS REQUIRED FOR NEW WORK. REMOVE ANY EXISTING ABANDONED PIPING NO LONGER IN SERVICE. COORDINATE LOCATION OF ALL NEW PIPING AND EXISTING PIPING WITH ALL NEW WORK AND WITH ALL OTHER TRADES FOR FUNCTIONAL AND AESTHETIC APPEARANCE (EXPOSED LOCATIONS). PRIOR TO INSTALLATION FOR NEW MAINS, BRANCHES, AND HEADS.
  - IN ADJACENT AREA TO REMAIN "UNFINISHED", MODIFY EXISTING HEADS AND BRANCHES AS REQUIRED TO MAINTAIN COVERAGE OF "UNFINISHED" AREAS IN ACCORDANCE WITH NFPA 13.
  - ALL SPRINKLER WORK SHALL BE IN ACCORDANCE WITH NFPA 13, STATE OF MAINE FIRE MARSHAL'S OFFICE, AND LOCAL AUTHORITY HAVING JURISDICTION.
  - SPRINKLER CONTRACTOR TO COORDINATE WITH LOCAL WATER COMPANY AND PROVIDE HYDRANT FLOW TEST PRIOR TO COMMENCEMENT OF ANY WORK, TO CONFIRM EXISTING WATER SUPPLY HYDRAULIC DATA, AND INCORPORATE DATA WITHIN THE SPRINKLER CALCULATIONS AND DESIGN, IN ACCORDANCE WITH NFPA 13.
  - DO NOT INSTALL SPRINKLER PIPING OVER ELECTRICAL SWITCH GEAR AND IN FRONT OF ACCESSIBLE JUNCTION BOXES. COORDINATE REQUIRED CLEARANCES FOR ACCESS AND SERVICE OF ALL ELECTRICAL SWITCH GEAR WITH ELECTRICAL CONTRACTOR.
  - COORDINATE REQUIRED CLEARANCES FOR ACCESS AND SERVICE OF ALL HVAC AND PLUMBING EQUIPMENT WITH MECHANICAL CONTRACTOR.
  - PROVIDE SPRINKLER COVERAGE OVER ALL CABLE TRAYS. COORDINATE LOCATIONS OF CABLE TRAYS WITH ELECTRICAL CONTRACTOR.
  - ALL SPRINKLER HEADS TO BE INSTALLED IN THE CENTER OF ACOUSTICAL CEILING TILES.

**G1 FIRST FLOOR CODE PLAN**  
1/8" = 1'-0" A5

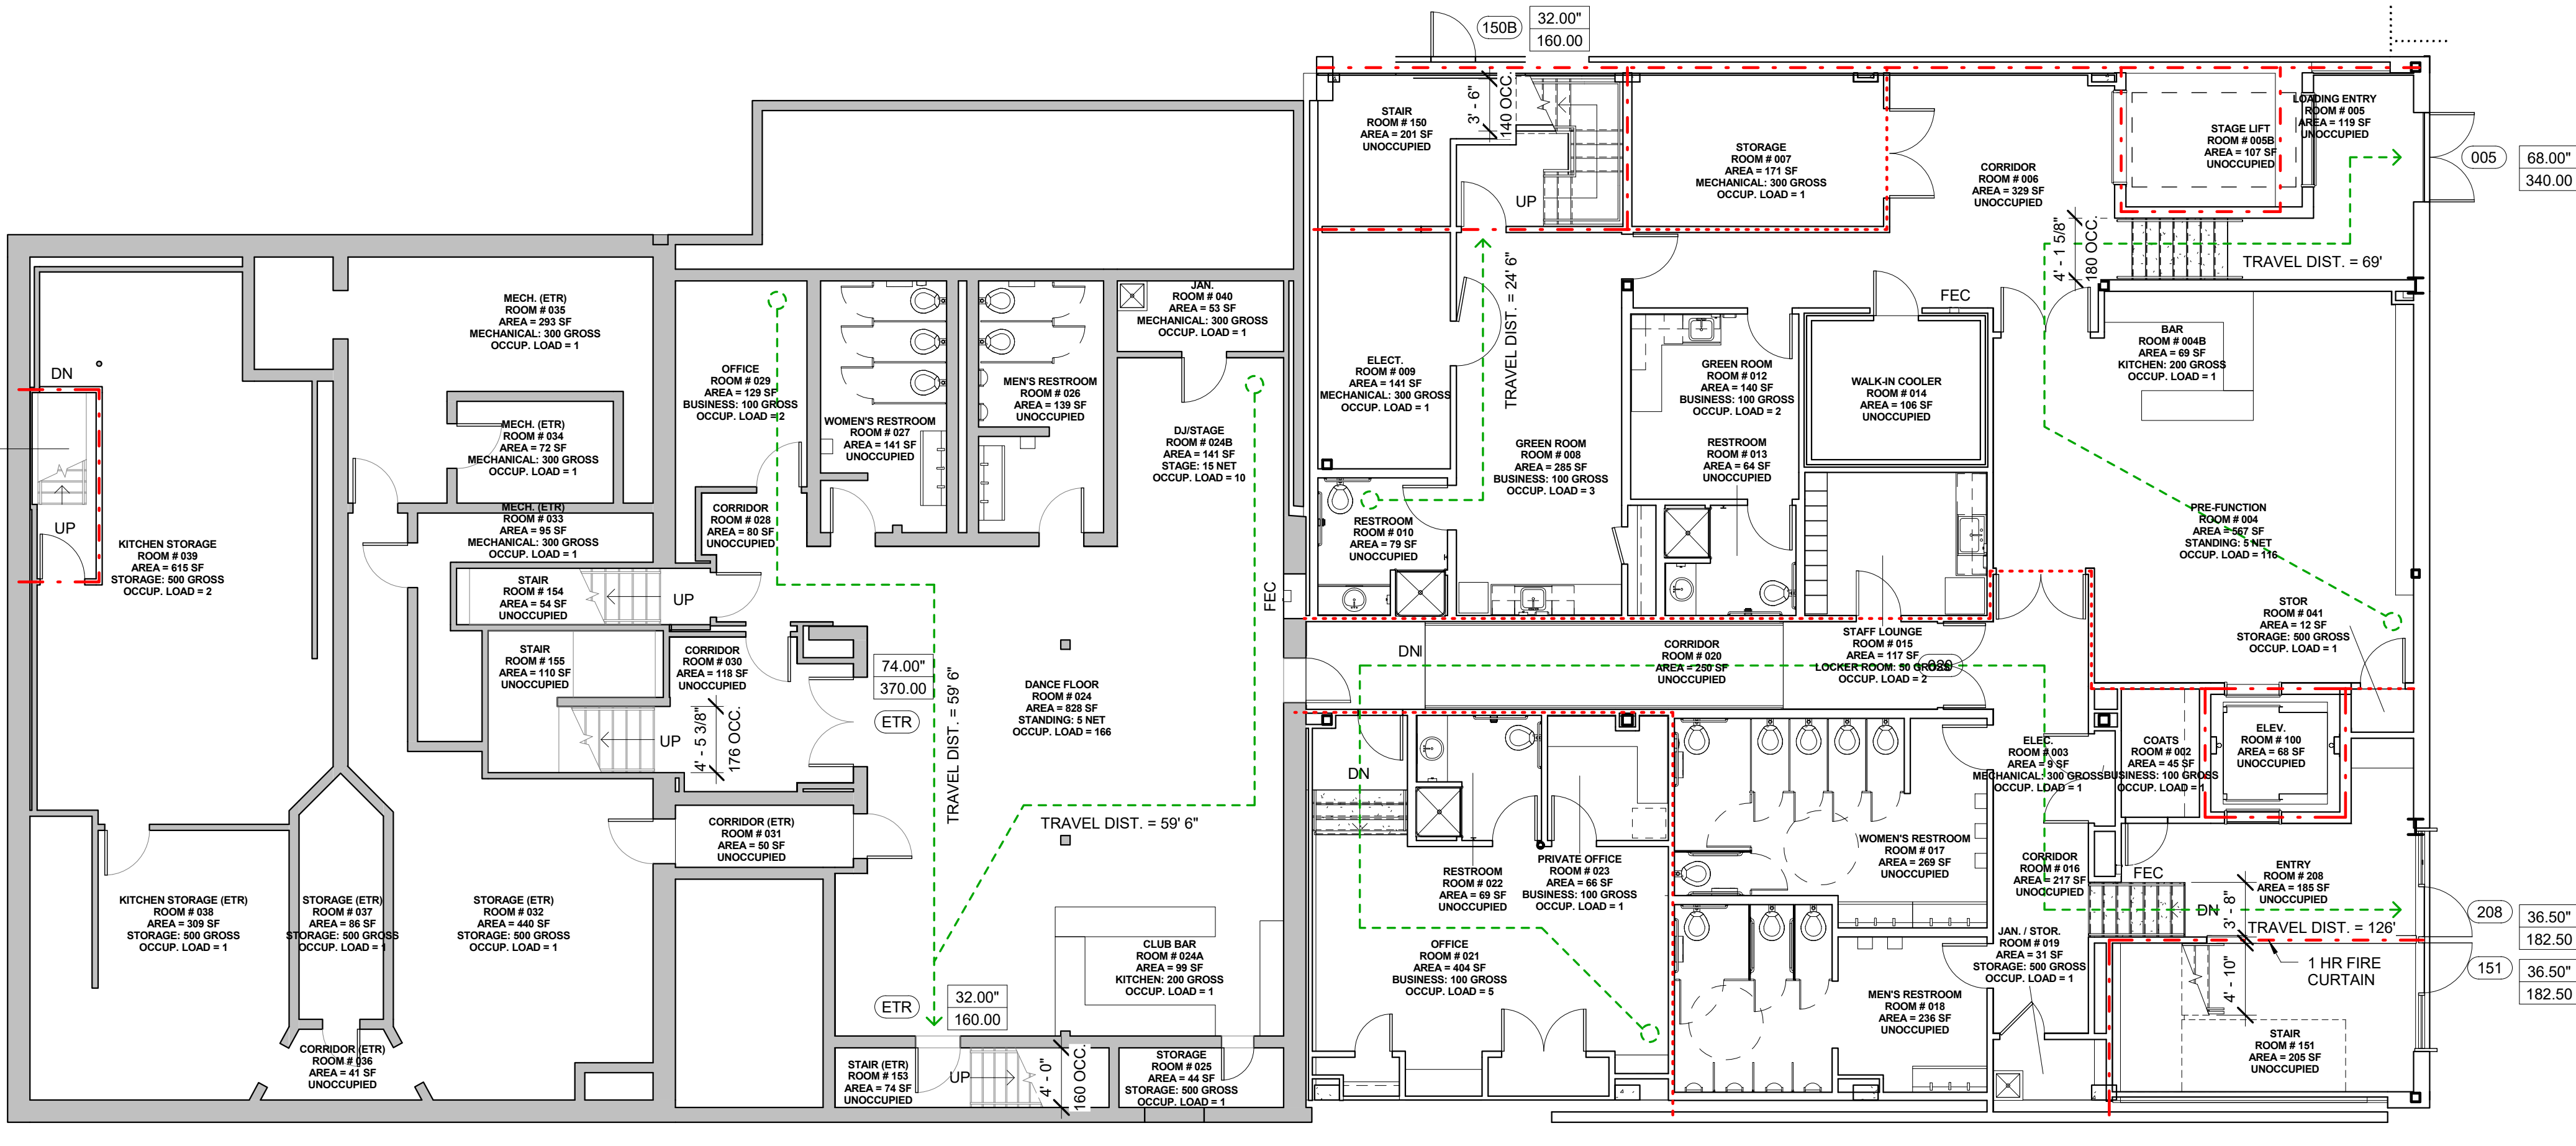

**A1 BASEMENT CODE PLAN**  
1/8" = 1'-0" A9

REV.	DESCRIPTION	DATE
0	DD SUBMISSION	25 MAR 2016

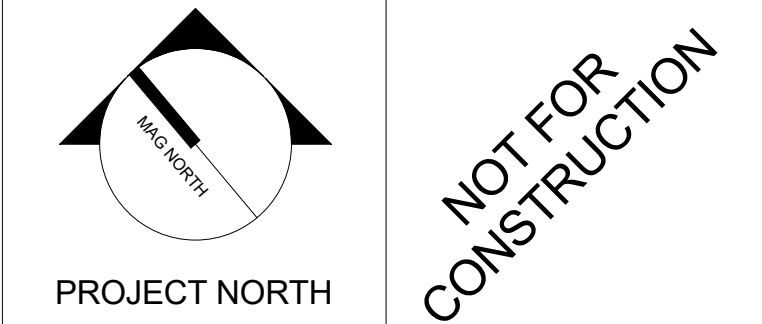

**WBRC**  
ARCHITECTS ENGINEERS  
WWW.WBRCAE.COM  
BANGOR, MAINE 207-947-4511  
PORTLAND, MAINE 207-528-4511  
SARASOTA, FLORIDA 941-556-0757

**ASYLUM**  
PROJECT:  
**CODE REVIEW BASEMENT AND FIRST FLOOR PLANS**

SHEET TITLE:

WBRC CAD FILE: C:\Users\jpc\Documents\407110 - ASYLUM DANCE CLUB - ARCH - jpc\yn\_bce\the.rvt

PROJECT No: 4071.10 GRAPHIC SCALE: 0" = 1"

SCALE: As Indicated SHEET No:

PROJECT MANAGER: JRB DRAWN BY: JRB CHECKED BY: JRB

**G1004**

3/25/2016 1:30:51 PM C:\Users\jpc\Documents\407110 - ASYLUM DANCE CLUB - ARCH - jpc\yn\_bce\the.rvt