LEGEND:

RISER DIAG SYM	NFPA SYMBOL*	DESCRIPTION	CATALOG #
FACP	FACP	Fire Alarm Control Panel	EST iQ500RD
FAA	FAA	Remote Annunciator	RLCD-CR
BPS	FACU	Booster Power Supply	BPS10A
F	P	Addressable Manual Station	SIGA-278
F WP		Conventional Weatherproof Manual station	MPSR2-545W-GE
ER		Addressable Smoke Detector w/ Base (ER indicates elevator recall)	SIGA-SB
D		Addressable Duct Smoke Detector	SIGA-SD
		Addressable Heat Detector w/ Base	SIGA2-HFS SIGA-SB
CO		Carbon Monoxide Detector	SD-TRK
RTS	RTS	Remote Test Switch	CO1224T
PR1	PR1	Multi-Voltage Relay	PR1
CTx	AIM	Addressable Input Module (x Denotes Single or Double Input)	SIGA-CTx
CR	AOM	Addressable Control Module	SIGA-CR
CC1S		Synchronization Module	SIGA-CC1S
S		Strobe Unit (Adjustable Candela)	G1F-VM
H		Horn/Strobe Unit (Adjustable Candela)	G1F-HDVM
LF		Low Frequency Horn Unit	GG4LFWF-H
WP S		Weather Proof Horn/Strobe Unit (Adjustable Candela)	757-8A-T
TS		Sprinkler Tamper Switch	FBO
FS		Waterflow Switch	FBO
DH		Magnetic Door Holder	FBO

*NFPA 170 (2009) Tables: 6.5, 6.7.1, 6.7.2, & 6.7.3

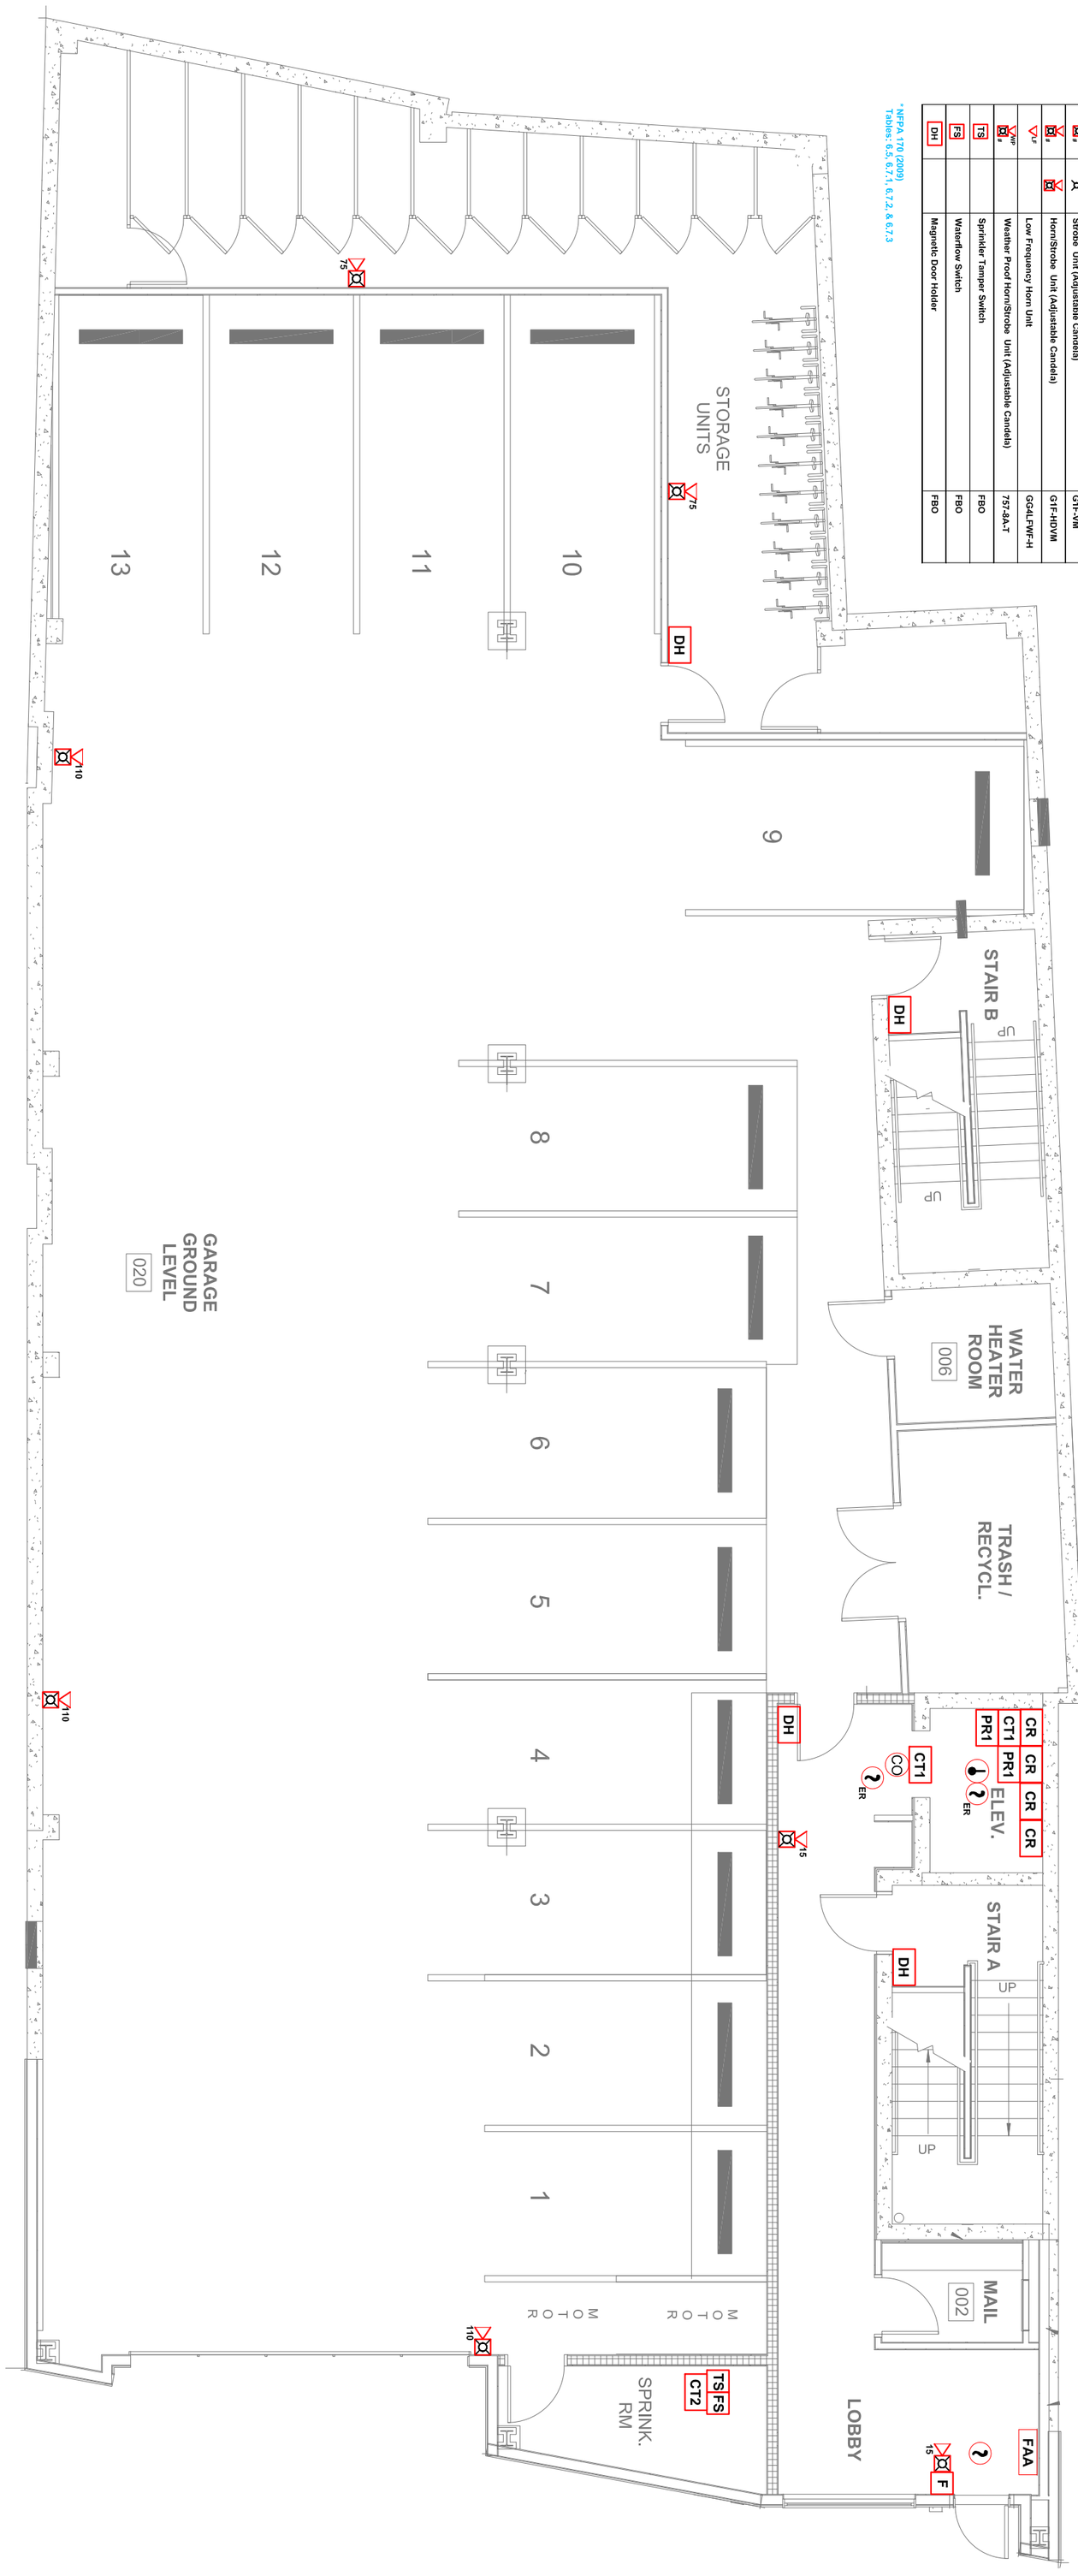

SCALE: 1/8" = 1'0"				
0	Original Issue	1/17	ENH	TRD
REV.	DESCRIPTION	DATE	DRWN:	RVW'D:

Luminato
Portland, ME
Floor Plans
Basement
DWG NO. FA-002

PO No. 91348

JOB NAME: **Luminato Portland, Maine Floor Plan Basement**

Contractor: **Deblois Electric, Inc.**

R.B. Allen Co., Inc.
P.O. BOX 770
131 LAFAYETTE RD
NO. HAMPTON, NH 03862
1-800-258-7264
EDWARDS SYSTEM TECHNOLOGY

DWG NAME: FA-002

Luminato Portland, ME Floor Plan Basement

DWG No: FA-002