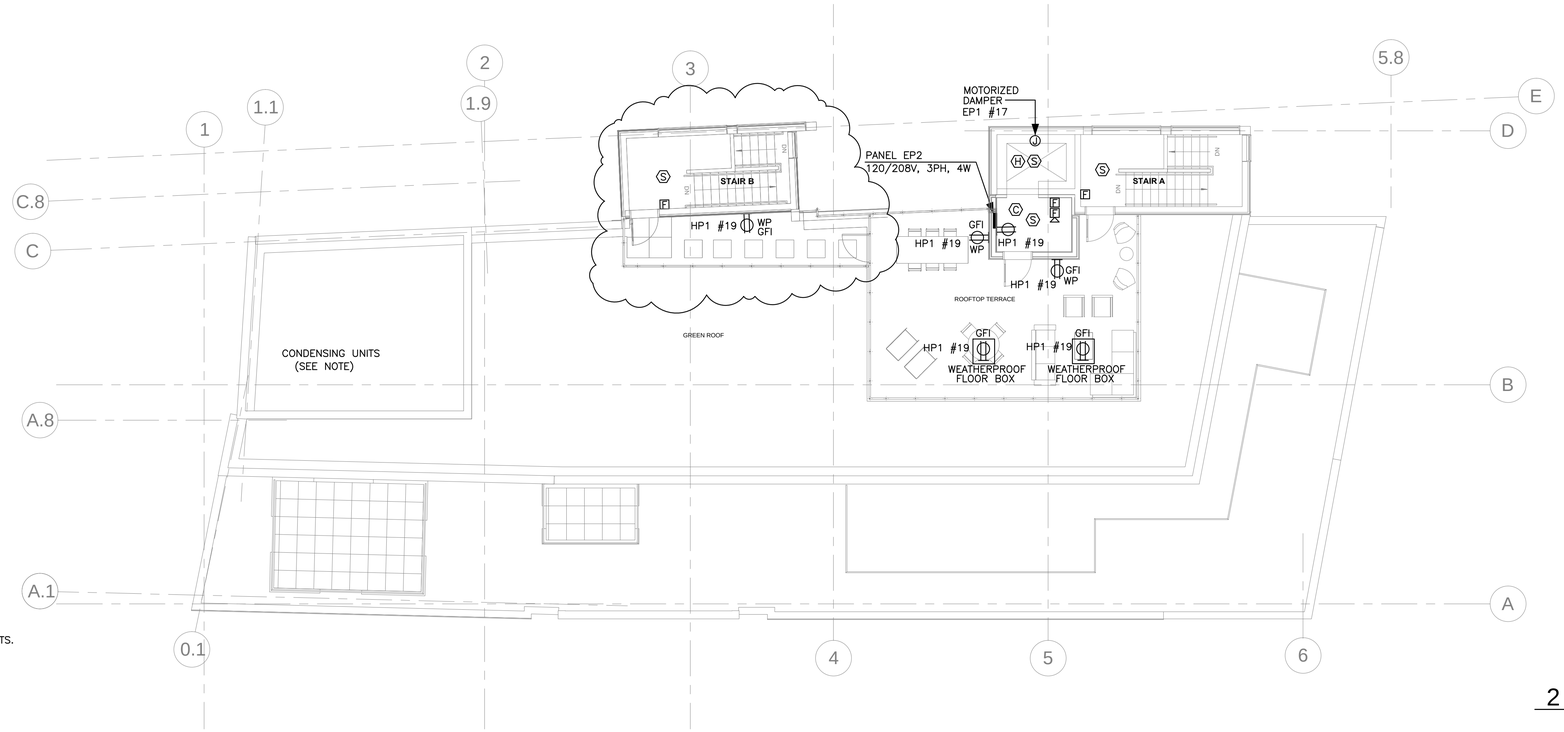

WHERE INDICATED, PROVIDE CONNECTIONS FOR 5 OUTDOOR CONDENSING UNITS.
PROVIDE A 30A/2P WEATHERPROOF DISCONNECT SWITCH FOR EACH UNIT.
CIRCUIT EACH CONDENSING UNIT WITH 2#10, 1#12G, IN A 3/4" CDT.

CU-503:	208V, 1PH 13.4MCA	UNIT 503	LOADCENTER
CU-504:	208V, 1PH 13.4MCA	UNIT 504	LOADCENTER
CU-506:	208V, 1PH 20.1MCA	UNIT 506	LOADCENTER
CU-601:	208V, 1PH 20.1MCA	UNIT 601	LOADCENTER
CU-602:	208V, 1PH 20.1MCA	UNIT 602	LOADCENTER

2 ROOF DECK - POWER
1/8" = 1'-0"

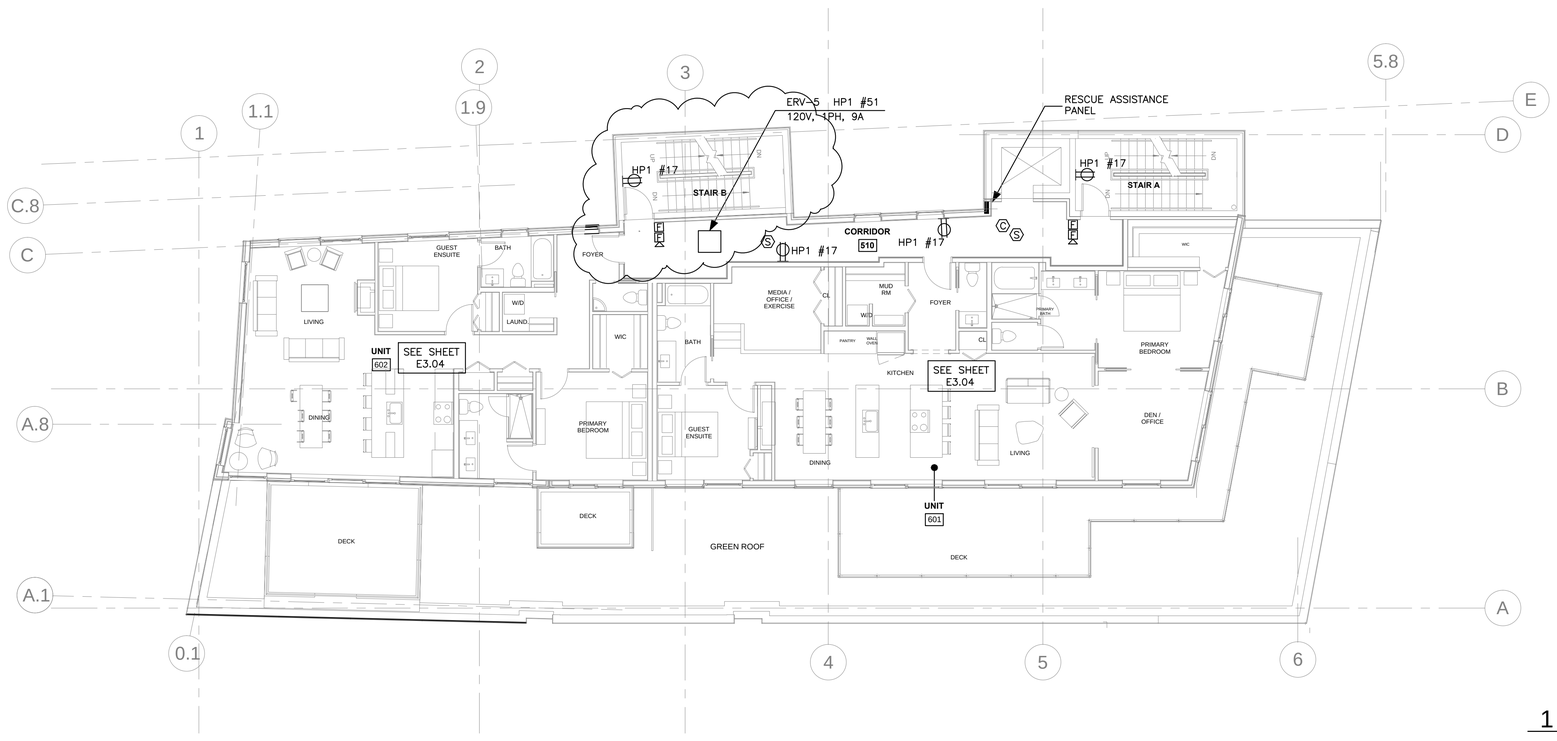

1 SIXTH FLOOR - POWER
1/8" = 1'-0"

NORTH

STATE OF MAINE
LAWRENCE E. BARTLETT
No. 7928
LICENSED
PROFESSIONAL ENGINEER
Lawrence E. Bartlett
7/28/16

Prepared For:
NewHeight Group

Consultant:
Bartlett Design
LIGHTING & ELECTRICAL ENGINEERING
144 MIDDLE STREET, PORTLAND, MAINE 04101
TEL (207) 443-5447 FAX (207) 443-5560

Architect:
ARCHETYPE architects
48 Union Wharf Portland, Maine 04101
(207) 772-6022 Fax (207) 772-4056

Project:
LUMINATO
Newbury Street Portland, Maine

Revisions:
06/17/16 100% REVIEW SET
07/22/16 REVISED PLANS
07/28/16 ADDENDUM A

Scale: AS NOTED

Date: JUNE 17 2016

SIXTH FLOOR AND ROOF POWER PLANS

E1.04