


Report of Moisture-Density

Method ASTM D-1557 MODIFIED Procedure C

Project Name PORTLAND ME - LUMINATO CONDOMINIUMS -
CONSTRUCTION MATERIALS TESTING SERVICES
Client LUMINATO CONDOMINIUM, LLC
Material Type AGGREGATE SUBBASE
Material Source STOREY BROTHERS - CUMBERLAND

Project Number 16-0910
Lab ID 21416G
Date Received 9/6/2016
Date Completed 9/12/2016
Tested By PAUL SHAFFER


Moisture-Density Relationship Curve

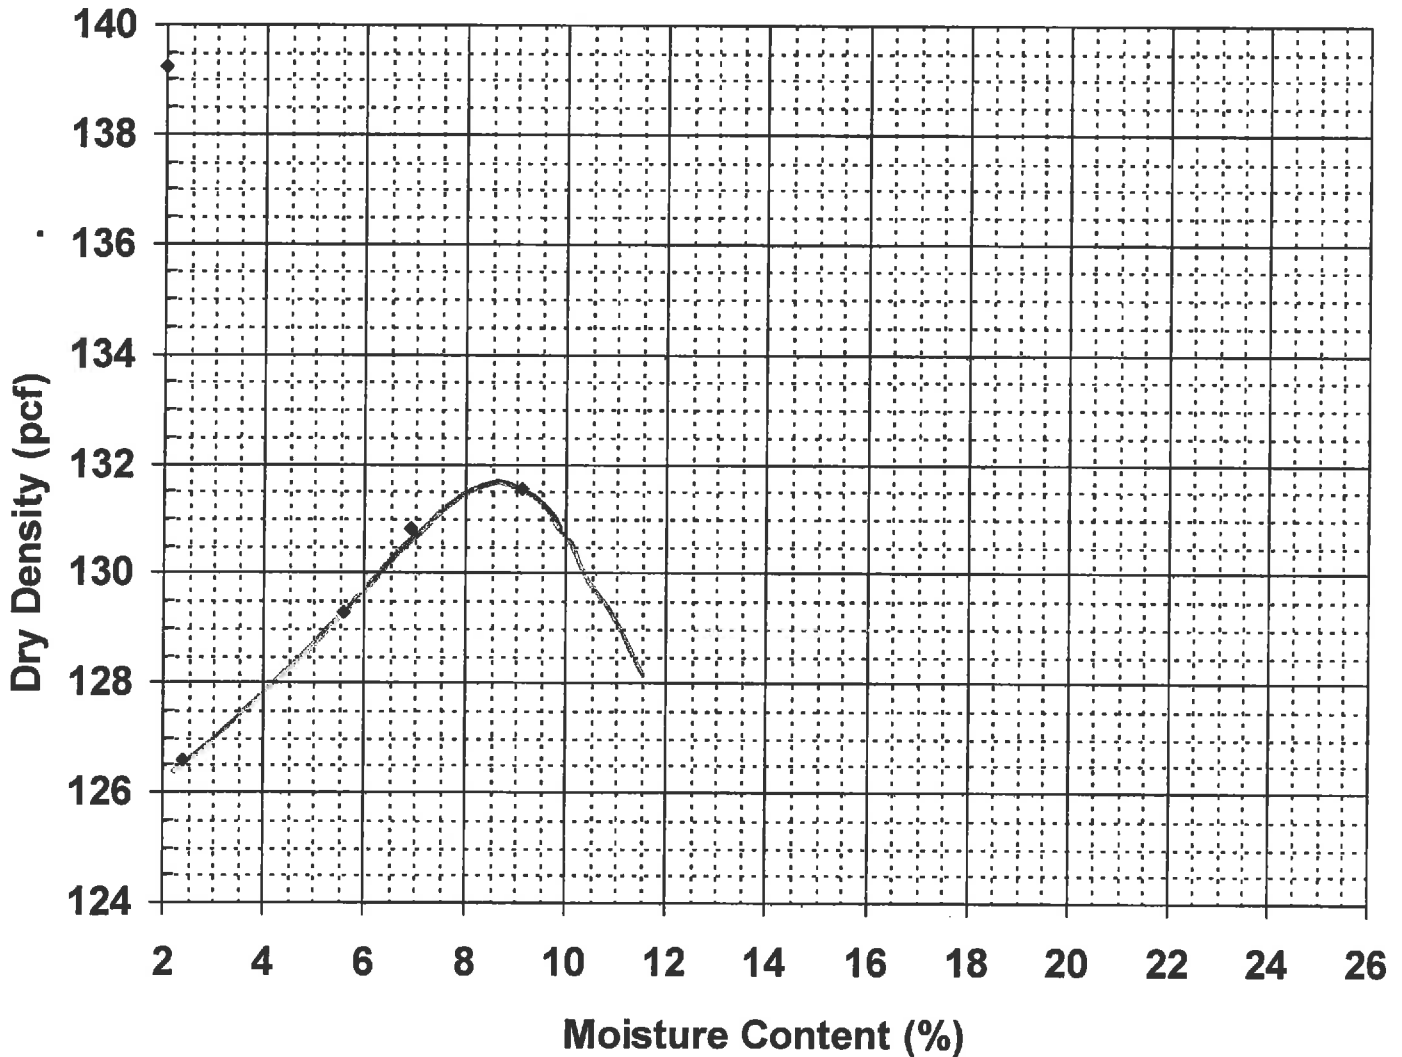

Maximum Dry Density (pcf) 131.9
Optimum Moisture Content (%) 8.5
Percent Oversized 30.0%

Corrected Dry Density (pcf) **138.6**
Corrected Moisture Content (%) **6.5**

Comments


Roger E. Domingo